

EGRESS LEGEND

CLOSET

A-111A

100 S.F.

X OCCUPANTS

ROOM IDENTIFICATION TAG

ROOM NAME

ROOM NUMBER

ROOM CALCULATED SQUARE FOOTAGE AND NET SQUARE FOOTAGE

NUMBER OF ROOM OCCUPANTS

TRAVEL DISTANCE DELINEATION

DIRECTION OF TRAVEL

CUMULATIVE EGRESS LOAD NUMBER

DISTANCE TO NEAREST EXIT

ACTUAL DOOR LOAD

DOOR CAPACITY

STAIR ## CAP. # FL.

CAPACITY: ##

ACTUAL: ##

STAIR AND FLOOR NUMBER

STAIR CAPACITY

ACTUAL STAIR LOAD

120 MINUTE RATED WALL

60 MINUTE RATED WALL

180 MINUTE RATED WALL

FIRE EXTINGUISHER COUNT AND LOCATIONS
BASED ON ONE (1) FIRE EXTINGUISHER FOR EACH 2,500 S.F. OF FLOOR AREA OR FRACTION THEREOF. SO DISTRIBUTED THAT ONE (1) EXTINGUISHER SHALL NOT BE MORE THAN 75 FEET TRAVEL DISTANCE FROM ANY POINT IN THE CORRIDOR.

MARK	DESCRIPTION	LOCATION	PROPOSED
ETR	EXISTING EXTINGUISHER/ CABINET TO REMAIN	SEE PLAN THIS SHEET	2 ETR
NEW	NEW CABINET & EXTINGUISHER	SEE PLAN THIS SHEET	6 NEW

MARK	DESCRIPTION	LOCATION	PROPOSED
ETR	EXISTING EXTINGUISHER/ CABINET TO REMAIN	SEE PLAN THIS SHEET	0 ETR
NEW	NEW CABINET & EXTINGUISHER	SEE PLAN THIS SHEET	5 NEW

PATH OF TRAVEL SCHEDULE - BASEMENT (200' W/O SPRINKLER) (300' W/ SPRINKLER)

MARK	LEVEL	LENGTH	MAX TRAVEL DISTANCE	MEETS CODE
EX01	LOWER LEVEL	206'	200'	YES
EX02	LOWER LEVEL	160'	200'	YES
EX03	LOWER LEVEL	172'	200'	YES
EX04	LOWER LEVEL	120'	200'	YES
EX05	LOWER LEVEL	90'	200'	YES
EX06	LOWER LEVEL	83'	200'	YES
EX07	LOWER LEVEL	62'	200'	YES
EX08	LOWER LEVEL	60'	200'	YES
EX09	LOWER LEVEL	57'	200'	YES
EX010	LOWER LEVEL	75'	200'	YES
EX011	LOWER LEVEL	52'	200'	YES
EX012	LOWER LEVEL	53'	200'	YES

PATH OF TRAVEL SCHEDULE - FIRST FLOOR (200' W/O SPRINKLER) (300' W/ SPRINKLER)

MARK	LEVEL	LENGTH	MAX TRAVEL DISTANCE	MEETS CODE
EX1	FIRST FLOOR	75'	200'	YES
EX2	FIRST FLOOR	74'	200'	YES
EX3	FIRST FLOOR	210'	200'	YES
EX4	FIRST FLOOR	90'	200'	YES
EX5	FIRST FLOOR	101'	200'	YES
EX6	FIRST FLOOR	94'	200'	YES
EX7	FIRST FLOOR	98'	200'	YES
EX8	FIRST FLOOR	93'	200'	YES
EX9	FIRST FLOOR	100'	200'	YES
EX10	FIRST FLOOR	89'	200'	YES
EX11	FIRST FLOOR	96'	200'	YES
EX12	FIRST FLOOR	104'	200'	YES
EX13	FIRST FLOOR	31'	200'	YES
EX14	FIRST FLOOR	129'	200'	YES
EX15	FIRST FLOOR	86'	200'	YES
EX16	FIRST FLOOR	90'	200'	YES
EX17	FIRST FLOOR	76'	200'	YES
EX18	FIRST FLOOR	70'	200'	YES
EX19	FIRST FLOOR	80'	200'	YES
EX20	FIRST FLOOR	77'	200'	YES
EX21	NOT USED			

1-1/2" TRIM

MAX. TO EXTINGUISHER HANDLE

2'-0"

BOTTOM OF CABINET

ELEVATION

1 1/2" FLAT TRIM

STAINLESS CABINET BODY SECURED TO TOP & BOTTOM STUD FRAMING

1 1/2" FLAT TRIM

METAL STUD WALL, SEE PARTITION TYPE FOR DETAIL

SECTION RECESSED


1 1/2" RETURN TRIM

STAINLESS CABINET BODY SECURED TO TOP & BOTTOM STUD FRAMING

1 1/2" RETURN TRIM


METAL STUD WALL, SEE PARTITION TYPE FOR DETAIL

SECTION SEMI-RECESSED

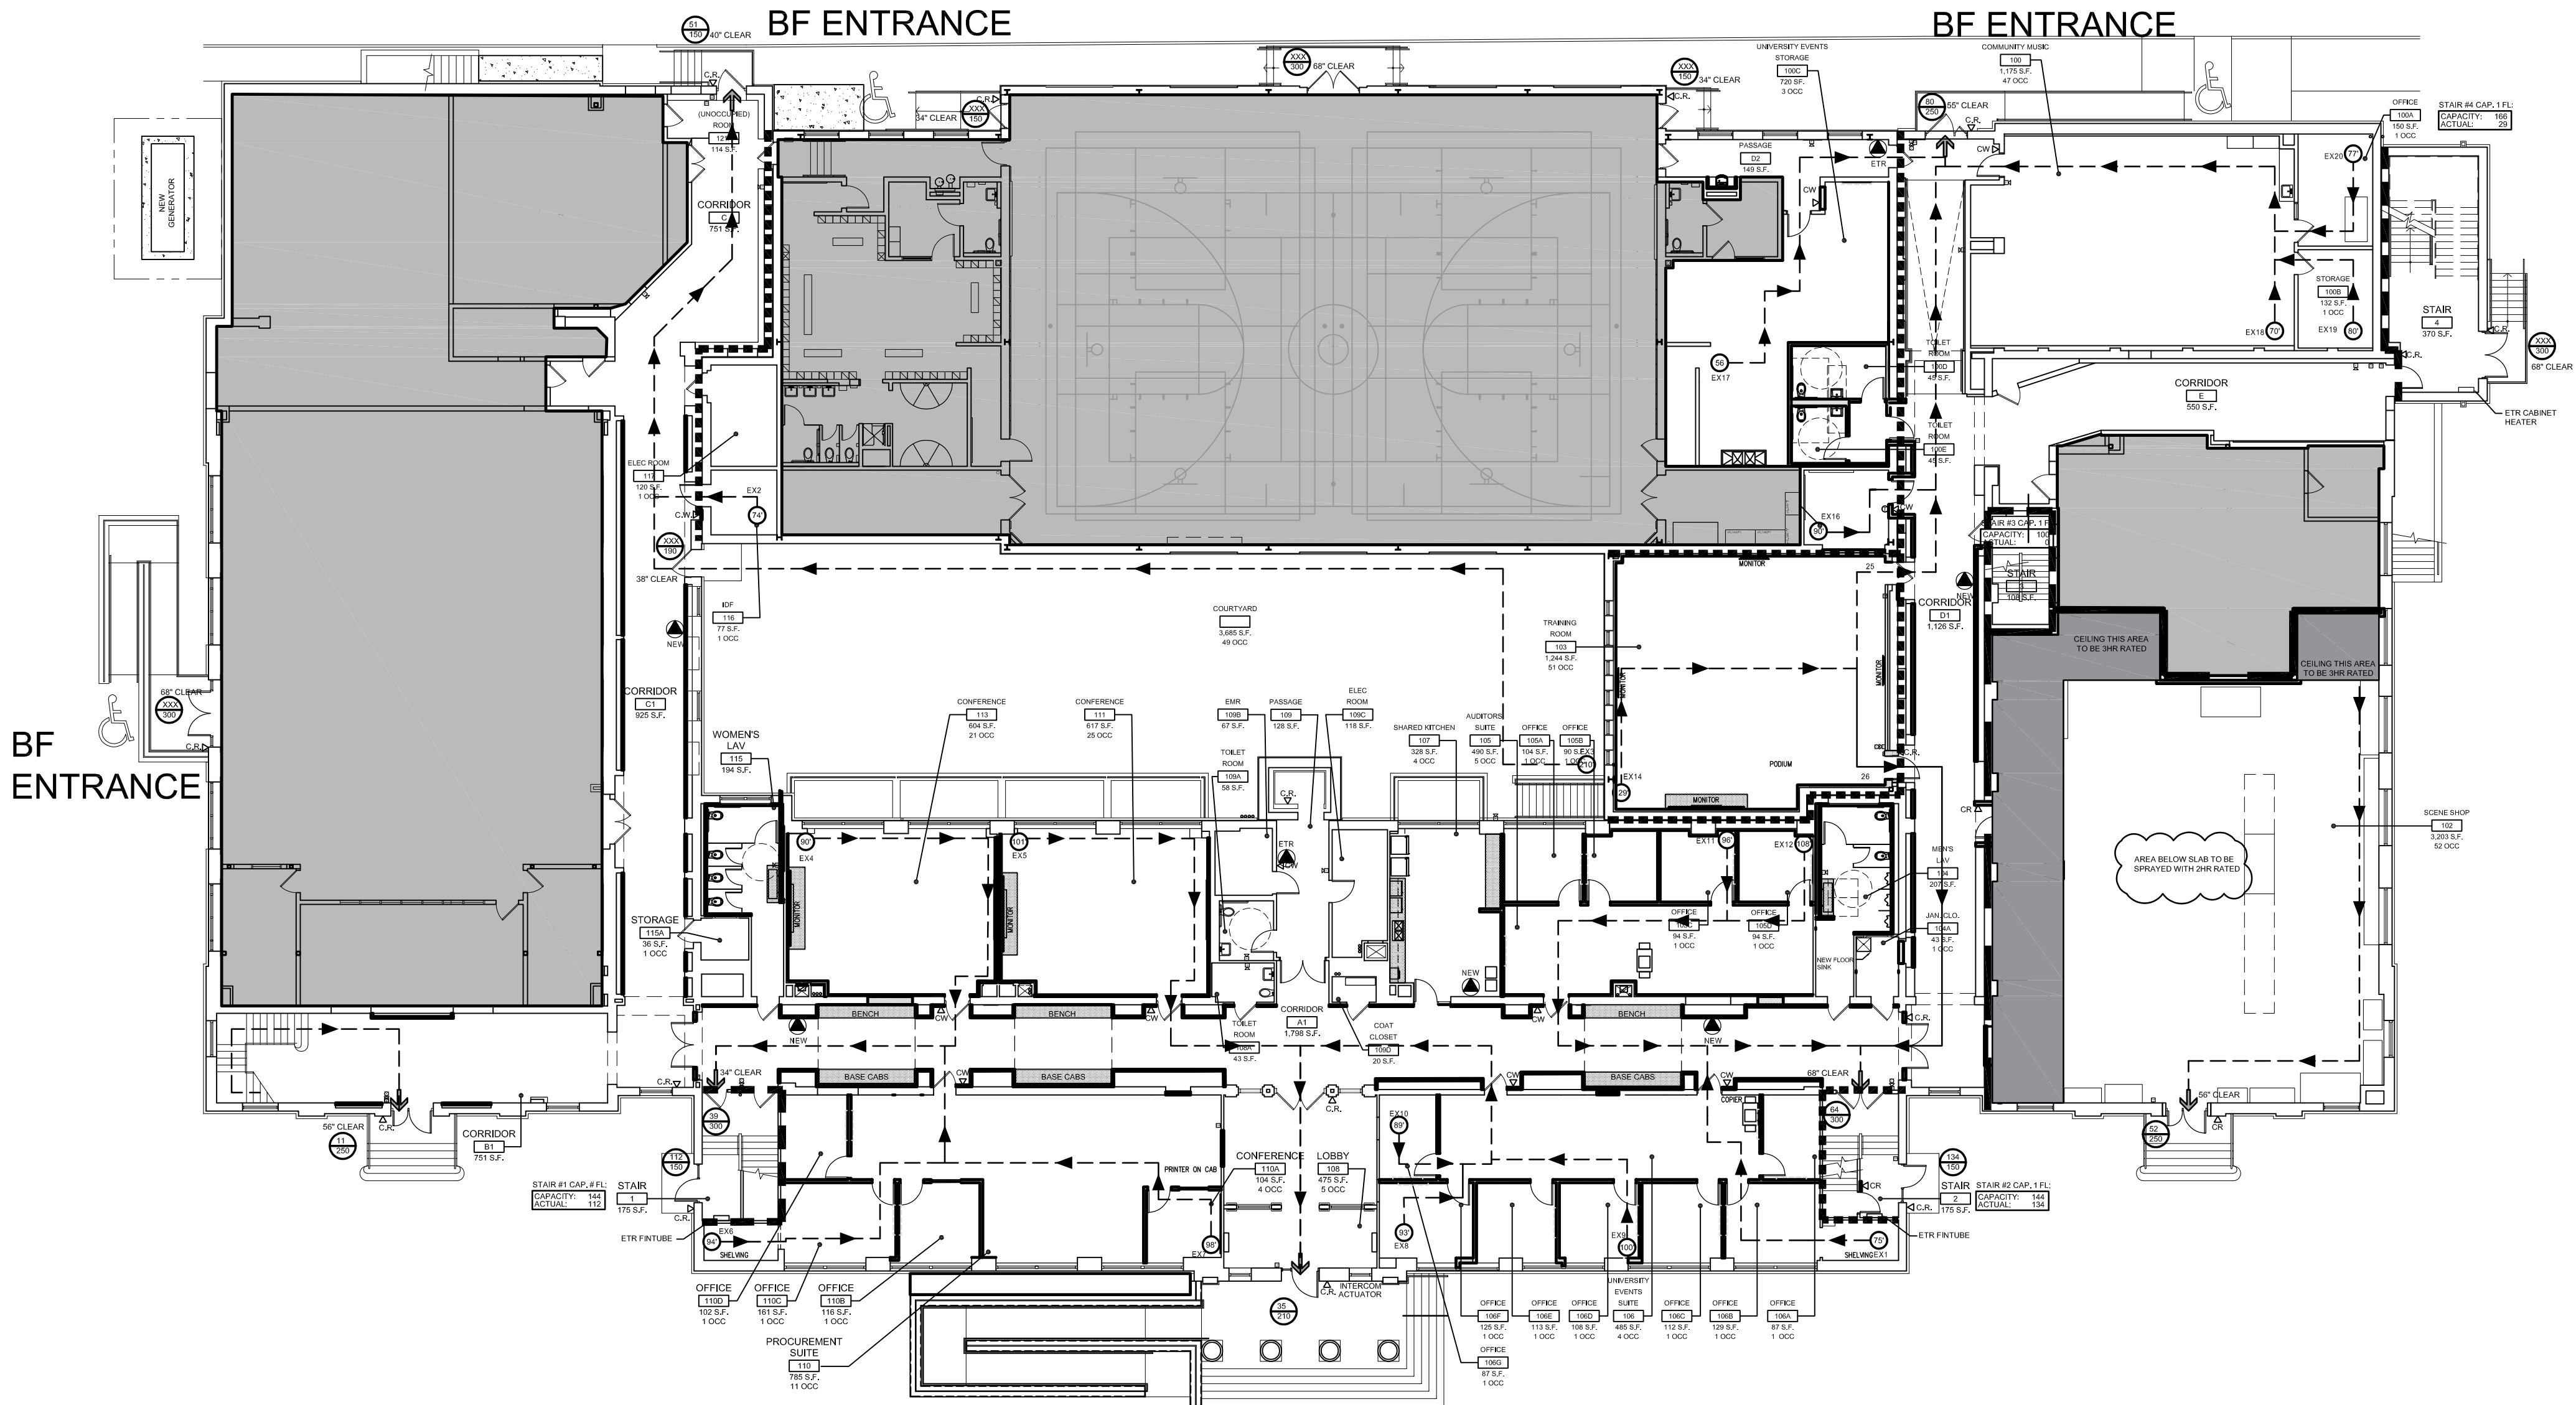

2 FIRST FLOOR EGRESS


SCALE: 1/16" = 1'-0"

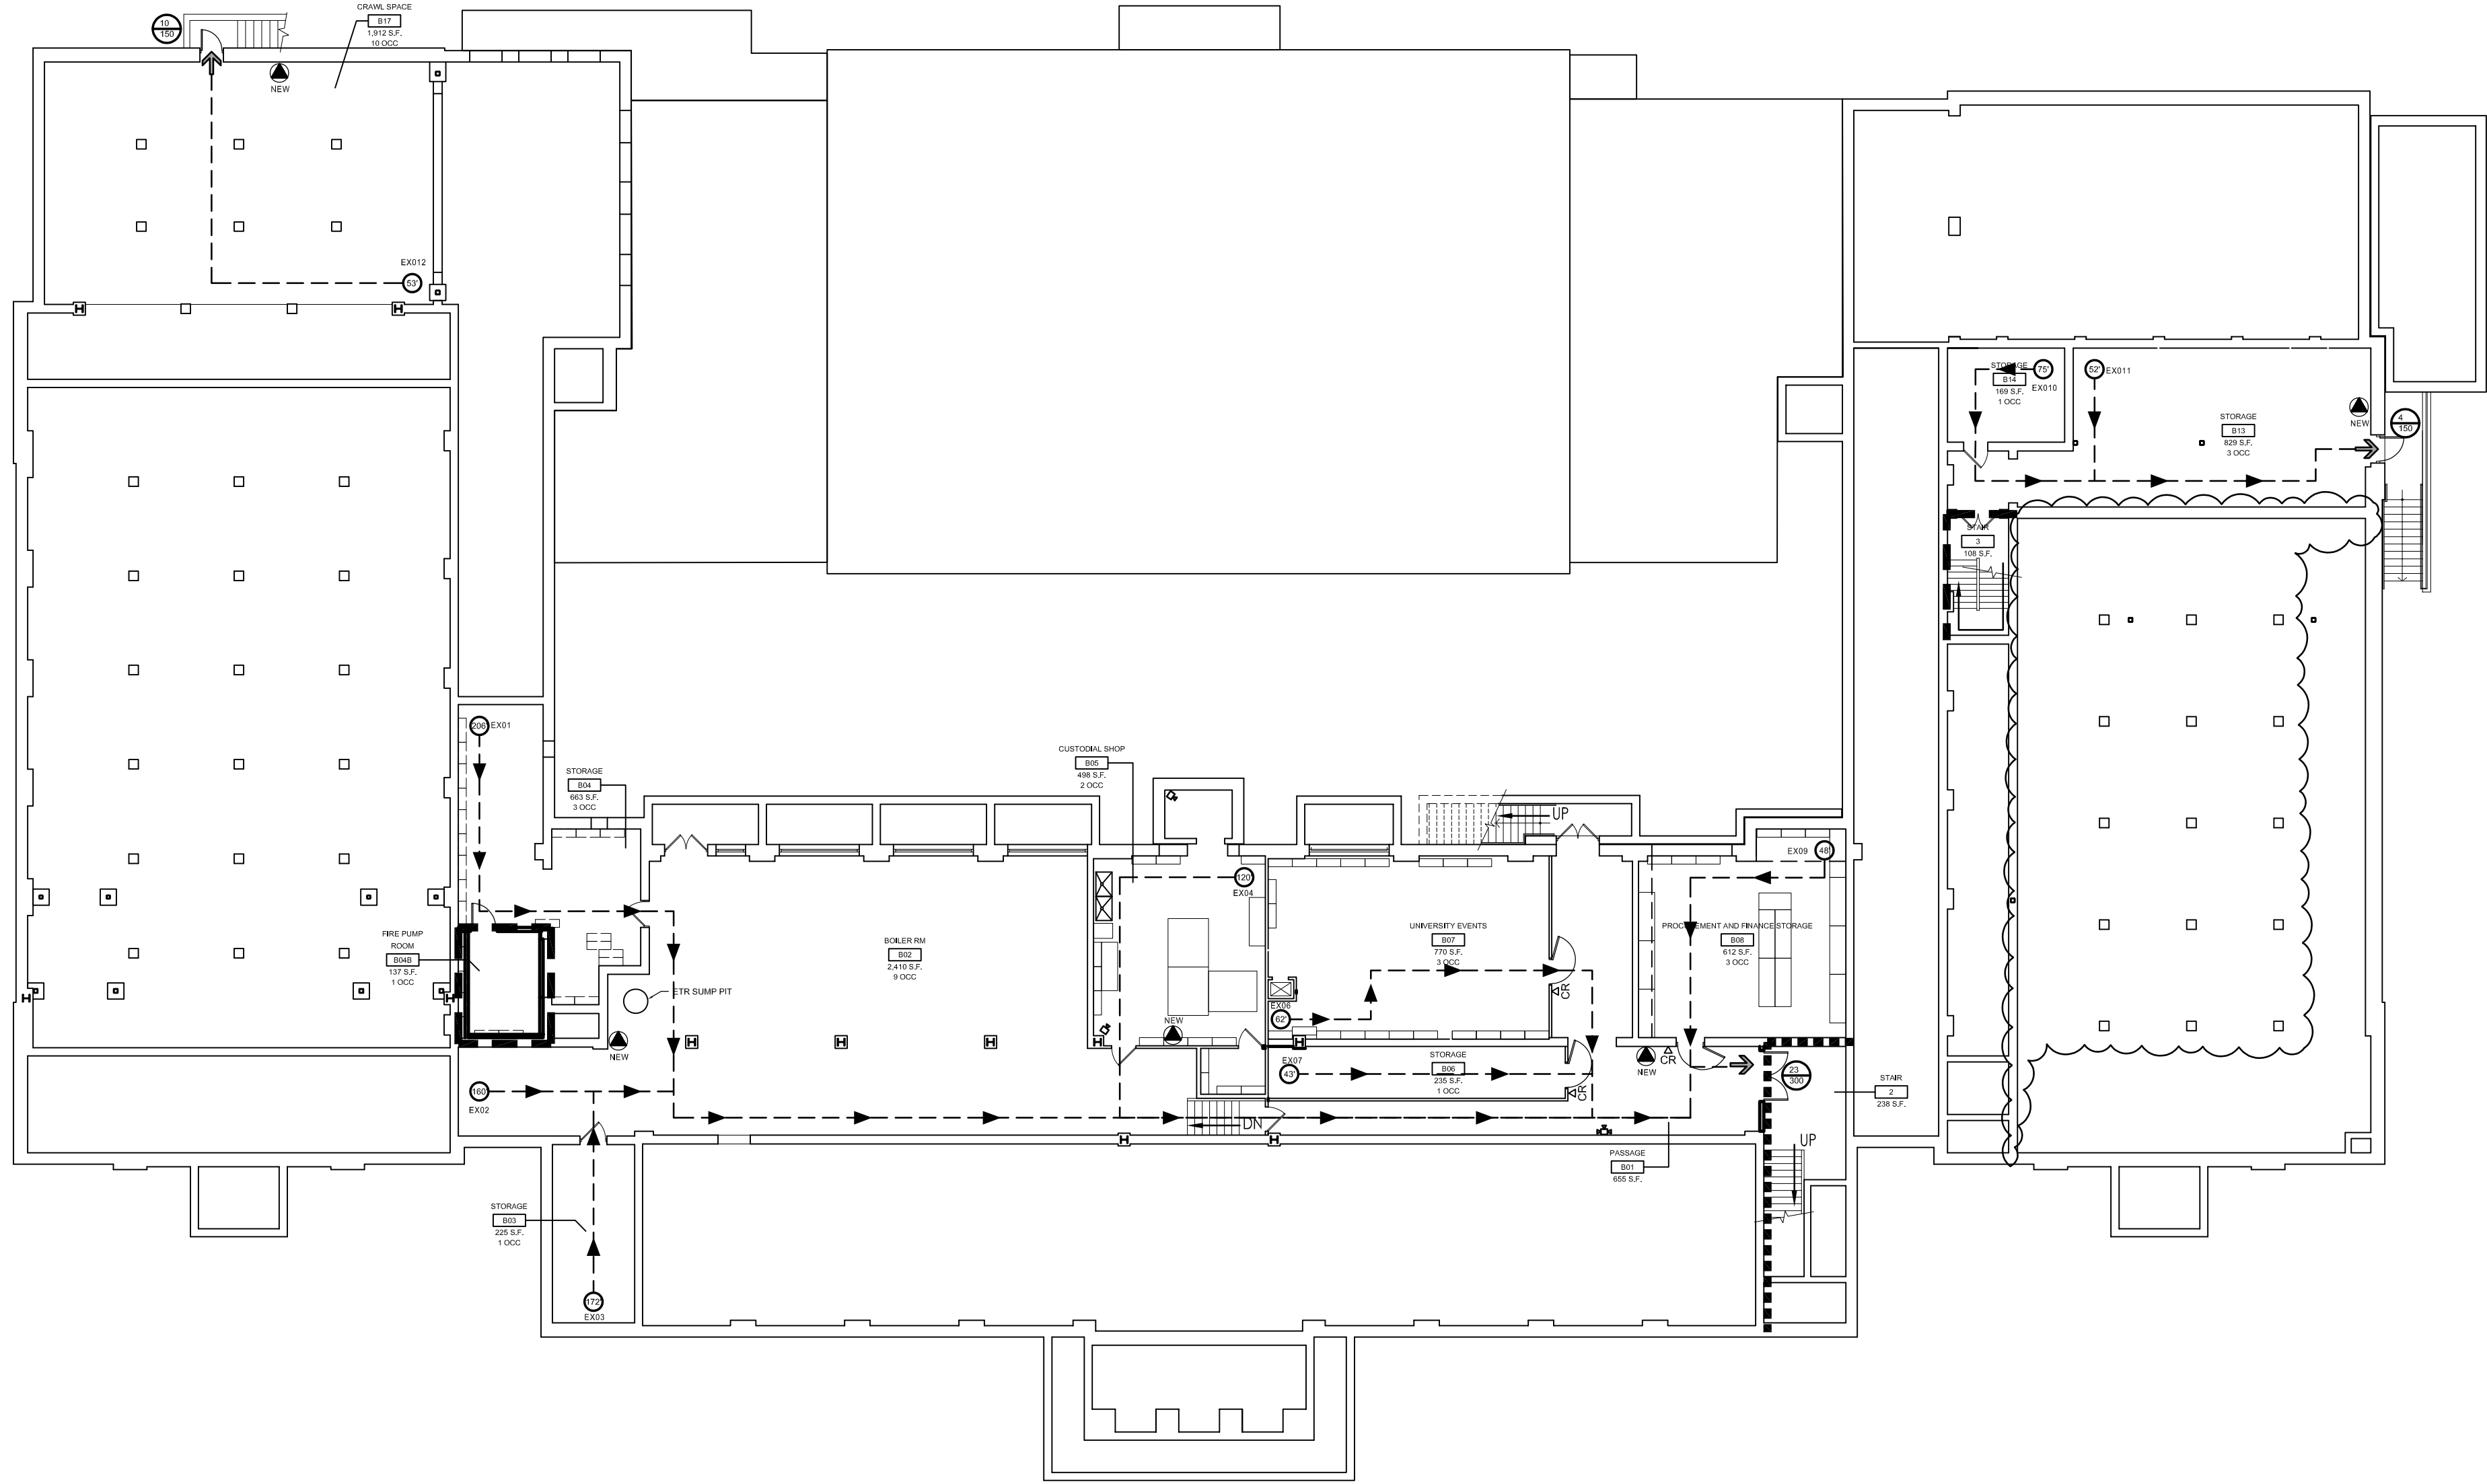

1 LOWER LEVEL EGRESS

SCALE: 1/16" = 1'-0"

KEY PLAN:

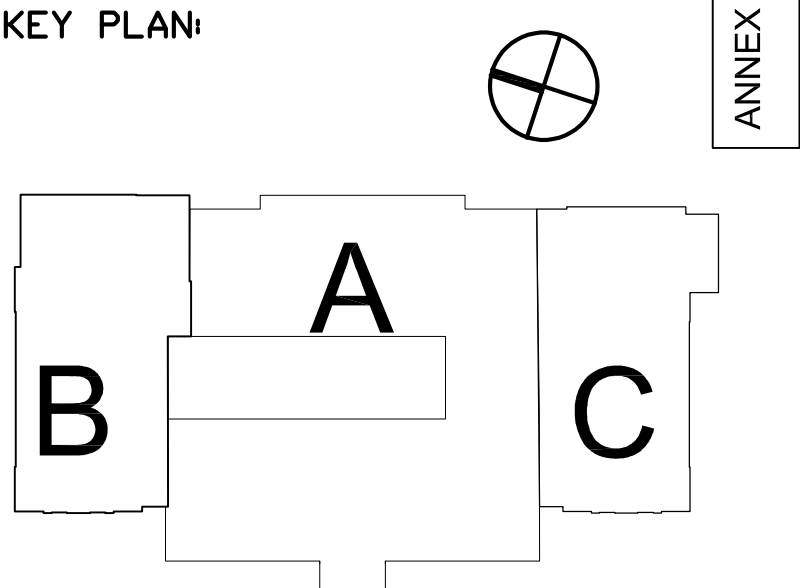

#1	12/23/25	ADDENDUM #1
	12/08/25	OUT TO BID
	12/03/25	DCA Submission

No.	Date	Description
Revisions		Issues

DiGroupArchitecture
ARCHITECTURE FOR CHANGE
15 Bethany Street • New Brunswick, NJ 08901 • T: 732.249.6242
2450 W Hunting Park Ave., Bldg 9 • Philadelphia, PA 19129-1302 • T: 215.634.3400

Richard D. Alderiso, AIA
NJ RA A1 15023, NY RA 027416, PA RA 405474

Client:
Rowan University
201 Mullica Hill Rd.
Glassboro, NJ 08028

Project:
Alterations to Facility Located at 202 Delsea Drive
BLOCK 26 / LOT 412
202 Delsea Dr.
Glassboro, NJ 08028

Drawing Information:
Project No: 25.024
Date: 04/24/2025
Drawn By: TC
Checked By: KG

Sheet Name:

**BASEMENT AND FIRST LEVEL
EGRESS PLANS**

Sheet No:

CS-003
Sheet 0 of 000