



Department of Community Affairs  
Construction Project Review

Project No: AC-045-26

Partial Release

BLDG INTERIOR

Frank Felice

Released: 4/1/2026

N.J.S.A. 52:27D-119 ET SEQ., AS AMENDED



## **Boiler Project at Bozorth Hall and Hawthorn Hall**

**PROJECT MANUAL**

**PROJECT NO. 77267**

**March 6, 2026**

**Engineer:**


**Schiller and Hersh Associates, Inc.**

**636 Skippack Pike, Suite 200**

**Blue Bell, PA 19422**

**T: 215-886-8947**

**Project #2566A**

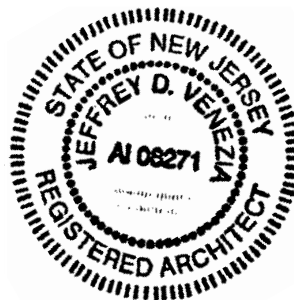

---

Jeffrey D. Venezia, AIA  
NJ RA AI 00827100

## ROWAN UNIVERSITY

### TABLE OF CONTENTS

#### INSTRUCTIONS TO BIDDERS AND GENERAL CONDITIONS

SECTION I	Construction Contract	Pages 1 – 10
SECTION II	Exhibit A: Insurance and Bonds	Pages 1 - 8
SECTION III	General Conditions	Pages 1 - 55
SECTION IV	<u>Forms</u>	
	Allowance Authorization Form	Page 1
	Allowance Charge Request Form	Page 1
	Request for Information Form	Page 1
	Change Order Request Form	Page 1
	Change Order Form	Page 1
	Hourly Labor Rate Breakdown Form	Page 1
	Daily Job Report Form	Page 1
	Application and Certificate for Payment Form (AIA G702)	Pages 1 - 2
	Attachment to G702 Certification For Payment	Pages 1 - 2
	Contractor's Partial or Final Release And Waiver of Liens	Page 1
	Rowan Tax Exempt Letter	Page 1
	Consent of Surety Company to Final Payment (AIA G707)	Page 1

#### DIVISION 01 GENERAL REQUIREMENTS

<u>SECTION</u>	
011000	Summary of Work
011400	Work Restrictions
012100	Allowances
012200	Unit Price (NOT INCLUDED / USED)
012300	Alternates (NOT INCLUDED / USED)
012400	Procedures and Controls
012500	Contract Modification Procedures
012900	Payment Procedures
013100	Coordination
013200	Construction Progress Schedule
013300	Submittal Procedures
014000	Quality Control Requirements
014100	Testing Services
014523	Testing & Inspections
014200	Reference Standards
015000	Construction Facilities & Temporary Controls
016000	Product Requirements
016350	Substitution Procedures
017000	Execution Requirements
017700	Contract Closeout
017820	Operation and Maintenance Data
018200	Demonstration and Training

## TECHNICAL SPECIFICATIONS

### DIVISION 04 MASONRY

#### SECTION

042000 Unit Masonry

### DIVISION 07 THERMAL AND MOISTURE PROTECTION

#### SECTION

078100 Sprayed Fire-Resistive Materials  
078413 Firestops and Smoke Seals  
079200 Joint Sealers

### DIVISION 08 OPENINGS

#### SECTION

081113 Hollow Metal Doors and Frames  
083113 Access Doors and Frames  
087100 Door Hardware

### DIVISION 09 FINISHES

#### SECTION

0929000 Gypsum Drywall  
099000 Painting

### DIVISION 10 SPECIALTIES

#### SECTION

104416 Fire Extinguishers

### DIVISION 23 MECHANICAL

#### SECTION

230000 Mechanical Summary of Work  
230500 Common Work Results for HVAC  
230513 Common Motor Requirements for HVAC Equipment  
230519 Meters and Gauges for HVAC Piping  
230523 General-Duty Valves for Piping  
230529 Hangers and Supports for HVAC Piping and Equipment  
230553 Identification for HVAC Piping and Equipment  
230593 Testing, Adjusting, and Balancing for HVAC  
230700 HVAC Insulation  
230900 Instrumentation and Control for HVAC  
231123 Facility Natural Gas Piping  
232113 Hydronic Piping  
232123 Hydronic Pumps  
232223 Steam Condensate Pumps  
233113 Metal Ducts  
233300 Air Duct Accessories  
233423 HVAC Power Ventilators  
235100 Breechings, Chimneys and Stacks  
235216 Condensing Boilers  
235218 Wall Mounted Condensing Boilers  
238239 Unit Heaters

DIVISION 26 ELECTRICAL

SECTION

260000	Electrical Summary of Work
260500	Common Work Results for Electrical
260519	Low Voltage Electrical Power Conductors and Cables
260526	Grounding and Bonding for Electrical Systems
260529	Hangers and Supports for Electrical Systems
260533	Raceways and Boxes for Electrical Systems
260553	Identification for Electrical Systems
262416	Panelboards
262726	Wiring Devices
262816	Enclosed Switches and Circuit Breakers
265119	LED Interior Lighting

DIVISION 28 ELECTRONIC SAFETY AND SECURITY

SECTION

284700	Fire Alarm System
--------	-------------------

END OF SECTION

SECTION 042000

UNIT MASONRY

PART 1 GENERAL

1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

1.2 SECTION INCLUDES

- A. The Work of this Section includes all labor, materials, equipment and services necessary to complete the unit masonry work as shown on the drawings and/or specified herein, including but not necessarily limited to the following:
  - 1. Concrete block walls and partitions.
  - 2. Metal joint reinforcing, anchors, ties, weeps, closures and related accessories for masonry.
  - 3. Control and expansion joints in masonry, filled with joint fillers.
  - 4. Mortar net.
  - 5. Chases, recesses, pockets and openings in masonry as required for installation of work by others.
  - 6. Building in of items furnished by others into masonry, including access doors, door frames, anchors, sleeves and inserts, and other similar items to be embedded in masonry.
  - 7. Grouting in of metal items built into masonry work.
  - 8. Protection, pointing and cleaning of masonry.

1.3 RELATED SECTIONS

- A. Concrete - Section 033000.
- B. Firestops and smoke seals - Section 078413.
- C. Sealant - Section 079200.

1.4 SUBMITTALS

- A. Submit Samples for the following:
  - 1. Joint reinforcing, each type, width and proposed location (labeled).
  - 2. Anchors, wedges and ties, each type, width and proposed location (labeled).
  - 3. Joint filler, each type.

4. Flashing, including splice sample, 12" long.
  5. Mortar color, 12" long cured sample.
- B. Submit technical and installation information for the following:
1. Mortar materials, each material and mortar type.
  2. Certification of mortar mix.
  3. Concrete block, joint reinforcing, anchors, ties and joint filler; submit manufacturer's technical and descriptive literature.
  4. Block manufacturer shall submit certifications of compliance with ASTM C 90, C 331 and UL 618 prior to any job site delivery. Field sampling of concrete block may be tested by an Independent Testing Laboratory retained by the Owner according to the requirements of ASTM C 140.
- C. Construction Procedures (Submit the following)
1. Procedures and materials for cleaning masonry work; including certification that cleaner will not adversely affect stone, gaskets, sealants, etc.

#### 1.5 QUALITY ASSURANCE

- A. Conform to the following non-cumulative tolerances (any masonry work not meeting these standards shall be re-built as directed by the Architect).
1. Variation from the plumb:
    - a. In lines and surfaces of columns, walls and arrises:
      - 1). In 10 feet 1/8"
      - 2). In any story of 25 feet maximum 1/4"
      - 3). In 40 feet or more 1/4"
    - b. For external corners, expansion joints and other conspicuous lines:
      - 1). In any story of 25 feet maximum 1/4"
      - 2). In 40 feet or more 3/8"
  2. Variation from the level or the grades indicated on the drawings; for exposed lintels, sills, parapets, horizontal grooves and other conspicuous lines:
    - a. In any bay or 20 feet maximum 1/4"
    - b. In 40 feet or more 1/4"
  3. Variation of the linear building lines from established position in plan related portion of columns and partitions:
    - a. In any bay or 20 feet maximum 1/4"
    - b. In 40 feet or more 1/2"
  4. Variation in cross-sectional dimensions of columns and in thickness of walls:
    - a. Minus 1/8"
    - b. Plus 1/8"

5. Variation in dimensions of masonry openings:

- |                         |             |
|-------------------------|-------------|
| a. Horizontal dimension | -0" + 1/16" |
| b. Vertical dimension   | +0" - 1/16" |

B. Job Mock-Up

1. Prior to installation of masonry work, erect sample wall panel mock-up using materials, bonding patterns and joint tooling required for final work and including cavity wall, masonry sill, typical pier with returns and stone base, window unit and sill, projecting courses, anchors and reinforcement as detailed. Provide special features as directed by the Architect for caulking and contiguous work. Build mock-up at the site, 4' x 4' size as directed by the Architect, indicating the proposed range of colors, textures and workmanship to be expected in the completed work. Reconstruct mock-up if directed by the Architect until it meets with Architect's approval. Obtain Architect's acceptance of visual qualities of the mock-up before start of masonry work. Retain mock-up during construction as a standard for judging completed masonry work. Do not alter, move or destroy mock-up until work is completed and accepted by the Architect. Use sample panels to test proposed cleaning procedures after sample panel meets with Architect's approval.
  2. Approved sample panel shall remain on view at the site until completion of face brick work and shall establish the technical and aesthetic standards for the Project.
3. Architect shall direct distribution of brick color and texture variation within mock-up.

C. Factory Control

1. The Architect reserves the right to visit the brick manufacturer's facility and review pre-sorting so that all brick falls within a color range acceptable to the Architect.
2. 4' x 4' mock-ups shall be constructed at the factory using the face brick specified. This mock-up, after approval of the Architect, shall become the quality control panel for the selected brick.
3. Prior to any shipment of the face brick from the factory, the Architect reserves the right to inspect the brick for the thoroughness of the pre-sorting and to reject any brick which in his opinion do not fall within acceptable color range.

D. Work of this Section shall conform to the requirements of the following (unless otherwise superseded by prevailing Building Code):

1. 2008 ACI 530/ASCE 5/TMS 402 Building Code Requirements for Masonry Structures.
2. 2008 ACI 530-1/ASCE 6/TMS 602 Specifications for Masonry Structures.
3. Brick Industry Association (BIA) "Technical Notes on Brick Construction."

E. Pre-Construction Conference: Prior to installation of masonry and associated work, Contractor shall arrange a meeting with Masonry Subcontractor, installers of related work, and other entities concerned with masonry wall performance, including the Architect and Owner. Contractor shall record discussions and agreements and furnish

copies to each participant. Provide at least seventy-two (72) hours' advance notice to participants prior to convening conference. Review methods and procedures related to masonry work, including, but not limited to, the following:

1. Review masonry requirements (drawings, specifications and other Contract Documents).
2. Review required submittals, both completed and yet to be completed.
3. Review and finalize construction schedule related to masonry work and verify availability of materials, installer's personnel, equipment and facilities needed to make progress and avoid delays.
4. Review required inspection, testing, certifying and material usage accounting procedures.
5. Review weather and forecasted weather conditions, and procedures for coping with unfavorable conditions.
6. Coordinate work with air/vapor barrier membrane and related flashing, review details to avoid conflicts.

#### 1.6 PRODUCT HANDLING

- A. General: Deliver, store, handle and protect all materials from damage, moisture, dirt and intrusion of foreign matter. Store all masonry units and mortar materials on raised

platforms and under ventilated and waterproof cover. Store packaged materials in manufacturer's unopened containers, marked with manufacturer's name and product brand name. Immediately reseal containers after partial use. Remove and replace damaged materials.

- B. Masonry Units: Pack, deliver and store to prevent breakage, cracking, chipping, spalling or other damage. Store, protect and ventilate units at project site.
- C. Aggregate: Store with provisions for good drainage.
- D. Reinforcement and Anchors: Store and protect so that when placed, joint reinforcement and anchors will be free of soil, dirt, ice, loose rust, scale, or other coatings which would destroy or reduce bond with mortar, and will not be disfigured or bent out of shape.

#### 1.7 CODE REQUIREMENTS

- A. Work of this Section shall conform to all applicable requirements of the State of New Jersey Building Code.

#### 1.8 TESTING FOR EFFLORESCENCE

- A. Test selected face brick for efflorescence in accordance with ASTM C 67.
- B. If, at the end of the test period, the samples of brick or mortar show efflorescence, the materials represented shall be rejected and new materials shall be re-tested. This process shall be repeated until no efflorescence appears. Testing shall be done by an independent testing laboratory at the expense of the Contractor; submit test results in writing to the Architect.

## 1.9 JOB CONDITIONS

- A. In cold weather, when the outside temperature is below forty (40) degrees F., conform to the requirements of "Cold Weather Masonry Construction and Protection Recommendations" publication by Brick Industry Association (BIA). No anti-freeze admixtures are permitted.
1. In addition, conform to the following:
    - a. Masonry materials must be warmed as required.
    - b. Brickwork must be protected a minimum of 24 hours after installation so as to maintain enough heat for hydration of the cement in the mortar.
- B. Hot-Weather Requirements: Protect unit masonry work when temperature and humidity conditions produce excessive evaporation of water from mortar and grout. Provide artificial shade and wind breaks and use cooled materials as required. Do not apply mortar to substrates with temperatures of 100 deg. F. and above. In addition, conform to the following:
1. Masonry materials must be cool.
  2. Mortar must be used within 2 hours of initial mixing.
- C. Protection of Masonry: During erection, cover tops of walls, projections, and sills with waterproof sheeting at end of each day's work. Cover partially completed masonry when construction is not in progress.
1. Extend cover a minimum of 24" down both sides and hold cover securely in place.
  2. Where one wythe of multi-wythe masonry walls is completed in advance of other wythes, secure cover a minimum of 24" down face next to unconstructed wythe and hold cover in place.
- D. Stain Prevention: Prevent grout, mortar, and soil from staining the face of masonry to be left exposed or painted. Immediately remove grout, mortar, and soil that come in contact with such masonry.
1. Protect base of walls from rain-splashed mud and mortar splatter by coverings spread on ground and over wall surface.
  2. Protect sills, ledges, and projections from mortar droppings.
  3. Protect surfaces of window and door frames, as well as similar products with painted and integral finishes, from mortar droppings.
  4. Turn scaffold boards near the wall on edge at the end of each day to prevent rain from splashing mortar and dirt on completed masonry.

## 1.10 ATTIC STOCK

- A. Provide additional 10% of dry mortar mix labeled, packaged and delivered to location determined by Owner for attic stock.

- B. Provide additional 5% of brick labeled, packaged and delivered to location determined by Owner for attic stock.

## PART 2 PRODUCTS

### 2.1 MATERIALS

- A. Standard Concrete Block
  - 1. Portland cement, ASTM C 150, Type 1, low alkali (less than 65) one source.
  - 2. Aggregates, ASTM C 331, lightweight expanded shale, clay or slate aggregates, manufactured by the rotary kiln process equal to "Solite," "Norlite," or "Haydite."
    - a. Block scheduled to receive painted finish shall contain normal weight aggregate meeting ASTM C-33 in addition to light weight aggregate in order to receive a smooth, uniform finish.
  - 3. Concrete Masonry Units: Load bearing lightweight aggregate concrete masonry units conforming to the requirements of ASTM C 90.
    - a. Block behind face brick and block for rated walls shall be 75% solid units.
- b. All other block may be hollow units.
  - 4. The producer of the concrete masonry units shall furnish certification from an independent testing laboratory confirming that all 8" or larger masonry units meet all of the UL 618 requirements for two (2) hours or better (as required), referencing full scale fire test reports (ASTM E 119). All 4" and 6" units shall conform to "National Bureau of Standards" and "National Research Council" full scale fire tests.
  - 5. Sizes and Shapes: Nominal face size 8" x 16" by thickness as indicated on drawings, with stretcher units, jamb units, header units, square corner units (at ends and corners of exposed or painted work), sash units (at control joints within masonry wall), lintel units and other special shapes and sizes required to complete the work.
  - 6. Finish: For exposed or painted block surfaces, in addition to ASTM requirements, block shall have uniformly dense, flat, fine grain texture, with no cracks, chips, spalls, or other defects which would impair appearance. For concealed CMU, surfaces shall be free from deleterious materials that would stain plaster or corrode metal.
  - 7. Curing: All concrete block shall be steam cured, and air dried for not less than thirty (30) days before delivery.
  - 8. Density of concrete block shall not exceed one hundred and five (105) lbs. per cubic foot.
  - 9. Shrinkage: Shrinkage of concrete blocks shall not exceed 0.065% when tested in accordance with ASTM C 426-99.
  - 10. Water Content
    - a. At the time of delivery to the job site, concrete masonry units shall have a value, in weight of contained water, of not more than thirty (30) percent of the fully saturated content for the unit tested.

- b. Ship all units from the factory, and store at the job site, with all necessary protection to prevent increase of water content from rain and other sources.
- B. Brick
  1. Size: Unless otherwise indicated, provide modular bricks size as follows - 3-5/8" h. x 2-1/4" th. x 7-5/8" w.
  2. Facing Brick: ASTM C 216, Grade SW, Type FBX, equal to \_\_\_\_\_.
  3. Where brick is fully concealed provide common brick conforming to ASTM C 62, Grade SW.
  4. Provide all special molded shapes as indicated on the drawings.
5. For sills, caps and similar applications resulting in exposure of brick surfaces which otherwise would be concealed from view, provide uncured units with all exposed surfaces finished.

C. Joint Reinforcing for Masonry Walls

1. Non-Seismic Construction: For anchoring face brick to CMU back-up, provide welded "ladder" design, of 3/16" dia. gauge steel rods with adjustable 3/16" wire rectangular pintle anchors fastened to reinforcement 16" o.c. Provide special formed prefabricated pieces at corners and intersections of walls or partitions. Anchors to extend at least 2" into face of brick. Show anchor locations on approved shop drawings. Joint reinforcing shall be equal to Ladder Type 270 with "Lox All Adjustable Anchor" made by Hohmann & Barnard or equal manufactured noted below in Para. C.6.
  - a. Reinforcing assembly shall have hot dip galvanized steel finish conforming to ASTM A 153 with zinc coating of 1.5 oz. of zinc per sq. ft. after fabrication.
2. Seismic Construction: For anchoring face brick to CMU back-up, provide No. 280 "S.I.S. Dub'l Loop-Lock Ladder Seismiclip Interlock System" made by Hohmann & Barnard or equal by manufacturer noted below in Para. C.6. All wire used in assembly shall be 3/16" dia. Assembly shall contain ladder reinforcing, welded loops, box tie, seismiclip and continuous wire in face brick mortar joint. Provide special formed prefabricated pieces at corners and intersections of walls or partitions. Reinforcing wire in face brick mortar joint to extend at least 2" into face of brick. Show anchor locations on approved shop drawings.
  - a. Reinforcing assembly shall be hot dip galvanized steel finish conforming to ASTM A 153 with zinc coating of 1.5 oz. of zinc per sq. ft., after fabrication.
3. For block walls forming part of exterior wall construction behind exterior stone veneer, provide super heavy duty reinforcing fabricated of 3/16" dia. side and cross rods, truss or ladder design, ties, spaced every block course. Provide prefabricated pieces at corners and intersections of walls or partitions.
  - a. Reinforcing assembly shall be hot dip galvanized steel finish conforming to ASTM A 153 with zinc coating of 1.5 oz. of zinc per sq. ft., after fabrication.
4. For interior block walls and partitions, provide standard reinforcing fabricated of 9 ga. side and cross rods, truss or ladder design, no ties, spaced every other block

course. Provide prefabricated pieces at corners and intersections of walls or partitions. Reinforcing shall be mill galvanized conforming to ASTM A 641, Class B-1, applied after fabrication.

5. Wire used in assemblies noted above shall be cold drawn steel wire conforming to ASTM A 82.
6. Approved Joint Reinforcing Manufacturer: Hohmann & Barnard, or approved equal.

D. Anchors and Ties

1. For anchoring brick to cold formed metal framing, provide one of the following or approved equal by other manufacturers noted above in Para. C.6:
  - a. "Wing-Nut Pos-I-Tie®" with self-drilling screw for steel studs zinc barrel and thermal wing-nut as manufactured by Heckmann Building Products. Provide Seismic Wire Pintle Tie hot-dip galvanized steel.
  - b. Hot-dip galvanized steel anchors equal to "X-Seal Veneer Anchor" with "X-Seal Tape" as manufactured by Hohman & Barnard or approved equal. Provide Model 187 "Seismiclip" with 9 ga. Wire.
2. Dovetail Anchor Slots: Hot-dip galvanized steel, 16 gauge equal to No. 100 Dovetail Anchor Slot made by Heckmann Building Products, No. 305 anchor slot made by Hohmann & Barnard, or approved equal by other manufacturers in Para. C.6.
3. Flexible Metal Ties for Dovetail Slots: Hot-dip galvanized, 16 gauge by 1" wide by Heckmann Building Products Inc., or approved equal manufacturer noted above in Para. C.6.
  - a. No. 106 Dovetail Corrugated Anchor.
  - b. No. 129 Dovetail Triangle Tie.
4. Wire Mesh: Hot-dip galvanized sixteen (16) gage steel wire, square mesh, width 3" by length to suit condition; No. 268 by Heckmann Building Products, or approved equal by manufacturer noted above in Para. C.6.
5. For anchoring face brick to concrete back-up where there are no dovetail slots provided, provide "CMU/Concrete Screw Wing-Nut Pos-I-Tie®" with five (5) gauge hot-dip galvanized (ASTM A 153, Class B-2) wire pintle tie made by Heckmann Building Products, or approved equal by manufacturer noted above in Para. C.6.
6. For anchoring CMU wall, at the exterior masonry cavity wall, to the underside of the concrete beam, provide dovetail slot as noted above and the following:
  - a. No. 121 galvanized steel dowel anchor and No. 421 tube as manufactured by Heckmann Building Products or approved by manufacturer noted above in Para. C.6. Galvanized to conform to ASTM A 153, Class B-2.
  - b. No. PTA-310 galvanized steel dowel anchor and No. NS-TA joint filler as manufactured by Hohmann & Barnard or approved equal by manufacturer noted above in Para. C.6. Galvanizing to conform to ASTM A 153, Class B-2.
7. For anchoring masonry to structural steel, provide hot-dip galvanized steel, as listed,

or approved equal by manufacturer noted above in Para. C.6:

- a. Made by Heckmann Building Products. Galvanizing shall conform to ASTM A 153, with zinc coating of 1.5 oz. of zinc per sq. ft.
  - 1). No. 195 Column Anchors
  - 2). No. 197 Column Anchors
  - 3). No. 315 Weld-On Anchor Rods with No. 316 Triangle Ties
- 4). No. 315-B Weld-On Anchor Straps with No. 316 Triangle Ties
  - b. Made by Hohmann & Barnard or approved equal. Galvanizing shall conform to ASTM A 153, with zinc coating of 1.5 oz. of zinc per sq. ft.
    - 1). No. 355 Column Anchors
    - 2). No. 356 Column Anchors
    - 3). No. 357 Beam Anchors
    - 4). No. 359 F anchor straps with VWT tie.
8. For anchoring CMU interior partitions to underside of steel beams, provide hot dip galvanized steel tube anchors equal to No. 419 and No. 421 made by Heckmann Building Products, No. PTA-420 made by Hohmann & Barnard, or approved equal by manufacturer noted above in Para. C.6.
9. For anchoring CMU interior partitions to underside of structural deck, provide 4" x 4" x 1/4" galvanized steel angles (ASTM A 36), 3'-0" long spaced 3'-0" o.c. alternately on each side of partition. Anchor partition securely to structural deck.
- E. Reinforcing Bars and Rods: ASTM A 615, Grade 60. See Drawings for size.
- F. Control and Expansion Joint Fillers
  1. Vertical Installation Within Concrete Masonry Wall: Extruded high grade neoprene rubber, cross shape, for use with concrete masonry sash units, which shall provide a force fit in the grooves of the sash block, and shall have 1/2" diameter tubular ends (compressed 25% when installed in 3/8" wide joint).
    - a. Provide the following sizes:
      - 1). 2-5/8" wide control joint fillers for 4" block walls.
      - 2). 4-5/8" wide for 6" block walls.
      - 3). 6-5/8" wide for 8", 10" and 12" block walls.
    - b. Provide backer rod and sealant joint over joint filler as per drawings and Section 079200 of these specifications.
  2. Isolation Joint Filler at Abutting Construction and at Intersecting CMU Walls: Compressible and resilient closed cell neoprene gasket with pressure sensitive adhesive backing, thickness 30% greater than thickness of joint. Acceptable joint filler shall be "Everlastic, Type NN-1" by Williams Products, Inc., or approved equal. Recess joint filler and install backer rod and sealant as per drawings and Section 079200 of these specifications.
  3. Within Face Brick: Provide filler rod and sealant installed by Section 079200. Filler depth shall be 2 times joint width.
    - a. Compressible filler between top of brick and bottom of shelf angle or steel lintel shall be "Soft Joint Sealant" made by Polytite, or approved equal.
4. Within Expansion Joint at Face Brick: Manufacturer's standard preformed, pre-compressed,

open-cell polyurethane foam sealant impregnated with a water based, non-drying polymer modified acrylic water repellent. Provide "Seismic Colorseal" installed to twenty-five 25 percent compression, as manufactured by Emseal or approved equal.

- a. Properties: Permanently elastic, mildew resistant, non-migratory, non-staining, and compatible with joint substrates and other joint sealants. Density: 8.4 to 9.1 lb./cu. ft..

## 2.2 MORTAR MATERIALS

- A. Portland Cement: ASTM C 150, Type 1, standard color, one source.
- B. Hydrated Lime: ASTM C 207, Type S, as manufactured by Corsons, or approved equal.
- C. Aggregate: Clean, washed, buff colored sand, graded per ASTM C 144.
- D. Aggregate for Grout: ASTM C 404.
- E. Water: Clean, fresh and suitable for drinking.

## 2.3 MORTAR MIX

- A. Exterior Face Brick Construction: Mortar mixes shall meet ASTM C 270, Type N, cement/lime mortar. Colors of mortars shall use coloring agent made by Davis Colors, Lehigh Cement or approved equal. Color of mortar to meet with Architect's approval. The Contractor may use pre-packaged colored mortar equal to "Color Mortar Blend" made by Glen-Gery.
  1. Color of mortar must meet with Architect's approved sample and mock-up panel.
- B. Exterior Block Back-Up Construction: Provide Portland cement/lime mortar as noted above conforming to ASTM C 270, Type N.
- C. Interior Masonry Construction: Provide Portland cement/lime mortar conforming to ASTM C 270, Type N, for load bearing conditions, mortar shall conform to ASTM C 270, Type M.
- D. Reinforced Concrete Block: Provide Portland cement/lime mortar conforming to ASTM C 270, Type S.
- E. Mortar for Cement Cants: One (1) part Portland cement and four (4) parts sand, by volume.
- F. Grout for Unit Masonry: Comply with ASTM C 476 for grout for use in construction of unit masonry. Use grout of consistency (fine or coarse) at time of placement which will completely fill all spaces intended to receive grout. Grout shall have a minimum compressive strength of 3000 psi when tested in accordance with ASTM C 1019.
- G. Mixing
  1. General: Add cement just before mixing and mix dry. Use sufficient amount of water as necessary to produce workable mix. Mix in small batches to make plastic mass.
  2. Mixing: Machine mix all mortars in approved type mixer with device to accurately and uniformly control water. Add hydrated lime dry. Mix dry materials not less

than two (2) minutes. Add water, then mix not less than three (3) minutes, not to exceed five (5) minutes. Mix only amount of mortar that can be used before initial set. Do not use mortar which has reached its initial set or two (2) hours after initial mixing, whichever comes earlier. Mortar may not be re-tempered. Clean mixer for each batch, whenever mortar type is changed, and at end of each day's work.

3. Acceleration or other admixtures not permitted.
4. Mortar shall have a flow after suction of not less than seventy-five (75) percent of that immediately after mixing as determined by ASTM C 91.

#### H. Admixtures

1. No air-entraining admixtures or cementitious materials containing air-entraining admixtures shall be used in the mortar.
2. No antifreeze compounds or other substances shall be used in the mortar to lower the freezing point.
3. Calcium chloride or admixtures containing calcium chloride shall not be used in mortar.

#### 2.4 WEEP HOLES

- A. Provide clear plastic weep holes 3/8" wide and 1-1/2" high by four (4) inches long equal to No. 342 made by Hohmann & Barnard or approved equal manufacturer listed above.

#### 2.5 THRU-WALL FLASHING

- A. Provide sheet membrane flashing as part of exterior wall membrane system. Provide sealants and tapes as recommended by the manufacturer. Provide preformed corner sections "end dams" with system when flashing is discontinuous.
  1. Provide flashing for surface adhered applications at sheathed areas with 26 ga. stainless steel termination bar.
  2. Wall flashing shall have 26 ga. stainless steel drip edge adhered to edge of flashing, drip edge shall be set in sealant as specified in Section 079200.

#### 2.6 MORTAR NET

- A. Provide 10" high HDPE "Mortar Net" open mesh mortar net of width to fit masonry cavity shown on drawings, manufactured by Hohmann & Barnard, or equal "Mortar Break II," made by Advanced Building Products.

### PART 3 EXECUTION

#### 3.1 SURFACE CONDITIONS

##### A. Inspection

1. Prior to all work of this Section, carefully inspect the installed work of all other trades

and verify that all such work is complete to the point where this installation may properly commence.

2. Verify that masonry may be completed in accordance with all pertinent codes and regulations, the referenced standards, and the original design.
3. Do not start any work until mock-ups are approved by the Architect.

B. Discrepancies

1. In the event of discrepancy, immediately notify the Architect in writing.
2. Do not proceed with installation in areas of discrepancy until all such discrepancies have been fully resolved.
3. Starting of work by the Contractor means acceptance by the Contractor of the substrate.

3.2 COORDINATION

- A. Carefully coordinate with all other trades to ensure proper and adequate interface of the work of other trades with the work of this Section.

3.3 PREPARATION

A. Brick

1. Wet brick having an initial rate of absorption greater than 30 grams per 30 square inches when tested per ASTM C67. Wet bricks by allowing water to run on the cubes or pallets of brick, or placing them in a large tank of water.
2. Except for absorbent units specified to be wetted, lay masonry units dry.

- B. Concrete Block: Do not wet concrete block units.

3.4 INSTALLATION

A. General

1. Build walls to the full thickness shown. Build single wythe walls to the actual thickness of the masonry units, using units of nominal thickness shown.
2. Build chases and recesses as shown or required for the work of other trades.
3. Leave openings for equipment to be installed before completion of masonry work. After installation of equipment, complete masonry work to match work immediately adjacent to the opening.
4. Lay out walls in advance for accurate spacing of surface bond patterns with uniform joint widths and to properly locate openings, movement type joints, returns and off-sets. Avoid the use of less than half size units at corners, jambs and wherever possible.
5. Lay up walls plumb and true with courses level, accurately spaced and coordinated

with other work.

6. Provide templates made of steel studs for plumbing of two story masonry openings.
7. Pattern Bond: Lay exposed masonry patterns as noted on drawings. If not shown, provide running bond. Lay concealed concrete block with all units in a wythe bonded by lapping not less than two (2) inches. Bond and interlock each course of each wythe at corners. Do not use units of less than four (4) inches horizontal face dimensions at corners or jambs.
8. Where possible, masonry walls and partitions shall be built after all overhead ducts, pipes and conduits are in place and tested. Masonry shall be neatly built around the items above. Walls and partitions shall be plumb, true to line and free from defects such as open cells, voids, dry joints and other similar defects. In rooms and spaces scheduled to have concrete block finish, all such surfaces including upper wall surfaces up to termination of structural ceiling in spaces without suspended ceilings, shall be made suitable for paint application. Cutting of openings in walls and partitions in place shall be done only with the approval of the Architect.
9. Do not use any brick that do not meet chippage and tolerances of the applicable ASTM standard noted herein for the grade, type or class of brick.
10. Mortar, ties and reinforcement must not extend into or bridge any expansion joints.

B. Mortar Bedding and Jointing

1. All joints between bricks shall be completely filled with mortar. Bed joints shall be beveled per BMI recommendations, with the brick then shoved in place. At cavity wall construction, care shall be taken that no excess mortar goes into masonry cavity. Head joints shall be completely filled with mortar and shall be formed by applying a full coat of mortar to the entire end or the entire side, as the case requires, and then shoving the mortar covered end and/or side of the brick tightly against the bricks previously laid; the practice of "slushing" by throwing mortar into the head joints will not be permitted. All brick shall be laid without disturbing the brick previously laid. Brick shall be laid within a minute or so after the mortar is placed. Dry or butt joints will not be permitted. Grouting shall be done only as necessary. Do not slush head joints.
2. After brick placement, mortar squeezed out of bed joints shall be cut off before tooling.
3. Lay concrete masonry units with full mortar coverage on horizontal and vertical face shells. Bed webs in mortar in starting course on exterior walls and in all courses of piers, columns and pilasters, where solid CMU is used and where adjacent to cells or cavities to be reinforced or filled with concrete or grout.
  - a. To ensure alignment of brick and block coursing, adjust block back-up by cutting block to ensure alignment of coursing or use adjustable anchorage.
4. Lay masonry walls with 3/8" joints unless otherwise shown on drawings.
5. Tool exposed joints slightly concave after the mortar joint is "thumbprint" hard. Concealed joints shall be struck flush, including at any CMU schedule to receive a waterproofing or air barrier membrane.

6. Remove masonry units disturbed after laying; clean and reset in fresh mortar. Do not pound corners at jambs to fit stretcher units which have been set in position. If adjustments are required, remove units, clean off mortar and reset in fresh mortar.
- C. Stopping and Resuming Work: Rake back 1/2 brick length in each course; do not tooth. Clean exposed surfaces of set masonry, wet units lightly (if required) and remove loose masonry units and mortar prior to laying fresh masonry.
- D. Built-In Work
1. As the work progresses, build in items specified under this and other Sections of these specifications. Fill in solidly with masonry around built-in items.
  2. Mortar in door frames, access doors, louvers and other metal items embedded or built into masonry work solidly with mortar as the masonry units are laid up.
  3. Grout under lintels, bearing plates, and steel bearing on masonry with solid bed grout.
  4. Sleeves, pipes, ducts and all other items which pass through masonry walls shall be caulked with interior grade sealant meeting requirements of Section 079200, so as to be air tight and prevent air leakage. Refer to Section 078413 for packing of voids in rated masonry walls.
  5. Fill vertical cells of masonry units solid with grout which have anchoring, reinforcing rods, supporting or hanging devices embedded in the cell including stone anchors and window or curtain wall anchors.
  6. Fill vertical cells of masonry units solid with mortar on each side of door frames to sixteen (16) inches beyond.
  7. Unless otherwise noted, fill vertical cells of masonry units solid with grout which are below steel bearing plates, steel beams, and ends of lintels, to eight (8) inches beyond bearing and from floor to bearing.
  8. Place wire mesh in horizontal joint below masonry unit cells to be filled with mortar, to prevent mortar from dropping into unfilled cells below.
  9. Masonry indicated as being reinforced shall have all voids filled solid with grout. Grout shall be consolidated in place by vibration or other methods which ensure complete filling of cells. When the least clear dimension of the grouted cell is less than two (2) inches, the maximum height of grout pour shall not exceed twelve (12) inches. When the least clear dimension is two (2) inches or more, maximum height of grout pour shall not exceed forty-eight (48) inches. When grouting is stopped for one (1) hour or longer, the grout pour shall be stopped 1-1/2" below the top of a masonry unit. Vertical bar reinforcing shall be accurately placed and held in position while being grouted, and shall be in place before grouting starts. All such reinforcing shall have a minimum clear cover of 5/8". Lap all bars a minimum of forty (40) bar diameters and provide steel spacer ties (not to exceed 192 bar diameter) to secure and position all vertical steel and prevent displacement during grouting. Provide continuous horizontal reinforcement embedded in mortar joints every second course.
- E. Cutting and Patching

1. All exposed masonry which requires cutting or fitting shall be cut accurately to size with motorized carborundum or diamond saw, producing cut edges.
  2. Do not saw cut any masonry openings in face brick construction without Architect's approval and after a procedure has been reviewed and approved.
  3. Holes made in exposed masonry units for attachment of handrail brackets and similar items shall be neatly drilled to proper size.
4. All masonry which requires patching in exposed work, if approved by Architect, shall be patched neatly with mortar to match appearance of masonry as closely as possible and to the Architect's satisfaction. Rake back joints and use pointing mortar to match as required.

F. Solid Wall Construction

1. Fill the vertical longitudinal joint between wythes solidly with mortar by parging the in-place wythe and shoving units into the parging.
2. Tie wythes with continuous horizontal reinforcement embedded in mortar joints sixteen (16) inches o.c. vertically.

G. Cavity Walls

1. All exterior masonry walls, unless otherwise indicated, shall be cavity walls of thickness indicated.
2. Two wythes of masonry cavity walls shall be securely tied together by horizontal joint reinforcement and ties anchored to reinforcement, as herein specified, spaced every other block course.
  - a. Where cavity back-up is concrete use ties specified herein spaced sixteen (16) inches o.c. both directions.
3. Cavity between facing and backing wythe shall be kept clean and clear of all mortar droppings, and no mortar ledges shall project into the cavity. Temporary wood strips, cut to width of cavity and fitted with lift-up wires, shall be laid on the joint reinforcement and carefully lifted out before placement of the next layer of reinforcement. Any projecting mortar shall be spread over the back of the outer wythe immediately following the setting of the masonry unit.
  - a. Mortar net shall be installed at the bottom of each cavity over the flashing to protect weep holes.
4. At cavity and solid walls adjacent to window openings fill block solid with mortar where window anchors are to be located. Coordinate with window subcontractor.
5. Concrete block back-up at cavity wall construction shall be anchored to slab at top with dovetail anchors spaced sixteen (16) inches o.c.
6. Anchor CMU back-up with anchors as specified herein.
7. Where stone veneer is used (Section 044200) in cavity wall configuration, back-up block shall be reinforced every block course.

8. Refer to Section 072100, "Thermal Insulation," for material and installation of cavity wall insulation.

#### H. Interior Block Partitions

1. Build to full height unless otherwise shown on drawings. At non-rated partitions fill void between CMU and structural deck with continuous neoprene filler conforming to the requirements of Section 079100. At fire rated partitions, fill void with fire stop material meeting the requirements of Section 078413. Fasten to structure at top of partition using steel angles as specified herein.
  2. Provide continuous horizontal joint reinforcing every other block course, except as otherwise noted. Fully embed longitudinal side rods in mortar for their entire length with a minimum cover of 5/8". Lap reinforcement a minimum of six (6) inches at ends of units.
  3. Provide continuity at corners and wall intersections by use of prefabricated "L" and "T" sections. Cut and bend units as directed by manufacturer for continuity at returns, offsets, column fireproofing, pipe enclosures and other special conditions.
  4. Corners
    - a. Provide interlocking masonry unit bond in each course at corners.
    - b. Provide continuity at corners with prefabricated "L" reinforcement units, in addition to masonry bonding.
  5. Intersecting and Abutting Walls
    - a. Unless vertical control joints are shown as part of structural frame, provide interlocking masonry bond. Provide starters and special shapes as shown on the drawings to bond these walls.
    - b. In addition to masonry bonding, provide horizontal reinforcement using prefabricated "T" units at interior partitions.

#### I. Ties and Anchors for Masonry Construction

1. Provide ties and anchors as shown or specified, but not less than one metal tie, spaced not to exceed sixteen (16) inches o.c. horizontally and/or vertically. Provide additional ties within 1'-0" of all openings and adjacent to expansion joints and spaced not more than 16" apart around perimeter of openings.
2. Anchor masonry to structure complying with the following:
  - a. Provide an open space not less than 1/2" in width between masonry and structural member, unless otherwise shown. Keep open space free of mortar or other rigid materials.
3. Attach brick veneer to cold formed metal framing by anchoring brick to studs using specified anchors penetrating through sheathing and through flange of stud. Prior to application of anchors cover sheathing and vapor barrier with tape specified herein. Space anchors 8" o.c. at each stud; provide stainless steel screw anchors for attaching anchor to studs.

#### J. Control and Expansion Joints

1. Provide expansion, control and isolation joints in masonry as shown. Build in related items as the masonry work progresses.
2. CMU Control Joint Spacing: If location of control joints is not shown, place vertical joints spaced not to exceed 25'-0" o.c. In addition, locate joints at points of natural weakness in the masonry work, including the following:
  - a. At structural column or joint between bay.
  - b. Above control joints in the supporting structure.
    - c. Above major openings at end of lintels upward and below at ends of sills downward. Place at one side of jamb for openings less than 6'-0" wide and at both sides for openings over 6'-0" wide.
    - d. At reduction of wall thickness.
    - e. Where masonry abuts supporting structure.
    - f. If additional joints are required, indicate same on approved shop drawings.
3. Brick Veneer Expansion Joint Spacing: Vertical expansion joints in brick veneer construction shall be located maximum 20'-0" o.c. unless otherwise noted in addition to expansion joints located within 2'-0" of each corner of the building.

K. Lintels

1. Install loose steel lintels furnished by Section 055000, allowing eight (8) inch bearing at ends.
2. For concrete block walls, use specially formed U-shaped concrete block lintel units with reinforcing bars in accordance with the following table, filled with grout.

Number and Size of Reinforcing Bars Required at Concrete Block Lintels		
Maximum Clearance Span	Wall Width	Rebar No. - Size
2'-0" to 6'-0" 6'-0" to 8'-0"	6"	2 - #3 2 - #4
2'-0" to 6'-0" 6'-0" to 8'-0"	8"	2 - #3 2 - #4
2'-0" to 6'-0" 6'-0" to 8'-0"	12"	3 - #3 3 - #4

3. U-shaped concrete block lintels shall extend a minimum of 8" at each side of opening.

3.5 FLASHING/WEEP HOLES

- A. General: Install embedded flashing and weep holes in masonry at relieving angles, shelf

angles, lintels, ledges, other obstructions to the downward flow of water in the wall, and where indicated. Space weeps 16" o.c. unless otherwise shown on drawings. Weeps shall occur immediately above the flashing.

- B. Prepare masonry surfaces so that they are smooth and free from projections that could puncture flashing.
- C. Flashing shall be placed, generally, at bottoms of cavity wall construction, over all wall openings, window jambs, at sills of window, and in other locations where indicated on

the drawings. Flashing shall overlap a minimum of 6". At bottoms of cavity walls, the flashing shall be built extending from the exterior face of the brick, up and into the mortar joint 2" at the inner wythe of the CMU back-up; at sheathed areas attached with pressure bar. At concrete spandrel beams and columns the flashing shall be installed with a termination bar. Extreme care shall be exercised in placing the masonry materials not to damage the flashing. Flashing damaged during the masonry erection shall be repaired or replaced by the Contractor at no additional cost to the Owner. Discontinuous flashing shall terminate with an end dam in a head joint, rising at least 1".

- D. When spanning an air space, flashing shall be supported with a mortar wash, insulation or treated wood blocking.
- E. Where flashing is penetrated by anchors, patch flashings at penetration using adhesive and mastic recommended by the manufacturer to ensure watertight seal.
- F. Install flashing in accordance with manufacturer's instructions, using adhesive, primer, thinner, cleaner and mastic as recommended by flashing manufacturer.
  - 1. Flashing shall overlap adjacent piece of flashing a minimum of 6".
- G. Provide drip edge when flashing extends beyond face of brick.

### 3.6 CANTS

- A. Provide specified mortar for cement cants at beams and other projections in elevator shafts, where adjoining wall is of masonry construction. Cants shall slope twenty (20) degrees from the horizontal.

### 3.7 CLEANING, PROTECTION, ADJUSTMENT

- A. Protection
  - 1. The Contractor shall take adequate precautions for the protection of all surfaces against mortar spatter, and shall immediately remove any such spatter should it inadvertently occur, leaving no stain or discoloration.
  - 2. Excess mortar shall be wiped off the masonry surfaces as the work progresses.
  - 3. Wood coverings shall be placed over all such masonry surfaces as are likely to be damaged during the progress of the entire project.
  - 4. Protective measures shall be performed in a manner satisfactory to the Architect.
  - 5. Damaged masonry units shall be replaced to satisfaction of the Architect.
  - 6. Exterior masonry walls shall be draped with waterproof covering until copings are in

place, to prevent water penetration in cavity.

- B. Clean-Up: Upon completion, all exposed masonry shall be thoroughly cleaned following recommendations of the BIA Technical Note No. 20. Before applying any cleaning agent to the entire wall, it shall be applied to a sample wall area of approximately 4' x 4' in a location approved by the Architect. No further cleaning work may proceed until the sample area has been approved by the Architect, after which time the same cleaning materials and method shall be used on the remaining wall area. If stiff brushes and water do not suffice, the surface shall be thoroughly saturated with clear water and then scrubbed with a solution of an approved detergent masonry cleaner, equal to "Vana Trol" made by ProSoCo Inc. or equal made by Diedrich or approved equal, mixed and applied as per manufacturer's directions, followed immediately by a thorough rinsing with clear water. All adjacent non- masonry surfaces shall be thoroughly protected during cleaning.
  - a. Unless otherwise required by cleaning agent manufacturer use only low pressure device (30 to 50 psi) for application of cleaning agent and water rinsing.
- C. Pointing: Point any defective joint with mortar identical with that specified for that joint.

END OF SECTION



## SECTION 078100

### SPRAYED FIRE-RESISTIVE MATERIALS

#### PART 1 GENERAL

##### 1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

##### 1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the sprayed fire-resistive materials as shown on the drawings and/or specified herein, including, but not necessarily limited to, the following:
  - 1. Spray-on fireproofing for structural steel and metal decking.
  - 2. Seal coat over fireproofing in special areas.
  - 3. Preparation of surfaces.
  - 4. Field quality control.

##### 1.3 RELATED SECTIONS

- A. Firestops and smoke seals – Section 078413.

##### 1.4 SUBMITTALS

- A. Product Data: For each fire-resistive product specified.
- B. Shop Drawings: Submit structural framing plans indicating the following:
  - 1. Locations and types of surface preparations required before applying sprayed fire-resistive material.
  - 2. Extent of sprayed fire-resistive material for each construction and fire-resistance rating, including the following:
    - a. Applicable fire-resistive design designations of a qualified testing and inspecting agency acceptable to authorities having jurisdiction.
    - b. Minimum thicknesses needed to achieve required fire-resistance ratings of structural components and assemblies.
  - 3. Identify restrained and unrestrained assemblies on shop drawings, show required thickness of fireproofing for each assembly.

### SPRAYED FIRE-RESISTIVE MATERIALS

- C. Product Certificates: Signed by manufacturer of sprayed fire-resistive material certifying that the products furnished comply with requirements.
- D. Installer Certificates: Signed by manufacturer certifying that installers comply with specified requirements.
- E. Qualification Data: For firms and persons specified in "Quality Assurance" Article to demonstrate their capabilities and experience. Include lists of completed projects with project names and addresses, names and addresses of architects and owners, and other information specified.
- F. If primer is to be used steel and/or metal deck, submit certifications by supplier of primer that primer is compatible with materials, and will not impair the required performance of the installed fireproofing. Such certification shall be accompanied by evidence that the primer was successfully used in conjunction with the fireproofing material in a UL test applicable to the construction. Submit certification prior to application of primer.
  - 1. Coordinate with Section 051200 – Structural Steel and 053100 – Metal Deck, and Structural Drawings prior to application of primer.
- G. Product Test Reports: Indicate that physical properties of proposed sprayed fire- resistive materials comply with specified requirements based on comprehensive testing of current product formulations by a qualified testing and inspecting agency according to requirements specified in "Quality Assurance" Article.
- H. Code Compliance: Proposed product must comply with prevailing Building Code and be approved by those individuals having jurisdiction.
- I. Letter from manufacturer stating that the UL Design selected for the project is not load restricted.

#### 1.5 QUALITY ASSURANCE

- A. Installer Qualifications: Engage an experienced installer certified, licensed, or otherwise qualified by sprayed fire-resistive material manufacturer as having the necessary experience, staff, and training to install manufacturer's products according to specified requirements. A manufacturer's willingness to sell its sprayed fire-resistive materials to Contractor or to an installer engaged by Contractor does not in itself confer qualification on the buyer.
- B. Submit data indicating that products containing no detectable asbestos as determined according to the method specified in 40 CFR, Part 763, Subpart E, Appendix E, Section 1, "Polarized Light Microscopy."
- C. Mockups: After processing of initial submittals and before delivery and installation of fireproofing materials, prepare a sample installation of fireproofing work, approximately 100 sq. ft. in area; providing an example of each type required, applied on each different substrate, to produce each different rating as required and reasonably representative of entire sprayed on fireproofing work, for joint approval by representative of fire resistant material manufacturer and Owner. Work in other areas shall not proceed until mock-up has been completed. Mock-up work which remains in compliance with requirements and is in undamaged and acceptable condition may be retained as final work in place.

#### SPRAYED FIRE-RESISTIVE MATERIALS

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver products to Project site in original, unopened packages with intact and legible manufacturers' labels identifying product and manufacturer; date of manufacture; shelf life, if applicable; and fire-resistance ratings applicable to Project.
- B. Use materials with limited shelf life within period indicated. Remove from Project site and discard materials whose shelf life has expired.
- C. Store materials inside, under cover, aboveground, so they are kept dry until ready for use. Remove from Project site and discard materials that have deteriorated.

#### 1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not apply sprayed fire-resistive material when ambient or substrate temperatures are 40 deg F. or lower, unless temporary protection and heat is provided to maintain temperatures at or above this level for 24 hours before, during, and for 24 hours after product application.
- B. Ventilation: Ventilate building spaces during and after application of sprayed fire-resistive material to achieve a minimum of four air changes per hour. Use natural means or, where this is inadequate, forced-air circulation until fire-resistive material dries thoroughly.

#### 1.8 SEQUENCING

- A. Sequence and coordinate application of sprayed fire-resistive materials with other related work specified in other Sections to comply with the following requirements:
  - 1. Provide temporary enclosures for interior applications to prevent deterioration of fire-resistive material due to exposure to unfavorable environmental conditions.
  - 2. Avoid unnecessary exposure of fire-resistive material to abrasion and other damage likely to occur during construction operations subsequent to its application.
  - 3. Do not apply fire-resistive material to metal roof deck substrates until roofing has been completed; prohibit roof traffic during application and drying of fire-resistive material. Fireproofing shall be considered dry when the moisture content is 6% or less.
  - 4. Do not begin applying fire-resistive material until clips, hangers, supports, sleeves, and other items penetrating fire protection are in place.
  - 5. Defer installing ducts, piping, and other items that would interfere with applying fire-resistive material until application of fire protection is completed.
  - 6. Do not install enclosing or concealing construction until after fire-resistive material has been applied, inspected, tested, and corrections have been made to defective applications.
  - 7. Protect permanently exposed walls, floor or special surfaces.

#### 1.9 WARRANTY

- A. General Warranty: The special warranty specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and

### SPRAYED FIRE-RESISTIVE MATERIALS

shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.

- B. Special Warranty: Submit a written warranty, executed by Contractor and cosigned by Installer, agreeing to repair or replace sprayed fire-resistive materials that fail within the specified warranty period.
  - 1. Failures include, but are not limited to, cracking, flaking, eroding in excess of specified requirements; peeling; and delaminating of sprayed fire-resistive materials from substrates due to defective materials and workmanship within the specified warranty period.
  - 2. Not covered under the warranty are failures due to damage by occupants and Owner's maintenance personnel, exposure to environmental conditions other than those investigated and approved during fire-response testing, and other causes not reasonably foreseeable under conditions of normal use.
- C. Warranty Period: Three (3) years from date of Substantial Completion.

## PART 2 PRODUCTS

### 2.1 CONCEALED SPRAYED FIRE-RESISTIVE MATERIALS

- A. General: For concealed applications of sprayed fire-resistive materials, provide manufacturer's standard products complying with requirements indicated in this Article for material composition and physical properties representative of installed products.
  - 1. Steel members are to be considered unrestrained unless specifically noted otherwise.
- B. UL design listings must state that the loading was determined by Allowable Stress Design Method or Load and Resistance Factor Design Method. UL design listings requiring a load restriction factor will not be allowed.
- C. Material Composition: As follows:
  - 1. Cementitious sprayed fire-resistive material consisting of factory-mixed, dry formulation of gypsum or Portland cement binders and lightweight mineral or synthetic aggregates mixed with water at Project site to form a slurry or mortar for conveyance and application.
- D. Physical Properties: Minimum values, unless otherwise indicated, or higher values required to attain designated fire-resistance ratings, measured per standard test methods referenced with each property listed as follows:
  - 1. Dry Density: Minimum 15 lb./cu. ft. for average and individual densities regardless of density indicated in referenced fire-resistive design, or greater if required to

## SPRAYED FIRE-RESISTIVE MATERIALS

attain fire-resistance ratings indicated, per ASTM E 605 or AWCI Technical Manual 12-A, Appendix A, "Alternate Method for Density Determination."

2. Thickness: Provide minimum average thickness required for fire-resistive design shown on approved submittals.
    - a. Fireproofing shall be of thicknesses and density to meet the requirements of the NJDCA for Type of construction indicated on drawings.
  3. Bond Strength: Not less than 200 lbf/sq. ft. per ASTM E 736.
  4. Compressive Strength: 5.21 lbf/sq. in. as determined in the laboratory per ASTM E 761. Minimum thickness of sprayed fire-resistive material tested shall be 0.75 inch and minimum dry density shall be as specified, but not less than 15 lb./cu. ft.
  5. Corrosion Resistance: No evidence of corrosion per ASTM E 937.
  6. Deflection: No cracking, spalling, delamination, or the like per ASTM E 759.
  7. Effect of Impact on Bonding: No cracking, spalling, delamination, or the like per ASTM E 760.
  8. Air Erosion: Maximum weight loss of 0.025 g/sq. ft. in 24 hours per ASTM E 859. For laboratory tests, minimum thickness of sprayed fire-resistive material is 0.75 inch, maximum dry density is 15 lb./cu. Ft., test specimens are not prepurged by mechanically induced air velocities, and tests are terminated after 24 hours.
  9. Fire-Test-Response Characteristics: Provide sprayed fire-resistive materials with the following surface-burning characteristics as determined by testing identical products per ASTM E 84 by UL or another testing and inspecting agency acceptable to authorities having jurisdiction.
    - a. Flame Spread: 10 or less.
    - b. Smoke Developed: 0.
  10. Fungal Resistance: No observed growth on specimens per ASTM G 21.
- E. Products: Subject to compliance with requirements, provide products by one of the following:
1. Cementitious Sprayed Fire-Resistive Material
    1. Pyrolite 5GP; Carbolite Co., Fireproofing Products Div.
    2. Monokote Type MK-6; GCP Applied Technologies.
    3. Cafco 300; Isolatek International Corp., Cafco Products.
    4. Type F3; Promat Firetemp.

## 2.2 SPRAYED FIRE-RESISTIVE MATERIALS FOR EXPOSED FIREPROOFING

- A. General: For exposed applications of sprayed fire-resistive materials, provide manufacturer's standard products complying with requirements indicated for material

### SPRAYED FIRE-RESISTIVE MATERIALS

composition and for minimum physical properties of each product listed, measured by standard test methods referenced with each property.

1. Steel members are to be considered unrestrained unless specifically noted otherwise.
- B. UL design listings must state that the loading was determined by Allowable Stress Design Method or Load and Resistance Factor Design Method. UL design listings requiring a load restriction factor will not be allowed.
- C. Cementitious Sprayed Fire-Resistive Material: Factory-mixed, dry, cement aggregate formulation, chloride-free formulation of Portland cement binders, additives, and inorganic aggregates, mixed with water at Project site to form a slurry or mortar for conveyance and application, complying with the following requirements:
  1. Dry Density: Values for average and individual densities as required for fire-resistance ratings indicated, per ASTM E 605 or AWCI Technical Manual 12-A, Appendix A, "Alternate Method for Density Determination," but with an average density of not less than 22 lb./cu. ft.
  2. Bond Strength: 425 psf minimum per ASTM E 736.
  3. Compressive Strength: 10,000 psf. per ASTM E 761.
  4. Corrosion Resistance: No evidence of corrosion per ASTM E 937.
  5. Deflection: No cracking, spalling, delamination, or the like per ASTM E 759.
  6. Effect of Impact on Bonding: No cracking, spalling, delamination, or the like per ASTM E 760.
  7. Air Erosion: Maximum weight loss of 0.025 g/sq. ft. per ASTM E 859.
  8. Combustion Characteristics: Passes ASTM E 136.
  9. Fire-Test-Response Characteristics: Provide sprayed fire-resistive materials with the following surface-burning characteristics as determined by testing identical products per ASTM E 84 by UL or another testing and inspecting agency acceptable to authorities having jurisdiction.
    - a. Flame Spread: 10 or less.
    - b. Smoke Developed: 0.
  10. Fungal Resistance: No observed growth on specimens per ASTM G 21.
  11. For exterior applications of sprayed fire-resistive material, provide manufacturer's formulation approved for surfaces exposed to the exterior.
- D. Products: Subject to compliance with requirements, provide one of the following:
  1. Cement-Aggregate Cementitious Sprayed Fire-Resistive Material:
    - a. Pyrocrete 239; Carbolite Co., Fireproofing Products Div.

#### SPRAYED FIRE-RESISTIVE MATERIALS

- b. Monokote Type Z106HY; GCP Applied Technologies.
- c. F4; Promat Firetemp.
- d. Cafco 400, Isolatek International Corp; Cafco Products.

## 2.3 AUXILIARY FIRE-RESISTIVE MATERIALS

- A. General: Provide auxiliary fire-resistive materials that are compatible with sprayed fire-resistive materials and substrates and are approved by UL or another testing and inspecting agency acceptable to authorities having jurisdiction for use in fire-resistive designs indicated.
- B. Adhesive for Bonding Fire-Resistive Material: Product approved by manufacturer of sprayed fire-resistive material, used where required by manufacturer to ensure proper bond.
- C. Metal Lath: Expanded metal lath fabricated from material of weight, configuration, and finish required to comply with fire-resistive designs indicated and fire-resistive product manufacturer's written recommendations. Include clips, lathing accessories, corner beads, and other anchorage devices required to attach lath to substrates and to receive sprayed fire-resistive material.
- D. Sealer for Sprayed Fire-Resistive Material in Elevator Shafts and Open Area Plenums: Transparent-drying, water-dispersible protective coating by manufacturer of fire-resistive material.
  - 1. Product: Subject to compliance with requirements, provide "Firebond Concentrate" by GCP Applied Technologies, or similar product recommended by the manufacturer.

## PART 3 EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates, with Installer present, to determine whether they are in satisfactory condition to receive sprayed fire-resistive material. A substrate is in satisfactory condition if it complies with the following:
  - 1. Substrates are free of oil, grease, rolling compounds, incompatible primers, loose mill scale, dirt, or other foreign substances capable of impairing bond of fire-resistive material with substrate under conditions of normal use or fire exposure.
  - 2. Objects penetrating fire-resistive material, including clips, hangers, support sleeves, and similar items, are securely attached to substrates.
  - 3. Substrates are not obstructed by ducts, piping, equipment, and other suspended construction that will interfere with applying fire-resistive material.
- B. Do not proceed with installation of fire-resistive material until unsatisfactory conditions have been corrected.

## SPRAYED FIRE-RESISTIVE MATERIALS

### 3.2 PREPARATION

- A. Clean substrates of substances that could impair bond of fire-resistive material, including oil, grease, rolling compounds, incompatible primers, and loose mill scale.
- B. For exposed applications, repair substrates to remove any surface imperfections that could affect uniformity of texture and thickness in finished surface of sprayed fire-resistive material. Remove minor projections and fill voids that would telegraph through fire-resistive products after application.
- C. Cover other work subject to damage from fallout or overspray of fire-resistive materials during application. Provide temporary enclosure as required to confine spraying operations, protect the environment, and ensure maintenance of adequate ambient conditions for temperature and ventilation.

### 3.3 INSTALLATION

- A. Comply with fire-resistive material manufacturer's written instructions for mixing materials, application procedures, and types of equipment used to convey and spray on fire-resistive material, as applicable to particular conditions of installation and as required to achieve fire-resistance ratings indicated.
- B. Install metal lath, as required, to comply with fire-resistance ratings and fire-resistive material manufacturer's written recommendations for conditions of exposure and intended use. Securely attach lath to substrate in position required for support and reinforcement of fire-resistive material. Use anchorage devices of type recommended in writing by fire-resistive material manufacturer. Attach lathing accessories where indicated or required for secure attachment to substrate.
- C. Coat substrates with adhesive before applying fire-resistive material where required to achieve fire-resistance rating or as recommended in writing by fire-resistive material manufacturer for material and application indicated.
- D. Extend fire-resistive material in full thickness over entire area of each substrate to be protected.
- E. Spray apply fire-resistive materials to maximum extent possible. Following the spraying operation in each area, complete the coverage by method recommended by the manufacturer.
- F. Where sealers are used, apply products that are tinted to differentiate them from the sprayed fire-resistive material over which they are applied.
- G. Maintain ambient conditions during installation and for cure period following installation, as recommended by manufacturer. Provide ventilation and avoid excessive rate of drying.
- H. Fireproofing to the underside of roof deck assemblies shall be done only after roofing application is complete, all roof mounted mechanical equipment is in place, and the roof is watertight.
- I. No fireproofing shall be applied prior to completion of concrete work on steel decking.

### SPRAYED FIRE-RESISTIVE MATERIALS

- J. Installation Sequence of Fireproofing: All patching and repairing of sprayed fireproofing, due to cutting by other trades or testing and inspection, shall be performed under this Section.
- K. Provisions shall be made for ventilation to properly dry the fireproofing after application. In enclosed areas lacking natural ventilation, air circulation and ventilation must be provided.

#### 3.4 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and to prepare test reports.
  - 1. Testing and inspecting agency will interpret tests and state in each report whether tested work complies with or deviates from requirements.
- B. Testing and inspecting of completed applications of sprayed fire-resistive material will take place in successive stages, in areas of extent and using methods as follows. Do not proceed with application of fire-resistive material for the next area until test results for previously completed applications of fire-resistive material show compliance with requirements.
  - 1. For each 1000-sq. ft. area, or partial area, on each floor, testing and inspecting agency will evaluate the following characteristics. Tested values must equal or exceed values indicated and values required for approved fire-resistance design.
    - a. Thickness for Floors, Roofs, and Walls: From the average of 10 measurements from a 144-sq. in. sample area, with sample width of not less than 6 inches per ASTM E 605.
  - 2. Thickness for Structural Frame Members: From a sample of 25 percent of structural members per floor, taking 9 measurements at a single cross section for structural frame beams or girders, 7 measurements of a single cross section for joists and trusses, and 12 measurements of a single cross section for columns per ASTM E 605.
  - 3. For each 10,000 sq. ft. area, or partial area, on each floor, testing and inspection agency will evaluate the following characteristics. Tested values must equal or exceed values indicated and values required for approved fire resistance design.
    - a. Bond Strength for Floors, Roofs, Walls, and Structural Framing Members: Cohesion and adhesion at frequency and from sample size indicated for determining thickness of each type of construction, per ASTM E 736.
  - 4. Density for Floors, Roofs, Walls, and Structural Frame Members: At frequency and from sample size indicated for determining thickness of each type of construction, per ASTM E 605 or AWCI Technical Manual 12-A, Appendix A, "Alternate Method for Density Determination."
- 5. When testing discovers applications of fire-resistive material not in compliance with requirements, testing and inspecting agency will perform additional random testing to determine extent of noncompliance.

#### SPRAYED FIRE-RESISTIVE MATERIALS

- C. Remove and replace applications of fire-resistive material where test results indicate that they do not comply with specified requirements for cohesion and adhesion or for density, or both.
- D. Apply additional fire-resistive material per manufacturer's written instructions where test results indicate that thickness does not comply with specified requirements.
- E. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

### 3.5 CLEANING, PROTECTING, AND REPAIR

- A. Cleaning: Immediately after completing spraying operations in each containable area of Project, remove material overspray and fallout from surfaces of other construction and clean exposed surfaces to remove evidence of soiling.
- B. Cure exposed sprayed fire-resistive material according to product manufacturer's written recommendations to prevent premature drying.
- C. Protect fire-resistive material, according to advice of product manufacturer and Installer, from damage resulting from construction operations or other causes so fire protection will be without damage or deterioration at the time of Substantial Completion.
- D. Coordinate application of fire-resistive material with other construction to minimize the need to cut or remove fire protection. As installation of other construction proceeds, inspect fire-resistive material and patch any damaged or removed areas.
  - 1. Patch and repair fireproofing where Owner's Testing Agency has performed tests.
- E. Repair or replace work that has not been successfully protected.

END OF SECTION

## SECTION 078413

### FIRESTOPS AND SMOKESEALS

#### PART 1 GENERAL

##### 1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

##### 1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the firestops and smoke seals as shown on the drawings and/or specified herein, including, but not limited to, the following:
  - 1. Penetrations through fire-resistance-rated floor and roof construction including both empty openings and openings containing cables, pipes, ducts, conduits, and other penetrating items.
  - 2. Penetrations through fire-resistance-rated walls and partitions including both empty openings and openings containing cables, pipes, ducts, conduits, and other penetrating items.
  - 3. Penetrations through smoke barriers and construction enclosing compartmentalized areas involving both empty openings and openings containing penetrating items.
  - 4. Sealant joints in fire-resistance-rated construction.
  - 5. Penetrations at each floor level in shafts and/or stairwells.
  - 6. Construction joints, including those between top of fire rated walls and underside of floors above.

##### 1.3 RELATED SECTIONS

- A. Unit masonry - Section 042000.
- B. Joint sealers - Section 079200.
- C. Drywall - Section 092900.

##### 1.4 REFERENCES

- A. ASTM E 814 "Standard Method of Fire Tests of Through-Penetration Firestops."
- B. UL 1479, UBC 7-5 (Both are same as A. above).

- C. ASTM E 136 "Standard Test Method for Assessing Combustibility of Materials."
  - D. UL 263, UBC 7-1 "Fire Tests of Building Construction and Materials"
  - E. UL 2079 "Tests For Fire Resistance of Building Joint Systems."
  - F. ASTM E 1399 "Test For Dynamic Movement Conditions."
  - G. ASTM E 1966 (Same as E. above).
  - H. ASTM G 21 "Standard Practice for Determining Resistance of Synthetic Polymeric Materials to Fungi."
  - I. Test Requirements: ASTM E 2307, "Standard Test Method for Determining Fire Resistance of Perimeter Fire Barrier Systems Using Intermediate-Scale, Multi-story Test Apparatus."
  - J. Inspection Requirements: ASTM E 2174, "Standard Practice for On-site Inspection of Installed Firestops."
  - K. Published Through-Penetration Systems by recognized independent testing agencies.
    - 1. UL Fire Resistance Directory, Volume II of current year.
    - 2. Warnock Hersey Certification Listings, current year.
    - 3. Omega Point Laboratories, current year.
  - L. International Firestop Council Guidelines for Evaluating Firestop Systems Engineering Judgments.
- 1.5 SUBMITTALS
- A. Submit manufacturer's product literature for each type of firestop material to be installed. Literature shall indicate product characteristics, typical uses, performance, limitation criteria, test data and indication that products comply with specified requirements.
  - B. Submit shop drawings detailing materials, installation methods, and relationships to adjoining construction for each firestop system, and each kind of construction condition penetrated and kind of penetrating item. Include

firestop design designation of qualified testing and inspection agency evidencing compliance with requirements for each condition indicated.

1. Submit documentation, including illustrations, for proposed UL listed (or equal) firestop and smoke seal assembly required for the Project.
- C. Material Safety Data Sheets: Submit MSDS for each firestop product.
- D. Submit qualifications of firestop installer, including letter from firestop manufacturer of products proposed to be installed, wherein manufacturer approves or recognizes as trained/ or certifies installer for installation of that manufacturer's products.
- E. Engineering Judgment: For those firestop applications that exist for which no qualified tested system is available through a manufacturer, an engineering judgment derived from similar qualified tested system designs or other tests will be submitted to local authorities having jurisdiction for their review and approval prior to installation. Engineering judgment documents must follow requirements set forth by the International Firestop Council.

## 1.6 QUALITY ASSURANCE

- A. General: Provide firestopping systems that are produced and installed to resist the spread of fire and the passage of smoke and other gases.
- B. Installation Responsibility: Assign installation of through-penetration firestop systems and fire-resistive joint systems in Project to a single sole source firestop specialty contractor.
- C. Firestopping materials shall conform to Flame (F) and Temperature (T) ratings as required by local building code and as tested by nationally accepted test agencies per ASTM E 814 or UL 1479. The F-rating must be a minimum of one (1) hour, but not less than the fire resistance rating of the assembly being penetrated. T-rating, when required by code authority, shall be based on measurement of the temperature rise on the penetrating item(s). The fire test shall be conducted with a minimum positive pressure differential of 0.01 inches of water column.
1. Penetrations in Horizontal Assemblies: Provide firestopping with ratings determined in accordance with UL 1479 or ASTM E 814.
    - a. F-Rating: Minimum of 1-hour rating, but not less than the fire-resistance rating of the floor construction being penetrated.
    - b. T-Rating: When penetrant is located outside of a wall cavity, minimum of 1-hour rating, but not less than the fire-resistance rating of the floor construction being penetrated.
    - c. W-Rating: Class 1 rating in accordance with water leakage test per UL 1479.

2. Penetrations in Smoke Barriers: Provide firestopping with ratings determined in accordance with UL 1479 or ASTM E 814.
  - a. L-Rating: Not exceeding 5.0 cfm/sq. ft. of penetration opening at both ambient and elevated temperatures.
- D. Firestopping products shall be asbestos free and free of any PCBs.
- E. Do not use any product containing solvents or that requires hazardous waste disposal.
- F. Do not use firestop products which after curing, dissolve in water.
- G. Do not use firestop products that contain ceramic fibers.
- H. Firestopping Installer Qualifications: Firestop application shall be performed by a single firestopping contractor who specializes in the installation of firestop systems, whose personnel to be utilized have received specific training and certification or approval from the proposed respective firestop manufacturer, and firestop installer shall have a minimum of three years' experience (under present company name) installing firestop systems of the type herein specified.
- I. Mock-Up: Prepare job site mock-ups of each typical Firestop System proposed for use in the project. Approved mock-ups will be left in place as part of the finished project and will constitute the quality standard for the remaining work.
- J. For firestopping exposed to view, traffic, moisture, and physical damage, provide products that do not deteriorate when exposed to these conditions.
  1. For piping penetrations for plumbing and wet-pipe sprinkler systems, provide moisture-resistant through-penetration firestop systems.
  2. For floor penetrations with annular spaces exceeding 4 inches or more in width and exposed to possible loading and traffic, provide firestop systems capable of supporting the floor loads involved either by installing floor plates or by other means.
  3. For penetrations involving insulated piping, provide through-penetration firestop systems not requiring removal of insulation.
- K. Mold Resistance: Provide penetration firestopping with mold and mildew resistance rating of less than or equal to 1 as determined by ASTM G 21.
- L. Firestopping Materials are either "cast-in-place" (integral with concrete placement) or "post-installed." Provide cast-in-place firestop devices prior to concrete placement.
- M. Firestop systems do not reestablish the structural integrity of load bearing partitions or assemblies, or support live loads and traffic. Installer shall consult the Structural Engineer prior to penetrating any load bearing assembly.

## 1.7 DELIVERY, STORAGE AND HANDLING

- A. Deliver materials in manufacturer's original unopened containers with manufacturer's name, product identification, lot numbers, UL or Warnock Hersey labels, and mixing and installation instructions, as applicable.
- B. Store materials in the original, unopened containers or packages, and under conditions recommended by manufacturer.
- C. All firestop materials shall be installed prior to expiration of shelf life.

## 1.8 PROJECT CONDITIONS

- A. Verify existing conditions and substrates before starting work
- B. Do not use materials that contain solvents, show sign of damage or are beyond their shelf life.
- C. During installation, provide masking and drop cloths as needed to prevent firestopping products from contaminating any adjacent surfaces.
- D. Conform to ventilation requirements if required by manufacturer's installation instructions or Material Safety Data Sheet.
- E. Weather Conditions: Do not proceed with installation of firestop products when temperatures are in excess or below the manufacturer's recommendations.
- F. Schedule installation of firestop products after completion of penetrating item installation but prior to covering or concealing of openings.
- G. Coordinate this work as required with work of other trades.

## 1.9 SEQUENCING AND SCHEDULING

- A. Pre-Installation Conference: Convene a pre-installation conference to establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work.
- B. Sequence: Perform work of this and other sections in proper sequence to prevent damage to the firestop systems and to ensure that their installation will occur prior to enclosing or concealing work.
- C. Install all firestop systems after voids and joints are prepared sufficiently to accept the applicable firestop system.
- D. Do not cover firestop systems until they have been properly inspected and accepted by the authority having jurisdiction.

## PART 2 PRODUCTS

### 2.1 ACCEPTABLE MANUFACTURERS

- A. Subject to compliance with requirements, provide products of one of the following manufacturers:
1. Hilti, Inc.
  2. Metacaulk.
  3. Nelson.
  4. Specified Technologies Inc.
  5. 3M.
  6. Tremco.
  7. U.S. Gypsum Co.

### 2.2 FIRESTOPPING, GENERAL

- A. Compatibility: Provide firestopping composed of components that are compatible with each other, the substrates forming openings, and the items, if any, penetrating the firestopping under conditions of service and application, as demonstrated by firestopping manufacturer based on testing and field experience.
- B. Accessories: Provide components for each firestopping system that are needed to install fill materials. Use only components specified by the firestopping manufacturer and approved by the qualified testing and inspecting agency for the designated fire-resistance-rated systems. Accessories include but are not limited to the following items:
1. Permanent forming/damming/backing materials including the following:
    - a. Semirefractory fiber (mineral wool) insulation.
    - b. Sealants used in combination with other forming/damming materials to prevent leakage of fill materials in liquid state.
    - c. Fire-rated form board.
    - d. Joint fillers for joint sealants.
  2. Temporary forming materials.
  3. Substrate primers.
  4. Collars.
  5. Steel sleeves.

- C. Applications: Provide firestopping systems composed of materials specified in this Section that comply with system performance and other requirements.
- D. Smoke seals at top of partitions shall be flexible to allow for partition deflection.
- E. Polypropylene Sleeves (PP): (For cast-in device options.)

### 2.3 FILL MATERIALS FOR THROUGH-PENETRATION FIRESTOP SYSTEMS

- A. Endothermic, Latex Compound Sealant: Single-component, endothermic, latex formulation.
- B. Intumescent, Latex Sealant: Single-component, Intumescent, latex formulation.
- C. Intumescent Putty: Non-hardening, dielectric, water-resistant putty containing no solvents, inorganic fibers, or silicone compounds.
- D. Intumescent Wrap Strips: Single-component, elastomeric sheet with aluminum or polyethylene foil on one side.
- E. Job-Mixed Vinyl Compound: Prepackaged vinyl-based powder product for mixing with water at Project site to produce a paintable compound, passing ASTM E 136, with flame-spread and smoke-developed ratings of zero per ASTM E 84.
- F. Mortar: Prepackaged dry mix composed of a blend of inorganic binders, fillers, and lightweight aggregate formulated for mixing with water at Project site to form a non-shrinking, homogeneous mortar.
- G. Pillows/Bags: Re-usable, heat-expanding pillows/bags composed of glass-fiber cloth cases filled with a combination of mineral-fiber, water-insoluble expansion agents and fire-retardant additives.
- H. Moldable putty pads by 3M or approved equal.
- I. Silicone Foam: Two-component, silicone-based liquid elastomer that, when mixed, expands and cures in place to produce a flexible, non-shrinking foam.
- J. Silicone Sealant: Moisture-curing, single-component, silicone-based, neutral-curing elastomeric sealant of grade indicated below:
  - 1. Grade: Pourable (self-leveling) formulation for openings in floors and other horizontal surfaces and non-sag formulation for openings in vertical and other surfaces requiring a non-slumping/gunnable sealant, unless firestop system limits use to non-sag grade for both opening conditions.
- K. Cast-in-Place Firestop Devices: Factory-assembled devices for use in cast-in-place concrete floors and consisting of an outer metallic or polypropylene sleeve lined with an intumescent strip, an extended rectangular flange attached to one end of the sleeve for fastening to concrete formwork, and a neoprene gasket.

- L. Fire Rated Cable Management Devices: Factory-assembled round metallic sleeve device for use with cable penetrations, containing an integrated smoke seal fabric membrane that can be opened and closed for re-penetration.
- M. Drop-In Firestop Devices: Factory-assembled devices for use with combustible or noncombustible penetrants in cored holes within concrete floors. Device shall consist of galvanized steel sleeve lined with an intumescent strip, an extended rectangular flange attached to one end of the sleeve for fastening to concrete floor, and neoprene gasket.
- N. Firestop Devices: Factory-assembled collars formed from galvanized steel and lined with intumescent material sized to fit specific diameter of penetrant.
- O. Intumescent Composite Sheets: Rigid panels consisting of aluminum-foil-faced elastomeric sheet bonded to galvanized-steel sheet.
- P. Blocks/Plugs: Intumescent flexible block/plug suitable for reuse in re-penetration of openings. Blocks shall allow up to 12" of unreinforced annular space.
- Q. Tub Box Kit: Cast-in place pre-formed plastic tub box kit with three support legs for use with drain piping assembly associated with bathtub installations.

#### 2.4 FIRE-RESISTIVE ELASTOMERIC JOINT SEALANTS

- A. Elastomeric Sealant Standard: Provide manufacturer's standard chemically curing, elastomeric sealant of base polymer indicated that complies with ASTM C 920 requirements, including those referenced for Type, Grade, Class, and Uses, and requirements specified in this Section applicable to fire-resistive joint sealants.
  - 1. Sealant Colors: Color of exposed joint sealants as selected by the Architect.
- B. Single-Component, Neutral-Curing Silicone Sealant: Type S; Grade NS; Class 25; exposure-related Use NT, and joint-substrate-related Uses M, G, A, and (as applicable to joint substrates indicated) O.
  - 1. Additional Movement Capability: Provide sealant with the capability to withstand 33 percent movement in both extension and compression for a total of 66 percent movement.
- C. Multi-Component, Non-Sag, Urethane Sealant: Type M; Grade NS; Class 25; exposure-related Use NT, and joint-substrate-related Uses M, A, and (as applicable to joint substrates indicated) O.
  - 1. Additional Movement Capability: Provide sealant with the capability to withstand 40 percent movement in extension and 25 percent in compression for a total of 65 percent movement in joint width existing at time of installation, when tested for adhesion and cohesion under

maximum cyclic movement per ASTM C 719, and remain in compliance with other requirements of ASTM C 920 for uses indicated.

- D. Single-Component, Non-Sag, Urethane Sealant: Type S; Grade NS; Class 25; and Uses NT, M, A, and (as applicable to joint substrates indicated) O.

## 2.5 MINERAL FIBER/CERAMIC WOOL NON-COMBUSTIBLE INSULATION (FIRE SAFING)

- A. Provide min. 4 pcf safing insulation to suit conditions and to comply with fire resistance and firestop manufacturer's requirements.
- B. Material shall be classified non-combustible when tested per ASTM E 136.
- C. Acceptable Manufacturers:
  - 1. Thermafiber, Inc. (an Owens Corning company); Thermafiber Safing Mineral Wool Insulation
  - 2. Rockwool; Roxul Safe Fire Safing Insulation
  - 3. Johns Manville; Mineral Wool Safing

## 2.6 MIXING

- A. For those products requiring mixing prior to application, comply with firestopping manufacturer's directions for accurate proportioning of materials, water (if required), type of mixing equipment, selection of mixer speeds, mixing containers, mixing time, and other procedures needed to produce firestopping products of uniform quality with optimum performance characteristics for application indicated.

# PART 3 EXECUTION

## 3.1 EXAMINATION

- A. Examine substrates and conditions with Installer present, for compliance with requirements for opening configuration, penetrating items, substrates, and other conditions affecting performance of firestopping. Do not proceed with installation until unsatisfactory conditions have been corrected.

## 3.2 PREPARATION

- A. Surface Cleaning: Clean out openings and joints immediately prior to installing firestopping to comply with recommendations of firestopping manufacturer and the following requirements:
  - 1. Remove all foreign materials from surfaces of opening and joint substrates and from penetrating items that could interfere with adhesion of firestopping.

2. Clean opening and joint substrates and penetrating items to produce clean, sound surfaces capable of developing optimum bond with firestopping. Remove loose particles remaining from cleaning operation.
  3. Remove laitance and form release agents from concrete.
- B. Priming: Prime substrates where recommended by firestopping manufacturer using that manufacturer's recommended products and methods. Confine primers to areas of bond; do not allow spillage and migration onto exposed surfaces.
- C. Masking Tape: Use masking tape to prevent firestopping from contacting adjoining surfaces that will remain exposed upon completion of work and that would otherwise be permanently stained or damaged by such contact or by cleaning methods used to remove smears from firestopping materials. Remove tape as soon as it is possible to do so without disturbing seal of firestopping with substrates.

### 3.3 CONDITIONS REQUIRING FIRESTOPPING

#### A. Interior Walls and Partitions

1. Construction joints between top of fire rated walls and underside of floors above, shall be firestopped.
2. Firestop system installed shall have been tested by either UL or Omega Point, including exposure to hose stream test and including for use with steel fluted deck floor assemblies.
3. Firestop system used shall allow for deflection of floor above.

#### B. Penetrations

1. Penetrations include conduit, cable, wire, pipe, duct, or other elements which pass through one or both outer surfaces of a fire rated floor, wall, or partition.
2. Except for floors on grade, where a penetration occurs through a structural floor or roof and a space would otherwise remain open between the surfaces of the penetration and the edge of the adjoining structural floor or roof, provide firestopping to fill such spaces in accordance with ASTM E 814.
3. These requirements for penetrations shall apply whether or not sleeves have been provided, and whether or not penetrations are to be equipped with escutcheons or other trim. If penetrations are sleeved, firestop annular space, if any, between sleeve and wall of opening.

- C. Provide firestopping to fill miscellaneous voids and openings in fire rated construction in a manner essentially the same as specified herein before.

### 3.4 INSTALLING THROUGH PENETRATION FIRESTOPS

- A. General: Comply with the through penetrations firestop manufacturer's installation instructions and drawings pertaining to products and applications indicated.
- B. Install forming/damming materials and other accessories of types required to support fill materials during their application and in the position needed to produce the cross-sectional shapes and depths required to achieve fire ratings of designated through-penetration firestop systems. After installing fill materials, remove combustible forming materials and other accessories not indicated as permanent components of firestop systems.
- C. Install fill materials for through penetration firestop systems by proven techniques to produce the following results:
  - 1. Completely fill voids and cavities formed by openings, forming materials, accessories, and penetrating items.
  - 2. Apply materials so they contact and adhere to substrates formed by openings and penetrating items.
  - 3. For fill materials that will remain exposed after completing work, finish to produce smooth, uniform surfaces that are flush with adjoining finishes.

### 3.5 INSTALLING FIRE RESISTIVE JOINT SEALANTS

- A. General: Comply with ASTM C 1193, and with the sealant manufacturer's installation instructions and drawings pertaining to products and applications indicated.
- B. Install joint fillers to provide support of sealants during application and at position required to produce the cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability and develop fire resistance rating required.
- C. Install sealants by proven techniques that result in sealants directly contacting and fully wetting joint substrates, completely filling recesses provided for each joint configuration, and providing uniform, cross sectional shapes and depths relative to joint width that optimum sealant movement capability. Install sealants at the same time joint fillers are installed.
- D. Tool no sag sealants immediately after sealant application and prior to the time skinning or curing begins. Form smooth, uniform beads of configuration indicated or required to produce fire resistance rating, as well as to eliminate air pockets, and to ensure contact and adhesion of sealants with sides of joint. Remove excess sealant from surfaces adjacent to joint. Do not use tooling agents that discolor sealants or adjacent surfaces or are not approved by sealant manufacturer.

### 3.6 INSTALLING FIRESAFING INSULATION

- A. Install fire safing insulation utilizing welded or screw applied galvanized steel impaling pins and retaining clips; space clips or pins 24" o.c. maximum.
- B. Completely fill voids in areas where safing insulation is required. At spandrel conditions/floor edges, depth of insulation top to bottom shall be at least four (4) inches.
- C. Cover top of all safing insulation with firestop sealant or spray.

### 3.7 FIELD QUALITY CONTROL

- A. Inspecting agency employed and paid by the Owner will examine completed firestopping to determine, in general, if it is being installed in compliance with requirements.
- B. Inspecting agency will report observations promptly and in writing to Contractor, Owner and Architect.
- C. Do not proceed to enclose firestopping with other construction until reports of examinations are issued.
- D. Where deficiencies are found, Contractor must repair or replace firestopping so that it complies with requirements.

### 3.8 CLEANING

- A. Clean off excess fill materials and sealants adjacent to openings and joints as work progresses by methods and with cleaning materials approved by manufacturers of firestopping products and of products in which openings and joints occur.
- B. Protect firestopping during and after curing period from contact with contaminating substances or from damage resulting from construction operations or other causes so that they are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated firestopping immediately and install new materials to product firestopping complying with specified requirements.

END OF SECTION

SECTION 079200

JOINT SEALERS

PART 1 GENERAL

1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment and services necessary to complete the joint sealers work as shown on the drawings and/or specified herein, including but not necessarily limited to the following:
  - 1. Interior wall joints not specified to be sealed in other Sections of work, including caulking to fill between architectural woodwork and any wall, floor and/or ceiling imperfections.
  - 2. Joints at wall penetrations.
  - 3. Joints between items of equipment and other construction.
  - 4. All other joints required to be sealed to provide a positive barrier against penetration of air and moisture.

1.3 RELATED SECTIONS

- A. Firestop sealants - Section 078413.
- B. Sealant within drywall construction - Section 092900

#### 1.4 QUALITY ASSURANCE

- A. Qualification of Installers: Use only personnel who are thoroughly familiar, skilled and specially trained in the techniques of sealant work, and who are completely familiar with the published recommendations of the sealant manufacturer.
- B. Pre-Construction Field Adhesion Testing: Before installing elastomeric sealants, field test their adhesion to project joint substrates according to the method in ASTM C794 and C 1521 that is appropriate for the types of Project joints.
- C. Perform testing per ASTM C1248 on interior and exterior sealants to determine if sealants or primers will stain adjacent surfaces. No sealant work shall start until results of these tests have been submitted to the Architect and he has given his written approval to proceed with the work.

#### 1.5 SUBMITTALS

- A. Shop Drawings: Submit shop drawings showing all joint conditions, indicating relation of adjacent materials, all sealant materials (sealant, bond breakers, backing, primers, etc.), and method of installation.
  - 1. Submit joint sizing calculations certifying that movement capability of sealant is not being exceeded.
- B. Samples: Submit the following:
  - 1. Color samples of sealants, submit physical samples (not color chart).
  - 2. Sealant bond breaker and joint backing.
- C. Product Data: Submit manufacturer's technical information and installation instructions for:
  - 1. Sealant materials, indicating that material meets standards specified herein.
  - 2. Backing rods.
- D. Submit manufacturer's certification as required by Article 1.6 herein.
- E. Submit results of testing required in Article 1.4 herein.

#### 1.6 MANUFACTURER'S RESPONSIBILITY AND CERTIFICATION

- A. Contractor shall require sealant manufacturer to review the Project joint conditions and details for this Section of the work. Contractor shall submit to the Architect written certification from the sealant manufacturer that joints are of the proper size and design, that the materials supplied are compatible with adjacent materials and backing, that the materials will properly perform to provide permanent watertight, airtight or vaportight seals (as applicable), and that materials supplied meet specified performance requirements.

## 1.1 ENVIRONMENTAL CONDITIONS

- A. Temperature: Install all work of this Section when air temperature is above forty (40) degrees F. and below eighty (80) degrees F., unless manufacturer submits written instructions permitting sealant use outside of this temperature range.
- B. Moisture: Do not apply work of this Section on surfaces which are wet, damp, or have frost.

## 1.2 PRODUCT HANDLING

- A. Protection: Use all means necessary to protect the materials of this Section, before, during and after installation and to protect the installed work and materials of all other trades.
- B. Replacements: In the event of damage, immediately make all repairs and replacements necessary.
- C. Storage
  - 1. Store sealant materials and equipment under conditions recommended by their manufacturer.
  - 2. Do not use materials stored for a period of time exceeding the maximum recommended shelf life of the material.
  - 3. Material shall be stored in unopened containers with manufacturers' name, batch number and date when shelf life expires.

## 1.3 GUARANTEE

- A. Provide a written, notarized guarantee from the manufacturer stating that the applied sealants shall show no material failure for a period of ten (10) years.
- B. Contractor to provide a written, notarized, guarantee stating that the applied sealants shall show no failure due to improper installation for a period of five (5) years.
- C. Guarantee shall be in a form acceptable to the Owner and executed by an authorized individual.
- D. Include in guarantee provision, agreement to repair and/or replace, at Contractor's expense, sealant defects which develop during guarantee period, because of faulty labor and/or materials.

## PART 2 PRODUCTS

### 2.1 SEALANT MATERIALS

- A. Exterior Wall Sealant: Provide one (1) part non-sag sealant conforming to the minimum standards of ASTM C920, Type S, Grade NS, Class 50.
- B. Acceptable Manufacturers:

1. The Dow Chemical Company; DOWSIL 790 or DOWSIL 795
  2. G.E.; Silpruf SCS 2000 or LM SCS 2700
  3. Tremco; Spectrem 1 or Spectrem 3
  4. Sonneborn; Sonolastic 150
- C. Interior Sealant: Provide a one (1) part acrylic based sealant conforming to ASTM C834.
- D. Acceptable Manufacturers:
1. Pecora; AC-20+ Silicone
  2. BASF; Masterseal NP 520
  3. Tremco
- E. Colors: Colors selected from manufacturer's standard selection.

## 2.2 MISCELLANEOUS MATERIALS

- A. Back-Up Materials: Provide back-up materials and preformed joint fillers, non-staining, non-absorbent, compatible with sealant and primer, and of a resilient nature; twenty-five (25) percent wider than joint width. Materials impregnated with oil, bitumen or similar materials shall not be used. Provide back-up materials only as recommended by sealant manufacturer in writing.
- B. Provide bond breakers, where required, of polyethylene tape as recommended by manufacturer of sealant.
- C. Provide primers recommended by the sealant manufacturer for each material to receive sealant. Note that each exterior joint must be primed prior to sealing.
- D. Provide solvent, cleaning agents and other accessory materials as recommended by the sealant manufacturer.
- E. Materials shall be delivered to the job in sealed containers with manufacturer's original labels attached. Materials shall be used per manufacturer's printed instructions.

## PART 3 EXECUTION

### 3.1 INSPECTION

- A. Examine the areas and conditions where joint sealers are to be installed and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.2 INSTALLATION

- A. Sealant Installation Standard: Comply with instructions and recommendations of the

manufacturer and in accordance with ASTM C1193 for use of joint sealants as applicable to materials, applications and conditions required by this Project where more stringent installation requirements are specified herein, such requirements shall apply.

B. Sample Section of Sealant

1. During sealant installation work in exterior wall, the manufacturer of sealant shall send his representative to the site, under whose supervision a section of the wall (used as "control section") shall be completed for purposes of determining performance characteristics of sealant in joints. Architect shall be informed of time and place of such installation of control section.
2. Control section shall be installed according to specification given herein and shall not be considered as acceptable until written acceptance is provided by the Architect.
3. Accepted control section shall be standard to which all other sealant work must conform.

C. Supervision: The Contractor shall submit to the Architect written certification from the sealant manufacturer that the applicators have been instructed in the proper application of their materials. The Contractor shall use only skilled and experienced workmen for installation of sealant.

D. Apply sealant under pressure with a hand or power actuated gun or other appropriate means. Gun shall have nozzle of proper size and provide sufficient pressure to completely fill joints as detailed. Neatly point or tool joint to provide the contour as indicated on the drawings.

E. Preparation and Application

1. Thoroughly clean all joints, removing all foreign matter such as dust, oil, grease, water, surface dirt and frost. Sealant must be applied to the base surface. Previously applied film must be entirely removed.
2. Stone, masonry and concrete surfaces to receive sealant shall be cleaned where necessary by grinding, water blast cleaning, mechanical abrading, or combination of these methods as required to provide a clean, sound base surface for sealant adhesion.
  - a. Do not use any acid or other material which might stain surfaces.
  - b. Remove laitance by grinding or mechanical abrading.
  - c. Remove loose particles present or resulting from grinding, abrading, or blast cleaning by blowing out joints with compressed air, oil and water free, or vacuuming joints prior to application of primer or sealant.
3. Clean non-porous surfaces such as metal and glass chemically. Remove protective coatings on metallic surfaces by solvent that leaves no residue and is compatible with sealant. Use solvent and wipe dry with clean, dry lint free paper towels. Do not allow solvent to air dry without wiping. Clean joint areas protected with masking tape or strippable films as above after removal of tape film.
4. Do not seal joints until they are in compliance with drawings, or meet with the control section standard.

5. Joint Size and Sealant Size: Joints to receive sealant shall be at least 1/4" wide. In joint 1/4" to 3/8" wide, sealant shall be 1/4" deep. In joints wider than 3/8" and up to 1" wide, sealant depth shall be one half the joint width. For joints wider than 1", sealant depth shall be as recommended by the sealant manufacturer. Depth of joint is defined as distance from outside face of joint to closest point of the filler.
6. Primer: Thoroughly clean joints and apply primer to all surfaces that will receive sealant. Apply primer on clean, dry surfaces, and prior to installation of joint backing. Completely wet both inner faces of the joint with primer. Mask adjacent surfaces of joint with non-staining masking tape prior to priming. Apply primer with clean brush and only when temperature is above 45 deg. F.
7. Joint Backing: In joints where depth of joint exceeds required depth of sealant, install joint backing (after primer is dry) in joints to provide backing and proper joint shape for sealant. Proper shape for sealant is a very slight "hourglass" shape, with back and front face having slight concave curvature. Use special blunt T- shaped tool or roller to install joint backing to the proper and uniform depth required for the sealant. Joint backing shall be installed with approximately twenty- five (25) percent compressions. Do not stretch, twist, braid, puncture, or tear joint backing. Butt joint backing at intersections.
8. Bond Breaker: Install bond breaker smoothly over joint backing so that sealant adheres only to the sides of the joint and not backing.
9. Sealant Application: Apply sealant in accordance with the manufacturer's application manual and manufacturer's instructions, using hand guns or pressure equipment, on clean, dry, properly prepared substrates, completely filling joints to eliminate air pockets and voids. Mask adjacent surfaces of joint with non-staining masking tape. Force sealant into joint in front of the tip of the "caulking gun" (not pulled after it) and force sealant against sides to make uniform contact with sides of joint and to prevent entrapped air or pulling of sealant off of sides. Fill sealant space solid with sealant.
10. Tooling: Tool exposed joints to form smooth and uniform beds, with slightly concave surface conforming to joint configuration per Figure 5A in ASTM C1193. Finished joints shall be straight, uniform, smooth and neatly finished. Remove masking tape immediately after tooling of sealant and before sealant face starts to "skin" over. Neatly remove any excess sealant from adjacent surfaces of joint, leaving the work in a neat, clean condition.
11. Replace sealant which is damaged during construction process.

### 3.3 FIELD QUALITY CONTROL

#### A. Field-Adhesion Testing: Field test joint-sealant adhesion to joint substrates as follows:

1. Extent of Testing: Test completed and cured sealant joints as follows:
  - a. Perform 5 tests for the first 1000 feet of joint length for each kind of sealant and joint substrate.
  - b. Perform one test for each 5,000 feet of joint length thereafter or one test per each floor per elevation.

2. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C1193 or Method A, Tail Procedure, in ASTM C1521.
    - a. For joints with dissimilar substrates, verify adhesion to each substrate separately; extend cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
  3. Inspect tested joints and report on the following:
    - a. Whether sealants filled joint cavities and are free of voids.
    - b. Whether sealant dimensions and configurations comply with specified requirements.
    - c. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each kind of product and joint substrate. Compare these results to determine if adhesion complies with sealant manufacturer's field-adhesion hand-pull test criteria.
  4. Record test results in a field-adhesion-test log. Include dates when sealants were installed, names of persons who installed sealants, test dates, test locations, whether joints were primed, adhesion results and percent elongations, sealant material, sealant configuration, and sealant dimensions.
  5. Repair sealants pulled from test area by applying new sealants following same procedures used originally to seal joints. Ensure that original sealant surfaces are clean and that new sealant contacts original sealant.
- B. Evaluation of Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

END OF SECTION

## SECTION 083113 - ACCESS DOORS AND FRAMES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Access doors and frames for walls.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Include construction details, fire ratings, materials, individual components and profiles, and finishes.
- B. Shop Drawings:
  - 1. Include plans, elevations, sections, details, and attachments to other work.
  - 2. Detail fabrication and installation of access doors and frames for each type of substrate.
- C. Product Schedule: Provide complete access door and frame schedule, including types, locations, sizes, latching or locking provisions, and other data pertinent to installation.

### PART 2 - PRODUCTS

#### 2.1 PERFORMANCE REQUIREMENTS

- A. Fire-Rated Access Doors and Frames: Units complying with NFPA 80 that are identical to access door and frame assemblies tested for fire-test-response characteristics according to the following test method and that are listed and labeled by UL or another testing and inspecting agency acceptable to authorities having jurisdiction:
  - 1. NFPA 252 or UL 10B for fire-rated access door assemblies installed vertically.

#### 2.2 ACCESS DOORS AND FRAMES FOR WALLS AND CEILINGS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Acudor Products, Inc.
  - 2. Elmdor
  - 3. Alfab, Inc.

4. Babcock-Davis.
  5. Jensen Industries; Div. of Broan-Nutone, LLC.
  6. Karp Associates, Inc.
  7. NYSTROM
  8. Or approved equal.
- B. Source Limitations: Obtain each type of access door and frame from single source from single manufacturer.
- C. Flush Access Doors with Exposed Flanges:
1. Assembly Description: Fabricate door to fit flush to frame. Provide manufacturer's standard-width exposed flange, proportional to door size.
  2. Locations: Wall and Ceiling.
  3. Door Size: as indicated on drawings.
  4. Uncoated Steel Sheet for Door: Nominal, 14 gage.
    - a. Finish: Factory prime.
  5. Frame Material: Sheet steel frame, nominal 16 gage, factory primed.
  6. Hinges: Stainless steel hinges with removable pin.
  7. Hardware: Screw driver slot with quarter turn cam lock.
- D. Fire-Rated, Flush Access Doors with Exposed Flanges:
1. Assembly Description: Fabricate door to fit flush to frame. Provide self-latching door with automatic closer and interior latch release. Provide frame with gypsum board beads for concealed flange installation.
  2. Locations: Wall and Ceiling.
  3. Fire-Resistance Rating: Not less than that of adjacent construction.
  4. Temperature-Rise Rating: 450 deg F at the end of 30 minutes.
  5. Uncoated Steel Sheet for Door: Nominal 0.036 inch, 20 gage.
    - a. Finish: Factory finish.
  6. Frame Material: Sheet steel, nominal 16 gauge, factory primed.
  7. Hinges: Stainless steel hinges.
  8. Hardware: Screw driver slot with quarter turn cam lock.

## 2.3 MATERIALS

- A. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
- B. Steel Sheet: Uncoated or electrolytic zinc coated, ASTM A 879/A 879M, with cold-rolled steel sheet substrate complying with ASTM A 1008/A 1008M, Commercial Steel (CS), exposed.
- C. Frame Anchors: Same type as door face.
- D. Inserts, Bolts, and Anchor Fasteners: Hot-dip galvanized steel according to ASTM A 153/A 153M or ASTM F 2329.

## 2.4 FABRICATION

- A. General: Provide access door and frame assemblies manufactured as integral units ready for installation.
- B. Metal Surfaces: For metal surfaces exposed to view in the completed Work, provide materials with smooth, flat surfaces without blemishes. Do not use materials with exposed pitting, seam marks, roller marks, rolled trade names, or roughness.
- C. Doors and Frames: Grind exposed welds smooth and flush with adjacent surfaces. Furnish attachment devices and fasteners of type required to secure access doors to types of supports indicated.
  - 1. For concealed flanges with drywall bead, provide edge trim for gypsum board securely attached to perimeter of frames.
  - 2. Provide mounting holes in frames for attachment of units to metal or wood framing.
  - 3. Provide mounting holes in frame for attachment of masonry anchors.
- D. Latching Mechanisms: Furnish number required to hold doors in flush, smooth plane when closed.

## 2.5 FINISHES

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.
- B. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- C. Appearance of Finished Work: Noticeable variations in same piece are not acceptable. Variations in appearance of adjoining components are acceptable if they are within the range of approved Samples and are assembled or installed to minimize contrast.
- D. Steel and Metallic-Coated-Steel Finishes:
  - 1. Factory Prime: Apply manufacturer's standard, fast-curing, lead- and chromate-free, universal primer immediately after surface preparation and pretreatment.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Comply with manufacturer's written instructions for installing access doors and frames.
- B. Install doors flush with adjacent finish surfaces or recessed to receive finish material.

### 3.3 ADJUSTING

- A. Adjust doors and hardware, after installation, for proper operation.
- B. Remove and replace doors and frames that are warped, bowed, or otherwise damaged.

END OF SECTION 083113

SECTION 081113

HOLLOW METAL DOORS AND FRAMES

PART 1 GENERAL

1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the steel doors and frames work as shown on the drawings and/or specified herein, including, but not limited to, the following:
  - 1. Interior and exterior hollow metal doors and frames for fire-rated and unrated door openings.
  - 2. Trimmed openings.
  - 3. Interior hollow metal vision panels.
  - 4. Preparation of metal doors and frames to receive finish hardware, including reinforcements, drilling and tapping necessary.
  - 5. Preparation of hollow metal doors to receive glazing where required.
  - 6. Steel louvers for hollow metal doors.
  - 7. Furnishing anchors for building into masonry and drywall.
  - 8. Factory prime painting of work of this Section.

1.3 RELATED SECTIONS

- A. Installation of doors and frames - Section 062000.
- B. Finish Hardware - Section 087100.
- C. Gypsum Drywall - Section 092900.
- D. Painting and Finishing - Section 099000.

1.4 SUBMITTALS

- A. Product Data: Include construction details, material descriptions, core descriptions, label compliance, compliance with standards referenced herein, sound and fire-resistance ratings, and finishes for each type of door and frame specified.
- B. Shop Drawings: Show fabrication and installation of doors and frames. Include details of each frame type, elevations of door design types, conditions at openings, details of construction, reinforcement for surface applied hardware, dimensions of profiles and hardware preparation, location and installation requirements of door and frame hardware

and reinforcements, and details of joints and connections. Show anchorage and accessories.

- C. Door Schedule: Submit schedule of doors and frames using same reference numbers for details and openings as those on Drawings.
  - 1. Coordinate glazing frames and stops with glass and glazing requirements.
- D. Oversize Construction Certification: For door assemblies required to be fire rated and exceeding limitations of labeled assemblies, submit certification of a testing agency acceptable to authorities having jurisdiction that each door and frame assembly has been constructed to comply with design, materials, and construction equivalent to requirements for labeled construction.

#### 1.5 QUALITY ASSURANCE

- A. Manufacturer Qualifications: A firm experienced in manufacturing custom steel doors and frames similar to those indicated for this Project and with a record of successful in-service performance, as well as sufficient production capacity to produce required units.
- B. Testing Agency Qualifications: An independent agency qualified according to ASTM E 329 for testing indicated.
- C. Source Limitations: Obtain custom steel doors and frames through one source from a single manufacturer.
- D. Fire-Rated Door and Frame Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated.
  - 1. Test Pressure: Test according to NFPA 252 or UL 10C. After 5 minutes into the test, the neutral pressure level in furnace shall be established at 40" or less above the sill.
  - 2. Oversize Fire-Rated Door Assemblies: For units exceeding sizes of tested assemblies, provide certification by a testing agency acceptable to authorities having jurisdiction that doors comply with standard construction requirements for tested and labeled fire-protection-rated door assemblies except for size.
  - 3. Temperature-Rise Rating: At exit enclosures, provide doors that have a temperature-rise rating as required by prevailing Building Code in 30 minutes of fire exposure.

- E. Smoke-Control Door Assemblies: Comply with NFPA 105 or UL 1784.
- F. Fire rated assemblies must have UL approved label.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver doors and frames palleted, wrapped, or crated to provide protection during transit and Project site storage. Do not use nonvented plastic.
- B. Inspect doors and frames, on delivery, for damage. Minor damage may be repaired provided refinished items match new work and are approved by Architect; otherwise, remove and replace damaged items as directed.
- C. Store doors and frames under cover at building site. Conform to the requirements of ANSI/SDI A250.11 for site storage unless more stringent requirements are noted herein. Place units on minimum 4-inch high wood blocking. Avoid using nonvented plastic or canvas shelters that could create a humidity chamber. If wrappers on doors become wet, remove cartons immediately. Provide minimum 1/4-inch spaces between stacked doors to permit air circulation.

### PART 2 PRODUCTS

#### 2.1 FABRICATION - GENERAL

- A. Fabricate hollow metal units to be rigid, neat in appearance and free from defects, warp or buckle. Accurately form metal to required sizes and profiles. Weld exposed joints continuously, grind, dress, and make smooth, flush and invisible. Metallic filler to conceal manufacturing defects is not acceptable.
- B. Unless otherwise indicated, provide countersunk flat Phillips or Jackson heads for exposed screws and bolts.
- C. Prepare hollow metal units to receive finish hardware, including cutouts, reinforcing, drilling and tapping in accordance with Finish Hardware Schedule and templates provided by hardware suppliers. Comply with applicable requirements of ANSI A115 "Specifications for Door and Frame Preparation for Hardware."
- D. Locate finish hardware as shown on final shop drawings in accordance with locations noted herein.

#### 2.2 MANUFACTURERS

- A. Acceptable Manufacturers: Subject to compliance with requirements, provide products manufactured by Steelcraft, Curries, Ceco Door Products, or Fleming.
- B. Exterior Doors and Frames
  - 1. Basis of Design Energy Efficient: Curries; 797 Mercury Series.
  - 2. Basis of Design: Curries Company (CU); Thermal Break TQ Series.

## 2.3 FRAMES

### A. Materials

1. Frames for exterior openings shall be made of commercial grade cold-rolled steel conforming to ASTM A 1008, Type B not less than 14 ga., and shall have a hot dipped galvanized coating conforming to ASTM A 924 and A 653 with A60 coating. The zinc-alloy coating shall be a dull matte surface treated for paint adhesion.
2. Frames for interior openings shall be either commercial grade cold-rolled steel conforming to ASTM A 1008, Type B or commercial grade hot-rolled steel conforming to ASTM A 1011, Commercial Steel, Type B. Metal thickness shall be not less than sixteen (16) ga. for frames in openings 4'-0" or less in width; not less than fourteen (14) ga. for frames in openings over 4'-0" in width.

### B. Design and Construction

1. All frames shall be welded units with integral trim, of the sizes and shapes shown on approved shop drawings. Knock-down frames are not permitted.
2. Thermal Break Frames: Subject to the same compliance standards and requirements as standard hollow metal frames. Tested for thermal performance in accordance with NFRC 102, and resistance to air infiltration in accordance with NFRC 400. Where indicated provide thermally broken frame profiles available for use in both masonry and drywall construction. Fabricate with 1/16" positive thermal break and integral vinyl weatherstripping.
3. All finished work shall be strong and rigid, neat in appearance, square, true and free of defects, warp or buckle. Molded members shall be clean cut, straight and of uniform profile throughout their lengths.
4. Jamb depths, trim, profile and backbends shall be as shown on drawings.
  - a. Frames at drywall partitions shall be formed with double return backbends to prevent cutting into drywall surface.
5. Welded frames shall have corners mitered and reinforced and faces of welded frames shall be continuously back welded full depth and width of frame conforming to NAAMM Standard HMMA-820; face joints shall be hairline.
6. Minimum depth of stops shall be 5/8".
7. Frames for multiple or special openings shall have mullion and/or rail members which are closed tubular shapes having no visible seams or joints. All joints between faces of abutting members shall be securely welded and finished smooth.
  - a. Mullions shall have 16 ga. internal steel stiffeners welded not less than 4" o.c.
8. Hardware Reinforcements

- a. Frames shall be mortised, reinforced, drilled and tapped at the factory for fully-templated mortised hardware only, in accordance with approved hardware schedule and templates provided by the hardware supplier. Where surface-mounted hardware is to be applied, frames shall have reinforcing plates.
  - b. Minimum thickness of hardware reinforcing plates shall be as follows (contractor shall provide larger and thicker plates as required to accommodate weight of door):
    - 1). Hinge and pivot reinforcements - seven (7) ga., 1-1/4" x 10" minimum size.
    - 2). Strike reinforcements - twelve (12) gauge.
    - 3). Flush bolt reinforcements - twelve (12) gauge.
    - 4). Closer reinforcements - twelve (12) gauge.
    - 5). Reinforcements for surface mounted hardware - twelve (12) gauge.
9. Floor Anchors
- a. Provide adjustable floor anchors, providing not less than two (2) inch height adjustment.
  - b. Minimum thickness of floor anchors shall be fourteen (14) gauge.
10. Jamb Anchors
- a. Frames for installation in masonry walls shall be provided with adjustable jamb anchors of the wire type. Anchors shall be not less than 0.156" diameter steel wire. The number of anchors provided on each jamb shall be as follows:
    - 1). Frames up to 7'-6" height - three (3) anchors.
    - 2). Frames 7'-6" to 8'-0" height - four (4) anchors.
    - 3). Frames over 8'-0" height - one (1) anchor for each 2'-0" or fraction thereof in height.
  - b. Frames for installation in stud partitions shall be provided with steel anchors of suitable design, not less than eighteen (18) gauge thickness, securely welded inside each jamb as follows:
    - 1). Frames up to 7'-6" height - four (4) anchors.
    - 2). Frames 7'-6" to 8'-0" height - five (5) anchors.
    - 3). Frames over 8'-0" height - five (5) anchors plus one additional for each 2'-0" or fraction thereof over 8'-0".
  - c. Frames to be anchored to previously placed concrete or masonry shall be provided with minimum 3/8" concealed bolts set into expansion shields or inserts at six (6) inches from top and bottom and twenty-four (24) inches o.c. Reinforce frames at anchor locations with sixteen (16) gauge sheet steel stiffeners welded to frame at each anchor.
11. Anchors in exterior frames and in masonry walls shall be hot dip galvanized per ASTM A 153.
12. Frames for installation in masonry wall openings more than 4'-0" in width shall have an angle or channel stiffener factory welded into the head. Such stiffeners shall be not less than twelve (12) gauge steel and not longer than the opening width and shall not be used as lintels or load bearing members.

13. Dust cover boxes (or mortar guards) of not thinner than twenty-six (26) gauge steel shall be provided at all hardware mortises on frames to be set in masonry or plaster partitions.
  14. Ceiling Struts: Minimum 3/8" thick x 2" wide steel.
  15. All frames shall be provided with a steel spreader temporarily attached to the feet of both jambs to serve as a brace during shipping and handling.
  16. Loose glazing stops shall be of cold rolled steel, not less than twenty (20) gauge thickness, butted at corner joints and secured to the frame with countersunk cadmium-or zinc-plated screws. Interior frames may be provided with snap-on glazing stops.
  17. Except on weather-stripped frames, drill stops to receive three (3) silencers on strike jambs of single door frames and two (2) silencers on heads of double-door frames.
- C. Finish: After fabrication, all tool marks and surface imperfections shall be removed, and exposed faces of all welded joints shall be dressed smooth. Frames shall then be chemically treated to ensure maximum paint adhesion and shall be coated on all surfaces with one coat of rust-inhibitive baked-on alkyd primer standard with the manufacturer which is fully cured before shipment to a dry film thickness of 2.0 mils.
1. Frames set in masonry walls shall be grouted in as described in Section 042000 "Unit Masonry." These frames shall have surfaces in contact with grout shop coated with epoxy coating spray applied at 4 to 6 mils, passing NFPA 101, Class A for smoke and flame spread, tested per ASTM E 84.
    - a. Basis of Design: Tnemec; Series 27 FC Typoxy
    - b. Other Acceptable Manufacturers:
      - 1). PPG
      - 2). Benjamin Moore
      - 3). Sherwin Williams

## 2.4 HOLLOW METAL DOORS

- A. Materials: Doors shall be made of commercial quality, level, cold rolled steel conforming to ASTM A 1008, Commercial Steel, Type B and free of scale, pitting or other surface defects. Face sheets for interior doors shall be not less than eighteen (18) gauge. Face sheets for exterior doors shall be not less than sixteen (16) gauge and shall have a hot dipped galvanized coating conforming to ASTM A 924 and A 653, A60 coating. The zinc alloy coating shall be a dull matte surface treated for paint adhesion.
- B. Exterior Doors (Energy Efficient): Face sheets fabricated of commercial quality hot-dipped zinc coated steel that complies with ASTM A924 A60. Provide doors complying with requirements indicated below by referencing ANSI/SDI A250.8 for level and model, and ANSI/SDI A250.4 for physical performance level.
1. Design: Flush panel.

2. Core Construction: Foamed in place polyurethane and steel reinforced core with no stiffener face welds.
  - a. Provide 16 gauge steel vertical reinforcements 6 inches apart and welded in place. Foamed in place polyurethane core is chemically bonded to all interior surfaces. No face welding is permitted.
  - b. Thermal properties to rate at a fully operable minimum U-Factor 0.374 and R-Value 2.53, including insulated door, Mercury thermal-break frame and threshold.
  - c. Kerf Type Frames: Thermal properties to rate at a fully operable minimum U-Factor 0.378 and R-Value 2.5, including insulated door, kerf type frame, and threshold.

C. Design and Construction

1. All doors shall be of the types and sizes shown on the approved shop drawings, and shall be fully welded seamless construction with no visible seams or joints on their faces or vertical edges. Minimum door thickness shall be 1-3/4".
2. All doors shall be strong, rigid and neat in appearance, free from warpage or buckles. Corner bends shall be true and straight and of minimum radius for the gauge of metal used.
3. Face sheets shall be stiffened by continuous vertical formed steel sections spanning the full thickness of the interior space between door faces. These stiffeners shall be not less than twenty-two (22) gauge spaced not more than six (6) inches apart and securely attached to face sheets by spot welds not more than five (5) inches o.c. Spaces between stiffeners shall be sound deadened and thermal insulated the full height of the door with an inorganic non-combustible batt type material.
4. Door faces shall be joined at their vertical edges by a continuous weld extending the full height of the door. All such welds shall be ground, filled and dressed smooth to make them invisible and provide a smooth flush surface.
5. Top and bottom edges of all doors shall be closed with a continuous recessed steel channel not less than fourteen (14) gauge, extending the full width of the door and spot welded to both faces. Exterior doors shall have an additional flush closing channel at their top edges and, where required for attachment of weather stripping, a flush closure also at their bottom edges. Openings shall be provided in the bottom closure of exterior doors to permit the escape of entrapped moisture.
6. Edge profiles shall be provided on both vertical edges of doors as follows:
  - a. Single-acting swing doors - beveled 1/8" in two (2) inches.
  - b. Double acting swing doors - rounded on 2-1/8" radius.
  - c. No square edge doors permitted.
7. Hardware Reinforcements
  - a. Doors shall be mortised, reinforced, drilled and tapped at the factory for fully templated hardware only in accord with the approved hardware schedule and

templates provided by the hardware supplier. Where surface-mounted hardware (or hardware, the interrelation of which is to be adjusted upon installation - such as top and bottom pivots, floor closers, etc.) is to be applied, doors shall have reinforcing plates.

- b. Minimum gauges for hardware reinforcing plates shall be as follows (contractor shall provide larger and thicker plates as required to accommodate weight of door):
  - 1). Hinge and pivot reinforcement - seven (7) gauge.
  - 2). Reinforcement for lock face, flush bolts, concealed holders, concealed or surface mounted closers - twelve (12) gauge.
  - 3). Reinforcements for all other surface mounted hardware - sixteen (16) gauge.

- D. Finish: After fabrication, all tool marks and surface imperfections shall be dressed, filled and sanded as required to make all faces and vertical edges smooth, level and free of all irregularities. Doors shall then be chemically treated to ensure maximum paint adhesion and shall be coated, on all exposed surfaces, with manufacturer's standard rust-inhibitive alkyd primer as specified for frames which shall be fully cured before shipment.
- E. Flatness: Doors shall maintain a flatness tolerance of 1/16" maximum, in any direction, including in a diagonal direction.

## 2.5 LABELED DOORS AND FRAMES

- A. Labeled doors and frames shall be provided for those openings requiring fire protection ratings as scheduled on drawings. Such doors and frames shall be labeled by Underwriters' Laboratories or other nationally recognized agency having a factory inspection service.
- B. If any door or frame specified by the Architect to be fire-rated cannot qualify for appropriate labeling because of its design, size, hardware or any other reason, the Architect shall be so advised before fabricating work on that item is started.

## 2.6 HARDWARE LOCATIONS

- A. The location of hardware on doors and frames shall be as noted in "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames" of the Door Hardware Institute unless otherwise required by prevailing Handicapped Codes.

## 2.7 CLEARANCES

- A. Fabricate doors and frames to meet edge clearances as follows:
  - 1. Jambs and Head: 1/8" plus or minus 1/16".
  - 2. Meeting Edges, Pairs of Doors: 1/8" plus or minus 1/16".
  - 3. Bottom: 3/4" if no threshold, 3/8" at threshold.
- B. Fire rated doors shall have clearances as required by NFPA 80.

## 2.8 MANUFACTURING TOLERANCES

- A. Manufacturing tolerance shall be maintained within the limits given in HMMA 841 of ANSI/NAAMM, current edition.

## 2.9 PREPARATION FOR FINISH HARDWARE

- A. Prepare door and frames to receive hardware:
  - 1. Hardware supplier shall furnish hollow metal manufacturer approved hardware schedule, hardware templates, and samples of physical hardware where necessary to ensure correct fitting and installation.
  - 2. Preparation includes sinkages and cut-outs for mortise and concealed hardware.
- B. Provide reinforcements for both concealed and surface applied hardware:
  - 1. Drill and tap mortise reinforcements at factory, using templates.
  - 2. Install reinforcements with concealed connections designed to develop full strength of reinforcements.

## 2.10 REJECTION

- A. Hollow metal frames or doors which are defective, have hardware cutouts of improper size or location, or which prevent proper installation of doors, hardware or work of other trades, shall be removed and replaced with new at no cost.

## PART 3 EXECUTION

### 3.1 INSPECTION

- A. Examine the areas and conditions where steel doors and frames are to be installed and correct any conditions detrimental to the proper and timely completion of the work. Do

not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.2 INSTALLATION

- A. Refer to Section 062000 for installation procedures for all work of this Section.

END OF SECTION

**SECTION 087100**  
**DOOR HARDWARE**

**PART 1 GENERAL**

**1.01 SECTION INCLUDES**

- A. Hardware for hollow metal doors.
- B. Hardware for fire-rated doors.
- C. Electrically operated and controlled hardware.
- D. Lock cylinders for doors with balance of hardware specified in other sections.
- E. Thresholds.
- F. Weatherstripping and gasketing.

**1.02 RELATED REQUIREMENTS**

- A. Section 081113 - Hollow Metal Doors and Frames.
- B. Section 281000 - Access Control: Electronic access control devices.

**1.03 REFERENCE STANDARDS**

- A. ADA Standards - Americans with Disabilities Act (ADA) Standards for Accessible Design 2010.
- B. BHMA A156.1 - Standard for Butts and Hinges 2021.
- C. BHMA A156.2 - Bored and Preamsembled Locks and Latches 2017.
- D. BHMA A156.3 - Exit Devices 2020.
- E. BHMA A156.4 - Door Controls - Closers 2019.
- F. BHMA A156.8 - Door Controls - Overhead Stops and Holders 2021.
- G. BHMA A156.16 - Auxiliary Hardware 2018.
- H. BHMA A156.18 - Materials and Finishes 2020.
- I. BHMA A156.21 - Thresholds 2019.
- J. BHMA A156.25 - Electrified Locking Devices 2018.
- K. BHMA A156.26 - Standard for Continuous Hinges 2021.
- L. BHMA A156.28 - Recommended Practices For Mechanical Keying Systems 2018.
- M. BHMA A156.115 - Hardware Preparation In Steel Doors And Steel Frames 2016.
- N. BHMA A156.115W - Hardware Preparation in Wood Doors with Wood or Steel Frames 2006.
- O. DHI (H&S) - Sequence and Format for the Hardware Schedule 2019.
- P. DHI (KSN) - Keying Systems and Nomenclature 2019.
- Q. NFPA 70 - National Electrical Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- R. NFPA 80 - Standard for Fire Doors and Other Opening Protectives 2022.
- S. NFPA 101 - Life Safety Code Most Recent Edition Adopted by Authority Having Jurisdiction, Including All Applicable Amendments and Supplements.
- T. NFPA 105 - Standard for Smoke Door Assemblies and Other Opening Protectives 2022.

- U. NFPA 252 - Standard Methods of Fire Tests of Door Assemblies 2022.
- V. UL 10C - Standard for Positive Pressure Fire Tests of Door Assemblies Current Edition, Including All Revisions.

#### **1.04 ADMINISTRATIVE REQUIREMENTS**

- A. Coordinate the manufacture, fabrication, and installation of products that door hardware is installed on.
- B. Sequence installation to ensure facility services connections are achieved in an orderly and expeditious manner.
- C. Preinstallation Meeting: Convene a preinstallation meeting four weeks prior to commencing work of this section; require attendance by affected installers and the following:
  - 1. Architect.
  - 2. Installer's Architectural Hardware Consultant (AHC).
  - 3. Hardware Installer.
  - 4. Owner's Security Consultant.
- D. Furnish templates for door and frame preparation to manufacturers and fabricators of products requiring internal reinforcement for door hardware.
- E. Keying Requirements Meeting:

#### **1.05 SUBMITTALS**

- A. See Section 013000 - Administrative Requirements for submittal procedures.
- B. Product Data: Manufacturer's catalog literature for each type of hardware, marked to clearly show products to be furnished for this project, and includes construction details, material descriptions, finishes, and dimensions and profiles of individual components.
- C. Shop Drawings - Door Hardware Schedule: A detailed listing that includes each item of hardware to be installed on each door.
  - 1. Prepared by or under supervision of Architectural Hardware Consultant (AHC).
  - 2. Comply with DHI (H&S) using door numbering scheme and hardware set numbers as indicated in Contract Documents.
    - a. Submit in vertical format.
  - 3. List groups and suffixes in proper sequence.
  - 4. Include complete description for each door listed.
  - 5. Include manufacturer's and product names, and catalog numbers; include functions, types, styles, sizes and finishes of each item.
  - 6. Include account of abbreviations and symbols used in schedule.
- D. Shop Drawings - Electrified Door Hardware: Include diagrams for power, signal, and control wiring for electrified door hardware that include details of interface with building safety and security systems. Provide elevations and diagrams for each electrified door opening as follows:
  - 1. Prepared by or under supervision of Architectural Hardware Consultant (AHC) and Electrified Hardware Consultant (EHC).
  - 2. Elevations: Include front and back elevations of each door opening showing electrified devices with connections installed and an operations narrative describing how opening operates from either side at any given time.
  - 3. Diagrams: Include point-to-point wiring diagrams that show each device in door opening system with related colored wire connections to each device.

- E. Manufacturer's Installation Instructions: Indicate special procedures and perimeter conditions requiring special attention.
- F. Manufacturer's qualification statement.
- G. Installer's qualification statement.
- H. Supplier's qualification statement.
- I. Maintenance Data: Include data on operating hardware, lubrication requirements, and inspection procedures related to preventative maintenance.
  - 1. Include manufacturer's parts lists and templates.
  - 2. Bitting List: List of combinations as furnished.
- J. Keying Schedule:
  - 1. Submit three (3) copies of Keying Schedule in compliance with requirements established during Keying Requirements Meeting unless otherwise indicated.
- K. Warranty: Submit manufacturer's warranty and ensure that forms have been completed in Owner's name and registered with manufacturer.
- L. Project Record Documents: Record actual locations of concealed equipment, services, and conduit.
- M. Maintenance Materials and Tools: Furnish the following for Owner's use in maintenance of project.
  - 1. See Section 016000 - Product Requirements, for additional provisions.
  - 2. Tools: One set of each special wrench or tool applicable for each different or special hardware component, whether supplied by hardware component manufacturer or not.

#### **1.06 QUALITY ASSURANCE**

- A. Standards for Fire-Rated Doors: Maintain one copy of each referenced standard on site, for use by Architect and Contractor.
- B. Manufacturer Qualifications: Company specializing in manufacturing products specified in this section with minimum three years of documented experience.
- C. Installer Qualifications: Company specializing in performing work of the type specified for commercial door hardware with at least three years of documented experience.
- D. Supplier Qualifications: Company with certified Architectural Hardware Consultant (AHC) and Electrified Hardware Consultant (EHC) to assist in work of this section.

#### **1.07 DELIVERY, STORAGE, AND HANDLING**

- A. Package hardware items individually; label and identify each package with door opening code to match door hardware schedule.

#### **1.08 WARRANTY**

- A. See Section 017800 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide manufacturer warranty against defects in material and workmanship for period indicated, from Date of Substantial Completion. Complete forms in Owner's name and register with manufacturer.
  - 1. Closers: Ten years, minimum.
  - 2. Exit Devices: Five years, minimum.
  - 3. Locksets and Cylinders: Ten years, minimum.

## **PART 2 PRODUCTS**

### **2.01 GENERAL REQUIREMENTS**

- A. Provide specified door hardware as required to make doors fully functional, compliant with applicable codes, and secure to extent indicated.
- B. Provide individual items of single type, of same model, and by same manufacturer.
- C. Locks: Provide a lock for each door, unless it's indicated that lock is not required.
  - 1. Lock Function: Provide lock and latch function numbers and descriptions of manufacturer's Series. As indicated in hardware sets.
  - 2. Trim: Provide lever handle or pull trim on outside of each lock, unless otherwise indicated.
  - 3. Strikes:
    - a. Finish: To match lock or latch.
    - b. Curved-Lip Strikes: Provide as standard, with extended lip to protect frame, unless otherwise indicated.
    - c. Center Strike At Pairs of Doors: 7/8 inch (22.2 mm) lip.
- D. Closers:
  - 1. Provide door closer on each exterior door, unless otherwise indicated.
  - 2. Provide door closer on each fire-rated and smoke-rated door.
  - 3. Spring hinges are not an acceptable self-closing device, unless otherwise indicated.
- E. Overhead Stops and Holders (Door Checks):
  - 1. Provide stop for every swinging door, unless otherwise indicated.
  - 2. Overhead Stop is not required if positive stop feature is specified for door closer; positive stop feature of door closer is not an acceptable substitute for a stop, unless otherwise indicated.
  - 3. Overhead stop is not required if a floor or wall stop has been specified for the door.
- F. Drip Guards: Provide at head of outswinging exterior doors unless protected by roof or canopy directly overhead.
- G. Thresholds:
  - 1. Exterior Applications: Provide at each exterior door, unless otherwise indicated.
- H. Smoke and Draft Control Seals:
  - 1. Provide gasketing for smoke and draft control doors that complies with local codes, requirements of assemblies tested in accordance with UL 1784.
- I. Weatherstripping and Gasketing:
  - 1. Provide weatherstripping on each exterior door at head, jambs, and meeting stiles of door pairs, unless otherwise indicated.
  - 2. Provide door bottom sweep on each exterior door, unless otherwise indicated.
- J. Electrically Operated and/or Controlled Hardware: Provide necessary power supplies, power transfer hinges, relays, and interfaces as required for proper operation; provide wiring between hardware and control components and to building power connection in compliance with NFPA 70.
- K. See Section 281000 for additional access control system requirements.
- L. Fasteners:
  - 1. Provide fasteners of proper type, size, quantity, and finish that comply with commercially recognized standards for proposed applications.

- a. Aluminum fasteners are not permitted.
- b. Provide phillips flat-head screws with heads finished to match door surface hardware unless otherwise indicated.
2. Provide machine screws for attachment to reinforced hollow metal and aluminum frames.
  - a. Self-drilling (Tek) type screws are not permitted.
3. Provide stainless steel machine screws and lead expansion shields for concrete and masonry substrates.
4. Provide wall grip inserts for hollow wall construction.
5. Fire-Resistance-Rated Applications: Comply with NFPA 80.
  - a. Provide wood or machine screws for hinges mortised to doors or frames, strike plates to frames, and closers to doors and frames.
  - b. Provide steel through bolts for attachment of surface mounted closers, hinges, or exit devices to door panels unless proper door blocking is provided.

## 2.02 PERFORMANCE REQUIREMENTS

- A. Provide door hardware products that comply with the following requirements:
  1. Applicable provisions of federal, state, and local codes.
    - a. NFPA 101.
  2. Accessibility: ADA Standards and ICC A117.1.
  3. Fire-Resistance-Rated Doors: NFPA 80, listed and labeled by qualified testing agency for fire protection ratings indicated, based on testing at positive pressure in accordance with NFPA 252 or UL 10C.
  4. Hardware on Fire-Resistance-Rated Doors: Listed and classified by UL (DIR), ITS (DIR), or testing firm acceptable to authorities having jurisdiction as suitable for application indicated.
  5. Hardware for Smoke and Draft Control Doors: Provide door hardware that complies with local codes, and requirements of assemblies tested in accordance with UL 1784.
  6. Hardware Preparation for Steel Doors and Steel Frames: BHMA A156.115.
  7. Hardware Preparation for Wood Doors with Wood or Steel Frames: BHMA A156.115W.
  8. Products Requiring Electrical Connection: Listed and classified by UL (DIR) as suitable for the purpose specified.

## 2.03 HINGES

- A. Manufacturers: Conventional butt hinges.
  1. BEST; dormakaba Group:
  2. Equals: As Approved by Architect.
- B. Properties:
  1. Butt Hinges: As applicable to each item specified.
    - a. Standard Weight Hinges: Minimum of two (2) permanently lubricated non-detachable bearings.
    - b. Heavy Weight Hinges: Minimum of four (4) permanently lubricated bearings on heavy weight hinges.
    - c. Template screw hole locations.
    - d. Bearings: Concealed fully hardened bearings.
    - e. UL 10C listed for fire-resistance-rated doors.
  2. Continuous Hinges: As applicable to each item specified.

- C. Sizes: See Door Hardware Schedule.
  - 1. Hinge Widths: As required to clear surrounding trim.
  - 2. Sufficient size to allow 180 degree swing of door.
- D. Finishes: See Door Hardware Schedule.
  - 1. Fully polish hinges; front, back, and barrel.
- E. Grades:
  - 1. Butt Hinges: Comply with BHMA A156.1 and BHMA A156.7 for templated hinges.
  - 2. Comply with BHMA A156.18 Materials and Finishes.
- F. Material: Base metal as indicated for each item by BHMA material and finish designation.
- G. Types:
  - 1. Butt Hinges: Include full mortise hinges.
- H. Options: As applicable to each item specified.
- I. Quantities:
  - 1. Butt Hinges: Three (3) hinges per leaves up to 90 inches (2286 mm) in height. Add one (1) for each additional 30 inches (762 mm) in height or fraction thereof.
    - a. Hinge weight and size unless otherwise indicated in hardware sets:
      - 1) For doors up to 36 inches (914 mm) wide and up to 1-3/4 inches (44.5 mm) thick provide hinges with a minimum thickness of 0.134 inch (3.4 mm) and a minimum of 4-1/2 inches (114 mm) in height.
      - 2) For doors from 36 inches (914 mm) wide up to 42 inches (1067 mm) wide and up to 1-3/4 inches (44.5 mm) thick provide hinges with a minimum thickness of 0.145 inch (3.7 mm) and a minimum of 4-1/2 inches (114 mm) in height.
      - 3) For doors from 42 inches (1067 mm) wide up to 48 inches (1219 mm) wide and up to 1-3/4 inches (44.5 mm) thick provide hinges with a minimum thickness of 0.180 inch (4.6 mm) and a minimum of 5 inches (127 mm) in height.
      - 4) For doors greater than 1-3/4 inches (44.5 mm) thick provide hinges with a minimum thickness of 0.180 inch (4.6 mm) and a minimum of 5 inches (127 mm) in height.
- J. Applications: At swinging doors.
  - 1. Provide non-removable pins at out-swinging doors with locking hardware and all exterior doors.
- K. Products:
  - 1. Butt Hinges:
    - a. Ball Bearing, Five (5) Knuckle.

## 2.04 BOLTS

- A. Manufacturers:
  - 1. ABH.
  - 2. Burns.
  - 3. Trimco.
- B. Properties:
  - 1. Dustproof Strikes: For bolting into floor, provide except at metal thresholds.

C. Options:

1. Extension Bolts: In leading edge of door, one bolt into floor, one bolt into top of frame.
2. Lever extensions: Provide for top bolt at oversized doors.

**2.05 EXIT DEVICES**

A. Manufacturers:

1. Precision Apex 2000 Series
2. Equals: As Approved by Architect.

B. Properties:

1. Actuation: Crossbar.
2. Touchpads: 'T' style metal touchpads and rail assemblies with matching chassis covers end caps.
3. Latch Bolts: Stainless steel deadlocking with 3/4 inch (19 mm) projection using latch bolt.
4. Lever Design: Match project standard lockset trims.
5. Cylinder: Include where cylinder dogging or locking trim is indicated.
6. Strike as recommended by manufacturer for application indicated.
7. Dogging:
  - a. Non-Fire-Resistance-Rated Devices: Cylinder 1/4 inch (6 mm) hex key dogging.
  - b. Fire-Resistance-Rated Devices: Manual dogging not permitted.
8. Touch bar assembly on wide style exit devices to have a 1/4 inch (6.3 mm) clearance to allow for vision frames.
9. All exposed exit device components to be of architectural metals and "true" architectural finishes.
10. Handing: Field-reversible.
11. Fasteners on Back Side of Device Channel: Concealed - exposed fasteners not allowed.
12. Vertical Latch Assemblies' Operation: Gravity, without use of springs.

C. Grades: Complying with BHMA A156.3, Grade 1.

1. Provide exit devices tested and certified by UL or by a recognized independent laboratory for mechanical operational testing to 10 million cycles minimum with inspection confirming Grade 1 Loaded Forces have been maintained.

D. Standards Compliance:

1. UL Listed for Panic and Fire for Class II Circuitry.
2. Provide UL (DIR) listed exit device assemblies for fire-resistance-rated doors.
3. Comply with UL 10C.

E. Code Compliance: As required by authorities having jurisdiction in the State in which the Project is located.

1. Listed by UL as a Controlled Exit Device (FULA) and Special Locking Arrangements (FWAX) category.

F. Options:

1. Electrified Devices:
2. Delayed Egress Devices: Manufacturer's standard for the application.
3. Internally mounted switch used to signal other components.
4. Internally mounted switch that monitors the position of the latchbolt.
5. MLR: Motorized latch retraction.

- G. Products:
  - 1. 2000.

## 2.06 ELECTRIC STRIKES

- A. Manufacturers:
  - 1. RCI
  - 2. HES.
  - 3. Equals: As Approved by Architect.
- B. Properties:
  - 1. Provide UL 1034 compliant devices.
  - 2. Provide UL 10C compliant devices.
  - 3. Include transformer and rectifier as necessary for complete installation.
- C. Installation: Connect electric strikes into fire alarm where non-rated doors are scheduled to release with fire or sprinkler alarm condition.

## 2.07 LOCK CYLINDERS

- A. Manufacturers:
  - 1. BEST. No Substitution
- B. Material:
  - 1. Manufacturer's standard corrosion-resistant brass alloy.
- C. Types: As applicable to each item specified.
  - 1. Patented small format interchangeable core (SFIC) type cylinders, with seven pin cores.

## 2.08 CYLINDRICAL LOCKS

- A. Manufacturers:
  - 1. BEST 9K Series. No Substitution
- B. Properties:
  - 1. Mechanical Locks:
    - a. Fitting modified ANSI A115.2 door preparation.
    - b. Door Thickness Fit: 1-3/8 inches (35 mm) to 2-1/4 inches (57 mm) thick doors.
    - c. Construction: Hub, side plate, shrouded rose, locking pin to be a one-piece casting with a shrouded locking lug.
      - 1) Through-bolted anti-rotational studs.
    - d. Cast stainless steel latch retractor with roller bearings for exceptionally smooth operation and superior strength and durability.
    - e. Bored Hole: 2-1/8 inch (54 mm) diameter.
    - f. Backset: 2-3/4 inches (70 mm) unless otherwise indicated.
    - g. Latch: Single piece tail-piece construction.
      - 1) Latchbolt Throw: 9/16 inch (14.3 mm), minimum.
    - h. Cylinders:
      - 1) Cylinder Core Types: Locks capable of supporting manufacturers' cores, as applicable.
    - i. Lever Trim:
      - 1) Style: See Door Hardware Schedule.
      - 2) Outside Lever Sleeve: Seamless one-piece construction.
  - 2. Electrified Locks: Same properties as standard locks, and as follows:

- a. Function: Electrically locked (Fail Safe) or unlocked (Fail Secure), as indicated for each lock in Door Hardware Schedule.
- C. Finishes: See Door Hardware Schedule.
  - 1. Core Faces: Match finish of lockset.
- D. Grades: Comply with BHMA A156.2, Grade 1, Series 4000, Operational Grade 1, Extra Heavy Duty.
- E. Material: Manufacturer's standard for specified lock.
- F. Products: Cylindrical locks, including mechanical and electrified types.

## 2.09 CLOSERS

- A. Manufacturers:
  - 1. BEST EHD9000 Series
  - 2. Equals: As Approved by Architect..
- B. Properties:
- C. Grades:
  - 1. Closers: Comply with BHMA A156.4, Grade 1.
    - a. Underwriters Laboratories Compliance:
      - 1) Product Listing: UL (DIR) and ULC for use on fire-resistance-rated doors.
        - (a) UL 228 - Door Closers-Holders, With or Without Integral Smoke Detectors.
- D. Installation:
  - 1. Mounting: Includes surface mounted installations.
  - 2. Mount closers on non-public side of door and stair side of stair doors unless otherwise noted in hardware sets.
  - 3. At outswinging exterior doors, mount closer on interior side of door.
  - 4. Provide adapter plates, shim spacers, and blade stop spacers as required by frame and door conditions.
  - 5. Where an overlapping astragal is included on pairs of swinging doors, provide coordinator to ensure door leaves close in proper order.

## 2.10 OVERHEAD STOPS AND HOLDERS

- A. Manufacturers:
  - 1. Architectural Builders Hardware Mfg (ABH)
  - 2. Glynn Johnson
  - 3. Rixson
- B. Sizes: Manufacturer's standard for the application.
- C. Finishes:
  - 1. Arms and Brackets: Zinc-plated.
- D. Grades: As applicable to item specified.
  - 1. Comply with BHMA A156.8, Grade 1.

## 2.11 PROTECTION PLATES

- A. Manufacturers:
  - 1. Burns.

2. Hiawatha.
  3. Trimco.
- B. Properties:
1. Plates:
    - a. Kick Plates: Provide along bottom edge of push side of every wood door with closer, except aluminum storefront and glass entry doors, unless otherwise indicated.
      - 1) Size: 10 inches (254 mm) high by 2 inch (51 mm) less door width (LDW) on push side of door.
    - b. Mop Plates: Provide along bottom edge of push side of doors to provide protection from cleaning liquids and equipment damage to door surface.
    - c. Edges: Beveled, on four (4) unless otherwise indicated.
  - C. Grades: Comply with BHMA A156.6.
  - D. Material: As indicated for each item by BHMA material and finish designation.
    1. Metal Properties: Stainless steel.
      - a. Metal, Standard Duty: Thickness 0.050 inch (1.27 mm), minimum.
  - E. Installation:
    1. Fasteners: Countersunk screw fasteners

## 2.12 STOPS AND HOLDERS

- A. Manufacturers:
1. Burns.
  2. Hiawatha.
  3. Trimco..
- B. General: Provide overhead stop/holder when wall or floor stop is not feasible.
- C. Grades:
1. Door Holders, Wall Bumpers, and Floor Stops: Comply with BHMA A156.16 and Resilient Material Retention Test as described in this standard.

## 2.13 WEATHERSTRIPPING AND GASKETING

- A. Manufacturers:
1. National Guard Products, Inc.
  2. Pemko.
  3. Reese.
- B. Products:
1. Weatherstripping: See Door Hardware Schedule.
  2. Smoke Seals: See Door Hardware Schedule.
  3. Meeting Stile Seals: See Door Hardware Schedule.
  4. Door Bottom Seals:
    - a. Door Sweeps: See Door Hardware Schedule.

## 2.14 KEYS AND CORES

- A. Manufacturers:
1. BEST, No Substitution
- B. Properties: Complying with guidelines of BHMA A156.28.
1. Provide small format interchangeable core.

2. Provide Patented CORMAX keys and cores.
3. Provide keying information in compliance with DHI (KSN) standards.
4. Keying Schedule: Arrange for a keying meeting, with Architect, Owner and hardware supplier, and other involved parties to ensure locksets and locking hardware, are functionally correct and keying complies with project requirements.
5. Keying: Master keyed.
6. Include construction keying and control keying with Brass removable core cylinders.
7. Supply keys in following quantities:
  - a. Grand Master Keys: 2 each.
  - b. Master Keys: 4 each each group.
  - c. Construction Master Keys: 4 each.
  - d. Construction Control Keys: 2 each.
  - e. Perm Core Control Keys: 4 each.
  - f. Change Keys: 2 each change keys for each keyed core.
8. Deliver keys with identifying tags to Owner by security shipment direct from manufacturer.
9. Include installation of permanent cores and return construction cores to hardware supplier. Construction cores and keys to remain property of hardware supplier.

### **PART 3 EXECUTION**

#### **3.01 EXAMINATION**

- A. Verify that doors and frames are ready to receive this work; labeled, fire-rated doors and frames are properly installed, and dimensions are as indicated on shop drawings.
- B. Correct all defects prior to proceeding with installation.
- C. Verify that electric power is available to power operated devices and of correct characteristics.

#### **3.02 INSTALLATION**

- A. Install hardware in accordance with manufacturer's instructions and applicable codes.
- B. Install hardware using the manufacturer's fasteners provided. Drill and tap all screw holes located in metallic materials. Do not use "Riv-Nuts" or similar products.
- C. Install hardware on fire-rated doors and frames in accordance with applicable codes and NFPA 80.
- D. Install hardware for smoke and draft control doors in accordance with NFPA 105.
- E. Use templates provided by hardware item manufacturer.
- F. Do not install surface mounted items until application of finishes to substrate are fully completed.
- G. Wash down masonry walls and complete painting or staining of doors and frames.
- H. Complete finish flooring prior to installation of thresholds.
- I. Set exterior door thresholds with full-width bead of elastomeric sealant at each point of contact with floor providing a continuous weather seal; anchor thresholds with stainless steel countersunk screws.

#### **3.03 FIELD QUALITY CONTROL**

- A. Perform field inspection and testing under provisions of Section 014000 - Quality Requirements.

### 3.04 CLEANING

- A. Clean finished hardware in accordance with manufacturer's written instructions after final adjustments have been made.
- B. Clean adjacent surfaces soiled by hardware installation activities.

### 3.05 PROTECTION

- A. Protect finished Work under provisions of Section 017000 - Execution and Closeout Requirements.
- B. Do not permit adjacent work to damage hardware or finish.

**END OF SECTION**

## Manufacturer list

ABH	Architectural Builders Hardware
BES	BEST
PRE	BEST (Precision)
NGP	National Guard Products
RCI	Rutherford Controls Inc

## Finish list

Code:	Name:
689	689 Aluminum
626	Satin Chrome
26D	26D>CHROMIUM PLATED SATIN
630	Satin Stainless Steel
C	Charcoal
CL	Clear

## Specification Report

### Set #1 - Mech Room

Doors: 107.1

6.0 Hinge	FBB179 NRP 45X45	26D	BES
1.0 Exit Device	FL 2201 LBR	630	PRE
1.0 Exit Device	FL 2203 LBR 4903 D	630	PRE
1.0 Rim Cylinder	12E 7 2 RP PATD	626	BES
2.0 Door Closer	EHD90 16 SDS90	689	BES
2.0 Protection Plate	PP0050 10" x 1" LDW B4E CSK	US32D	ABH
1.0 Gasketing	5070 Meeting Stile Astragal	CL	NGP
1.0 Gasketing	2525 Head & Jambs (2)	C	NGP

### Set #2 - Mech Room

Doors: B101.1

3.0 Hinge	FBB179 NRP 45X45	26D	BES
1.0 Exit Device	FL 2103 D 4903	630	PRE
1.0 Rim Cylinder	12E 7 2 RP PATD	626	BES
1.0 Door Closer	EHD90 16 SDS90	689	BES
1.0 Protection Plate	PP0050 10" x 2" LDW B4E CSK	US32D	ABH
1.0 Gasketing	2525 Head & Jambs (2)	C	NGP

### Set #3 - Elev Mech

Doors: 107A.1

3.0 Hinge	FBB179 NRP 45X45	26D	BES
1.0 Cylindrical Lock	9K 3 7 D 14 D S3 PATD	626	BES
1.0 Door Closer	EHD90 16 DS90	689	BES
1.0 Protection Plate	PP0050 10" x 2" LDW B4E CSK	US32D	ABH
1.0 Gasketing	2525 Head & Jambs (2)	C	NGP

### Set #4 - Phone/DATA - Card Access

Doors: 107B.1

3.0 Hinge	FBB179 45X45	26D	BES
1.0 Cylindrical Lock	9K 3 7 D 14 D S3 PATD	626	BES
1.0 Electric Strike	F2164 F2LM	32D	RCI
1.0 Door Closer	EHD90 16 AF90	689	BES
1.0 Protection Plate	PP0050 10" x 2" LDW B4E CSK	US32D	ABH
1.0 Wall Stop	AB400	626	ABH
1.0 Card Reader	By Rowan Univ Security		
1.0 Power Supply	By Rowan Univ Security		

Boiler Project at Bozorth Hall and Hawthorn Hall

Rowan University  
Rowan Project No. 77267

PROJECT MANUAL  
Volume 1

Schiller and Hersh Associates, Inc.  
Project No. 2566A

1.0 Wiring Diagram	FURNISHED BY HWDE SUPPLIER		
1.0 Door Position Switch	By Rowan Univ Security		
1.0 Gasketing	2525 Head & Jambs (2)	C	NGP

NOTE: Operation: Door normally closed and locked. Presentation of valid credential to card reader releases electric strike allowing authorized entry. Request to Exit by Rowan University Security Vendor. Mechanical key override. Coordinate wiring / installation with GC / EC / Security Vendor.

Set #5 - Mech Room – Card Access

Doors: 107.2

3.0 Hinge	FBB179 NRP 45X45	26D	BES
1.0 Exit Device	FL 2103 D 4903	630	PRE
1.0 Rim Cylinder	12E 7 2 RP PATD	626	BES
1.0 Electric Strike	F0162 LM	32D	RCI
1.0 Door Closer	EHD90 16 SDS90	689	BES
1.0 Protection Plate	PP0050 10" x 2" LDW B4E CSK	US32D	ABH
1.0 Card Reader	By Rowan Univ Security		
1.0 Power Supply	By Rowan Univ Security		
1.0 Wiring Diagram	FURNISHED BY HWDE SUPPLIER		
1.0 Door Position Switch	By Rowan Univ Security		
1.0 Gasketing	2525 Head & Jambs (2)	C	NGP

NOTE: Operation: Door normally closed and locked. Presentation of valid credential to card reader releases electric strike allowing authorized entry. Request to Exit by Rowan University Security Vendor. Mechanical key override. Coordinate wiring / installation with GC / EC / Security Vendor.

## SECTION 092900

### GYPSUM DRYWALL

#### PART 1 GENERAL

##### 1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the Contract Documents.

##### 1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the gypsum drywall as shown on the drawings and/or specified herein, including, but not limited to, the following:
  - 1. Gypsum board work for partitions and furrings.
  - 2. Metal supports for gypsum drywall construction.
  - 3. Acoustical insulation for gypsum drywall work.
  - 4. Sealant for gypsum drywall work.
  - 5. Concealed metal reinforcing for attachment of railings, toilet partitions and other items supported on drywall partitions and walls.
  - 6. Taping and finishing of drywall joints.
  - 7. Installing rings and frames in drywall surfaces for grilles, registers and lighting fixtures.
  - 8. Bracing and connections.

##### 1.3 RELATED SECTIONS

- A. Hollow metal door frames - Section 081113.
- B. Access doors - Section 083113.
- C. Painting - Section 099000.
- D. Rings for grilles, registers and light fixtures - Division 23 and 26.

##### 1.4 QUALITY ASSURANCE

- A. The following standards, as well as other standards which may be referred to in this Section, shall apply to the work of this Section:
  - 1. The Gypsum Construction Handbook, latest edition, USG.
  - 2. Construction Guide, latest edition, National Gypsum.

3. ASTM A 568 "Standard Specification for Steel, Sheet, Carbon, and High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, General Requirements For"
  4. ASTM C 475 "Standard Specification for Joint Treatment Materials for Gypsum Wallboard Construction"
  5. ASTM C 645 "Standard Specification for Non-Structural Steel Framing Members"
  6. ASTM C 754 "Standard Specification for Installation of Steel Framing Members to Receive Screw Attached Gypsum Panel Products"
  7. ASTM C 840 "Standard Specification for Application and Finishing of Gypsum Board"
  8. ASTM C 919 "Standard Specification for Use of Sealants in Acoustical Applications"
  9. ASTM C 954 "Standard Specification for Steel Drill Screws for the Application of Gypsum Board or Metal Plaster Bases to Steel Studs From 0.033 in. to 0.112 in. in Thickness"
  10. ASTM C 1002 "Standard Specification for Steel Self-Piercing Tapping Screws for the Application of Gypsum Board"
  11. ASTM C 1177 "Standard Specification for Glass Mat Gypsum Substrate for Use as Sheathing"
  12. ASTM C 1178 "Standard Specification for Glass Mat Water Resistant Gypsum Backing Board"
  13. ASTM C 1278 "Standard Specification for Fiber-Reinforced Gypsum Panel"
  14. ASTM C 1396 "Standard Specification for Gypsum Board"
  15. ASTM D 3273 "Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber"
- B. Allowable Tolerances: 1/32" offsets between planes of board faces, and 1/16" in 8'-0" for plumb, level, warp and bow.
- C. System Design Load
1. Provide standard drywall wall assemblies designed and tested by manufacturer to withstand a lateral load of 5 lbs. per sq. ft. for the maximum wall height required, and with deflection limited to L/240 of partition height.
    - a. Drywall assemblies with tile finish shall have a deflection limit of L/360.
  2. Provide drywall ceiling assemblies designed, fabricated and installed to have a deflection not to exceed L/360.
- D. Fire-Resistance Rating: Where gypsum drywall with fire resistance ratings are indicated, provide materials and installations which are identical with those of applicable assemblies tested per ASTM E 119 by fire testing laboratories, or to design designations in UL "Fire Resistance Directory" or in listing of other testing agencies acceptable to authorities having jurisdiction, and compliant with UL Test #2079; criteria for cycle movement for all field height wall sections requiring allowance for vertical deflection within framing details.

- E. Installer: Firm with not less than 5 years of successful experience in the installation of specified materials.
- F. Code-Compliance Certification of Studs and Tracks: Provide documentation that framing members are certified according to the product-certification program of the Steel Framing Industry Association (SFIA) or be a part of a similar organization that provides verifiable code compliance program.

#### 1.5 SUBMITTALS

- A. Submit shop drawing for each drywall partition, furring and ceiling system showing size and gauges of framing members, hanger and anchorage devices, wallboard types, insulation, sealant, methods of assembly and fastening, control joints indicating column lines, corner details, joint finishing and relationship of drywall work to adjacent work.
- B. Samples: Each material specified herein, 12" x 12", or 12" long, or in manufacturer's container, as applicable for type of material submitted.
- C. Manufacturer's Literature: Submit technical and installation instructions for each drywall partition, furring and ceiling system specified herein, and for each fire-rated and sound-rated gypsum board assembly. Submit other data as required to show compliance with these specifications, including data for mold resistant joint compound.
- D. Test Reports: This Contractor shall submit test report, obtained by drywall manufacturer, indicating conformance of drywall assemblies to required fire ratings and sound ratings.
- E. Evaluation Reports: Submit evaluation reports certified under an independent third party inspection program administered by an agency accredited by IAS to ICC-ES AC98, IAS Accreditation Criteria for Inspection Agencies.

#### 1.6 PRODUCT HANDLING AND PROTECTION

- A. Deliver, store and handle drywall work materials to prevent damage. Deliver materials in their original, unopened containers or bundles, and store where protected from moisture, damage and from exposure to the elements. Store wallboard in flat stacks.
- B. Protect wallboard from becoming wet.
- C. Protect metal framing from corrosion, deformation, and other damage during delivery, storage, and handling as required by AISI's "Code of Standard Practice".

#### 1.7 ENVIRONMENTAL CONDITIONS

- A. Provide and maintain minimum temperature of fifty-five (55) degrees F. and adequate ventilation to eliminate excessive moisture within the building in the area of the drywall work for at least twenty-four (24) hours, prior to, during and after installation of drywall work. Installation shall not start until windows are glazed and doors are installed, unless openings are temporarily closed. Space above suspended ceilings shall be vented sufficiently to prevent temperature and pressure build up.

#### 1.8 JOB MOCK-UP

- A. At a suitable location, where directed by the Architect, lay up a portion of a finished wall and ceiling demonstrating the quality of work, including finishing, to be obtained under

this Section. Omit drywall boards in locations as directed by the Architect to show stud spacing and attachments; after acceptance, complete assembly.

- B. Adjust the finishing techniques as required to achieve the finish required by the Architect as described in this Section of these specifications.
- C. Upon approval of the mock-up, the mock-up may be left in place as a portion of the finished work of this Section.
- D. All drywall work shall be equal in quality to approved mock-up.

## PART 2 PRODUCTS

### 2.1 MANUFACTURERS

- A. Acceptable Manufacturers for Gypsum Drywall Panels and Accessories: U.S. Gypsum Co., Georgia Pacific, CertainTeed Corporation, Continental Building Products, or National Gypsum Co. meeting specification requirements are acceptable.
  - 1. All drywall products must be manufactured in North America.
- B. Acceptable Manufacturers for Metal Supports of Drywall Assemblies: Unless otherwise noted, provide products manufactured by ClarkDietrich, Super Stud Building Products, or Marino/Ware.

### 2.2 METAL SUPPORTS

- A. Metal Studs, Framing and Furring
  - 1. C-Shaped Studs: Channel type with holes for passage of conduit formed from minimum 0.0312 inch (20 U.S. Std. gauge) (unless heavier gauge is required to meet deflection limits) cold formed steel, width as shown on drawings.
  - 2. Furring Channels: Hat shaped, formed from galvanized steel, 25 U.S. Std. gauge.
    - a. Product: ClarkDietrich; Furring Channel, or comparable product.
  - 3. "C-H," "CT," or "I" Type Stud: 1-1/2" x 2-1/2", 4" or 6" wide (to suit detail) galvanized steel. Use for shaft wall construction; gauge and size as required to meet deflection limits given herein.
    - a. Product: ClarkDietrich; CT Stud, or a comparable product.
  - 4. Double "E" Type Stud or "J" Track with Holding Tabs: 1" x 2-1/2", 4" or 6" wide (to suit detail) galvanized steel. Use for shaft wall construction; gauge and size as required to meet deflection limits given herein.
    - a. Product: ClarkDietrich; J-Tabbed Track, or a comparable product.
  - 5. Continuous 16 gauge x 8" wide steel wall plate screwed to studs as required for support of railings, toilet partitions and other items supported on drywall partitions and walls.
- B. Protective Coating: All cold-formed steel members shall have coating conforming to AISI S220; ASTM A 653, G60 or coating with equivalent corrosion resistance of ASTM

A653/A653M, G60. Galvannealed products are not acceptable

### 2.3 GYPSUM WALLBOARD TYPES

- A. Fire-Rated Gypsum Wallboard: 5/8" thick as indicated on drawings, 5/8" Sheetrock Ecosmart Firecode X by USG, "Firecheck Type C" by Lafarge/Continental, "Gold Bond Fireshield" by National Gypsum, or "Type C" and "Type X" by CertainTeed Corp., 48" wide, in maximum lengths available to minimize end-to-end butt joints.

### 2.4 ACCESSORIES

- A. Acoustical Insulation: Paper-less, non-combustible, semi-rigid mineral fiber mat, 2" thick, in walls (unless otherwise indicated), 3 lb./cu. ft. maximum density; Thermafiber, Inc. (an Owens Corning company) "Thermafiber SAFB".
- B. Fasteners for Wallboard: USG Brand Screws; Type S Bugle Head for fastening wallboard to lighter gauge interior metal framing (up to 20 ga.). Type S-12 Bugle Head for fastening wallboard to heavier gauge interior metal framing (20 ga. to 12 ga.); Type S and Type S-12 Pan Head for attaching metal studs to door frames and runners; and Type G Bugle Head for fastening wallboard to wallboard. Lengths specified below under "Part 3 - Execution" Articles and as recommended by drywall manufacturer.
  - 1. For Portland cement base boards, fasteners shall be equal to Durock Steel Screws by U.S. Gypsum.
- C. Laminating Adhesive: "Sheetrock Brand Joint Compound."
- D. Metal Trim - Corner Beads: For 90 degree External Corners - ClarkDietrich; 103 Deluxe Cornerbead or "Dur-A-Bead" No. 103, 26 U.S. Std. ga. galvanized steel, 1-1/4" x 1-1/4", for 90 degree external corners.
- E. Metal Trim - Edge Beads: "Sheetrock Brand Paper Faced Metal Bead and Trim."
- F. Partition/Concrete Ceiling Trim: Trim-Tex Super Seal Tear Away.
- G. Metal Trim Treatment Materials and Joint Treatment Materials for Gypsum Drywall Boards: Paper tape for joint reinforcing; Setting Type (Durabond 90) or Lightweight Setting Type Joint Compound for taping and topping; and Ready Mix Compound for finishing.
  - 1. For mold-resistant drywall, water resistant drywall, and tile backer board, use glass mesh tape with setting joint compound that is rated 10 when tested in accordance with ASTM D 3273 and evaluated in accordance with ASTM D 3274.
- H. Control Joints: ClarkDietrich; #093 Control Joint or No. 0.093, USG.
- I. Acoustical Sealant: Subject to compliance with requirements, provide one of the following:
  - 1. USG; Acoustical Sealant
  - 2. Tremco Mfg. Co.; Tremco Acoustical Caulking
  - 3. BASF; Masterseal NP520
- J. Neoprene Gaskets: Conform to ASTM D 1056.

## PART 3 EXECUTION

### 3.1 INSPECTION

- A. Examine the areas and conditions where gypsum drywall is to be installed and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.2 GENERAL INSTALLATION REQUIREMENTS

#### A. General

1. Install drywall work in accordance with drywall manufacturer's printed instructions and as indicated on drawings and specified herein.
2. All metal framing for drywall partitions shall extend from floor to underside of structural deck above. Provide for vertical deflection with positive mechanical connections of framing members to structure.
3. Provide concealed reinforcement, 16 ga. thick by eight (8) inches wide or as detailed or as recommended by manufacturer, for attachment of railings, toilet partitions, and other items to be supported on the partitions which cannot be attached to the metal framing members. Concealed reinforcement shall span between metal studs and be attached thereto using two (2) self-tapping pan head screws at each stud.

- a. Back of drywall shall be scored or notched to prevent bulging out where reinforcement plate occurs.

- B. Fire-Rated Assemblies: Install fire-rated assemblies in accordance with requirements of authorities having jurisdiction, Underwriters' Laboratories and test results obtained and published by the drywall manufacturer, for the fire-rated drywall assembly types indicated on the drawings.

#### C. Sealant

1. Install continuous acoustical sealant bead at top and bottom edges of wallboard where indicated or required for sound rating as wallboard is installed, and between metal trim edge beads and abutting construction.
2. Install acoustical sealant in 1/8" wide vertical control joints within the length of the wall or partitions, and in all other joints, specified below under "Control Joints." Install bead of acoustical sealant around electric switch and outlet boxes, piping, ducts, and around any other penetration in the wallboard; place sealant bead between penetrations and edge of wallboard.
3. Where sealant is exposed to view, protect adjacent surfaces from damage and from sealant material, and tool sealant flush with and in same plane as wallboard surface. Sealant beads shall be 1/4" to 3/8" diameter.

#### D. Wallboard Application

1. Do not install wallboard panels until steel door frames are in place; coordinate work with Section 081113, "Steel Doors and Frames."

2. See drawings for all board types. Use fire-rated wallboard for fire-rated assemblies. Use water-resistant wallboard where indicated on drawings and where wallboard would be subject to moisture. Install water-resistant wallboard in full, large sheets (no scraps) to limit number of butt joints.
  3. Apply wallboard with long dimension parallel to stud framing members, and with abutting edges occurring over stud flanges.
  4. Install wallboard for partitions from floor to underside of structure above and secure rigidly in place by screw attachment, unless otherwise indicated.
  5. Provide "Thermafiber" safing insulation meeting standards of Section 078413 at flutes of metal deck where partitions carry up to bottom of metal deck.
  6. Neatly cut wallboard to fit around outlets, switch boxes, framed openings, piping, ducts, and other items which penetrate wallboard; fill gaps with acoustic sealant.
  7. Where wallboard is to be applied to curved surfaces, dampen wallboard on back side as required to obtain required curve. Finish surface shall present smooth, even curve without fluting or other imperfections.
  8. Screw fasten wallboard with power-driven electric screw driver, screw heads to slightly depress surface of wallboard without cutting paper, screws not closer than 3/8" from ends and edges of wallboard.
  9. Where studs are doubled-up, screw fasten wallboard to both studs in a staggered pattern.
- E. Metal Trim: Install and mechanically secure in accordance with manufacturer's instructions; and finish with three (3) coats of joint compound, feathered and finish sanded smooth with adjacent wallboard surface, in accordance with manufacturer's instructions.
1. Corner Beads: Install specified corner beads in single lengths at all external corners, unless corner lengths exceed standard stock lengths.
  2. Edge Beads: Install specified edge beads in single lengths at all terminating edges of wallboard exposed to view, where edges abut dissimilar materials, where edges would be exposed to view, and elsewhere where shown on drawings. Where indicated on drawings, seal joint between metal edge bead and adjoining surface with specified gasket, 1/8" wide minimum and set back 1/8" from face of wallboard, unless other size and profile indicated on drawings.
  3. Casing beads shall be set in long lengths, neatly butted at joints. Provide casing beads at juncture of board and vertical surfaces and at exposed perimeters.
- F. Control Joint Locations: Gypsum board surfaces shall be isolated with control joints where:
1. Ceiling abuts a structural element, dissimilar wall or other vertical penetration.
  2. Construction changes within the plane of the partition or ceiling.
  3. Shown on approved shop drawings.
  4. Ceiling dimensions exceed thirty (30) feet in either direction.

5. Wings of "L," "U," and "T" shaped ceiling areas are joined.
  6. Expansion or control joints occur in the structural elements of the building.
  7. Shaftwall runs exceed 30' without interruption.
  8. Partition or furring abuts a structural element or dissimilar wall or ceiling.
  9. Partition or furring runs exceed 30' without interruption.
  10. Where control joints are required, ceiling height door frames may be used as control joints. Less than ceiling height frames shall have control joints extending to the ceiling from both corners.
- G. Joint Treatment and Spackling
1. Joints between face wallboards in the same plane, joints at internal corners of intersecting partitions and joints at internal corners of intersections between ceilings and walls or partitions shall be filled with joint compound.
  2. Screw heads and other depressions shall be filled with joint compound. Joint compound shall be applied in three (3) coats, feathered and finish surface sanded smooth with adjacent wallboard surface, in accordance with manufacturer's instructions. Treatment of joints and screw heads with joint compound is also required where wallboard will be covered by finish materials which require a smooth surface, such as vinyl wall coverings.

### 3.3 FURRED WALLS AND PARTITIONS

- A. Use specified metal furring channels. Run metal furring channel framing members vertically, space sixteen (16) inches o.c. maximum. Fasten furring channels to concrete or masonry surfaces with power-driven fasteners or concrete stub nails spaced sixteen (16) inches o.c. maximum through alternate wing flanges (staggered) of furring channel. Furring channels shall be shimmed as necessary to provide a plumb and level backing for wallboard. At inside of exterior walls, an asphalt felt protection strip shall be installed between each furring channel and the wall. Furring channel and splices shall be provided by nesting channels at least eight (8) inches and securely anchoring to concrete or masonry with two (2) fasteners in each wing.
- B. Wallboard Installation: Same as specified under Article 3.4 - "Metal Stud Partitions."

### 3.4 METAL STUD PARTITIONS

- A. Unless otherwise noted, steel framing members shall be installed in accordance with ASTM C 754.
- B. Runner Installation: Use channel type. Align accurately at floor according to partition layout. Anchor runners securely sixteen (16) inches o.c. maximum with power-driven anchors to floor slab, with power-driven anchors to structural slab above. See "Stud Installation" below for runners over heads of metal door frames. Where required, carefully remove sprayed-on fireproofing to allow partition to be properly installed.
- C. Stud Installation
1. Use channel type, positioned vertically in runners, spaced as noted on drawings, but not more than sixteen (16) inches o.c.

2. Anchor studs to floor runners with screw fasteners. Provide snap-in or slotted hole slip joint bolt connections of studs to ceiling runners leaving space for movement. Anchor studs at partition intersections, partition corners and where partition abuts other construction to floor and ceiling runners with sheet metal screws through each stud flange and runner flange.
  3. Connection at ceiling runner for non-rated partitions shall be snap-in or slotted hole slip joint bolt connection that shall allow for movement. Seal studs abutting other construction with 1/8" thick neoprene gasket continuously between stud and abutting construction.
  4. Connections for fire rated partitions at ceiling runners shall conform to UL Design #2079.
  5. Install metal stud horizontal bracing wherever vertical studs are cut or wallboard is cut for passage of pipes, ducts or other penetrations, and anchor horizontal bracing to vertical studs with sheet metal screws.
6. At jambs of door frames and borrowed light frames, install doubled-up studs (not back to back) from floor to underside of structural deck, and securely anchor studs
- to jamb anchors of frames and to runners with screws. Provide cross braces from hollow metal frames to underside of slab.
7. Over heads of door frames, install cut-to-length section of runner with flanges slit and web bent to allow flanges to overlap adjacent vertical studs, and securely anchor runner to adjacent vertical studs with sheet metal screws. Install cut-to-length vertical studs from runner (over heads of door frame) to ceiling runner sixteen (16) inches maximum o.c. and at vertical joints of wallboard, and securely anchor studs to runners with sheet metal screws.
  8. At control joints, in field of partition, install double-up studs (back to back) from floor to ceiling runner, with 1/4" thick continuous compressible gasket between studs. When necessary, splice studs with eight (8) inches minimum nested laps and attach flanges together with two (2) sheet metal screws in each flange. All screws shall be self-tapping sheet metal screws.
- D. Runners and Studs at Chase Wall: As specified above for "Runners" and "Studs" and as specified herein. Chase walls shall have either a single or double row of floor and ceiling runners with metal studs sixteen (16) inches o.c. maximum and positioned vertically in the runners so that the studs are opposite each other in pairs with the flanges pointing in the same direction. Anchor all studs to runner flanges with sheet metal screws through each stud flange and runner flange following requirements of paragraph 3.4, B. Provide cross bracing between the rows of studs by attaching runner channels or studs set full width of chase attached to vertical studs with one self-tapping screw at each end. Space cross bracing not over thirty-six (36) inches o.c. vertically.
- E. Wallboard Installation - Single Layer Application (Screw Attached)
1. Install wallboard with long dimension parallel to framing member and with abutting edge joints over web of framing member. Install wallboard with long dimension perpendicular to framing members above and below openings in drywall extending to second stud at each side of opening. Joints on opposite sides of wall shall be arranged so as to occur on different studs.

2. Boards shall be fastened securely to metal studs with screws as specified. Where a free end occurs between studs, back blocking shall be required. Center abutting ends over studs. Correct work as necessary so that faces of boards are flush, smooth, true.
  3. Wallboard screws shall be applied with an electric screw gun. Screws shall be driven not less than 3/8" from ends or edges of board to provide uniform dimple not over 1/32" deep. Screws shall be spaced twelve (12) inches o.c. in the field of the board and 8" o.c. staggered along the abutting edges.
  4. All ends and edges of wallboard shall occur over screwing members (studs or furring channels). Boards shall be brought into contact but shall not be forced into place. Where ends or edges abut, they shall be staggered. Joints on opposite sides of a partition shall be so arranged as to occur on different studs.
  5. At locations where piping receptacles, conduit, switches, etc., penetrate drywall partitions, provide non-drying sealant and an approved sealant stop at cut board locations inside partition.
- F. Wallboard Installation - Double-Layer Application
1. General: See drawings for wallboard partition types required.
  2. First Layer (Screw Attached): Install as described above for single layer application.
  3. Second Layer (Screw Attached): Screw attach second layer, unless laminating method of attachment indicated on drawings or necessary to obtain required sound rating or fire rating. Install wallboard vertically with vertical joints offset thirty-two (32) inches from first layer joints and staggered on opposite sides of wall. Attach wallboard with 1-5/8" screws sixteen (16) inches o.c. along vertical joints and sixteen (16) inches o.c. in the field of the wallboard. Screw through first layer into metal framing members.
  4. Second Layer (Laminated): Install wallboard vertically. Stagger joints of second layer from first layer joints. Laminate second layer with specified laminating adhesive in beads or strips running continuously from floor to ceiling in accordance with manufacturer's instructions. After laminating, screw wallboard to framing members with 1-5/8" screws, spaced twelve (12) inches o.c. around perimeter of wallboard.
- G. Wallboard Installation - Laminated Application: Where laminated wallboard is indicated, use specified laminating adhesive, install wallboard vertically and maintain tolerances as specified for screw attached wallboard.
- H. Insulation Installation: Install where indicated on drawings. Place blanket tightly between studs.
- I. Deflection of Structure Above: To allow for possible deflection of structure above partitions, provide top runners for non-rated partitions with 1-1/4" minimum flanges and do not screw studs or drywall to top runner. Where positive anchorage of studs to top runner is required, anchorage device shall be by means of slotted hole (in clip connection with screw attachment to web of steel through bushings located in slots of clips), or other anchorage device approved by Architect.

J. Control Joints

1. Leave a 1/2" continuous opening between gypsum boards for insertion of surface mounted joint.
2. Back by double framing members.
3. Attach control joint to face layer with 9/16" galvanized staples six (6) inches o.c. at both flanges along entire length of joint.
4. Provide two (2) inch wide gypsum panel strip or other adequate seal behind control joint in fire rated partitions and partitions with safing insulation.

3.5 DRYWALL FASCIAS AND CEILINGS

- A. Furnish and install inserts, hanger clips and similar devices in coordination with other work.
- B. Secure hangers to inserts and clips. Clamp or bolt hangers to main runners.
- C. Space main runners 4'-0" o.c. and space hangers 4'-0" o.c. along runners, except as otherwise shown.
- D. Level main runners to a tolerance of 1/4" in 12'-0", measured both lengthwise on each runner and transversely between parallel runners.
- E. Metal Furring Channels: Space sixteen (16) inches o.c. maximum. Attach to 1-1/2" main runner channels with furring channel clips (on alternate sides of main runner channels). Furring channels shall not be let into or come in contact with abutting masonry walls. End splices shall be provided by nesting furring channels no less than eight (8) inches and securely wire tying. At any openings that interrupt the furring channels, install additional cross reinforcing to restore lateral stability.
- F. Mechanical accessories, hangers, splices, runner channels and other members used in suspension system shall be of metal, zinc coated, or coated with rust inhibitive paint, of suitable design and of adequate strength to support units securely without sagging, and such as to bring unit faces to finished indicated lines and levels.
1. Provide special furring where ducts are over two (2) feet wide.
- G. Apply board with its long dimension at right angles to channels. Locate board butt joints over center of furring channels. Attach board with one (1) inch self-drilling drywall screws twelve (12) inches o.c. in field of board at each furring channel; eight (8) inches o.c. at butt joints located not less than 3/8" from edges.

3.6 SHAFT WALLS

- A. Runner Installation: Use "J" metal runners at floor and ceiling, with the short leg toward finish side of wall. Securely attach runners to structural supports with power-driven fasteners at both ends and twenty-four (24) inches o.c.
- B. Shaft Wall Liner: Cut shaft wall liner panels one (1) inch less from floor to ceiling height and erect vertically between J-runners.
- C. C-H Studs: Cut metal studs 3/8" to not more than 1/2" less than floor to ceiling height and install between shaft wall liner panels so that panels are fitted snugly into the one (1) inch wide "H," "T," or "I" portion of the stud. Space studs twenty-four (24) inches o.c.,

unless otherwise indicated on drawings. Install full-length steel E-Studs or J-runners vertically at T-intersections, corners, door jambs, and columns. Install full length E-Studs or J-runners over shaft wall liner both sides of closure panels. Frame openings cut within a liner panel with J-Runner around perimeter. For openings, frame with vertical E-Stud or J-runner at edges, horizontal runner at head and sill, and reinforcing as shown on the drawings. Suitably frame all openings to maintain structural support for wall. Install floor-to-ceiling steel E-Studs or J-runners each side of elevator door frames to act as strut-studs. Attach strut-stud to floor and ceiling runners with two (2) 3/8" Type S screws, space twelve (12) inches o.c. Over metal doors, install a cut to length section of runner and attach to strut-studs with clip angles and 3/8" Type S Screws space twelve (12) inches o.c.

- D. Wallboard Installation - Double Layer Installation: Erect gypsum wallboard base layer vertically or horizontally to meet fire rating on one side of studs with end joints

staggered. Fasten base layer panels to studs with one (1) inch Type S screws twenty-four (24) inches o.c. Caulk perimeter of base layer panels. Apply gypsum wallboard face layer vertically over base layer with joints staggered and attached with 1-5/8" Type S screws staggered from those in base, spaced eight (8) inches o.c. and driven into studs.

- E. Wallboard Installation (Where Both Sides of Shaft Wall are Finished): Apply gypsum wallboard face layers vertically both sides of studs. Stagger joints on opposite partition sides. Fasten panels with one (1) inch or two (2) inches Type S screws spaced eight (8) inches o.c. in field and along edges into studs.
- F. Where handrails are indicated for direct attachment to drywall shaft system, provide not less than a sixteen (16) ga. x eight (8) inches wide galvanized steel reinforcement strip, accurately positioned and secured to studs and concealed behind not less than one 1/2" thick course of gypsum board in the system.
- G. Integrate stair hanger rods with drywall shaft system by locating cavity of system as required to enclose rods.
- H. Horizontal Shaftwall Duct and Ceiling Assemblies: Provide I-stud cavity shaftwall system for horizontal duct protection consisting of I-studs 24" o.c. with 1" fire-rated shaft liner panels inserted in the stud tabs, and three layers of 1/2" firecode C gypsum board attached to the stud flanges opposite the shaft liner panels.

### 3.7 ERECTION AT COLUMN ENCLOSURES

- A. Metal furring supports shall be provided under work of this Section, and shall be cut to lengths as necessary for tight fit such that spacing is not more than sixteen (16) inches o.c.
- B. Board shall be fastened securely to supports with screws as specified. Place boards in position with minimum number of joints. Where free ends occur between supports, back-blocking or furring shall be required. Center abutting ends over supports. Correct work as necessary so that faces of boards are flush, smooth and true. Provide clips or cross furring for attachment as required.
- C. All layers shall be screw attached to furring.
- D. When column finish called for on drawings to be in the same plane as drywall finish layer,

maintain even, level plane.

### 3.8 FINISHING

- A. Taping: A thin, uniform layer of compound shall be applied to all joints and angles to be reinforced. Reinforcing tape shall be applied immediately, centered over the joint, seated into the compound. A skim coat shall follow immediately, but shall not function as a fill or second coat. Tape shall be properly folded and embedded in all angles to provide a true angle.
- B. Filling: After initial coat of compound has hardened, additional compound shall be applied, filling the board taper flush with the surface. The fill coat shall cover the tape and feather out slightly beyond the tape. On joints with no taper, the fill coat shall cover

the tape and feather out at least four (4) inches on either side of the tape. No fill coat is necessary on interior angles.

- C. After compound has hardened, a finishing coat of compound shall be spread evenly over and extending slightly beyond the fill coat on all joints and feathered to a smooth, uniform finish. Over tapered edges, the finished joint shall not protrude beyond the plane of the surface. All taped angles shall receive a finish coat to cover the tape and taping compound, and provide a true angle. Where necessary, sanding shall be done between coats and following the final application of compound to provide a smooth surface, ready for painting.
- D. Fastener Depressions: Compound shall be applied to all fastener depressions followed, when hardened by at least two (2) coats of compound, leaving all depressions level with the plane of the surface.
- E. Finishing Beads and Trim: Compound shall be applied to all bead and trim and shall be feathered out from the ground to the plane of the surface. When hardened, this shall be followed by two (2) coats of compound each extending slightly beyond the previous coat. The finish coat shall be feathered from the ground to the plane of the surface and sanded as necessary to provide a flat, smooth surface ready for decoration.
- F. Except as otherwise noted, level of finish for surface exposed to view shall conform to Level 4 of ASTM C 840 and GA-214 of the Gypsum Association.
- G. Drywall construction with defects of such character which will mar appearance of finished work, or which is otherwise defective, will be rejected and shall be removed and replaced at no expense to the Owner.

### 3.9 CLEANING AND ADJUSTMENT

- A. At the completion of installation of the work, all rubbish shall be removed from the building leaving floors broom clean. Excess material, scaffolding, tools and other equipment shall be removed from the building.
- B. Work shall be left in clean condition ready for painting or wall covering. All work shall be as approved by Architect.
- C. Cutting and Repairing: Include all cutting, fitting and repairing of the work included herein in connection with all mechanical trades and all other trades which come in conjunction with any part of the work, and leave all work complete and perfect after all trades have

completed their work.

### 3.10 PROTECTION OF WORK

- A. Installer shall advise Contractor of required procedures for protecting drywall work from damage and deterioration during remainder of construction period.

END OF SECTION

## SECTION 099000

### PAINTING AND FINISHING

#### PART 1 GENERAL

##### 1.1 GENERAL REQUIREMENTS

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

##### 1.2 SECTION INCLUDES

- A. Work of this Section includes all labor, materials, equipment, and services necessary to complete the painting and finishing as shown on the drawings and/or specified herein, including, but not limited to, the following:
  - 1. Prime painting unprimed surfaces to be painted under this Section.
  - 2. Painting all items furnished with a prime coat of paint, including touching up of or repairing of abraded, damaged or rusted prime coats applied by others.
  - 3. Painting all ferrous metal (except stainless steel) exposed to view.
  - 4. Painting all galvanized ferrous metals exposed to view.
  - 5. Painting interior concrete block exposed to view.
  - 6. Painting gypsum drywall exposed to view.
  - 7. Painting plaster surfaces.
  - 8. Painting concrete floor.
  - 9. Sealing of concrete floor.
  - 10. Painting of wood exposed to view, except items which are specified to be painted or finished under other Sections of these specifications. Back painting of all wood in contact with concrete, masonry or other moisture areas.
  - 11. Painting pipes, pipe coverings, conduit, ducts, insulation, hangers, supports and other mechanical and electrical items and equipment exposed to view.
  - 12. Painting surfaces above, behind or below grilles, gratings, diffusers, louvers, lighting fixtures, and the like, which are exposed to view through these items.
  - 13. Incidental painting and touching up as required to produce proper finish for painted surfaces, including touching up of factory finished items.
  - 14. Painting of any surface not specifically mentioned to be painted herein or on drawings, but for which painting is obviously necessary to complete the job, or work which comes within the intent of these specifications, shall be included as though specified.

### 1.3 RELATED SECTIONS

- A. Shop priming is required on some, but not all of the items scheduled to be field painted. Refer to other Sections of work for complete description.
- B. Shop Coat on Machinery and Equipment: Refer to the Sections under which various items of manufactured equipment with factory applied shop prime coats are furnished, including, but not necessarily limited to, the following Sections. All items of equipment furnished with prime coat finish shall be finish painted under this Section.
  - 1. Plumbing - Division 22.
  - 2. Heating, ventilation and air conditioning - Division 23.
- C. Color Coding of Mechanical Piping and Electrical Conduits - Divisions 22 and 26.
  - 1. This Color Coding consists of an adhesive tape system and is in addition to painting of piping and conduits under this Section, as specified above.

### 1.4 MATERIALS AND EQUIPMENT NOT TO BE PAINTED

- A. Items of equipment furnished with complete factory finish, except for items specified to be given a finish coat under this Section.
- B. Factory-finished toilet partitions.
- C. Factory-finished acoustical tile.
- D. Non-ferrous metals, except for items specified and/or indicated to be painted.
- E. Finished hardware, excepting hardware that is factory primed.
- F. Surfaces not to be painted shall be left completely free of droppings and accidentally applied materials resulting from the work of this Section.

### 1.5 QUALITY ASSURANCE

- A. Job Mock-Up
  - 1. In addition to the samples specified herein to be submitted for approval, apply in the field, at their final location, each type and color of approved paint materials, applied 10 feet wide, floor to ceiling of wall surfaces, before proceeding with the remainder of the work, for approval by the Architect. Paint mock-ups to include door and frame assembly.
  - 2. These applications when approved will establish the quality and workmanship for the work of this Section.
  - 3. Repaint individual areas which are not approved, as determined by the Architect, until approval is received. Assume at least two paint mock-ups of each color and gloss for approval.
- B. Qualification of Painters: Use only qualified painters for the mixing and application of paint on exposed surfaces.

- C. Paint Coordination: Provide finish coats which are compatible with the prime paints used. Review other Sections of these specifications in which prime paints are to be provided to ensure compatibility of the total coatings system for the various substrates. Upon request from other subcontractors, furnish information on the characteristics of the finish materials proposed to be used, to ensure that compatible prime coats are used. Provide barrier coats over incompatible primers or remove and re-prime as required. Notify the Architect in writing of any anticipated problems using the coating systems as specified with substrates primed by others.
- D. All paints must conform to the Volatile Organic Compounds (VOC) standards of prevailing codes and ordinances.

#### 1.6 SUBMITTALS

##### A. Materials List

- 1. Before any paint materials are delivered to the job site, submit to the Architect a complete list of all materials proposed to be furnished and installed under this portion of the work.
- 2. This shall in no way be construed as permitting substitution of materials for those specified or accepted for this work by the Architect.

##### B. Samples

- 1. Accompanying the materials list, submit to the Architect copies of the full range of colors available in each of the proposed products.
- 2. Upon direction of the Architect, prepare and deliver to the Architect two (2) identical sets of Samples of each of the selected colors and glosses painted onto 8-1/2" x 11" x 1/4" thick material; whenever possible, the material for Samples shall be the same material as that on which the coating will be applied in the work.

- C. Manufacturer's Recommendations: In each case where material proposed is not the material specified or specifically described as an acceptable alternate in this Section of these specifications, submit for the Architect's review the current recommended method of application published by the manufacturer of the proposed material.

##### D. Close out Submittal

- 1. Coating Maintenance Manual: Upon conclusion of the project, the Contractor or plant manufacturer/supplier shall furnish a coating maintenance manual such as Sherwin Williams "Custodian Project Color and Product Information" report or equal. Manual shall include an Area Summary with finish schedule, Area Detail designating where each product/color/finish was used, product data pages, MSDS, care and cleaning instructions, touch-up procedures, and color samples of each color and finish used.

#### 1.7 PRODUCT HANDLING

- A. Deliver all paint materials to the job site in their original unopened containers with all labels intact and legible at time of use.
- B. Protection

1. Store only the approved materials at the job site, and store only in a suitable and designated area restricted to the storage of paint materials and related equipment.
  2. Use all means necessary to ensure the safe storage and use of paint materials and the prompt and safe disposal of waste.
  3. Use all means necessary to protect paint materials before, during and after application and to protect the installed work and materials of all other trades.
- C. Replacements: In the event of damage, immediately make all repairs and replacements necessary.
- 1.8 EXTRA STOCK

- A. Upon completion of this portion of the Work, deliver to the Owner an extra stock of paint equaling approximately ten (10) percent of each color and gloss used and each coating material used, with all such extra stock tightly sealed in clearly labeled containers.

1.9 JOB CONDITIONS

- A. Apply water-based paints only when the temperature of surfaces to be painted and the surrounding air temperatures are between 50 degrees F. and 90 degrees F., unless otherwise permitted by the paint manufacturer's printed instructions.
- B. Apply solvent-thinned paints only when the temperature of surfaces to be painted and the surrounding air temperatures are between 45 degrees F. and 95 degrees F. unless otherwise permitted by the paint manufacturer's printed instructions.
- C. Do not apply paint in snow, rain, fog or mist; or when the relative humidity exceeds eighty-five (85) percent; or to damp or wet surfaces; unless otherwise permitted by the paint manufacturer's printed instructions.
- D. Painting may be continued during inclement weather only if the areas and surfaces to be painted are enclosed and heated within the temperature limits specified by the paint manufacturer during application and drying periods.

PART 2 PRODUCTS

2.1 PAINT MANUFACTURERS

- A. Except as otherwise noted, provide the painting products listed for all required painting made by one of the manufacturers listed in the paint schedule (Section 2.4). These companies are Benjamin Moore, PPG Paints (PPG), and Sherwin Williams (S-W). Comply with number of coats and required minimum mil thicknesses as specified herein.

2.2 MATERIALS

- A. Provide undercoat paint produced by the same manufacturer as the finish coats. Use only thinners approved by the paint manufacturer and use only to recommended limits.
- B. Colors and Glosses: All colors and glosses shall be as selected by the Architect. Certain colors will require paint manufacturer to prepare special factory mixes to match colors selected by the Architect. Color schedule (with gloss) shall be furnished by the Architect.

- C. Coloring Pigment: Products of or furnished by the manufacturer of the paint or enamel approved for the work.
- D. Linseed Oil: Raw or boiled, as required, of approved manufacture, per ASTM D 234 and D 260, respectively.
- E. Turpentine: Pure distilled gum spirits of turpentine, per ASTM D 13.
- F. Shellac: Pure gum shellac (white or orange) cut in pure denatured alcohol using not less than four (4) lbs. of gum per gallon of alcohol.
- G. Driers, Putty, Spackling Compound, Patching Plaster, etc.: Best quality, of approved manufacture.
- H. Heat Resistant Paint: Where required, use heat resistant paint when applying paint to heating lines and equipment.

## 2.3 GENERAL STANDARDS

- A. The various surfaces shall be painted or finished as specified below in Article 2.4. However, the Architect reserves the right to change the finishes within the range of flat, semi-gloss or gloss, without additional cost to the Owner.
- B. All paints, varnishes, enamels, lacquers, stains and similar materials must be delivered in the original containers with the seals unbroken and label intact and with the manufacturer's instructions printed thereon.
- C. All painting materials shall bear identifying labels on the containers with the manufacturer's instructions printed thereon.
- D. Paint shall not be badly settled, caked or thickened in the container, shall be readily dispersed with a paddle to a smooth consistency and shall have excellent application properties.
- E. Paint shall arrive on the job color-mixed except for tinting of under-coats and possible thinning.
- F. All thinning and tinting materials shall be as recommended by the manufacturer for the particular material thinned or tinted.
- G. It shall be the responsibility of the Contractor to see that all mixed colors match the color selection made by the Architect prior to application of the coating.

## 2.4 SCHEDULE OF FINISHES

- A. High Performance Coating on Exterior Galvanized Ferrous Metals

First Coat: "PittGuard Rapid Coat Epoxy 95-245 Series by PPG, "Series 27WB Typoxy" by Tnemec; "Epoxy Mastic Coating V160" by Benjamin Moore Corotech or "Recoatable Epoxy Primer 867-45" by Sherwin Williams.

Second Coat: "Pitthane Ultra 95-812 (Gloss)" or "High Build 95-8800 (Semi-Gloss)" by PPG; "Series 1080 (gloss) Endura-Shield WB" or "Series 1081 (semi-gloss) Endura-Shield WB" by Tnemec; "Acrylic Aliphatic Urethane V500 (Gloss)" or "V510 (Semi-Gloss)" by Benjamin Moore Corotech or "Hi-Solids Urethane B65-300/350" by Sherwin Williams.

B. High Performance Coating on Exterior Non-Galvanized Ferrous Metals

- Prime Coat: "Amercoat 68HS Epoxy Zinc-Rich Primer" by PPG; "Series 94-H<sub>2</sub>O Hydro-Zinc" by Tnemec; "Organic Zinc Rich Primer V170" by Benjamin Moore Corotech or "Zinc Clad II Plus Inorganic Zinc Rich Coating B69V212" by Sherwin Williams.
- Second Coat: "Pitt Guard Rapid Coat Epoxy 95-245" by PPG; "Series 27WB Typoxy" by Tnemec; "Epoxy Mastic Coating V160" by Benjamin Moore Corotech or "Macropoxy 646 Fast Cure Epoxy B58-600" by Sherwin Williams.
- Third Coat: "Pitthane Ultra 95-812 (Gloss)" or "High Build 95-8800 (Semi-Gloss)" by PPG; "Series 1070V (gloss) Fluoronar" or "Series 1071V (semi-gloss) Fluoronar" by Tnemec; "Acrylic Aliphatic Urethane V500 (Gloss)" or "V510 (Semi-Gloss)" by Benjamin Moore Corotech or "Hi- Solids Polyurethane B65-300/350" by Sherwin Williams.

C. Interior Ferrous Metal

Satin Finish/Latex

- Primer: Benj. Moore Ultra Spec HP Acrylic Metal Primer (HP04)  
PPG Pitt Tech Plus DTM Acrylic Primer 4020  
S-W Pro-Industrial Pro-Cryl Universal Primer B66-3100 Series
- First Coat: Benj. Moore Corotech Pre-Catalyzed WB Epoxy Eggshell (V342)  
PPG Pitt Glaze WB1 Pre-Catalyzed Eggshell Epoxy 16-310  
S-W Pro Industrial Acrylic Eg-Shel, B66-660 Series
- Second Coat: Benj. Moore Corotech Pre-Catalyzed WB Epoxy Eggshell (V342)  
PPG Pitt Glaze WB1 Pre-Catalyzed Eggshell Epoxy 16-310  
S-W Pro Industrial Acrylic Eg-Shel, B66-660 Series  
a. Total DFT not less than: 3.9 mils

Semi-Gloss Finish/Latex

- Primer: Benj. Moore Ultra Spec-HP Acrylic Metal Primer (HP04)  
PPG Devflex 4020 PF DTM Primer/Flat Finish  
S-W Pro-Industrial Pro-Cryl Universal Primer B66-3100 Series
- First Coat: Benj. Moore Corotech Pre-Catalyzed WB Epoxy Semi-Gloss (V341)  
PPG Pitt Glaze WB1 Pre-Catalyzed Semi-Gloss Epoxy 16-510  
S-W Pro Industrial Acrylic Semi-Gloss, B66-650 Series
- Second Coat: Benj. Moore Corotech Pre-Catalyzed WB Epoxy Semi-Gloss (V341)  
PPG Pitt Glaze WB1 Pre-Catalyzed Semi-Gloss Epoxy 16-510  
S-W Pro Industrial Acrylic Semi-Gloss, B66-650 Series  
a. Total DFT not less than: 4.0 mils

D. Interior Concrete Block

Flat Finish/Vinyl Acrylic Latex over Filler

- Block Filler: Benj. Moore Ultra Spec Masonry Int./Ext. High Build Block Filler (571)  
PPG Speedhide HI Fill Latex Block Filler 6-15XI  
S-W Pro Industrial Heavy-Duty Block Filler, B42-150
- First Coat: Benj. Moore Ultra Spec 500 Interior Flat Latex (N536)  
PPG Speedhide Zero Interior Latex Flat 6-4110XI  
S-W ProMar 200 Zero VOC Interior Latex Flat, B30-12600 Series
- Second Coat: Benj. Moore Ultra Spec 500 Interior Flat Latex (N536)  
PPG Speedhide Zero Interior Latex Flat 6-4110XI  
S-W ProMar 200 Zero VOC Interior Latex Flat, B30-12600 Series

- a. Total DFT not less than: 10.7 mils

Eggshell Finish/Vinyl Acrylic Latex Over Filler

- Block Filler: Benj. Moore Ultra Spec Masonry Int./Ext. High Build Block Filler (571)  
PPG Speedhide HI Fill Latex Block Filler 6-15XI  
S-W Pro Industrial Heavy-Duty Block Filler, B42-150
- First Coat: Benj. Moore Ultra Spec 500 Interior Latex Eggshell (N538)  
PPG Speedhide Zero Interior Latex Eggshell 6-4310XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series
- Second Coat: Benj. Moore Ultra Spec 500 Interior Latex Eggshell (N538)  
PPG Speedhide Zero Interior Latex Eggshell 6-4310XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series
- a. Total DFT not less than: 10.9 mils

Semi-Gloss Finish/Vinyl Acrylic Latex over Filler

- Block Filler: Benj. Moore Ultra Spec Masonry Int./Ext. High Build Block Filler (571)  
PPG Speedhide HI Fill Latex Block Filler 6-15XI  
S-W Pro Industrial Heavy-Duty Block Filler, B42-150
- First Coat: Benj. Moore Ultra Spec 500 Interior Latex Gloss (N540)  
PPG Speedhide Zero Interior Semi-Gloss Latex, 6-4510XI Series  
S-W ProMar 200 Zero VOC Interior Latex Semi-Gloss, B31-2600 Series
- Second Coat: Benj. Moore Ultra Spec 500 Interior Latex Gloss (N540)  
PPG Speedhide Zero Interior Semi-Gloss Latex, 6-4510XI Series  
S-W ProMar 200 Zero VOC Interior Latex Semi-Gloss, B31-2600 Series
- a. Total DFT not less than: 10.7 mils

E. Interior Drywall

Flat Finish/Vinyl Acrylic Latex

- Primer: Benj. Moore Ultra Spec 500 Interior Latex Primer (N534)  
PPG Speedhide Zero Interior Latex Primer 6-4900XI  
S-W ProMar 200 Zero VOC Interior Latex Primer, B28-2600
- First Coat: Benj. Moore Ultra Spec 500 Latex Flat (N536)  
PPG Speedhide Zero Interior Latex Flat 6-4110XI  
S-W ProMar 200 Zero VOC Interior Latex Flat, B30-12600 Series
- Second Coat: Benj. Moore Ultra Spec 500 Latex Flat (N536)  
PPG Speedhide Zero Interior Latex Flat 6-4110XI  
S-W ProMar 200 Zero VOC Interior Latex Flat, B30-12600 Series
- a. Total DFT not less than: 3.6 mils

Eggshell Finish/ Scuff Resistant Latex

- Primer: Benjamin Moore Ultra Spec 500 Interior Latex Primer (N534)
- First Coat: Benjamin Moore Ultra Spec Scuff-X Latex Eggshell (485)
- Second Coat: Benjamin Moore Ultra Spec Scuff-X Latex Eggshell (485)

Matte Finish/Scuff and Stain Resistant Acrylic Latex

- Primer: PPG Pure Performance Interior Latex Primer 9-900
- First Coat PPG UltraLast Interior Latex Paint + Primer Matte 13-210
- Second Coat PPG UltraLast Interior Latex Paint + Primer Matte 13-210

Eggshell Finish/Scuff and Stain Resistant Acrylic Latex

- Primer: PPG Pure Performance Interior Latex Primer 9-900
- First Coat PPG UltraLast Interior Latex Paint + Primer Eggshell 13-310

Second Coat PPG UltraLast Interior Latex Paint + Primer Eggshell 13-310  
Semi-Gloss Finish/Scuff and Stain Resistant Acrylic Latex  
Primer: PPG Pure Performance Interior Latex Primer 9-900  
First Coat PPG UltraLast Interior Latex Paint + Primer Semi-Gloss 13-510  
Second Coat PPG UltraLast Interior Latex Paint + Primer Semi-Gloss 13-510

Eggshell Finish/Vinyl Acrylic Latex

Primer: Benj. Moore Ultra Spec 500 Interior Latex Primer (N534)  
PPG Speedhide Zero Interior Latex Primer 6-4900XI  
S-W ProMar 200 Zero VOC Interior Latex Primer, B28-2600  
First Coat: Benj. Moore Ultra Spec 500 Interior Latex Eggshell (N538)  
PPG Speedhide Zero Interior Latex Eggshell 6-4310XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series  
Second Coat: Benj. Moore Ultra Spec 500 Interior Latex Eggshell (N538)  
PPG Speedhide Zero Interior Latex Eggshell 6-4310XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series  
a. Total DFT not less than: 3.8 mils

F. Interior Painted Wood

Satin Finish/Latex

Primer: Benj. Moore Fresh Start Latex Primer (0023)  
PPG Seal Grip Int./Ext. Acrylic Universal Primer/Sealer 17-921  
S-W Multi-Purpose Latex Primer/Sealer B51 Series  
First Coat: Benj. Moore Ultra Spec 500 Interior Latex Semi-Gloss (N539)  
PPG Speedhide Zero Interior Latex Satin, 6-4410XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series  
Second Coat: Benj. Moore Ultra Spec 500 Interior Latex Semi-Gloss (N539)  
PPG Speedhide Zero Interior Latex Satin, 6-4410XI  
S-W ProMar 200 Zero VOC Interior Latex Eg-Shel, B20-1900 Series  
a. Total DFT not less than: 4.0 mils

Semi-Gloss Finish/Latex

Primer: Benj. Moore Fresh Start Latex Primer (0023)  
PPG Seal Grip Int./Ext. Acrylic Universal Primer/Sealer 17-921  
S-W Multi-Purpose Latex Primer/Sealer B51 Series  
First Coat: Benj. Moore Ultra Spec 500 Interior Latex Gloss (N540)  
PPG Speedhide Zero Interior Semi-Gloss Latex, 6-4510XI  
S-W ProMar 200 Zero VOC Interior Latex Semi-Gloss, B31-2600 Series  
Second Coat: Benj. Moore Ultra Spec 500 Interior Latex Gloss (N540)  
PPG Speedhide Zero Interior Semi-Gloss Latex, 6-4510XI  
S-W ProMar 200 Zero VOC Interior Latex Semi-Gloss, B31-2600 Series  
a. Total DFT not less than: 3.8 mils

G. Primer for Fiberglass Faced Drywall:

1 coat Benjamin Moore 046 Fresh Start Acrylic All-Purpose High Hiding Primer  
1 coat PPG Paints Seal Grip Interior/Exterior Acrylic Universal Primer/Sealer 17-921  
1 coat Sherwin Williams "Builders Solution."

H. Interior Drywall to Receive Wallcovering

Primer: 1 coat "Shield Z Mold and Mildew Proof Commercial Wallcovering  
Primer" made by Zinsser

1 coat Multi-Purpose Interior/Exterior B51-450 by Sherwin Williams

I. Concrete Floor Paint

Primer: Corotech V155 Solid Epoxy Pre-Primer  
First Coat: Corotech V440 Waterborne Amine Epoxy  
Second Coat: Corotech V440 Waterborne Amine Epoxy  
Non-Slip Aggregate: Broadcast Corotech V630 Anti-Slip Aggregate.

PPG Paints

Primer: 1 Coat-PPG Megaseal HSPC 0 VOC Epoxy Primer/Sealer @ 6-8 mils dft  
Finish: 2 Coats-PPG Aquapon WB EP Ultra Low VOC Water Based Semi-Gloss/Gloss Epoxy, 98-51E Series.@ 2-4 mils DFT; VOC 26g/l  
Non-Slip: Add PPG Amercoat 886 Anti-Slip Additive (pumice) into the first coat of epoxy finish.

J. Concrete Floor Sealer: Two coats, Super Diamond VOX by Euclid Chemical or approved equal.

2.5 EXISTING SURFACES TO BE PAINTED

A. Existing surfaces shall be painted in accordance with schedule given in Article 2.4 herein except that first or prime coat may be eliminated where existing paint is sound. Where existing paint must be removed down to base material, provide first or prime coat as specified.

2.6 PIPING AND MECHANICAL EQUIPMENT EXPOSED TO VIEW

- A. Paint all exposed piping, conduits, ductwork and mechanical and electrical equipment. Use heat resisting paint when applied to heating lines and equipment. The Contractor is cautioned not to paint or otherwise disturb moving parts in the mechanical systems. Mask or otherwise protect all parts as required to prevent damage.
- B. Exposed Uncovered Ductwork, Piping, Hangers and Equipment: Latex Enamel Undercoater and one (1) coat Acrylic Latex Flat.
- C. Exposed Covered Piping, Duct Work and Equipment: Primer/Sealer and one (1) coat Acrylic Latex Flat.
- D. Panel Boards, Grilles and Exposed Surfaces of Electrical Equipment: Latex Enamel Undercoater and two (2) coats Latex Semi-Gloss.
- E. Equipment or Apparatus with Factory-Applied Paint: Refinish any damaged surfaces to match original finish. Do not paint over name plates and labels.
- F. All surfaces of insulation and all other work to be painted shall be wiped or washed clean before any painting is started.
- G. All conduit, boxes, distribution boxes, light and power panels, hangers, clamps, etc., are included where painting is required.
- H. All items of Mechanical and Electrical trades which are furnished painted under their respective Contracts shall be carefully coordinated with the work of this Section so as to leave no doubt as to what items are scheduled to be painted under this Section.

## PART 3 EXECUTION

### 3.1 INSPECTION

- A. Examine the areas and conditions where painting and finishing are to be applied and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.2 GENERAL WORKMANSHIP REQUIREMENTS

- A. Only skilled mechanics shall be employed. Application may be by brush or roller. Spray application only upon acceptance from the Architect in writing.
- B. The Contractor shall furnish the Architect a schedule showing when he expects to have completed the respective coats of paint for the various areas and surfaces. This schedule shall be kept current as the job progresses.
- C. The Contractor shall protect his work at all times, and shall protect all adjacent work and materials by suitable covering or other method during progress of his work. Upon completion of the work, he shall remove all paint and varnish spots from floors, glass and other surfaces. He shall remove from the premises all rubbish and accumulated materials of whatever nature not caused by others and shall leave his part of the work in clean, orderly and acceptable condition.
- D. Remove and protect hardware, accessories, device plates, lighting fixtures, and factory finished work, and similar items, or provide ample in place protection. Upon completion of each space, carefully replace all removed items by workmen skilled in the trades involved.
- E. Remove electrical panel box covers and doors before painting walls. Paint separately and re-install after all paint is dry.
- F. All materials shall be applied under adequate illumination, evenly spread and flowed on smoothly to avoid runs, sags, holidays, brush marks, air bubbles and excessive roller stipple.
- G. Coverage and hide shall be complete. When color, stain, dirt or undercoats show through final coat of paint, the surface shall be covered by additional coats until the paint film is of uniform finish, color, appearance and coverage, at no additional cost to the Owner.
- H. All coats shall be dry to manufacturer's recommendations before applying succeeding coats.
- I. All suction spots or "hot spots" in plaster after the application of the first coat shall be touched up before applying the second coat.
- J. Do not apply paint behind frameless mirrors that use mastic for adhering to wall surface.

### 3.3 PREPARATION OF SURFACES

- A. Existing Surfaces: Clean existing surfaces requiring paint or finishing, remove all loose and flaking paint or finish and sand surface smooth as required to receive new paint or

finish. No “telegraphing” of lines, ridges, flakes, etc., through new surfacing is permitted. Where this occurs, Contractor shall be required to sand smooth and re-finish until surface meets with Architect’s approval.

B. General

1. The Contractor shall be held wholly responsible for the finished appearance and satisfactory completion of painting work. Properly prepare all surfaces to receive paint, which includes cleaning, sanding, and touching-up of all prime coats applied under other Sections of the work. Broom clean all spaces before painting is started. All surfaces to be painted or finished shall be perfectly dry, clean and smooth.
2. Perform all preparation and cleaning procedures in strict accordance with the paint manufacturer’s instructions and as herein specified, for each particular substrate condition.
3. Clean surfaces to be painted before applying paint or surface treatments. Remove oil and grease with clean cloths and cleaning solvents prior to mechanical cleaning. Program the cleaning and painting so that dust and other contaminants from the cleaning process will not fall in wet, newly painted surfaces.

C. Metal Surfaces

1. Weld Fluxes: Remove weld fluxes, splatters, and alkali contaminants from metal surfaces in an approved manner and leave surface ready to receive painting.
2. Bare Metal: Thoroughly clean off all foreign matter such as grease, rust, scale and dirt before priming coat is applied. Clean surfaces, where solder flux has been used, with benzene. Clean surfaces by flushing with non-hydrocarbon based cleaner. For aluminum surfaces, wipe down with an oil free solvent prior to application of any pre-treatment.
  - a. Bare metal to receive high performance coating specified herein must be blast cleaned SSPC SP-6 prior to application if field applied primer; coordinate with steel trades furnishing ferrous metals to receive this coating to ensure that this cleaning method is followed.
3. Shop Primed Metal: Clean off foreign matter as specified for "Bare Metal." Prime bare, rusted, abraded and marred surfaces with approved primer after proper cleaning of surfaces. Sandpaper all rough surfaces smooth.
4. Galvanized Metal: Prepare surface as per the requirements of ASTM D 6386.
5. Metal Filler: Fill dents, cracks, hollow places, open joints and other irregularities in metal work to be painted with an approved metal filler suitable for the purpose and meeting the requirements of the related Section of work; after setting, sand to a smooth, hard finish, flush with adjoining surface.

- D. Plaster Surfaces: Scrape off all plaster nibs or other projections and sand smooth or finish to match adjoining surface texture. Cut out all scratches, cracks, holes, depressions and similar voids and fill with non-shrinking grout, spackles, patching plaster or other approved patching material; allow to dry, refill if necessary, then sand smooth (or refinish) to provide a flush, smooth surface of the same texture as the adjacent plaster surface.

1. Allow at least 28 days, from installation of final plaster coat, before starting work.
- E. Gypsum Drywall Surfaces: Scrape off all projections and splatters, spackles all holes or depressions, including taped and spackled joints, sand smooth. Conform to standards established in Section 092900, "Gypsum Drywall."
- F. Wood Surfaces: Sand to remove all roughness, loose edges, splinters, or splinters and then brush to remove dust. Wash off grease or dirt with an approved cleaner. Fill all cracks, splits, nail holes, screw holes, and surface defects with putty after the priming coat has been applied. Putty shall be brought up flush with the surface and sanded smooth and touched-up with primer when dry.
- G. Block Masonry Surfaces: Thoroughly clean off all grit, grease, dirt mortar drippings or splatters, and other foreign matter. Remove nibs or projections from masonry surfaces. Fill cracks, holes or voids not filled under the "Masonry" Section, with Portland cement grout, and bag surface so that it has approximately the same texture as the adjacent masonry surface.
- H. Testing for Moisture Content: Contractor shall test all plaster, masonry, and drywall surfaces for moisture content using a reliable electronic moisture meter. Contractor shall also test latex type fillers for moisture content before application of top coats of paint. Do not apply any paint or sealer to any surface or to latex type filler where the moisture content exceeds seven (7) percent as measured by the electronic moisture meter.
- I. Touch-Up: Prime paint all patched portions in addition to all other specified coats.

#### 3.4 MATERIALS PREPARATION

- A. Mix and prepare painting materials in strict accordance with the manufacturer's directions.
- B. Store materials not in actual use in tightly covered containers. Maintain containers used in storage, mixing, and application of paint in a clean condition, free of foreign materials and residue.
- C. Stir all materials before application to produce a mixture of uniform density, and as required during the application of the materials. Do not stir any film which may form on the surface into the material. Remove the film and, if necessary, strain the material before using.
- D. Tint each undercoat a lighter shade to facilitate identification of each coat where multiple coats of the same material are to be applied. Tint undercoats to match the color of the finish coat but provide sufficient difference in shade of undercoats to distinguish each separate coat.

#### 3.5 APPLICATION

- A. General
  1. Apply paint by brush or roller in accordance with the manufacturer's directions. Use brushes best suited for the type of material being applied. Use rollers of carpet, velvet back, or high pile sheep's wool as recommended by the paint manufacturer for material and texture required.
  2. The number of coats and paint film thickness required is the same regardless of the application method. Do not apply succeeding coats until the previous coat has completely dried. Sand between each enamel or varnish coat application with fine

sandpaper, or rub surfaces with pumice stone, where required to produce an even, smooth surface in accordance with the coating manufacturer's directions.

3. Apply additional coats when undercoats, stains, or other conditions show through the final coat of paint, until the paint film is of uniform finish, color and appearance. Give special attention to ensure that all surfaces, including edges, corners, crevices, welds, and exposed fasteners receive a film thickness equivalent to that of flat surfaces.
  4. Paint surfaces behind movable equipment and furniture the same as similar exposed surfaces. Paint surfaces behind permanently fixed equipment or furniture with prime coat only.
    - a. "Exposed surfaces" is defined as those areas visible when permanent or built-in fixtures, convector covers, covers for finned tube radiation, grilles, etc., are in place in areas scheduled to be painted.
  5. Paint interior surfaces of ducts, where visible through registers or grilles, with a flat, non-specular black paint, before final installation of equipment.
  6. Paint the back sides of access panels, removable or hinged covers to match the exposed surfaces.
  7. Finish doors on tops, bottoms, and side edges the same as the faces, unless otherwise indicated.
  8. Enamel finish applied to wood or metal shall be sanded with fine sandpaper and then cleaned between coats to produce an even surface.
  9. Paste wood filler applied on open grained wood after beginning to flatten, shall be wiped across the grain of the wood, then with a circular motion, to secure a smooth, filled, clean surface with filler remaining in open grain only. After overnight dry, sand surface with the grain until smooth before applying specified coat.
- B. Scheduling Painting
1. Apply the first coat material to surfaces that have been cleaned, pre-treated or otherwise prepared for painting as soon as practicable after preparation and before subsequent surface deterioration.
  2. Allow sufficient time between successive coatings to permit proper drying. Do not re-coat until paint has dried to where it feels firm, does not deform or feel sticky under moderate thumb pressure, and the application of another coat of paint does not cause lifting or loss of adhesion of the undercoat.
- C. Prime Coats: Re-coat primed and sealed walls and ceilings where there is evidence of suction spots or unsealed areas in first coat, to assure a finish coat with no burn-through or other defects due to insufficient sealing.
- D. Pigmented (Opaque) Finishes: Completely cover to provide an opaque, smooth surface of uniform finish, color, appearance and coverage.
- E. "Touching-Up" of Factory Finishes: Unless otherwise specified or shown, materials with a factory finish shall not be painted at the project site. To "touch-up," the Contractor shall use the factory finished material manufacturer's recommended paint materials to repair abraded, chipped, or otherwise defective surfaces.

### 3.6 APPLICATION OF ELECTROSTATIC PAINT

- A. Preparation: Sand, or chemically clean as appropriate, all abraded surfaces, corroded areas and other imperfections in surfaces to be coated. Fill or feather edges of sanded areas to produce for a smooth transition to bare metal.
- B. Apply prime and finish materials in accordance with manufacturer's directions. Apply each material at not less than the manufacturer's recommended spreading rate. Use special equipment, applicators, and techniques recommended by manufacturer as best suited for the particular applications.
- C. Apply additional coats beyond scheduled requirements when undercoating, stains or other conditions show through final paint coat until the special coating is of uniform finish, color and appearance.

### 3.7 PROTECTION

- A. Protect work of other trades, whether to be painted or not, against damage by the painting and finishing work. Leave all such work undamaged. Correct any damages by cleaning, repairing or replacing, and repainting, as acceptable to the Architect.
- B. Provide "Wet Paint" signs as required to protect newly painted finishes. Remove temporary protective wrappings provided by others for protection of their work after completion of painting operations.

### 3.8 CLEAN UP

- A. During the progress of the work, remove from the site all discarded paint materials, rubbish, cans and rags at the end of each work day.
- B. Upon completion of painting work, clean window glass and other paint spattered surfaces. Remove spattered paint by proper methods of washing and scraping, using care not to scratch or otherwise damage finished surfaces.
- C. At the completion of work of other trades, touch-up and restore all damaged or defaced painted surfaces.

END OF SECTION

## **SECTION 104416 FIRE EXTINGUISHERS**

### **PART 1 - GENERAL**

#### **1.1 GENERAL REQUIREMENTS**

- A. Work of this Section, as shown or specified, shall be in accordance with the requirements of the Contract Documents.

#### **1.2 SECTION INCLUDES**

- A. The Work of this Section includes all labor, materials, equipment, and services necessary to complete the fire extinguishers and cabinets as shown on the drawings and/or specified herein.

#### **1.3 RELATED SECTIONS**

- A. Gypsum Drywall - Section 092900.

#### **1.4 QUALITY ASSURANCE**

- A. Provide portable fire extinguishers and accessories by one manufacturer.
- B. UL-Listed Products: Provide new portable fire extinguishers which are UL-listed and bear UL "Listing Mark" for type, rating, and classification of extinguisher indicated.

#### **1.5 SUBMITTALS**

- A. Product Data: Submit manufacturer's technical data and installation instructions for all portable fire extinguishers required. For fire extinguisher cabinets include roughing-in dimensions, and details showing mounting methods, relationships to surrounding construction, door hardware, cabinet type and materials, trim style and door construction, style and materials. Where color selections by Architect are required, include color charts showing full range of manufacturer's standard colors and designs available.
- B. Samples: Submit samples, 6" square, of each required finish. Prepare samples on metal of same gauge as metal to be used in the work. Where normal color variations are to be expected, include 2 or more units in each sample showing the limits of such variations.

### **PART 2 - PRODUCTS**

#### **2.1 MANUFACTURERS**

- A. Subject to compliance with requirements, provide products of one of the following:
  - 1. JL Industries.
  - 2. Larsen's Mfg. Co.

3. Potter Roemer.
4. Or approved equal.

## 2.2 EXTINGUISHERS

- A. General: Provide fire extinguishers for each location indicated, in colors and finishes selected by Architect from manufacturer's standard which comply with requirements of governing authorities.
- B. Abbreviations indicated below to identify extinguisher type related to UL classification and rating system and not necessarily to type and amount of extinguishing material contained in extinguisher.
- C. Multi-Purpose Dry Chemical Type: UL rated 2-A:10-B:C, 5 lb. nominal capacity, in enameled steel container, for Class A, Class B and Class C fires.

## 2.3 MOUNTING BRACKETS

- A. Provide manufacturer's standard bracket designed to prevent accidental dislodgment of extinguisher, of proper size for type and capacity of extinguisher specified, in manufacturer's standard enamel finish; color to match extinguisher.

## 2.4 CABINETS

- A. Type and Style: Fire extinguisher cabinets shall be metal, recessed, with plexiglass panel, sized to fit within the partition or wall depth. Provide fire-rated cabinets within fire-rated partitions.
- B. Color: Fire extinguisher cabinets shall be factory pre-finished with baked enamel in the colors selected by the Architect from the standard range of colors of the selected manufacturer.
- C. Design is based on "Model G-2409-R1" of Larsen's Mfg. Co. or approved equal. Other manufacturers noted herein may substitute their equivalent cabinet upon acceptance by the Architect.

## 2.5 IDENTIFICATION

- A. Identify bracket-mounted extinguishers with red letter decals spelling 'FIRE EXTINGUISHER' applied to wall surface. Letter size, style and location as selected by the Architect.

## PART 3 - EXECUTION

### 3.1 INSPECTION

- A. Examine the areas and conditions where fire extinguishers and cabinets are to be installed and correct any conditions detrimental to the proper and timely completion of the work. Do not proceed with the work until unsatisfactory conditions are corrected to permit proper installation of the work.

### 3.2 INSTALLATION

- A. Install items included in this Section in locations indicated and at heights to comply with applicable regulations of governing authorities.
  - 1. Securely fasten mounting brackets and fire extinguisher cabinets to structure, square and plumb, to comply with manufacturer's instructions.
- B. Where exact location of cabinets and bracket-mounted fire extinguishers is not indicated, locate as directed by the Architect.

### 3.3 SERVICE

- A. Determine the approximate completion date of the work and then inspect, charge, and tag the fire extinguishers at a date not more than 10 days before or not less than one day before actual completion date of the work.

END OF SECTION 104416



Department of Community Affairs  
Construction Project Review  
Project No. AC-045-26

Frank Pollock  
Released: 3/30/2025  
N.J.S.A. 62:27D-119 ET SEQ., AS AMENDED



## **Boiler Project at Bozorth Hall and Hawthorn Hall**

**PROJECT MANUAL**

**PROJECT NO. 77267**

**March 6, 2026**

**Engineer:**

**Schiller and Hersh Associates, Inc.**

**636 Skippack Pike, Suite 200**

**Blue Bell, PA 19422**

**T: 215-886-8947**

**Project #2566A**

---

Richard L. Delp, P.E.  
NJ Professional Engineer  
NO. GE45368

## ROWAN UNIVERSITY

### TABLE OF CONTENTS

#### INSTRUCTIONS TO BIDDERS AND GENERAL CONDITIONS

SECTION I	Construction Contract	Pages 1 – 10
SECTION II	Exhibit A: Insurance and Bonds	Pages 1 - 8
SECTION III	General Conditions	Pages 1 - 55
SECTION IV	<u>Forms</u>	
	Allowance Authorization Form	Page 1
	Allowance Charge Request Form	Page 1
	Request for Information Form	Page 1
	Change Order Request Form	Page 1
	Change Order Form	Page 1
	Hourly Labor Rate Breakdown Form	Page 1
	Daily Job Report Form	Page 1
	Application and Certificate for Payment Form (AIA G702)	Pages 1 - 2
	Attachment to G702 Certification For Payment	Pages 1 - 2
	Contractor's Partial or Final Release And Waiver of Liens	Page 1
	Rowan Tax Exempt Letter	Page 1
	Consent of Surety Company to Final Payment (AIA G707)	Page 1

#### DIVISION 01 GENERAL REQUIREMENTS

<u>SECTION</u>	
011000	Summary of Work
011400	Work Restrictions
012100	Allowances
012200	Unit Price (NOT INCLUDED / USED)
012300	Alternates (NOT INCLUDED / USED)
012400	Procedures and Controls
012500	Contract Modification Procedures
012900	Payment Procedures
013100	Coordination
013200	Construction Progress Schedule
013300	Submittal Procedures
014000	Quality Control Requirements
014100	Testing Services
014523	Testing & Inspections
014200	Reference Standards
015000	Construction Facilities & Temporary Controls
016000	Product Requirements
016350	Substitution Procedures
017000	Execution Requirements
017700	Contract Closeout
017820	Operation and Maintenance Data
018200	Demonstration and Training

## TECHNICAL SPECIFICATIONS

### DIVISION 04 MASONRY

#### SECTION

042000 Unit Masonry

### DIVISION 07 THERMAL AND MOISTURE PROTECTION

#### SECTION

078100 Sprayed Fire-Resistive Materials  
078413 Firestops and Smoke Seals  
079200 Joint Sealers

### DIVISION 08 OPENINGS

#### SECTION

081113 Hollow Metal Doors and Frames  
083113 Access Doors and Frames  
087100 Door Hardware

### DIVISION 09 FINISHES

#### SECTION

0929000 Gypsum Drywall  
099000 Painting

### DIVISION 10 SPECIALTIES

#### SECTION

104416 Fire Extinguishers

### DIVISION 23 MECHANICAL

#### SECTION

230000 Mechanical Summary of Work  
230500 Common Work Results for HVAC  
230513 Common Motor Requirements for HVAC Equipment  
230519 Meters and Gauges for HVAC Piping  
230523 General-Duty Valves for Piping  
230529 Hangers and Supports for HVAC Piping and Equipment  
230553 Identification for HVAC Piping and Equipment  
230593 Testing, Adjusting, and Balancing for HVAC  
230700 HVAC Insulation  
230900 Instrumentation and Control for HVAC  
231123 Facility Natural Gas Piping  
232113 Hydronic Piping  
232123 Hydronic Pumps  
232223 Steam Condensate Pumps  
233113 Metal Ducts  
233300 Air Duct Accessories  
233423 HVAC Power Ventilators  
235100 Breechings, Chimneys and Stacks  
235216 Condensing Boilers  
235218 Wall Mounted Condensing Boilers  
238239 Unit Heaters

DIVISION 26 ELECTRICAL

SECTION

260000	Electrical Summary of Work
260500	Common Work Results for Electrical
260519	Low Voltage Electrical Power Conductors and Cables
260526	Grounding and Bonding for Electrical Systems
260529	Hangers and Supports for Electrical Systems
260533	Raceways and Boxes for Electrical Systems
260553	Identification for Electrical Systems
262416	Panelboards
262726	Wiring Devices
262816	Enclosed Switches and Circuit Breakers
265119	LED Interior Lighting

DIVISION 28 ELECTRONIC SAFETY AND SECURITY

SECTION

284700	Fire Alarm System
--------	-------------------

END OF SECTION

## SECTION 260000 – ELECTRICAL SUMMARY OF WORK

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and other Divisions Specification Sections, apply to this Section.
- B. The requirements of all other sections of Division 26, 27 and 28 apply to this section.

#### 1.2 WARRANTY FOR PROJECT

- A. The Contractor shall provide the Owner with a 2-year warranty on all materials, labor and systems from the date of Substantial Completion for each Phase. The date of Substantial completion will be as set in a letter issued by the Engineer.

#### 1.3 DEFINITIONS

- A. For a complete list of definitions for this contract refer to the Division 1 specifications.
- B. Provide: Means to provide, install and make the equipment/system completely functional and operational with testing, commissioning and training.
- C. Install: Means to provide, install and make the equipment/system completely functional and operational with testing, commissioning and training.

#### 1.4 SCOPE OF WORK

- A. Work Included: It is the intent of these specifications and the accompanying drawings that the Contractor shall, unless otherwise specified herein, furnish all labor, materials, tools, and equipment necessary, together with the necessary accessories to constitute a satisfactory and complete installation, to complete the installation of the electrical work, as indicated on the drawings and described hereinafter. The Contractor shall properly install, equip, adjust and put in perfect condition, the respective portions of the work specified, and to so interconnect the various items or sections of the work to form a complete and properly operating whole. The work shall consist of, but shall not necessarily be limited to the following:
  - 1. General:
    - a. For detailed scope of work for each electrical system, refer to the respective Division 26, 27 & 28 specification sections.
    - b. All necessary rigging.
    - c. Removal of trash and general clean-up.
    - d. All necessary permits, approvals, fees, etc.
    - e. Instructions to the Owner.
    - f. Cutting, patching and clean-up.
  - 2. Scope of Work:
    - a. Demolish power wiring, conduits and disconnects for mechanical and plumbing

equipment being demolished.

- b. Provide and install new power wiring, disconnects and emergency shut-down switches for the boilers and water heaters.
- c. Provide and install new heat detectors and multi-criteria (smoke, carbon monoxide, and heat) detectors and integrate with the existing fire alarm system. New CO detection shall alarm the building, not just cause a supervisory condition.
- d. Provide and install new wiring devices and backboxes.
- e. Provide and install wiring for all mechanical and plumbing equipment on the project. Provide and install NEC required disconnecting means for all required equipment and locations.
- f. Replace combination exit signs/battery powered emergency lighting fixtures as indicated on drawings. Provide and install new combination exit signs/battery powered emergency lighting fixtures as indicated on drawings.

Bozorth Hall:

- g. Provide and install new conduits and branch circuits to existing electrical panels.
- h. Relocate lighting fixtures, as required, to accommodate the mechanical and plumbing construction.
- i. Patch/infill existing concrete walls as required to restore rating of room.

Hawthorn Hall:

- j. Provide and install new panelboard.
- k. Provide and install new conduits and branch circuits to new electrical panel.
- l. Provide new LED lighting fixtures as indicated on the drawings.

B. It will be the responsibility of the Contractor to examine all Drawings (Architectural, Structural, Mechanical, Plumbing and Electrical) to determine the full extent of the work. All field measurements and verifications of conditions and materials will be the obligation of the Contractor. The submission of a Proposal by the Contractor will be considered an indication that all work has been included in the Proposal. It will also be considered an indication that a thorough review of conditions, materials, and all related specifications have been investigated by the Contractor, and the results of such investigations have been included in the Contractor's Proposal.

C. Coordination Between Mechanical (MC), Electrical (EC) and Plumbing (PC) Contractors:

1. The Electrical Contractor shall:

- a. Receive and set the motor starters as provide by the Mechanical and Plumbing Contractors.
- b. Provide power wiring, including final connection of same, from source to starters or contactors to motors.
- c. Receive and install the wall-mounted electrical control devices, thermal switches, etc., and provide all wiring for same.
- d. Provide all fused or unfused disconnect switches and circuit breakers not supplied as part of the HVAC system and as required by the National Electrical Code, or as shown on the drawings, or as specified.
- e. Adjust connections to electrical motors to insure proper rotation.

2. The Mechanical Contractor will:

- a. Furnish and set all motors for mechanical equipment.
  - b. Furnish all motor starters, starter/disconnects, HVAC unit mounted disconnects, contactors, pushbuttons and switches for local and remote control of all HVAC equipment and turn over to the Electrical Contractor for installation.
  - c. Provide pre-wired control panels, including relays, switches, pilot lights, etc., all as shown and/or specified, complete with wiring to numbered terminal strips.
  - d. Furnish and install duct and pipe-mounted control devices, such as freezestats, aquastats, flow switches, etc.
  - e. Furnish wiring diagrams for the systems, in sufficient time to allow roughing-in of conduit in accordance with the proposed work schedule.
  - f. Provide all control wiring including 120V controls, 120V power and 120/24V control power transformers as required for a complete and fully functional HVAC DDC control system. The MC is required to provide 120V power to their HVAC DDC control panels and system.
3. The Plumbing Contractor will:
- a. Furnish and set all motors for plumbing equipment.
  - b. Coordinate locations of all equipment with both the Mechanical and Electrical Contractors.
  - c. Provide the Electrical Contractor with information and instructions for connection of electrical service to water coolers, domestic hot water heater, etc.
4. The Electrical Contractor shall examine the drawings and read the specifications for the mechanical trades, and shall note all motor-driven equipment, starters and control apparatus noted, shown or specified herein.

#### 1.5 WARRANTY

- A. Contractors shall note that all equipment warranties, as described in the various sections of the Specifications, will begin after Substantial Completion. It will not make any difference when equipment is ordered, delivered or installed, warranties will commence after the Architect issues his letter of "Substantial Completion."
- B. All equipment is to include factory start-up unless the Contractor receives written permission, from the Owner, for Contractor start-up. Copies of the start-up report must be included with the Request for Final Payment, otherwise final payment will be withheld until the factory reports are submitted.
- C. All equipment furnished for this Project shall include a 2 year warranty on parts and labor.

PART 2 - PRODUCTS (Not applicable).

PART 3 - EXECUTION (Not applicable).

END OF SECTION 260000

## SECTION 260500 – COMMON WORK RESULTS FOR ELECTRICAL

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Electrical equipment coordination and installation.
  - 2. Sleeves for raceways and cables.
  - 3. Sleeve seals.
  - 4. Grout.
  - 5. Common electrical installation requirements.

#### 1.3 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For sleeve seals.

#### 1.5 COORDINATION

- A. Coordinate arrangement, mounting, and support of electrical equipment:
  - 1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
  - 2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
  - 3. To allow right of way for piping and conduit installed at required slope.
  - 4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.
- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."

## PART 2 - PRODUCTS

### 2.1 SLEEVES FOR RACEWAYS AND CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel.
  - 1. Minimum Metal Thickness:
    - a. For sleeve cross-section rectangle perimeter less than 50 inches (1270 mm) and no side more than 16 inches (400 mm), thickness shall be 0.052 inch (1.3 mm).
    - b. For sleeve cross-section rectangle perimeter equal to, or more than, 50 inches (1270 mm) and 1 or more sides equal to, or more than, 16 inches (400 mm), thickness shall be 0.138 inch (3.5 mm).

### 2.2 SLEEVE SEALS

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and raceway or cable.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Calpico, Inc.
    - c. Link Seal.
    - d. Metraflex Co.
    - e. Pipeline Seal and Insulator, Inc.
  - 2. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
  - 3. Pressure Plates: Stainless steel. Include two for each sealing element.
  - 4. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

### 2.3 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

## PART 3 - EXECUTION

### 3.1 COMMON REQUIREMENTS FOR ELECTRICAL INSTALLATION

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electrical equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

### 3.2 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Electrical penetrations occur when raceways, cables, wireways, cable trays, or busways penetrate concrete slabs, concrete or masonry walls, or fire-rated floor and wall assemblies.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- E. Cut sleeves to length for mounting flush with both surfaces of walls.
- F. Extend sleeves installed in floors 2 inches (50 mm) above finished floor level.
- G. Size pipe sleeves to provide 1/4-inch (6.4-mm) annular clear space between sleeve and raceway or cable, unless indicated otherwise.
- H. Seal space outside of sleeves with grout for penetrations of concrete and masonry
  - 1. Promptly pack grout solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect grout while curing.
- I. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants."
- J. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway and cable penetrations. Install sleeves and seal raceway and cable

penetration sleeves with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping."

- K. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.
- L. Aboveground, Exterior-Wall Penetrations: Seal penetrations using cast-iron pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.
- M. Underground, Exterior-Wall Penetrations: Install cast-iron pipe sleeves. Size sleeves to allow for 1-inch (25-mm) annular clear space between raceway or cable and sleeve for installing mechanical sleeve seals. Link-Seal modular, elastomer sealing system shall be used for existing walls in underground situations with no sleeve.

### 3.3 SLEEVE-SEAL INSTALLATION

- A. Install to seal exterior wall penetrations.
- B. Use type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

### 3.4 FIRESTOPPING

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electrical installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section "Penetration Firestopping." Refer to the Architectural drawings for locations of all fire-rated floor and wall assemblies.

END OF SECTION 260500

## SECTION 260519 – LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Building wires and cables rated 600 V and less.
  - 2. Connectors, splices, and terminations rated 600 V and less.
  - 3. Sleeves and sleeve seals for cables.
- B. Refer to Section 3.2 for allowable conduit and MC cable locations.

#### 1.3 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Qualification Data: For testing agency.
- C. Field quality-control test reports.

#### 1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: An independent agency, with the experience and capability to conduct the testing indicated, that is a member company of the InterNational Electrical Testing Association or is a nationally recognized testing laboratory (NRTL) as defined by OSHA in 29 CFR 1910.7, and that is acceptable to authorities having jurisdiction.
  - 1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association or the National Institute for Certification in Engineering Technologies to supervise on-site testing specified in Part 3.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NFPA 70.

## 1.6 COORDINATION

- A. Set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

## PART 2 - PRODUCTS

### 2.1 CONDUCTORS AND CABLES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. American Insulated Wire Corp.; a Leviton Company.
  - 2. General Cable Corporation.
  - 3. Senator Wire & Cable Company.
  - 4. Southwire Company.
- B. Copper Conductors: Comply with NEMA WC 70. All conductors on the project shall be copper, unless specifically noted as aluminum on the drawings.
- C. Aluminum Conductors (only where specifically noted and allowed as shown on the drawings): Aluminum, complying with ASTM B 800 and ASTM B 801.
- D. Conductor Insulation: Comply with NEMA WC 70 for Types THHN-THWN. Conductor sizes #12 and #10 shall be solid and #8 and larger shall be stranded.
- E. Type MC Cable: Aluminum armor with copper conductors. Multiconductor Cable: Comply with NEMA WC 70 for metal-clad cable, Type MC with ground wire.

### 2.2 CONNECTORS AND SPLICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AFC Cable Systems, Inc.
  - 2. Hubbell Power Systems, Inc.
  - 3. O-Z/Gedney; EGS Electrical Group LLC.
  - 4. 3M; Electrical Products Division.
  - 5. Tyco Electronics Corp.
- B. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

### 2.3 SLEEVES FOR CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch (1.3- or 3.5-mm) thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."

## 2.4 SLEEVE SEALS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Advance Products & Systems, Inc.
  - 2. Calpico, Inc.
  - 3. Metraflex Co.
  - 4. Pipeline Seal and Insulator, Inc.
- B. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and cable.
  - 1. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
  - 2. Pressure Plates: Stainless steel. Include two for each sealing element.
  - 3. Connecting Bolts and Nuts: Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

## PART 3 - EXECUTION

### 3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Stranded for No. 8 AWG and larger.
- B. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.

### 3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Exposed Feeders: Type THHN-THWN, single conductors in raceway.
- B. Underground Feeders: Type XHHW, single conductors in Type PVC schedule 40 UL listed conduit. Refer to drawings for ductbanks requiring encasement in 3" of concrete.
- C. Feeders Concealed in Ceilings, Walls, Partitions: Type THHN-THWN, single conductors in raceway.
- D. Use the following wiring methods as indicated for all branch circuits:
  - 1. Outdoor, underground: Type PVC schedule 40 UL listed conduit. Refer to drawings for ductbanks requiring encasement in 3" of concrete.
  - 2. Indoor, Type THHN-THWN, single conductors in raceway:
    - a. Mechanical rooms.

- b. Electrical rooms.
  - c. Sprinkler rooms.
  - d. Elevator machine rooms.
  - e. Above hard / drywall ceilings.
  - f. Corridors.
  - g. Rooms with exposed ceiling structure.
  - h. In concrete block walls.
3. In areas listed above in D2, MC cable jumpers to equipment is acceptable. Maximum MC cable jumper lengths to equipment shall be 6'. Type MC aluminum-clad multi-conductor copper cabling with ground.
4. Indoor, concealed in drywall walls and accessible ceilings and not in areas listed above in D.2: Type MC aluminum-clad multi-conductor copper cabling with ground.
- E. Dimming Lighting Branch Circuits: Where branch circuit wiring is routed to 0-10V dimming light fixtures and switches, UL listed metalclad type MC-PCS (Luminary) cable. Where required to be in raceway as per D.2 above, in addition to the phase, neutral and ground wires, provide additional 2#16 AWG solid TFN Twisted jacketed pair (purple/gray) rated at 600V for 0-10V controls.
- F. Class 1 Control Circuits: Type MC Cable.
- G. Class 2 Control Circuits: Type MC Cable.
- H. Fire Alarm: Type MC FPLP cabling where concealed in walls, cable tray, accessible ceilings, exposed ceilings and partitions and Type THHN-THWN, in raceway where exposed as outlined in D.2 above.
- I. INSTALLATION OF CONDUCTORS AND CABLES
- J. Conceal cables in finished walls, ceilings, and floors, unless otherwise indicated.
- K. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- L. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- M. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- N. Support cables according to Division 26 Section "Hangers and Supports for Electrical Systems."
- O. Identify and color-code conductors and cables according to Division 26 Section "Identification for Electrical Systems."
- P. Common neutrals shall not be used. Provide individual, dedicated neutral for each circuit.
- Q. Common grounds are acceptable, in accordance with the NEC.

### 3.3 CONNECTIONS

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
- B. Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.
  - 1. Use oxide inhibitor in each splice and tap conductor for aluminum conductors.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 12 inches (300 mm) of slack.

### 3.4 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Rectangular Sleeve Minimum Metal Thickness:
  - 1. For sleeve rectangle perimeter less than 50 inches (1270 mm) and no side greater than 16 inches (400 mm), thickness shall be 0.052 inch (1.3 mm).
  - 2. For sleeve rectangle perimeter equal to, or greater than, 50 inches (1270 mm) and 1 or more sides equal to, or greater than, 16 inches (400 mm), thickness shall be 0.138 inch (3.5 mm).
- E. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- F. Cut sleeves to length for mounting flush with both wall surfaces.
- G. Extend sleeves installed in floors 2 inches (50 mm) above finished floor level.
- H. Size pipe sleeves to provide 1/4-inch (6.4-mm) annular clear space between sleeve and cable unless sleeve seal is to be installed.
- I. Seal space outside of sleeves with grout for penetrations of concrete and masonry.
- J. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and cable, using joint sealant appropriate for size, depth, and location of joint according to Division 07 Section "Joint Sealants."
- K. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at cable penetrations. Install sleeves and seal with firestop materials according to Division 07 Section "Penetration Firestopping."

- L. Roof-Penetration Sleeves: Seal penetration of individual cables with flexible boot-type flashing units applied in coordination with roofing work.
- M. Aboveground Exterior-Wall Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Size sleeves to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.
- N. Underground Exterior-Wall Penetrations: Install cast-iron "wall pipes" for sleeves. Size sleeves to allow for 1-inch (25-mm) annular clear space between cable and sleeve for installing mechanical sleeve seals.

### 3.5 SLEEVE-SEAL INSTALLATION

- A. Install to seal underground exterior-wall penetrations.
- B. Use type and number of sealing elements recommended by manufacturer for cable material and size. Position cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

### 3.6 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly according to Division 07 Section "Penetration Firestopping."

### 3.7 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections and prepare test reports.
- B. Perform tests and inspections and prepare test reports.
- C. Tests and Inspections:
  - 1. After installing conductors and cables and before electrical circuitry has been energized, test feeder conductors for compliance with requirements.
    - a. Megger testing for 600V feeder conductors.
  - 2. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
- D. Test Reports: Prepare a written report to record the following:
  - 1. Test procedures used.
  - 2. Test results that comply with requirements.
  - 3. Test results that do not comply with requirements and corrective action taken to achieve compliance with requirements.
- E. Remove and replace malfunctioning cabling and retest as specified above.

END OF SECTION 260519

## SECTION 260526 – GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes methods and materials for grounding systems and equipment, plus the following special applications:
  - 1. Underground distribution grounding.
  - 2. Building grounding.
  - 3. IT grounding.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Other Informational Submittals: Plans showing dimensioned as-built locations of grounding features specified in Part 3 "Field Quality Control" Article, including the following:
  - 1. Ground rods.
  - 2. Ground rings.
  - 3. Grounding arrangements and connections for separately derived systems.
  - 4. Grounding for sensitive electronic equipment.
- C. Qualification Data: For testing agency and testing agency's field supervisor.
- D. Field quality-control test reports.
- E. Operation and Maintenance Data: For grounding to include the following in emergency, operation, and maintenance manuals:
  - 1. Instructions for periodic testing and inspection of grounding features at grounding connections for separately derived systems and telecommunication systems based on NETA MTS.
    - a. Tests shall be to determine if ground resistance or impedance values remain within specified maximums, and instructions shall recommend corrective action if they do not.
    - b. Include recommended testing intervals.

#### 1.4 QUALITY ASSURANCE

- A. Testing Agency Qualifications: An independent agency, with the experience and capability to conduct the testing indicated, that is a member company of the InterNational Electrical Testing

Association or is a nationally recognized testing laboratory (NRTL) as defined by OSHA in 29 CFR 1910.7, and that is acceptable to authorities having jurisdiction.

1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association to supervise on-site testing specified in Part 3.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with UL 467 for grounding and bonding materials and equipment.

## PART 2 - PRODUCTS

### 2.1 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
  1. Stranded Conductors: ASTM B 8.
  2. Bonding Conductor: Minimum No. 4 AWG, stranded conductor or as noted on the drawings.
  3. Bonding Jumper: Copper tape, braided conductors, terminated with copper ferrules; 1-5/8 inches (41 mm) wide and 1/16 inch (1.6 mm) thick.

### 2.2 CONNECTORS

- A. Listed and labeled by a nationally recognized testing laboratory acceptable to authorities having jurisdiction for applications in which used, and for specific types, sizes, and combinations of conductors and other items connected.
- B. Bolted Connectors for Exposed Cables and Pipes: Copper or copper alloy, bolted pressure-type, with at least two bolts.
  1. Pipe Connectors: Clamp type, sized for pipe.
- C. Compression Connectors for all Concealed and Underground Cables: Compression kits of types recommended by kit manufacturer for materials being joined and installation conditions. Must comply with IEEE std 837-2002, UL 467 Listed and CSA 22.2 Certified or approved equal by the Engineer.

### 2.3 GROUNDING ELECTRODES

- A. Ground Rods: Copper-clad steel; 3/4 inch by 10 feet (19 mm by 3 m in diameter).
  1. Backfill Material: Electrode manufacturer's recommended material.

## PART 3 - EXECUTION

### 3.1 APPLICATIONS

- A. Conductors: Install stranded conductors for No. 8 AWG and larger, unless otherwise indicated.
- B. Underground Grounding Conductors: Install bare copper conductor, No. 4/0 AWG minimum.
  - 1. Bury at least 24 inches (600 mm) below grade.
  - 2. Duct-Bank Grounding Conductor: Bury 12 inches (300 mm) above duct bank when indicated as part of duct-bank installation.
- C. Conductor Terminations and Connections:
  - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
  - 2. Underground Connections: Compression connectors.
  - 3. Connections to Ground Rods at Test Wells: Compression connectors.
  - 4. Connections to Structural Steel and Poles: Compression connectors.
  - 5. Connections to Structural Rebar: Compression connectors.

### 3.2 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with all feeders and branch circuits.
- B. Install insulated equipment grounding conductors with the following items, in addition to those required by NFPA 70:
  - 1. Feeders and branch circuits.
  - 2. Lighting circuits.
  - 3. Receptacle circuits.
  - 4. Single-phase motor and appliance branch circuits.
  - 5. Three-phase motor and appliance branch circuits.
  - 6. Flexible raceway runs.
  - 7. Armored and metal-clad cable runs.
  - 8. Cable tray systems.
  - 9. All IT communications racks.

### 3.3 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Ground Rods: Drive rods until tops are 12 inches (50 mm) below finished floor or final grade, unless otherwise indicated.
  - 1. Interconnect ground rods with grounding electrode conductor below grade and as otherwise indicated. Make connections without exposing steel or damaging coating, if any.

- C. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance, except where routed through short lengths of conduit.
  - 1. Bonding to Structure: Bond straps directly to basic structure, taking care not to penetrate any adjacent parts.
  - 2. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install so vibration is not transmitted to rigidly mounted equipment.
  - 3. Use exothermic-welded connectors for outdoor locations.

### 3.4 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing and inspecting agency to perform the following field tests and inspections and prepare test reports:
- B. Perform the following tests and inspections and prepare test reports:
  - 1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
  - 2. Test completed grounding system at each location where a maximum ground-resistance level is specified, at service disconnect enclosure grounding terminal at individual ground rods. Make tests at ground rods before any conductors are connected.
    - a. Measure ground resistance not less than two full days after last trace of precipitation and without soil being moistened by any means other than natural drainage or seepage and without chemical treatment or other artificial means of reducing natural ground resistance.
    - b. Perform tests by fall-of-potential method according to IEEE 81.
  - 3. Prepare dimensioned drawings locating each test well, ground rod and ground rod assembly, and other grounding electrodes. Identify each by letter in alphabetical order, and key to the record of tests and observations. Include the number of rods driven and their depth at each location, and include observations of weather and other phenomena that may affect test results. Describe measures taken to improve test results.
  - 4. Panel testing: Perform ground resistance testing between all existing and new panel boards and the main switchboard in the main electrical rooms. Provide test report indicating the resistance for each panel to the main.
- C. Report measured ground resistances that exceed the following values:
  - 1. Power and Lighting Equipment or System with Capacity 500 kVA and Less: 10 ohms.
  - 2. Power and Lighting Equipment or System with Capacity 500 kVA and More: 5 ohms.
  - 3. Structural Steel / Lightning Protection Grounds: 10 ohms.
- D. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Engineer promptly and include recommendations to reduce ground resistance.

END OF SECTION 260526

## SECTION 260529 – HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Hangers and supports for electrical equipment and systems.
  - 2. Construction requirements for concrete bases.

#### 1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. IMC: Intermediate metal conduit.
- C. RMC: Rigid metal conduit (galvanized).

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design supports for multiple raceways, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- C. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- D. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of five times the applied force.

#### 1.5 SUBMITTALS

- A. Product Data: For the following:
  - 1. Steel slotted support systems.
  - 2. Nonmetallic slotted support systems.

- B. Shop Drawings: Show fabrication and installation details and include calculations for the following:
  - 1. Trapeze hangers. Include Product Data for components.
  - 2. Steel slotted channel systems. Include Product Data for components.
  - 3. Nonmetallic slotted channel systems. Include Product Data for components.
  - 4. Equipment supports.
- C. Welding certificates.

## 1.6 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Comply with NFPA 70.

## 1.7 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 03.

## PART 2 - PRODUCTS

### 2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Comply with MFMA-4, factory-fabricated components for field assembly.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Allied Tube & Conduit.
    - b. Cooper B-Line, Inc.; a division of Cooper Industries.
    - c. ERICO International Corporation.
    - d. GS Metals Corp.
    - e. Thomas & Betts Corporation.
    - f. Unistrut; Tyco International, Ltd.
    - g. Wesanco, Inc.
  - 2. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
  - 3. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
  - 4. Channel Dimensions: Selected for applicable load criteria.
- B. Raceway and Cable Supports: As described in NECA 1 and NECA 101.
- C. Conduit and Cable Support Devices: Galvanized Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.

- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M, steel plates, shapes, and bars; galvanized.
- F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
  - 1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) Hilti Inc.
      - 2) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
      - 3) MKT Fastening, LLC.
      - 4) Simpson Strong-Tie Co., Inc.; Masterset Fastening Systems Unit.
  - 2. Mechanical-Expansion Anchors: Insert-wedge-type, stainless steel, for use in hardened portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
    - a. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
      - 1) Cooper B-Line, Inc.; a division of Cooper Industries.
      - 2) Empire Tool and Manufacturing Co., Inc.
      - 3) Hilti Inc.
      - 4) ITW Ramset/Red Head; a division of Illinois Tool Works, Inc.
      - 5) MKT Fastening, LLC.
  - 3. Concrete Inserts: Stainless Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
  - 4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
  - 5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
  - 6. Hanger Rods: Threaded steel.

## PART 3 - EXECUTION

### 3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway (including trapeze type systems): Space supports for EMT, IMC, and RMC as scheduled in NECA 1, where its Table 1 lists maximum spacings less than stated in NFPA 70. Minimum rod size shall be 1/4 inch (6 mm) in diameter. Exception:

1. Where attached to wood framing systems in the building, the support spacing shall be double the requirements scheduled in NECA 1, where its Table 1 lists maximum spacings less than stated in NFPA 70.
  2. The intent of this exception is to distribute the loading of the raceways on the wood framing system.
- C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with galvanized steel slotted support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
1. Secure raceways and cables to these supports with two-bolt conduit clamps.
- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch (38-mm) and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

### 3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT, IMC, and RMC may be supported by openings through structure members, as permitted in NFPA 70.
- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb (90 kg).
- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
1. To Wood: Fasten with lag screws or through bolts.
  2. To New Concrete: Bolt to concrete inserts.
  3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
  4. To Existing Concrete: Expansion anchor fasteners.
  5. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches (100 mm) thick or greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches (100 mm) thick.
  6. To Steel: Beam clamps (MSS Type 19, 21, 23, 25, or 27) complying with MSS SP-69.
  7. To Light Steel: Sheet metal screws.
  8. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that meet seismic-restraint strength and anchorage requirements.
- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.

### 3.3 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils (0.05 mm).
- B. Touchup: Comply with requirements in Division 09 painting Sections for cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 260529

## SECTION 260533 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes raceways, fittings, boxes, enclosures, and cabinets for electrical wiring.
- B. Refer to Section "Low-Voltage Electrical Power Conductors and Cables" for allowable applications of conduit/raceway vs. MC Cable.

#### 1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. EPDM: Ethylene-propylene-diene terpolymer rubber.
- C. FMC: Flexible metal conduit.
- D. LFMC: Liquidtight flexible metal conduit.
- E. LFNC: Liquidtight flexible nonmetallic conduit.
- F. RMC or GRS: Galvanized rigid metal conduit.

#### 1.4 SUBMITTALS

- A. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- B. Shop Drawings: For the following raceway components. Include plans, elevations, sections, details, and attachments to other work.
  - 1. Custom enclosures and cabinets.
- C. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:
  - 1. Structural members in the paths of conduit groups with common supports.
  - 2. HVAC and plumbing items and architectural features in the paths of conduit groups with common supports.

## 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. Comply with NFPA 70.

## PART 2 - PRODUCTS

### 2.1 METAL CONDUIT AND TUBING

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AFC Cable Systems, Inc.
  - 2. Alflex Inc.
  - 3. Allied Tube & Conduit; a Tyco International Ltd. Co.
  - 4. Maverick Tube Corporation.
  - 5. O-Z Gedney; a unit of General Signal.
  - 6. Wheatland Tube Company.
- B. Rigid Steel Conduit: ANSI C80.1 with threaded fittings.
- C. IMC: ANSI C80.6.
- D. EMT: ANSI C80.3, with compression fittings.
- E. LFMC: Flexible steel conduit with PVC jacket.
- F. Fittings for Conduit (Including all Types and Flexible and Liquidtight), EMT, and Cable: NEMA FB 1; listed for type and size raceway with which used, and for application and environment in which installed.
  - 1. Fittings for EMT: Die-cast, compression type.
  - 2. Fittings for RGS: Threaded type.
- G. Joint Compound for Rigid Steel Conduit or IMC: Listed for use in cable connector assemblies, and compounded for use to lubricate and protect threaded raceway joints from corrosion and enhance their conductivity.

### 2.2 NONMETALLIC CONDUIT AND TUBING

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. AFC Cable Systems, Inc.
  - 2. CANTEX Inc.
  - 3. CertainTeed Corp.; Pipe & Plastics Group.
  - 4. Condux International, Inc.
  - 5. ElecSYS, Inc.
  - 6. Electri-Flex Co.

7. Lamson & Sessions; Carlon Electrical Products.
8. Manhattan/CDT/Cole-Flex.
9. RACO; a Hubbell Company.
10. Thomas & Betts Corporation.

- B. ENT: NEMA TC 13.
- C. RNC: NEMA TC 2, Type PVC Schedule 40, unless otherwise indicated.
- D. LFNC: UL 1660.
- E. Fittings for ENT and RNC: NEMA TC 3; match to conduit or tubing type and material.
- F. Fittings for LFNC: UL 514B.

### 2.3 BOXES, ENCLOSURES, AND CABINETS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Cooper Crouse-Hinds; Div. of Cooper Industries, Inc.
  2. EGS/Appleton Electric.
  3. Erickson Electrical Equipment Company.
  4. Hoffman.
  5. Hubbell Incorporated; Killark Electric Manufacturing Co. Division.
  6. O-Z/Gedney; a unit of General Signal.
  7. RACO; a Hubbell Company.
  8. Spring City Electrical Manufacturing Company.
  9. Thomas & Betts Corporation.
- B. Sheet Metal Outlet and Device Boxes: NEMA OS 1.
- C. Cast-Metal Outlet and Device Boxes: NEMA FB 1, aluminum, Type FD, with gasketed cover.
- D. Nonmetallic Outlet and Device Boxes: NEMA OS 2.
- E. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- F. Cast-Metal Access, Pull, and Junction Boxes: NEMA FB 1, galvanized with gasketed cover.
- G. Hinged-Cover Enclosures: NEMA 250, Type 1, with continuous-hinge cover with flush latch, unless otherwise indicated.
  1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
- H. Cabinets:
  1. NEMA 250, Type 1, galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
  2. Hinged door in front cover with flush latch and concealed hinge.
  3. Key latch to match panelboards.
  4. Metal barriers to separate wiring of different systems and voltage.
  5. Accessory feet where required for freestanding equipment.

## 2.4 SLEEVES FOR RACEWAYS

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch (1.3- or 3.5-mm) thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."

## PART 3 - EXECUTION

### 3.1 RACEWAY APPLICATION

- A. Outdoor: Apply raceway products as specified below, unless otherwise indicated:
  - 1. Exposed Conduit: Rigid steel conduit.
  - 2. Concealed Conduit, Aboveground: Rigid steel conduit.
  - 3. Underground Conduit: RNC, Type EPC-40-PVC, direct buried or concrete encased ductbank as indicated on the drawings.
  - 4. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFNC.
  - 5. Boxes and Enclosures, Aboveground: NEMA 250, Type 4X.
- B. Indoor: Comply with the following indoor applications, unless otherwise indicated; refer also to Section "Low-Voltage Electrical Power Conductors and Cables":
  - 1. For allowable indoor raceways and MC Cable, refer to Section 260519.
  - 2. Indoor conduit for all areas: EMT.
  - 3. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
  - 4. Damp or Wet Locations or in Kitchens: Rigid steel conduit.
  - 5. Raceways for Optical Fiber or Communications Cable in Spaces Used for Environmental Air: EMT.
  - 6. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4X, stainless steel in damp or wet locations.
- C. Minimum Raceway Size: 3/4-inch (21-mm) trade size.
- D. Raceway Fittings: Compatible with raceways and suitable for use and location.
  - 1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings, unless otherwise indicated.
  - 2. Electrical Metallic Tubing: Use die-cast compression fittings.
- E. Install nonferrous conduit or tubing for circuits operating above 60 Hz. Where aluminum raceways are installed for such circuits and pass through concrete, install in nonmetallic sleeve.

- F. Do not install aluminum conduits in contact with concrete.

### 3.2 INSTALLATION

- A. Comply with NECA 1 for installation requirements applicable to products specified in Part 2 except where requirements on Drawings or in this Article are stricter.
- B. Keep raceways at least 6 inches (150 mm) away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Complete raceway installation before starting conductor installation.
- D. Support raceways as specified in Division 26 Section "Hangers and Supports for Electrical Systems."
- E. Arrange stub-ups so curved portions of bends are not visible above the finished slab.
- F. Install no more than the equivalent of three 90-degree bends in any conduit run except for communications conduits, for which fewer bends are allowed.
- G. Conceal conduit and EMT within finished walls, ceilings, and floors, unless otherwise indicated.
- H. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- I. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors, including conductors smaller than No. 4 AWG.
- J. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb (90-kg) tensile strength. Leave at least 12 inches (300 mm) of slack at each end of pull wire.
- K. Raceways for Optical Fiber and Communications Cable: Install raceways, metallic, as follows:
  - 1. Install with a maximum of two 90-degree bends or equivalent for each length of raceway unless Drawings show stricter requirements. Separate lengths with pull or junction boxes or terminations at distribution frames or cabinets where necessary to comply with these requirements.
- L. Install raceway sealing fittings at suitable, approved, and accessible locations and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where otherwise required by NFPA 70.
- M. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block, and install box flush with surface of wall.

### 3.3 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.
- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
- D. Rectangular Sleeve Minimum Metal Thickness:
  - 1. For sleeve cross-section rectangle perimeter less than 50 inches (1270 mm) and no side greater than 16 inches (400 mm), thickness shall be 0.052 inch (1.3 mm).
  - 2. For sleeve cross-section rectangle perimeter equal to, or greater than, 50 inches (1270 mm) and 1 or more sides equal to, or greater than, 16 inches (400 mm), thickness shall be 0.138 inch (3.5 mm).
- E. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
- F. Cut sleeves to length for mounting flush with both surfaces of walls.
- G. Extend sleeves installed in floors 2 inches (50 mm) above finished floor level.
- H. Size pipe sleeves to provide 1/4-inch (6.4-mm) annular clear space between sleeve and raceway unless sleeve seal is to be installed.
- I. Seal space outside of sleeves with grout for penetrations of concrete and masonry.
- J. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway, using joint sealant appropriate for size, depth, and location of joint. Refer to Division 07 Section "Joint Sealants" for materials and installation.
- K. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway penetrations. Install sleeves and seal with firestop materials. Comply with Division 07 Section "Penetration Firestopping."
- L. Roof-Penetration Sleeves: Seal penetration of individual raceways with flexible, boot-type flashing units applied in coordination with roofing work.
- M. Aboveground, Exterior-Wall Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch (25-mm) annular clear space between pipe and sleeve for installing mechanical sleeve seals.
- N. Underground, Exterior-Wall Penetrations: Install cast-iron "wall pipes" for sleeves. Size sleeves to allow for 1-inch (25-mm) annular clear space between raceway and sleeve for installing mechanical sleeve seals.

### 3.4 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section "Penetration Firestopping."

### 3.5 PROTECTION

- A. Provide final protection and maintain conditions that ensure coatings, finishes, and cabinets are without damage or deterioration at time of Substantial Completion.
  - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
  - 2. Repair damage to PVC or paint finishes with matching touchup coating recommended by manufacturer.

END OF SECTION 260533

## SECTION 260553 – IDENTIFICATION FOR ELECTRICAL SYSTEMS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Identification for raceway and metal-clad cable.
  - 2. Identification for conductors and communication and control cable.
  - 3. Warning labels and signs.
  - 4. Instruction signs.
  - 5. Equipment identification labels.
  - 6. Miscellaneous identification products.
  - 7. Self-adhesive labels for all switches and receptacles.

#### 1.3 SUBMITTALS

- A. Product Data: For each electrical identification product indicated.
- B. Identification Schedule: An index of nomenclature of electrical equipment and system components used in identification signs and labels.
- C. Samples: For each type of label and sign to illustrate size, colors, lettering style, mounting provisions, and graphic features of identification products.

#### 1.4 QUALITY ASSURANCE

- A. Comply with ANSI A13.1 and ANSI C2.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.145.

#### 1.5 COORDINATION

- A. Coordinate identification names, abbreviations, colors, and other features with requirements in the Contract Documents, Shop Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual, and with those required by codes, standards, and 29 CFR 1910.145. Use consistent designations throughout Project.

- B. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- C. Coordinate installation of identifying devices with location of access panels and doors.
- D. Install identifying devices before installing acoustical ceilings and similar concealment.

## PART 2 - PRODUCTS

### 2.1 RACEWAY IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.
- B. Color for Printed Legend:
  - 1. Power Circuits: Black letters on an orange field.
  - 2. Emergency Circuits: Black letters on a red field.
  - 3. Legend: Indicate system or service and voltage, if applicable.
- C. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- D. Snap-Around Labels: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeves, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- E. Snap-Around, Color-Coding Bands: Slit, pretensioned, flexible, solid-colored acrylic sleeves, 2 inches (50 mm) long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- F. Self-Adhesive Vinyl Tape: Colored, heavy duty, waterproof, fade resistant; 2 inches (50 mm) wide; compounded for outdoor use.

### 2.2 CONDUCTOR AND COMMUNICATION- AND CONTROL-CABLE IDENTIFICATION MATERIALS

- A. Color-Coding Conductor Tape: Colored, self-adhesive vinyl tape not less than 3 mils (0.08 mm) thick by 1 to 2 inches (25 to 50 mm) wide.
- B. Marker Tapes: Vinyl or vinyl-cloth, self-adhesive wraparound type, with circuit identification legend machine printed by thermal transfer or equivalent process.

### 2.3 WARNING LABELS AND SIGNS

- A. Comply with NFPA 70 and 29 CFR 1910.145.

- B. Self-Adhesive Warning Labels: Factory printed, multicolor, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment, unless otherwise indicated.
- C. Baked-Enamel Warning Signs: Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application. 1/4-inch (6.4-mm) grommets in corners for mounting. Nominal size, 7 by 10 inches (180 by 250 mm).
- D. Warning label and sign shall include, but are not limited to, the following legends:
  - 1. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES (915 MM)."
- E. Multiple Services: Label multiple services in the same building indicating the location of the other service and the purpose of the service.

## 2.4 INSTRUCTION SIGNS

- A. Engraved, laminated acrylic or melamine plastic, minimum 1/16 inch (1.6 mm) thick for signs up to 20 sq. in. (129 sq. cm) and 1/8 inch (3.2 mm) thick for larger sizes.
  - 1. Engraved legend with black letters on white face.
  - 2. Punched or drilled for mechanical fasteners.
  - 3. Framed with mitered acrylic molding and arranged for attachment at applicable equipment.

## 2.5 EQUIPMENT IDENTIFICATION LABELS

- A. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8 inch (10 mm). Overlay shall provide a weatherproof and ultraviolet-resistant seal for label.

## 2.6 MISCELLANEOUS IDENTIFICATION PRODUCTS

- A. Cable Ties: Fungus-inert, self-extinguishing, 1-piece, self-locking, Type 6/6 nylon cable ties.
  - 1. Minimum Width: 3/16 inch (5 mm).
  - 2. Tensile Strength: 50 lb (22.6 kg), minimum.
  - 3. Temperature Range: Minus 40 to plus 185 deg F (Minus 40 to plus 85 deg C).
  - 4. Color: Black, except where used for color-coding.
- B. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

## PART 3 - EXECUTION

### 3.1 APPLICATION

- A. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service and Feeders: Identify with orange self-adhesive vinyl label.

- B. Accessible Raceways and Cables of Auxiliary Systems: Identify the following systems with color-coded, self-adhesive vinyl tape applied in bands or snap-around, color-coding bands:
1. Fire Alarm System: Red.
  2. Fire-Suppression Supervisory and Control System: Red and yellow.
  3. Combined Fire Alarm and Security System: Red and blue.
  4. Security System: Blue and yellow.
  5. Mechanical and Electrical Supervisory System: Green and blue.
  6. Telecommunication System: Green and yellow.
  7. Control Wiring: Green and red.
- C. Power-Circuit Conductor Identification: For primary and secondary conductors No. 1 AWG and larger in vaults, pull and junction boxes, manholes, and handholes use color-coding conductor tape and aluminum wraparound marker labels. Identify source and circuit number of each set of conductors. For all conductor cables, identify phase in addition to the above.
- D. Branch-Circuit Conductor Identification: Where there are conductors for more than three branch circuits in same junction or pull box, use color-coding conductor tape. For all conditions (more than one conductor in a box), identify each ungrounded conductor according to source and circuit number.
- E. Conductors to Be Extended in the Future: Attach write-on tags to conductors and list source and circuit number.
- F. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, signal, sound, intercommunications, voice, and data connections.
1. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, and pull points. Identify by system and circuit designation.
  2. Use system of marker tape designations that is uniform and consistent with system used by manufacturer for factory-installed connections.
  3. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and Operation and Maintenance Manual.
- G. Locations of Underground Lines: Identify with underground-line warning tape for power, lighting, communication, and control wiring and optical fiber cable. Install underground-line warning tape for both direct-buried cables and cables in raceway.
- H. Warning Labels for Indoor Cabinets, Boxes, and Enclosures for Power and Lighting: Comply with 29 CFR 1910.145 and apply baked-enamel warning signs. Identify system voltage with black letters on an orange background. Apply to exterior of door, cover, or other access.
1. Equipment Requiring Workspace Clearance According to NFPA 70: Unless otherwise indicated, apply to door or cover of equipment but not on flush panelboards and similar equipment in finished spaces.
- I. Instruction Signs:
1. Operating Instructions: Install instruction signs to facilitate proper operation and maintenance of electrical systems and items to which they connect. Install instruction signs with approved legend where instructions are needed for system or equipment operation.
- J. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and Operation and Maintenance Manual.

Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm systems unless equipment is provided with its own identification.

1. Labeling Instructions:

- a. Indoor Equipment: Self-adhesive, engraved, laminated acrylic or melamine label. Unless otherwise indicated, provide a single line of text with 1/2-inch- (13-mm-) high letters on 1-1/2-inch- (38-mm-) high label; where 2 lines of text are required, use labels 2 inches (50 mm) high.
- b. Outdoor Equipment: Engraved, laminated acrylic or melamine label.
- c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.

2. Equipment to Be Labeled:

- a. Panelboards, electrical cabinets, and enclosures, including panel source and circuit number.
- b. Access doors and panels for concealed electrical items.
- c. Electrical switchgear and switchboards, including panel source and circuit number.
- d. Transformers, including panel source and circuit number.
- e. Electrical substations.
- f. Emergency system boxes and enclosures.
- g. Motor-control centers.
- h. Disconnect switches, including panel source and circuit number.
- i. Enclosed circuit breakers, including panel source and circuit number.
- j. Motor starters and drives, including panel source and circuit number.
- k. Push-button stations.
- l. Power transfer equipment.
- m. Contactors.
- n. Remote-controlled switches, dimmer modules, and control devices, including panel source and circuit number.
- o. Battery inverter units.
- p. Battery racks.
- q. Power-generating units.
- r. Voice and data cable terminal equipment.
- s. Master clock and program equipment.
- t. Intercommunication and call system master and staff stations.
- u. Television/audio components, racks, and controls.
- v. Fire-alarm control panel and annunciators, including panel source and circuit number
- w. Fire alarm initiation and notification devices shall have a clear, self-adhesive label applied that contains minimum 10 pt black lettering indicating the SLC or NAC panel loop number and address or number of the device.
- x. Security and intrusion-detection control stations, control panels, terminal cabinets, and racks.
- y. CCTV systems.
- z. Monitoring and control equipment.
- aa. Uninterruptible power supply equipment.
- bb. Terminals, racks, and patch panels for voice and data communication and for signal and control functions.
- cc. Junction boxes with panel source and circuit number(s).
- dd. Receptacles and switches, including panel source and circuit number. Minimum 10 pt font. See 3.2.K below for additional requirements.

### 3.2 INSTALLATION

- A. Verify identity of each item before installing identification products.
- B. Location: Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment.
- C. Apply identification devices to surfaces that require finish after completing finish work.
- D. Self-Adhesive Identification Products: Clean surfaces before application, using materials and methods recommended by manufacturer of identification device.
- E. Attach non-adhesive signs and plastic labels with screws and auxiliary hardware appropriate to the location and substrate.
- F. System Identification Color Banding for Raceways and Cables: Each color band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot (15-m) maximum intervals in straight runs, and at 25-foot (7.6-m) maximum intervals in congested areas.
- G. Color-Coding for Phase and Voltage Level Identification, 600 V and Less: Use the colors listed below for ungrounded service, feeder, and branch-circuit conductors.
  - 1. Color shall be factory applied or, for sizes larger than No. 10 AWG if authorities having jurisdiction permit, field applied.
  - 2. Colors for 208/120-V Circuits:
    - a. Phase A: Black.
    - b. Phase B: Red.
    - c. Phase C: Blue.
  - 3. Colors for 480/277-V Circuits:
    - a. Phase A: Brown.
    - b. Phase B: Orange.
    - c. Phase C: Yellow.
  - 4. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches (150 mm) from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.
- H. Aluminum Wraparound Marker Labels and Metal Tags: Secure tight to surface of conductor or cable at a location with high visibility and accessibility.
- I. Underground-Line Warning Tape: During backfilling of trenches install continuous underground-line warning tape directly above line at 6 to 8 inches (150 to 200 mm) below finished grade. Use multiple tapes where width of multiple lines installed in a common trench or concrete envelope exceeds 16 inches (400 mm) overall.
- J. Painted Identification: Prepare surface and apply paint according to Division 09 painting Sections.

- K. For all Receptacles and switches, provide the following labeling: Provide clear, self adhesive label on all faceplates with 10 pt black lettering identifying the panel source and circuit number.
  
- L. For all mechanical and plumbing equipment, provide the following labeling:
  - 1. Indoor: Provide clear, self-adhesive label with minimum 10 pt black lettering identifying the panel source and circuit number.
  - 2. Outdoor: Provide engraved label with minimum 14 pt black lettering on a white background identifying the panel source and circuit number.

END OF SECTION 260553

## SECTION 262416 - PANELBOARDS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS:

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division-01 Specification sections, apply to work of this section.
- B. Requirements specified in all other sections of Division 26 apply to this Section.

#### 1.2 SUMMARY:

- A. Extent of panelboard, load-center and enclosure work, including cabinets and cutout boxes, is indicated by drawings and schedules, and as specified herein.
- B. Types of panelboards and enclosures required for the project include the following:
  - 1. Power-distribution panelboards.
  - 2. Lighting and appliance panelboards.
- C. Refer to other Division-26 sections for wires/cables, electrical boxes and fittings, and raceway work required in conjunction with installation of panelboards and enclosures.
- D. Wires/cables, electrical boxes and fittings, and raceways required in conjunction with the installation of panelboards and enclosures are specified in other Division-26 sections.

#### 1.3 SUBMITTALS:

- A. Product Data: Submit manufacturer's data on panelboards and enclosures.
- B. Wiring Diagrams: Submit wiring diagrams for panelboards showing connections to electrical power feeders and distribution branches.

#### 1.4 QUALITY ASSURANCE:

- A. Installer's Qualifications: A firm with at least 3 years of successful installation experience on projects utilizing panelboards similar to those required for this project.
- B. Codes and Standards:
  - 1. Electrical Code Compliance: Comply with applicable local code requirements of the authority having jurisdiction and NEC Article 384 as applicable to installation, and construction of electrical panelboards and enclosures.
  - 2. UL Compliance: Comply with applicable requirements of UL 67, "Electric Panelboards," and UL's 50, 869, 486A, 486B, and 1053 pertaining to panelboards, accessories and enclosures. Provide panelboard units which are UL-listed and labeled.
  - 3. Special-Use Markings: Provide panelboards, constructed for special-use, with

appropriate UL markings which indicate that they are suitable for special type of use/application.

4. NEMA Compliance: Comply with NEMA Stds Pub/No. 250, "Enclosures for Electrical Equipment (1000 Volts Maximum)," Pub/No. PB 1, "Panelboards," and Pub/No. PB 1.1, "Instructions for Safe Installation, Operation and Maintenance of Panelboards Rated 600 Volts or Less."

- C. Federal Specification Compliance: Comply with FS W-P-115, "Power Distribution Panel", pertaining to panelboards and accessories.

## 1.5 SEQUENCING AND SCHEDULING:

- A. Coordinate installation of panelboards and enclosures with installation of wires/cables, electrical boxes and fittings, and raceway work.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS:

- A. Manufacturers: Subject to compliance with requirements, provide panelboard products manufactured by:
  1. Square D Co.
  2. General Electric Co.
  3. Cutler- Hammer / Eaton Electrical

### 2.2 PANELBOARDS:

- A. General: Except as otherwise indicated, provide panelboards, enclosures and ancillary components, of types, sizes, and ratings indicated, which comply with manufacturer's standard materials; with the design and construction in accordance with published product information; equip with proper number of unit panelboard devices as required for complete installation. Where types, sizes, or ratings are not indicated, comply with NEC, UL and established industry standards for those applications indicated.
- B. Overcurrent Protective Devices (OCPDs): Provide type, rating, and features as indicated. Comply with Division 26 Section "Overcurrent Protective Devices," with OCPDs adapted to panelboard installation. Tandem circuit breakers shall not be used. Multipole breakers shall have common trip.
- C. Equipment Ground Bus: Adequate for feeder and branch-circuit equipment ground conductors. Bonded to box.
- D. Provision for Future Devices: Equip with mounting brackets, bus connections, and necessary appurtenances, for the OCPD ampere ratings indicated for future installation of devices.
- E. Feed-Through Lugs: Sized to accommodate feeders indicated.
- F. Double-Main Lugs: Sized to accommodate feeders indicated. Provide custom sizes separate from the integral main circuit breakers with internal factory wiring from the double main lugs to the integral main circuit breaker.

G. Special Features: Provide the following features for panelboards as indicated.

1. Split Bus: Vertical bus of indicated panels divided into two vertical sections with connections as indicated. Provide split bus panels for Normal -Emergency Loads, where indicated.
2. Contactors in Panels: Mechanically held, with current rating, poles, and connections as indicated.
3. All Panelboards and distribution boards: Provide both enclosure fronts and doors with full piano type hinges.

## 2.3 DISTRIBUTION PANELBOARDS

A. Branch-Circuit Breakers: Use bolt-on breakers.

1. Power Distribution Panelboards General: Provide dead-front safety type power distribution panelboards as indicated, with panelboard switching and protective devices in quantities, ratings, types, and with arrangement shown; with anti-turn solderless pressure type main lug connectors approved for use with copper conductors. Equip with copper bus bars with not less than 98-percent conductivity, and with full-sized neutral bus; provide suitable lugs on neutral bus for outgoing feeders requiring neutral connections. Provide molded-case main and branch circuit-breaker types for each circuit, with toggle handles that indicate when tripped. Where multiple-pole breakers are indicated, provide with common trip so overload on one pole will trip all poles simultaneously. Provide panelboards with bare uninsulated grounding bars suitable for bolting to enclosures. Select enclosures fabricated by same manufacturer as panelboards, which mate and match properly with panelboards. Provide enclosure fronts and doors with full piano type hinges.

B. Distribution panelboards shall be equal to Square D I-Line Power Distribution Panelboards. Power Distribution Panelboards shall be rated minimum R.M.S. Symmetrical as noted on the drawings for the 277/480 Volt and 120/208 Volt panelboards.

C.. Panelboard Enclosures: Provide galvanized sheet steel cabinet type enclosures, in sizes and NEMA types as indicated, code-gage, minimum 16-gage thickness. Construct with multiple knockouts and wiring gutters. Provide fronts with full piano hinge, and doors with flush locks, piano hinge and keys, all panelboard enclosures keyed alike, with concealed piano door hinges and door swings as indicated. Equip with interior circuit-directory frame, and card with clear plastic covering. Provide baked gray enamel finish over a rust inhibitor coating. Design enclosures for recessed mounting, where indicated. Provide enclosures which are fabricated by same manufacturer as panelboards, which mate and match properly with panelboards to be enclosed.

D. Special Features:

1. Surge Protection Devices (SPD): 120kA minimum, UL 1449 3<sup>rd</sup> edition compliant, bus connected without leads.
2. 84, 56 or 42 pole panelboards as shown on the contract drawings.
3. Arc-Flash labels: Provide an arc-flash label for the exterior of each panelboard.
4. Provide phase label color code chart for each panelboard to comply with the NEC.

## 2.4 LIGHTING AND APPLIANCE BRANCH CIRCUIT PANELBOARDS

A. Branch OCPDs: Bolt-on circuit breakers, replaceable without disturbing adjacent units.

- B. Lighting and Appliance Panelboards General: Provide dead-front safety type lighting and appliance panelboards as indicated, with switching and protective devices in quantities, ratings, types and arrangements shown; with anti-burn solderless pressure type lug connectors approved for use with copper conductors; construct unit for connecting feeders at top of panel; equip with copper bus bars, full-sized neutral bar, with bolt-in type heavy-duty, quick-make, quick-break, single-pole circuit-breakers, with toggle handles that indicate when tripped. Provide suitable lugs on neutral bus for each outgoing feeder required; and provide bare uninsulated grounding bars suitable for bolting to enclosures. Select enclosures fabricated by same manufacturer as panelboards, which mate and match properly with panelboards.
1. Panelboard Enclosures: Provide galvanized sheet steel cabinet type enclosures, in sizes and NEMA types as indicated, code-gage, minimum 16-gage thickness. Construct with multiple knockouts and wiring gutters. Provide fronts with piano hinge, and doors with piano hinge, flush locks and keys, all panelboard enclosures keyed alike, with concealed piano door hinges and door swings as indicated. Equip with interior circuit-directory frame, and card with clear plastic covering. Provide baked gray enamel finish over a rust inhibitor coating. Design enclosures for recessed mounting. Provide enclosures which are fabricated by same manufacturer as panelboards, which mate and match properly with panelboards to be enclosed. Provide enclosure fronts and doors with full piano type hinges.
- C. Double-Width Panels: Where more than 42 poles are indicated or where otherwise indicated, provide two panelboards connected by feed-thru lugs. Contractor shall provide wire and conduit between panels equal to the main incoming feeders.
- D. Doors: In panel front, with concealed hinges. Secure with flush catch and tumbler lock, all keyed alike.
- E. Molded-Case Circuit Breakers: Provide factory-assembled, molded-case circuit breakers of frame sizes, characteristics, and ratings including RMS symmetrical interrupting ratings indicated. Select breakers with permanent thermal and instantaneous magnetic trip, and with fault-current limiting protection, ampere ratings as indicated. Construct with overcenter, trip-free, toggle-type operating mechanisms with quick-make, quick-break action and positive handle trip indication. Construct breakers for mounting and operating in any physical position, and operating in an ambient temperature of 40 deg C. Provide breakers with mechanical screw type removable connector lugs, AL/CU rated.
- F. Panelboards shall be made by Square D, type NF. Panelboards shall be rated minimum R.M.S. Symmetrical as shown on the drawings for the 277/480V.
- G. Panelboards shall be made by Square D, type NQ. Panelboards shall be rated minimum R.M.S. Symmetrical as shown on the drawings for the 120/208V panelboards.
- H. Accessories: Provide panelboard accessories and devices including, but not necessarily limited to, time-delay type fuses, ground-fault protection units, etc., as recommended by panelboard manufacturer for ratings and applications indicated.
- I. Special Features:
1. Provide bus-mounted 120kA Surge Protection Device (SPD), UL 1449, 3<sup>rd</sup> edition listed, in panels, where noted on the drawings.
  2. Provide enclosure fronts with full piano hinges and doors within the fronts with full piano

- hinges. Secure fronts with standard manufacturer fastening devices.
3. 84, 56, or 42 pole panelboards as shown on the contract drawings.
  4. Arc-Flash labels: Provide an arc-flash label for the exterior of each panelboard.
  5. Provide phase label color code chart for each panelboard to comply with the NEC.

### PART 3 - EXECUTION

#### 3.1 EXAMINATION:

- A. Examine areas and conditions under which panelboards and enclosures are to be installed, and notify Contractor in writing of conditions detrimental to proper completion of work. Do not proceed with work until unsatisfactory conditions have been corrected in a manner acceptable to Installer.

#### 3.2 INSTALLATION OF PANELBOARDS:

- A. Install panelboards and enclosures as indicated, in accordance with manufacturer's written instructions, applicable requirements of NEC standards and NECA's "Standards of Installation," and in compliance with recognized industry practices to ensure that products fulfill requirements.
- B. Ground Fault Protection: Install panelboard ground fault circuit interrupter devices in accordance with installation guidelines of NEMA 289, "Application Guide for Ground Fault Circuit Interrupters."
- C. Tighten connectors and terminals, including screws and bolts, in accordance with equipment manufacturer's published torque values for equipment connectors. Where manufacturer's torquing requirements are not indicated, tighten connectors and terminals to comply with tightening torques specified in UL Stds 486A and B.
- D. Fasten enclosures firmly to walls and structural surfaces, ensuring that they are permanently and mechanically anchored.
- E. Provide properly wired electrical connections for panelboards within enclosures.
- F. Fill out panelboard's circuit directory card upon completion of installation work.
- G. Provision for Future Circuits at Flush Panelboards: Stub four 1-inch empty conduits from panel into accessible ceiling space.

#### 3.3 GROUNDING:

- A. Provide equipment grounding connections for panelboard enclosures as indicated. Tighten connections to comply with tightening torques specified in UL 486A to assure permanent and effective grounds.

#### 3.4 FIELD QUALITY CONTROL:

- A. Prior to energization of electrical circuitry, check all accessible connections to manufacturer's tightening torque specifications.
- B. Prior to energization of panelboards, check with ground resistance tester phase-to-phase and phase-to-ground insulation resistance levels to ensure requirements are fulfilled.

- C. Prior to energization, check panelboards for electrical continuity of circuits, and for short-circuits.

3.5 ADJUSTING AND CLEANING:

- A. Adjust operating mechanisms for free mechanical movement.
- B. Touch-up scratched or marred surfaces to match original finishes.

3.6 DEMONSTRATION:

- A. Subsequent to wire and cable hook-ups, energize panelboards and demonstrate functioning in accordance with requirements. Where necessary, correct malfunctioning units, and then retest to demonstrate compliance.

END OF SECTION 262416

## SECTION 262726– WIRING DEVICES

### PART 1 – GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this and the other sections of Division 26.
- B. Requirements specified in all other sections of Division 26 apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Receptacles
  - 2. Plugs and Plug Connectors
  - 3. Snap Switches
  - 4. Ground Fault Circuit Interrupter Receptacles
  - 5. Wall Plates
- B. Related Sections: The following sections contain requirements that relate to this section:
  - 1. Division 26 Section "Electrical Identification" for requirements for labels on wall plates.

#### 1.3 SUBMITTALS

- A. Product data for each type of product specified.
- B. Samples of those products indicated for sample submission in Architect's comments on product data submittal. Include color and finish samples of device plates and other items per Architect's request.

#### 1.4 QUALITY ASSURANCE

- A. Regulatory Requirements: Comply with provisions of the following codes.
- B. NFPA 70 "National Electrical Code".
  - 1. UL and NEMA Compliance: Provide wiring devices which are listed and labeled by UL and comply with applicable UL and NEMA standards.

### PART 2 - PRODUCTS

#### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Hubbell Inc.
  - 2. Leviton.

3. Pass and Seymour Inc.

## 2.2 WIRING DEVICES:

- A. General: Provide wiring devices, in types, characteristics, grades, colors, and electrical ratings for applications indicated which are UL listed and which comply with NEMA WD 1 and other applicable UL and NEMA standards. Verify color selections with Architect.
- B. Receptacles: Comply with UL 498 and NEMA WD 1. Where not otherwise indicated, provide 20A heavy duty, specification grade tamper-resistant receptacles. Provide receptacles equal to Hubbell Wiring Devices BR20TR series. Verify color selections with Architect.
- C. Where receptacles are wired to normal/emergency or emergency only circuits, provide red colored receptacles, with ratings equal to above.
- D. Receptacles, Industrial Heavy Duty: Provide pin and sleeve design receptacles conforming to UL 498. Provide features indicated.
- E. Ground-Fault Interrupter (GFI) Receptacles: Provide weather-resistant, tamper-resistant, "feed-thru" type ground-fault circuit interrupter, with integral commercial heavy-duty NEMA 5-20R duplex receptacles arranged to protect connected downstream receptacles on same circuit. Provide unit designed for installation in a 2-3/4 inch deep outlet box without adapter, grounding type, Class A, Group 1, per UL Standard 943. Provide receptacles equal to Hubbell Wiring Devices GFTWRST20 series, which comply with 2015 UL 943 for self-testing requirements. Verify color selections with Architect.
- F. Recessed receptacle for wall mounted projectors and clocks: Provide recessed receptacle, 20A rated, tamper-resistant, 2 pole, 3 wire, grounding, with side wire terminations. Provide receptacles equal to Hubbell Wiring Device-Kellems RR201CHSSTR. Verify color selections with Architect.
- G. Plugs: 15-amperes, 125-volts, 3-wire, grounding, armored cap plugs, parallel blades with cord clamp, and 0.4 inch cord hole; match NEMA configuration with power source's.
- H. Plug Connectors: 15-amperes, 125-volts, bakelite-body armored connectors, 3-wire, grounding, parallel blades, double wipe contact, with cord clamp, and 0.4 inch cord hole, match NEMA configuration to mating plug's. Arrange as indicated.
- I. Snap Switches: quiet type AC switches as indicated in Table 2 in Part 3 below. Comply with UL 20 and NEMA WD1. Where not otherwise indicated, provide 20A industrial/institutional heavy duty grade switches.
  1. Standard Toggle: Provide Hubbell Wiring Device-Kellems 122\*-I (\* - single pole, double pole, three-way and four-way as required) series or approved equal with colors as selected by the Architect.
  2. Piloted Toggle: Provide Hubbell Wiring Device-Kellems HBL122\*PL (\* - single pole, three-way and four-way as required) or approved equal with colors as selected by the Architect.
  3. Standard Key: Hubbell Wiring Device-Kellems HBL122\*LI with HBL1209 key for locking (\* - single pole, double pole, three-way and four-way as required) series or approved equal with colors as selected by the Architect

## 2.3 WIRING DEVICE ACCESSORIES

- A. Wall plates: single and combination, of types, sizes, and with ganging and cutouts as indicated. Provide plates which mate and match with wiring devices to which attached. Provide metal screws for securing plates to devices with screw heads colored to match finish of plates. Provide wall plate color to match wiring devices except as otherwise indicated. Provide wall plates with engraved legend where indicated. Conform to requirements of Section "Electrical Identification." Provide plates possessing the following additional construction features:
1. Material and Finish: 0.04 inch thick, type 302 satin finished stainless steel.
  2. Outdoor covers & material for Wet Locations: Cast Aluminum with spring-loaded lift cover, and listed and labeled for use in "wet locations." Provide gray while-in-use cover MX2480S by Hubbell Taymac or approved equal for roof locations. All other locations provide clear horizontal Arlington DBH\*1C. Coordinate mounting types with GC.

## PART 3 - EXECUTION

### 3.1 INSTALLATION OF WIRING DEVICES AND ACCESSORIES:

- A. Install wiring devices and accessories as indicated, in accordance with manufacturer's written instructions, applicable requirements of NEC and in accordance with recognized industry practices to fulfill project requirements.
- B. Coordinate with other Work, including painting, electrical boxes and wiring installations, as necessary to interface installation of wiring devices with other Work.
- C. Install wiring devices only in electrical boxes which are clean; free from building materials, dirt, and debris.
- D. Install wiring devices after wiring work is completed.
- E. Install wall plates after painting work is completed.
- F. Tighten connectors and terminals, including screws and bolts, in accordance with equipment manufacturer's published torque tightening values for wiring devices. Where manufacturer's torquing requirements are not indicated, tighten connectors and terminals to comply with tightening torques specified in UL Standard 486A. Use properly scaled torque indicating hand tool.

### 3.2 PROTECTION

- A. Protect installed components from damage. Replace damaged items prior to final acceptance.

### 3.3 FIELD QUALITY CONTROL

- A. Testing: Prior to energizing circuits, test wiring for electrical continuity, and for short-circuits. Ensure proper polarity of connections is maintained. Subsequent to energizing, test wiring devices and demonstrate compliance with requirements, operating each operable device at least six times.
- B. Test ground fault interrupter operation with both local and remote fault simulations in accordance with manufacturer recommendations.

END OF SECTION 262726

## SECTION 262816 – ENCLOSED SWITCHES AND CIRCUIT BREAKERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes individually mounted enclosed switches and circuit breakers used for the following:
  - 1. Feeder and branch-circuit protection.
  - 2. Motor and equipment disconnecting means.
- B. Related Sections include the following:
  - 1. Division 26 Section "Wiring Devices" for attachment plugs, receptacles, and toggle switches used for disconnecting means.

#### 1.3 DEFINITIONS

- A. GFCI: Ground-fault circuit interrupter.
- B. RMS: Root mean square.
- C. SPDT: Single pole, double throw.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of switch, circuit breaker, accessory, and component indicated. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.
- B. Shop Drawings: For each switch and circuit breaker.
  - 1. Dimensioned plans, elevations, sections, and details, including required clearances and service space around equipment. Show tabulations of installed devices, equipment features, and ratings. Include the following:
    - a. Enclosure types and details for types other than NEMA 250, Type 1.
    - b. Current and voltage ratings.
    - c. Short-circuit current rating.
    - d. UL listing for series rating of installed devices.
    - e. Features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.

2. Wiring Diagrams: Power, signal, and control wiring. Differentiate between manufacturer-installed and field-installed wiring.
- C. Qualification Data: Submit data for testing agencies indicating that they comply with qualifications specified in "Quality Assurance" Article.
- D. Field Test Reports: Submit written test reports and include the following:
  1. Test procedures used.
  2. Test results that comply with requirements.
  3. Results of failed tests and corrective action taken to achieve test results that comply with requirements.
- E. Manufacturer's field service report.
- F. Maintenance Data: For enclosed switches and circuit breakers and for components to include in maintenance manuals specified in Division 01. In addition to requirements specified in Division 01 Section "Closeout Procedures," include the following:
  1. Routine maintenance requirements for components.
  2. Manufacturer's written instructions for testing and adjusting switches and circuit breakers.
  3. Time-current curves, including selectable ranges for each type of circuit breaker.

## 1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: Testing agency that is a member company of the InterNational Electrical Testing Association and that is acceptable to authorities having jurisdiction.
  1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association or National Institute for Certification in Engineering Technologies to supervise on-site testing specified in Part 3.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NEMA AB 1 and NEMA KS 1.
- D. Comply with NFPA 70.
- E. Product Selection for Restricted Space: Drawings indicate maximum dimensions for enclosed switches and circuit breakers, including clearances between enclosures, and adjacent surfaces and other items. Comply with indicated maximum dimensions.

## 1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Rate equipment for continuous operation under the following conditions, unless otherwise indicated:
  1. Ambient Temperature: Not less than minus 22 deg F (minus 30 deg C) and not exceeding 104 deg F (40 deg C).
  2. Altitude: Not exceeding 6600 feet (2000 m).

## 1.7 COORDINATION

- A. Coordinate layout and installation of switches, circuit breakers, and components with other construction, including conduit, piping, equipment, and adjacent surfaces. Maintain required workspace clearances and required clearances for equipment access doors and panels.

## 1.8 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Spares: For the following:
    - a. Potential Transformer Fuses: One for every 10 installed; minimum of 3.
    - b. Control-Power Fuses: One for every 10 installed; minimum of 3.
    - c. Fuses and Fusible Devices for Fused Circuit Breakers: One for every 10 installed; minimum of 3.
    - d. Fuses for Fused Switches: One for every 10 installed; minimum of 3.
    - e. Fuses for Fused Power-Circuit Devices: One for every 10 installed; minimum of 3.
  - 2. Spare Indicating Lights: Six of each type installed.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Fusible Switches:
    - a. Eaton Corp.; Cutler-Hammer Products.
    - b. General Electric Co.; Electrical Distribution & Control Division.
    - c. Square D Co.
  - 2. Molded-Case Circuit Breakers:
    - a. Eaton Corp.; Cutler-Hammer Products.
    - b. General Electric Co.; Electrical Distribution & Control Division.
    - c. Square D Co.
  - 3. Combination Circuit Breaker and Ground-Fault Trip:
    - a. Eaton Corp.; Cutler-Hammer Products.
    - b. General Electric Co.; Electrical Distribution & Control Division.
    - c. Square D Co.

### 2.2 ENCLOSED SWITCHES

- A. Enclosed, Nonfusible Switch: NEMA KS 1, Type HD, with lockable handle.

- B. Enclosed, Fusible Switch, 800 A and Smaller: NEMA KS 1, Type HD, with clips to accommodate specified fuses, lockable handle with two padlocks, and interlocked with cover in closed position.
- C. Elevators: Provide (2) NO/NC contacts where indicated and for all disconnects in an elevator machine room.

## 2.3 ENCLOSED CIRCUIT BREAKERS

- A. Molded-Case Circuit Breaker: NEMA AB 1, with interrupting capacity to meet available fault currents.
  - 1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
  - 2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
  - 3. Electronic Trip Unit Circuit Breakers: RMS sensing; field-replaceable rating plug; with the following field-adjustable settings:
    - a. Instantaneous trip.
    - b. Long- and short-time pickup levels.
    - c. Long- and short-time time adjustments.
    - d. Ground-fault pickup level, time delay, and  $I^2t$  response.
  - 4. GFCI Circuit Breakers: Single- and two-pole configurations with 5-mA trip sensitivity.
  - 5. Molded-Case Switch: Molded-case circuit breaker without trip units.
  - 6. Shunt-Trip: Integral shunt-trip module within the Molded-case circuit breaker.
- B. Molded-Case Circuit-Breaker Features and Accessories: Standard frame sizes, trip ratings, and number of poles.
  - 1. Lugs: Mechanical style suitable for number, size, trip ratings, and material of conductors.
  - 2. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HACR for heating, air-conditioning, and refrigerating equipment.
  - 3. Ground-Fault Protection: Integrally mounted relay and trip unit with adjustable pickup and time-delay settings, push-to-test feature, and ground-fault indicator.

## 2.4 ENCLOSURES

- A. NEMA AB 1 and NEMA KS 1 to meet environmental conditions of installed location.
  - 1. Outdoor Locations: NEMA 250, Type 3R.
  - 2. Kitchen Areas: NEMA 250, Type 4X, stainless steel.
  - 3. Other Wet or Damp Indoor Locations: NEMA 250, Type 4.
  - 4. Hazardous Areas Indicated on Drawings: NEMA 250, Type 7C.

## 2.5 FACTORY FINISHES

- A. Manufacturer's standard prime-coat finish ready for field painting.

- B. Finish: Manufacturer's standard grey paint applied to factory-assembled and -tested enclosures before shipping.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine elements and surfaces to receive enclosed switches and circuit breakers for compliance with installation tolerances and other conditions affecting performance.
  - 1. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Temporary Lifting Provisions: Remove temporary lifting eyes, channels, and brackets and temporary blocking of moving parts from enclosures and components.

### 3.3 IDENTIFICATION

- A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs as specified in Division 26 Section "Identification for Electrical Systems."
- B. Enclosure Nameplates: Label each enclosure with engraved metal or laminated-plastic nameplate mounted with corrosion-resistant screws.

### 3.4 CONNECTIONS

- A. Install equipment grounding connections for switches and circuit breakers with ground continuity to main electrical ground bus.
- B. Install power wiring. Install wiring between switches and circuit breakers, and control and indication devices.
- C. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.

### 3.5 FIELD QUALITY CONTROL

- A. Prepare for acceptance tests as follows:
  - 1. Test insulation resistance for each enclosed switch, circuit breaker, component, and control circuit.
  - 2. Test continuity of each line- and load-side circuit.
- B. Testing Agency: Engage a qualified independent testing agency to perform specified testing.

- C. Testing: After installing enclosed switches and circuit breakers and after electrical circuitry has been energized, demonstrate product capability and compliance with requirements.
  - 1. Procedures: Perform each visual and mechanical inspection and electrical test indicated in NETA ATS, Section 7.5 for switches and Section 7.6 for molded-case circuit breakers. Certify compliance with test parameters.
  - 2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.

### 3.6 ADJUSTING

- A. Set field-adjustable switches and circuit-breaker trip ranges.

### 3.7 CLEANING

- A. On completion of installation, inspect interior and exterior of enclosures. Remove paint splatters and other spots. Vacuum dirt and debris; do not use compressed air to assist in cleaning. Repair exposed surfaces to match original finish.

END OF SECTION 262816

## SECTION 265119 - LED INTERIOR LIGHTING

### PART 1 - GENERAL

#### 1.1 SUMMARY

A. Section includes the following:

1. Materials.
2. Finishes.
3. Luminaire support.

B. Related Requirements:

1. Section 260923 "Lighting Control Devices" for automatic control of lighting, including time switches, photoelectric relays, occupancy sensors, and multipole lighting relay panes, and architectural dimming systems and for LED dimming controls with dimming drivers specified in interior lighting Sections.
2. Refer to Lighting Fixture Schedule on Contract Drawings.

#### 1.2 DEFINITIONS

- A. CCT: Correlated color temperature.
- B. CRI: Color Rendering Index.
- C. Fixture: See "Luminaire."
- D. IP: International Protection or Ingress Protection Rating.
- E. LED: Light-emitting diode.
- F. Lumen: Measured output of lamp and luminaire, or both.
- G. Luminaire: Complete lighting unit, including lamp, reflector, and housing.

#### 1.3 ACTION SUBMITTALS

A. Product Data: For each type of product, arranged by designation.

B. Shop Drawings: For nonstandard or custom luminaires.

1. Include plans, elevations, sections, and mounting and attachment details.
2. Include details of luminaire assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
3. Include diagrams for power, signal, and control wiring.

C. Product Schedule: For luminaires and lamps. Use same designations indicated on Drawings.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Reflected ceiling plan(s) and other details, drawn to scale and coordinated with each other, using input from installers of the items involved:
- B. Seismic Qualification Certificates: For luminaires, accessories, and components, from manufacturer.
- C. Product Certificates: For each type of luminaire.
- D. Sample warranty.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

#### 1.6 WARRANTY

- A. Warranty: Manufacturer and Installer agree to repair or replace components of luminaires that fail in materials or workmanship within specified warranty period.
- B. Warranty Period: 5 years from date of Substantial Completion.

### PART 2 - PRODUCTS

#### 2.1 LUMINAIRE REQUIREMENTS

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Standards:
  - 1. ENERGY STAR certified.
  - 2. California Title 24 compliant.
  - 3. NRTL Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by an NRTL.
  - 4. FM Global Compliance: Luminaires for hazardous locations shall be listed and labeled for indicated class and division of hazard by FM Global.
  - 5. UL Listing: Listed for damp location.
  - 6. Recessed luminaires shall comply with NEMA LE 4.
- C. CRI of minimum 80. CCT, as noted in Lighting Fixture Schedule.
- D. Rated lamp life of 50,000 hours to L70.
- E. Lamps dimmable from 100 percent to 10 percent of maximum light output in classrooms and common spaces. Lecture Hall fixture shall be dimmable from 100 percent to 1 percent.
- F. Internal driver, unless otherwise noted.

- G. Nominal Operating Voltage: As noted in Lighting Fixture Schedule.
  - 1. Lens Thickness: At least 0.125 inch (3.175 mm) minimum unless otherwise indicated.

## 2.2 MATERIALS

- A. Metal Parts:
  - 1. Free of burrs and sharp corners and edges.
  - 2. Sheet metal components shall be steel unless otherwise indicated.
  - 3. Form and support to prevent warping and sagging
- B. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.
- C. Diffusers, and Globes:
  - 1. [Retain "Acrylic" Subparagraph below if acrylic options in "Diffusers and Globes" Paragraph above are retained.
  - 2. Acrylic: One hundred percent virgin acrylic plastic, with high resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
  - 3. Glass: Annealed crystal glass unless otherwise indicated.

## 2.3 METAL FINISHES

- A. Variations in finishes are unacceptable in the same piece. Variations in finishes of adjoining components are acceptable if they are within the range of approved Samples and if they can be and are assembled or installed to minimize contrast.

## 2.4 LUMINAIRE SUPPORT

- A. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for channel and angle iron supports and nonmetallic channel and angle supports.
- B. Single-Stem Hangers: 1/2-inch (13-mm) steel tubing with swivel ball fittings and ceiling canopy. Finish same as luminaire.
- C. Wires: ASTM A 641/A 641 M, Class 3, soft temper, zinc-coated steel, 12 gage (2.68 mm).
- D. Rod Hangers: 3/16-inch (5-mm) minimum diameter, cadmium-plated, threaded steel rod.
- E. Hook Hangers: Integrated assembly matched to luminaire, line voltage, and equipment with threaded attachment, cord, and locking-type plug.

## 2.5 LIGHTING FIXTURE SCHEDULE

- A. General: Various fixture types required are indicated below. Fixtures must comply with minimum requirements as stated herein. Review architectural drawings and specifications to

verify ceiling types, modules, suspension systems appropriate to installation. In general, where so noted, substitutions for different type of fixture will be acceptable, based only on the alternate manufacturer listed for the specific fixture type, and on objective criteria as submitted in accordance with Instructions to the Bidders.

- B. A contractor submitted shop drawing for the lighting fixtures, stamped as Approved by the contractor, constitutes that the contractor has reviewed, coordinated and approved all information (number and quantity of switching devices, ceiling types, wiring schemes, etc.) on the Electrical and Architectural drawings.
- C. Refer to the contract drawings for the lighting fixture schedule.
  - 1. **Model numbers are shown for information only. The written description for each fixture shall supersede the model number. It shall be the contractor's responsibility to verify all model numbers. All final fixture finishes shall be selected by the Architect prior to fixture approval. Contractor shall bid on the most expensive finish available for each fixture, unless otherwise noted.**

### PART 3 - EXECUTION

#### 3.1 INSTALLATION

- A. Comply with NECA 1.
- B. Install luminaires level, plumb, and square with ceilings and walls unless otherwise indicated.
- C. Install lamps in each luminaire.
- D. Supports: Sized and rated for luminaire weight.
- E. Flush-Mounted Luminaire Support: Secured to outlet box.
- F. Wall-Mounted Luminaire Support:
  - 1. Do not attach luminaires directly to gypsum board.
- G. Suspended Luminaire Support:
  - 1. Pendants and Rods: Where longer than 48 inches (1200 mm), brace to limit swinging.
  - 2. Stem-Mounted, Single-Unit Luminaires: Suspend with twin-stem hangers. Support with approved outlet box and accessories that hold stem and provide damping of luminaire oscillations. Support outlet box vertically to building structure using approved devices.
  - 3. Continuous Rows of Luminaires: Use tubing or stem for wiring at one point and tubing or rod, wire support for suspension for each unit length of luminaire chassis, including one at each end.
  - 4. Do not use ceiling grid as support for pendant luminaires. Connect support wires or rods to building structure.
- H. Ceiling-Grid-Mounted Luminaires:
  - 1. Secure to any required outlet box.

2. Secure luminaire using approved fasteners in a minimum of four locations, spaced near corners of luminaire.
    - I. Comply with requirements in Section 260519 "Low-Voltage Electrical Power Conductors and Cables" for wiring connections.
    - J. Identify system components, wiring, cabling, and terminals. Comply with requirements for identification specified in Section 260553 "Identification for Electrical Systems."
- 3.2 FIELD QUALITY CONTROL
- A. Perform the following tests and inspections:
    1. Operational Test: After installing luminaires, switches, and accessories, and after electrical circuitry has been energized, test units to confirm proper operation.
    2. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery power and retransfer to normal.
  - B. Luminaire will be considered defective if it does not pass operation tests and inspections.
  - C. Prepare test and inspection reports.

END OF SECTION 265119

## SECTION 284700 –FIRE ALARM SYSTEMS

### PART 1 – GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this and the other sections of Division 26.
- B. Requirements specified in all other sections of Division 26 apply to this Section.

#### 1.2 SUMMARY

- A. Work covered by this section includes the furnishing of labor, equipment, and materials for modification of existing fire alarm system as indicated on the drawings and specifications. Owner's vendor, Wayman Fire Protection, 888-492-9626.
- B. Intent is for the contractor to add new devices to the existing fire alarm system. Carbon monoxide detection in multi-criteria detectors should alarm the system, not cause a supervisory signal. Shop drawings should show new wiring.
- C. Existing fire alarm control panel is:
  - 1. Bozorth Hall: Edwards EST3 panel.
  - 2. Hawthorn Hall: Edwards iO series panel.
- D. The Fire Alarm System shall consist of all necessary hardware equipment and software programming to perform the following functions:
  - 1. SLC loop expansion with addressable detectors.
  - 2. Field labeling: Each initiation and notification device shall have a clear, self-adhesive label applied that contains minimum 10 pt black lettering indicating the SLC or NAC panel loop number and address or number of the device.
  - 3. A final fire alarm shop drawing as-built will be required at the completion of construction. This as-built must show all devices, their address (NAC or SLC) and the wiring configuration; wiring configuration means to show the notification and initiation wiring sequence from device to device, not the actual wiring location in the building.

#### 1.3 ACCEPTABLE MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Edwards (Existing fire alarm control panels)

#### 1.4 CODES

- A. The system and all associated operations shall be in accordance with the following:
1. Guidelines of the following Building Code: IBC 2021.
  2. NFPA 72, National Fire Alarm Code 2019
  3. NFPA 70, National Electrical Code 2020
  4. NFPA 101, Life Safety Code
  5. NFPA 90A, Standard for the Installation of Air Conditioning and Ventilating Systems
  6. Other applicable NFPA standards
  7. Local Jurisdictional Adopted Codes and Standards
  8. ADA Accessibility Guidelines

#### 1.5 SYSTEM DESCRIPTION

- A. Wiring/Signal Transmission:
1. Transmission shall be addressable signal transmission, dedicated to fire alarm service only.
  2. System connections for initiating (signaling) circuits and notification appliance circuits shall be Class B.
  3. Circuit Supervision: Circuit faults shall be indicated by a trouble signal at the FACP. Provide a distinctive indicating audible tone and alphanumeric annunciation.

#### 1.6 SUBMITTALS

- A. General: Submit the following according to Conditions of Contract and Division 01 Specification Sections.
1. Product data sheets for system components highlighted to indicate the specific products, features, or functions required to meet this specification. Alternate or as-equal products submitted under this contract must provide a detailed line-by-line comparison of how the submitted product meets, exceeds, or does not comply with this specification.
  2. Wiring diagrams from manufacturer.
  3. Shop drawings: Provide shop drawings showing equipment/device locations and connecting wiring of entire fire alarm system. Include wiring and riser diagrams, the candela values for all strobes and full battery & voltage drop calculations for the system. The shop drawings are required to be signed and sealed (both digitally signed and embossed) by a NJ Professional Engineer due to the need to submit to the NJ DCA.
  4. System Power and battery charts with performance graphs and voltage drop calculations to assure that the system will operate per the prescribed backup time periods and under all voltage conditions per all applicable standards.
  5. Provide copies of NICET Level II Fire Alarm certifications for at least two (2) technicians assigned to this project.
  6. System operation description including method of operation and supervision of each

type of circuit and sequence of operations for all manually and automatically initiated system inputs and outputs. A list of all input and output points in the system shall be provided with a label indicating location or use of SLC, NAC, RAC, Sensor, and auxiliary control circuits.

7. Operation and maintenance data for inclusion in Operating and Maintenance Manual. Include data for each type product, including all features and operating sequences, both automatic and manual. Provide the names, addresses, and telephone numbers of service organizations.
8. Record of field tests of system.
9. Record Shop Drawings: A final fire alarm mass notification shop drawing as-built will be required at each building at the completion of construction. This as-built must show all devices, their address (NAC or SLC) and the wiring configuration; wiring configuration means to show the notification and initiation wiring sequence from device to device, not the actual wiring location in the building. The goal is to have an accurate shop drawing showing how the fire alarm and mass notification system is wired in the building.

#### 1.7 QUALITY ASSURANCE

- A. Installer Qualifications: A factory authorized installer is to perform the work of this section.
- B. The system controls shall be UL listed for Power Limited Applications per NEC 760. All circuits must be marked in accordance with NEC article 760-23.
- C. Installer's Qualifications: Firm with at least 5 years of successful installation experience on projects with fire alarm systems work similar to that required for this project. At least one NICET Level 2 technician shall be on site at all times during the fire alarm installation. The installer shall have a NICET Level 3 technician visit the site at least one time per week during the fire alarm installation to review and approve the installation.
  1. Firm with manufacturer's factory trained personnel.
  2. Firm with factory authorized service organization and spare parts stock.
  3. All control equipment must have transient protection devices to comply with UL 864 requirements. In addition to the UL-UOJZ requirement mentioned above, the system controls shall be UL listed for Power Limited Applications per NEC 760. All circuits must be marked in accordance with NEC article 760-23.
- D. Each and all items of the Fire Alarm System shall be listed as a product of a single fire alarm system manufacturer under the appropriate category by Underwriters Laboratories, Inc. (UL), and shall bear the "UL" label.

#### 1.8 EXTRA MATERIALS

- A. General: Furnish extra materials, packaged with protective covering for storage, and identified with labels clearly describing contents as follows:
  1. Smoke, Carbon Monoxide and Heat Detectors: Furnish quantity equal to 5 percent of the number of units of each type installed but not less than two of each type.

## 1.9 WARRANTY

- A. The Contractor shall provide the Owner with a 2-year warranty on all materials, labor and systems from the date of Substantial Completion. The date of Substantial completion will be as set in a letter issued by the Architect – no exceptions.

## PART 2 – PRODUCTS

### 2.1 COMPONENTS

- A. Intelligent Devices — General: Each remote device shall have a microprocessor with non-volatile memory to support its functionality and serviceability. Each device shall store as required for its functionality the following data: device serial number, device address, device type, personality code, date of manufacture, hours in use, time and date of last alarm, amount of environmental compensation left/used, last maintenance date, job/project number, current detector sensitivity values, diagnostic information (trouble codes) and algorithms required to process sensor data and perform communications with the loop controller. Each device shall be capable of electronic addressing, either automatically or application programmed assigned, to support physical/electrical mapping and supervision by location. Setting a device's address by physical means shall not be necessary.
- B. Intelligent Detectors — General: The System Intelligent Detectors shall be capable of full digital communications using both broadcast and polling protocol. Each detector shall be capable of performing independent fire detection algorithms. The fire detection algorithm shall measure sensor signal dimensions, time patterns and combine different fire parameters to increase reliability and distinguish real fire conditions from unwanted deceptive nuisance alarms. Signal patterns that are not typical of fires shall be eliminated by digital filters. Devices not capable of combining different fire parameters or employing digital filters shall not be acceptable. Each detector shall have an integral microprocessor capable of making alarm decisions based on fire parameter information stored in the detector head. Distributed intelligence shall improve response time by decreasing the data flow between detector and analog loop controller. Detectors not capable of making independent alarm decisions shall not be acceptable. Maximum total analog loop response time for detectors changing state shall be 0.5 seconds. Each detector shall have a separate means of displaying communication and alarm status. A green LED shall flash to confirm communication with the analog loop controller. A red LED shall flash to display alarm status. The detector shall be capable of identifying up to 32 diagnostic codes. This information shall be available for system maintenance. The diagnostic code shall be stored at the detector. Each smoke detector shall be capable of transmitting pre-alarm and alarm signals in addition to the normal, trouble and need cleaning information. It shall be possible to program control panel activity to each level. Each smoke detector may be individually programmed to operate at any one of five (5) sensitivity settings. Each detector microprocessor shall contain an environmental compensation algorithm that identifies and sets ambient "Environmental Thresholds" approximately six times an hour. The microprocessor shall continually monitor the environmental impact of temperature, humidity, other contaminants as well as detector aging. The process shall employ digital compensation to adapt the detector to both 24-hour long term and 4-hour short-term environmental changes. The microprocessor shall monitor the environmental compensation value and alert the system operator when the detector approaches 80% and 100% of the allowable environmental compensation value. Differential sensing algorithms shall maintain a constant differential between selected detector sensitivity and the "learned" base line sensitivity. The base line sensitivity

information shall be updated and permanently stored at the detector approximately once every hour. The intelligent analog detectors shall be suitable for mounting on any Signature Series detector mounting base.

- C. Intelligent Modules — General: It shall be possible to address each Intelligent Signature Series module without the use of DIP or rotary switches. Devices using DIP switches for addressing shall not be acceptable. The personality of multifunction modules shall be programmable at site to suit conditions and may be changed at any time using a personality code downloaded from the Analog Loop Controller. Modules requiring EPROM, PROM, ROM changes or DIP switch and/or jumper changes shall not be acceptable. The modules shall have a minimum of 2 diagnostic LEDs mounted behind a finished cover plate. A green LED shall flash to confirm communication with the loop controller. A red LED shall flash to display alarm status. The module shall be capable of storing up to 24 diagnostic codes which can be retrieved for troubleshooting assistance. Input and output circuit wiring shall be supervised for open and ground faults. The module shall be suitable for operation in the following environment: Temperature: 32oF to 120oF (0oC to 49oC), Humidity: 0-93% RH, non-condensing.
- D. Single Input Module, SIGA-CT1 (Waterflow Detectors, Tamper Switches etc.): Provide intelligent single input modules SIGA-CT1. The Single Input Module shall provide one (1) supervised Class B input circuit capable of a minimum of 4 personalities, each with a distinct operation. The module shall be suitable for mounting on North American 2 ½” (64mm) deep 1-gang boxes and 1 ½” (38mm) deep 4” square boxes with 1-gang covers. The single input module shall support the following circuit types: Normally-Open Alarm Latching (Manual Stations, Heat Detectors, etc.), Normally-Open Alarm Delayed Latching (Waterflow Switches), Normally-Open Active Non-Latching (Monitor, Fans, Dampers, Doors, etc.), Normally-Open Active Latching (Supervisory, Tamper Switches).
- E. Dual Input Module, SIGA-CT2: Provide intelligent dual input modules SIGA-CT2. The Dual Input Module shall provide two (2) supervised Class B input circuits each capable of a minimum of 4 personalities, each with a distinct operation. The module shall be suitable for mounting on North American 2 ½” deep 1-gang boxes and 1 ½” (38mm) deep 4” square boxes with 1-gang covers. The dual input module shall support the following circuit types: Normally-Open Alarm Latching (Manual Stations, Heat Detectors, etc.), Normally-Open Alarm Delayed Latching (Waterflow Switches), Normally-Open Active Non-Latching (Monitor, Fans, Dampers, Doors, etc.), Normally-Open Active Latching (Supervisory, Tamper Switches).
- F. Single Input Signal Module, SIGA-CC1: Provide intelligent single input signal modules SIGA-CC1. The Single Input (Single Riser Select) Signal Module shall provide one (1) supervised Class B output circuit capable of a minimum of 2 personalities, each with a distinct operation. When selected as a telephone power selector, the module shall be capable of generating its own “ring tone”. The module shall be suitable for mounting on North American 2 ½” (64mm) deep 2-gang boxes and 1 ½” (38mm) deep 4” square boxes with 2-gang covers, or European 100mm square boxes. The single input signal module shall support the following operations: Audible/Visible Signal Power Selector (Polarized 24 Vdc @ 2A).
- G. Control Relay Module, SIGA-CR: Provide intelligent control relay modules SIGA-CR. The Control Relay Module shall provide one form “R” dry relay contact rated at 2 amps @ 24 Vdc to control external appliances or equipment shutdown. The control relay shall be rated for pilot duty and releasing systems. The position of the relay contact shall be confirmed by the system firmware. The control relay module shall be suitable for mounting on North American 2 ½” (64mm) deep 1-gang boxes and 1 ½” deep 4” square boxes with 1-gang covers.

## 2.2 OTHER DETECTION SYSTEMS

- A. CO and combination CO/Smoke detectors: Where shown on the drawings, provide and install a carbon monoxide or a combination carbon monoxide/smoke detector. Detectors shall be addressable and similar to the addressable detectors specified above.

## 2.3 BATTERIES

- A. The battery shall have sufficient capacity to power the fire alarm system for not less than twenty-four hours plus 5 minutes of alarm upon a normal AC power failure.
- B. The batteries are to be completely maintenance free. No liquids are required. Fluid level checks for refilling, spills, and leakage shall not be required.
- C. If necessary to meet standby requirements, external battery and charger systems may be used.

## PART 3 – EXECUTION

### 3.1 INSTALLATION, GENERAL

- A. Install system components and all associated devices in accordance with applicable NFPA Standards and manufacturer's recommendations.
- B. Installation personnel shall be supervised by persons who are qualified and experienced in the installation, inspection, and testing of fire alarm systems. Examples of qualified personnel shall include, but not be limited to, the following:
  - 1. Factory trained and certified personnel.
  - 2. National Institute of Certification in Engineering Technologies (NICET) fire alarm level II certified personnel.
  - 3. Personnel licensed or certified by state or local authority.

### 3.2 EQUIPMENT INSTALLATION

- A. Furnish and install a complete Fire Alarm & Voice Evacuation System as described herein and as shown on the plans. Include sufficient control unit(s), annunciator(s), manual stations, automatic fire detectors, smoke detectors, audible and visible notification appliances, wiring, terminations, electrical boxes, and all other necessary material for a complete operating system.
- B. Water-Flow and Valve Supervisory Switches: Connect for each sprinkler valve required to be supervised.
- C. Device Location-Indicating Lights: Locate in the public space immediately adjacent to the device they monitor.
- D. Label all fire alarm devices with the initiation circuit and device number as well as the notification circuit and device number. All labeling shall exactly match the as-built shop drawings, which shall be submitted with the O&M manuals.

- E. Each of the following types of devices or equipment shall be provided with supervised circuits as shown on the drawings but shall be typically as follows:
  - 1. Sprinkler Valve Supervisory Switches: Provide one (1) supervisory module circuit for each sprinkler valve supervisory switch.
  - 2. When waterflow and tamper switches exist at the same location, provide one (1) dual input addressable module. When odd numbers of devices exist at a single location, provide additional single input addressable modules.
  
- F. Each of the following types of alarm notification appliances shall be circuited as shown on the drawings but shall be typically as follows:
  - 1. Audible Signals: Provide sufficient spare capacity to assure that the addition of five (5) audible devices can be supported without the need for addition control components (power supplies, signal circuit modules, amplifiers, batteries, etc.)
  - 2. Visual Signals Provide sufficient spare capacity to assure that the addition of three (3) visual devices can be supported without the need for addition control components (power supplies, signal circuit modules, batteries, etc.)

### 3.3 WIRING INSTALLATION

- A. System Wiring: Wire and cable shall be MC cable type FPLP and shall be acceptable to the Authority Having Jurisdiction (AHJ) and shall be installed in accordance with the appropriate articles from the current approved edition of NFPA 70: National Electric Code (NEC). Refer to Division 26 Section "Low Voltage Electrical Power Conductors and Cables" for acceptable locations for type MC cable vs. individual conductors in raceway – provide fire alarm wiring in conduit in Boiler Rooms, penthouses, electrical rooms, sprinkler rooms, public areas with exposed ceilings, above non-accessible ceilings, in block walls, and the like.
  - 1. Standard FPLP or FPLR cabling shall not be used. See MC cable FPLP requirements above.
  
- B. Each addressable analog loop shall be circuited so device loading is not to exceed 80% of loop capacity in order to leave for space for future devices. The loop shall have Class A operation. Isolation protection between every 50 devices is not required, as it is removed in NFPA 72.
  
- C. Contractor shall obtain from the Fire Alarm System Manufacturer written instruction regarding the appropriate wire/cable sizes and types (shielded and non-shielded) to be used for this installation. No deviation from the written instruction shall be made by the Contractor without the prior written approval of the Fire Alarm System Manufacturer.
  
- D. Color Coding: Color-code fire alarm conductors differently from the normal building power wiring. Paint fire alarm system junction boxes and covers red.

### 3.4 FIELD QUALITY CONTROL

- A. Manufacturer's Field Services: Provide services of a factory-authorized service representative to supervise the field assembly and connection of components and the pretesting, testing, and adjustment of the system.
  
- B. Service personnel shall be qualified and experienced in the inspection, testing, and

maintenance of fire alarm systems. Examples of qualified personnel shall be permitted to include, but shall not be limited to, individuals with the following qualifications:

1. Factory trained and certified.
  2. National Institute for Certification in Engineering Technologies (NICET) fire alarm certified.
  3. International Municipal Signal Association (IMSA) fire alarm certified.
  4. Certified by a state or local authority.
  5. Trained and qualified personnel employed by an organization listed by a national testing laboratory for the servicing of fire alarm systems.
- C. Pretesting: Determine, through pretesting, the conformance of the system to the requirements of the Drawings and Specifications. Correct deficiencies observed in pretesting. Replace malfunctioning or damaged items with new and retest until satisfactory performance and conditions are achieved.
- D. Final Test Notice: Provide a 10-day minimum notice in writing when the system is ready for final acceptance testing.
- E. Minimum System Tests: Test the system according to the procedures outlined in NFPA 72.
- F. Retesting: Correct deficiencies indicated by tests and completely retest work affected by such deficiencies. Verify by the system test that the total system meets the Specifications and complies with applicable standards.
- G. Report of Tests and Inspections: Provide a written record of inspections, tests, and detailed test results in the form of a test log.
- H. Final Test, Certificate of Completion, and Certificate of Occupancy:
1. Test the system as required by the Authority Having Jurisdiction in order to obtain a certificate of occupancy.

### 3.5 CLEANING AND ADJUSTING

- A. Cleaning: Remove paint splatters and other spots, dirt, and debris. Clean unit internally using methods and materials recommended by manufacturer.
- B. Occupancy Adjustments: When requested within one year of date of Substantial Completion, provide on-site assistance in adjusting sound levels and adjusting controls and sensitivities to suit actual occupied conditions. Provide up to three visits to the site for this purpose.

### 3.6 TRAINING

- A. Provide the services of a factory-authorized service representative to demonstrate the system and train Owner's maintenance personnel as specified below.
1. Train Owner's maintenance personnel in the procedures and schedules involved in operating, troubleshooting, servicing, and preventive maintaining of the system.
  2. Schedule training with the Owner at least seven days in advance.

END OF SECTION 284700



Department of Community Affairs  
Construction Project Review

Project No: AC-045-26

Partial Release

BLDG INTERIOR

Frank Felice

Released: 4/1/2026

N.J.S.A. 52:27D-119 ET SEQ., AS AMENDED



## **Boiler Project at Bozorth Hall and Hawthorn Hall**

**PROJECT MANUAL**

**PROJECT NO. 77267**

**March 6, 2026**

**Engineer:**

**Schiller and Hersh Associates, Inc.**

**636 Skippack Pike, Suite 200**

**Blue Bell, PA 19422**

**T: 215-886-8947**

**Project #2566A**

---

Richard L. Delp, P.E.  
NJ Professional Engineer  
NO. GE45368

## ROWAN UNIVERSITY

### TABLE OF CONTENTS

#### INSTRUCTIONS TO BIDDERS AND GENERAL CONDITIONS

SECTION I	Construction Contract	Pages 1 – 10
SECTION II	Exhibit A: Insurance and Bonds	Pages 1 - 8
SECTION III	General Conditions	Pages 1 - 55
SECTION IV	<u>Forms</u>	
	Allowance Authorization Form	Page 1
	Allowance Charge Request Form	Page 1
	Request for Information Form	Page 1
	Change Order Request Form	Page 1
	Change Order Form	Page 1
	Hourly Labor Rate Breakdown Form	Page 1
	Daily Job Report Form	Page 1
	Application and Certificate for Payment Form (AIA G702)	Pages 1 - 2
	Attachment to G702 Certification For Payment	Pages 1 - 2
	Contractor's Partial or Final Release And Waiver of Liens	Page 1
	Rowan Tax Exempt Letter	Page 1
	Consent of Surety Company to Final Payment (AIA G707)	Page 1

#### DIVISION 01 GENERAL REQUIREMENTS

<u>SECTION</u>	
011000	Summary of Work
011400	Work Restrictions
012100	Allowances
012200	Unit Price (NOT INCLUDED / USED)
012300	Alternates (NOT INCLUDED / USED)
012400	Procedures and Controls
012500	Contract Modification Procedures
012900	Payment Procedures
013100	Coordination
013200	Construction Progress Schedule
013300	Submittal Procedures
014000	Quality Control Requirements
014100	Testing Services
014523	Testing & Inspections
014200	Reference Standards
015000	Construction Facilities & Temporary Controls
016000	Product Requirements
016350	Substitution Procedures
017000	Execution Requirements
017700	Contract Closeout
017820	Operation and Maintenance Data
018200	Demonstration and Training

## TECHNICAL SPECIFICATIONS

### DIVISION 04 MASONRY

#### SECTION

042000 Unit Masonry

### DIVISION 07 THERMAL AND MOISTURE PROTECTION

#### SECTION

078100 Sprayed Fire-Resistive Materials  
078413 Firestops and Smoke Seals  
079200 Joint Sealers

### DIVISION 08 OPENINGS

#### SECTION

081113 Hollow Metal Doors and Frames  
083113 Access Doors and Frames  
087100 Door Hardware

### DIVISION 09 FINISHES

#### SECTION

0929000 Gypsum Drywall  
099000 Painting

### DIVISION 10 SPECIALTIES

#### SECTION

104416 Fire Extinguishers

### DIVISION 23 MECHANICAL

#### SECTION

230000 Mechanical Summary of Work  
230500 Common Work Results for HVAC  
230513 Common Motor Requirements for HVAC Equipment  
230519 Meters and Gauges for HVAC Piping  
230523 General-Duty Valves for Piping  
230529 Hangers and Supports for HVAC Piping and Equipment  
230553 Identification for HVAC Piping and Equipment  
230593 Testing, Adjusting, and Balancing for HVAC  
230700 HVAC Insulation  
230900 Instrumentation and Control for HVAC  
231123 Facility Natural Gas Piping  
232113 Hydronic Piping  
232123 Hydronic Pumps  
232223 Steam Condensate Pumps  
233113 Metal Ducts  
233300 Air Duct Accessories  
233423 HVAC Power Ventilators  
235100 Breechings, Chimneys and Stacks  
235216 Condensing Boilers  
235218 Wall Mounted Condensing Boilers  
238239 Unit Heaters

DIVISION 26 ELECTRICAL

SECTION

260000	Electrical Summary of Work
260500	Common Work Results for Electrical
260519	Low Voltage Electrical Power Conductors and Cables
260526	Grounding and Bonding for Electrical Systems
260529	Hangers and Supports for Electrical Systems
260533	Raceways and Boxes for Electrical Systems
260553	Identification for Electrical Systems
262416	Panelboards
262726	Wiring Devices
262816	Enclosed Switches and Circuit Breakers
265119	LED Interior Lighting

DIVISION 28 ELECTRONIC SAFETY AND SECURITY

SECTION

284700	Fire Alarm System
--------	-------------------

END OF SECTION

## SECTION 230000 – MECHANICAL SUMMARY OF WORK

### PART 1 – GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of Contract, including General and Supplementary Conditions and other Divisions Specification Sections, apply to this Section.
- B. The requirements of all other sections of Division 23 apply to this section.

#### 1.2 WARRANTY FOR PROJECT

- A. The Contractor shall provide the Owner with a 2-year warranty on all materials, labor and systems from the date of Substantial Completion. The date of Substantial completion will be as set in a letter issued by the Architect – no exceptions.

#### 1.3 DEFINITIONS

- A. For a complete list of definitions for this contract refer to the Division 1 specifications.
- B. Provide: Means to provide, install and make the equipment/system completely functional and operational with testing, commissioning and training.
- C. Install: Means to provide, install and make the equipment/system completely functional and operational with testing, commissioning and training.

#### 1.4 SCOPE OF WORK

- A. The following description of work will use the following abbreviations:
  - 1. General Contractor – GC
  - 2. Electrical Contractor – EC
  - 3. Mechanical Contractor (HVAC) – MC
- B. Work Included: It is the intent of these specifications and the accompanying drawings that the Contractor shall, unless otherwise specified herein, furnish all labor, materials, tools, and equipment necessary, together with the necessary accessories to constitute a satisfactory and complete installation, to complete the installation of the mechanical work, as indicated on the drawings and described hereinafter. The Contractor shall properly install, equip, adjust and put in perfect condition, the respective portions of the work specified, and to so interconnect the various items or sections of the work to form a complete and properly operating whole. The work shall consist of, but shall not necessarily be limited to the following:
  - 1. For detailed scope of work for each mechanical system, refer to the respective Division 23 specification sections.
  - 2. Provide demolition of materials indicated on the drawings.
  - 3. Remove heat exchangers and all associated, hot water piping, steam piping shown. Remove associated drain piping, condensate pumps, vent piping and controls as noted on the contract documents.
  - 4. Remove all heating hot water piping and steam piping to points indicated including valves, hangers, supports, appurtenances and associated hangers, supports and insulation shown on the drawings.

5. Remove hot water and chilled water pumps and all associated, hot water piping, chilled water piping to limits shown. Remove associated supports and controls as noted on the contract documents.
  6. Remove exhaust fans and all associated supports and controls as noted on the contract documents.
  7. Provide unit heaters and all associated hot water piping and controls as noted on the contract documents.
  8. Provide and install new exhaust fans and associated ductwork, hangers, supports, dampers, and controls and wiring.
  9. Provide and install boiler systems and all associated hot water piping and gas piping. Provide associated pumps, expansion tanks, air separators, breeching and controls as noted on the contract documents.
  10. Provide and install pressure motive condensate pump, flash tank and all associated, steam and condensate piping. Provide associated supports, valves and controls as noted on the contract documents.
  11. Provide all new piping, ductwork, & equipment insulation.
  12. Provide complete system balancing at the completion of the project per contract specifications.
  13. Provide all associated control equipment required unless otherwise noted.
  14. Providing all necessary permits, approvals, fees, etc.
  15. Provide instructions to the owner as outlined in these Specifications.
  16. Provide all cutting and patching as required to perform the work of this contract.
  17. Provide all necessary rigging as required to perform the work of this contract.
  18. Provide manufacturer startup for all systems specified as outlined in these Specifications.
  19. Provide removal of trash and general clean-up.
  20. Provide as-built drawings.
  21. Provide operation and maintenance manuals.
  22. Employ the services of the local Underwriters' Inspection Agency and pay for all associated fees.
  23. Completion Date: All HVAC work shall be completed on the date of substantial completion for the project as set in the Division 1 specifications.
- C. The work shall include all materials, equipment and systems shown on the drawings and work for other Divisions required to complete all the work ready for operation.
- D. The Contractor shall provide all labor, material, equipment and services for the complete and proper installation and operation of the electrical work as indicated, required or implied by the drawings and as specified herein.
- E. All of the specifications listed and all of the drawings listed are part of the Contract Documents of the Contractor. The Contractor shall review all drawings and specification divisions to determine the full scope of his work.
- F. It will be the responsibility of the Contractor to examine all Drawings (Architectural, Structural, Mechanical, Electrical and Plumbing) to determine the full extent of the work. All field measurements and verifications of conditions and materials will be the obligation of the Contractor. The submission of a Proposal by the Contractor will be considered an indication that all work, in compliance with these specifications and the drawings, has been included in the Proposal. It will also be considered an indication that a thorough review of conditions, materials, and all related specifications have been investigated by the Contractor, and the results of such investigations have been included in the Contractor's Proposal.
- G. Coordination Between Mechanical (MC), Electrical (EC) and Plumbing (PC) Contractors:
1. The Electrical Contractor shall:

- a. Receive and set the motor starters as provide by the Mechanical and Plumbing Contractors.
  - b. Provide power wiring, including final connection of same, from source to starters or contactors to motors.
  - c. Receive and install the wall-mounted electrical control devices, thermal switches, etc., and provide all wiring for same.
  - d. Provide all fused or unfused disconnect switches and circuit breakers not supplied as part of the HVAC system and as required by the National Electrical Code, or as shown on the drawings, or as specified.
  - e. Adjust connections to electrical motors to insure proper rotation.
  - f. Provide duct detectors and tubes to the MC for installation in the ductwork. EC shall wire and program the duct detectors and remote test stations into the fire alarm system.
2. The Mechanical Contractor will:
- a. Furnish and set all motors for mechanical equipment.
  - b. Furnish all motor starters, starter/disconnects, HVAC unit mounted disconnects, contactors, pushbuttons and switches for local and remote control of all HVAC equipment and turn over to the Electrical Contractor for installation.
  - c. Provide pre-wired control panels, including relays, switches, pilot lights, etc., all as shown and/or specified, complete with wiring to numbered terminal strips.
  - d. Furnish and install duct and pipe-mounted control devices, such as freezestats, aquastats, flow switches, etc.
  - e. Furnish wiring diagrams for the systems, in sufficient time to allow roughing-in of conduit in accordance with the proposed work schedule.
  - f. Provide all control wiring including 120V controls, 120V power and 120/24V control power transformers as required for a complete and fully functional HVAC DDC control system.

#### 1.5 WARRANTY

- A. Contractors shall note that all equipment warranties, as described in the various sections of the Specifications, will begin after Substantial Completion. It will not make any difference when equipment is ordered, delivered or installed, warranties will commence after the Architect issues his letter of "Substantial Completion."
- B. All equipment is to include factory start-up unless the Contractor receives written permission, from the owner, for Contractor start-up. Copies of the start-up report must be included with the Request for Final Payment, otherwise final payment will be withheld until the factory reports are submitted.
- C. All equipment furnished for this Owner shall include a one-year warranty on parts and labor. This warranty shall supercede all notations in all the other Division 23 specification sections.

PART 2 - PRODUCTS (Not applicable).

PART 3 - EXECUTION (Not applicable).

END OF SECTION 230000

## SECTION 230500 – COMMON WORK RESULTS FOR HVAC

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  1. Sleeves.
  2. Grout.
  3. Equipment installation requirements common to equipment sections.
  4. Painting and finishing.
  5. Supports and anchorages.
  6. Concrete Bases

#### 1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and chases.
- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.
- F. The following are industry abbreviations for plastic materials:
  1. CPVC: Chlorinated polyvinyl chloride plastic.
  2. PE: Polyethylene plastic.
  3. PVC: Polyvinyl chloride plastic.
- G. The following are industry abbreviations for rubber materials:
  1. EPDM: Ethylene-propylene-diene terpolymer rubber.
  2. NBR: Acrylonitrile-butadiene rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For the following:
  - 1. Transition fittings.
  - 2. Dielectric fittings.
  - 3. Mechanical sleeve seals.
  - 4. Escutcheons.
- B. Welding certificates.

#### 1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
- B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."
  - 1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
  - 2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- C. Electrical Characteristics for HVAC Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.

#### 1.7 COORDINATION

- A. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for HVAC installations.
- B. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.
- C. Coordinate requirements for access panels and doors for HVAC items requiring access that are concealed behind finished surfaces. Access panels and doors are specified in Division 08 Section "Access Doors and Frames."

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the manufacturers specified.
  2. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

### 2.2 JOINING MATERIALS

- A. Refer to individual Division 23 piping Sections for special joining materials not listed below.
- B. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch (3.2-mm) maximum thickness unless thickness or specific material is indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
  2. AWWA C110, rubber, flat face, 1/8 inch (3.2 mm) thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.
- C. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- D. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.
- E. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- F. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAg1, silver alloy for refrigerant piping, unless otherwise indicated.
- G. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- H. Solvent Cements for Joining Plastic Piping:
1. CPVC Piping: ASTM F 493.
  2. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
- I. Fiberglass Pipe Adhesive: As furnished or recommended by pipe manufacturer.

## 2.3 SLEEVES

- A. Galvanized-Steel Sheet: 0.0239-inch (0.6-mm) minimum thickness; round tube closed with welded longitudinal joint.

## 2.4 GROUT

- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
  - 1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
  - 2. Design Mix: 5000-psi (34.5-MPa), 28-day compressive strength.
  - 3. Packaging: Premixed and factory packaged.

## PART 3 - EXECUTION

### 3.1 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install HVAC equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.
- D. Install equipment to allow right of way for piping installed at required slope.

### 3.2 PAINTING

- A. Painting of HVAC systems, equipment, and components is specified in Division 09 Sections "Interior Painting" and "Exterior Painting."
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

### 3.3 ERECTION OF METAL SUPPORTS AND ANCHORAGES

- A. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor HVAC materials and equipment.
- B. Field Welding: Comply with AWS D1.1.

### 3.4 GROUTING

- A. Mix and install grout for HVAC equipment base bearing surfaces, pump and other equipment base plates, and anchors.
- B. Clean surfaces that will come into contact with grout.
- C. Provide forms as required for placement of grout.
- D. Avoid air entrapment during placement of grout.
- E. Place grout, completely filling equipment bases.
- F. Place grout on concrete bases and provide smooth bearing surface for equipment.
- G. Place grout around anchors.
- H. Cure placed grout.

### 3.5 CONCRETE BASES

- A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions.
  - 1. Construct concrete bases of dimensions indicated, but not less than 4 inches larger in both directions than supported unit.
  - 2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of the base.
  - 3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
  - 4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  - 5. Install anchor bolts to elevations required for proper attachment to supported equipment.
  - 6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
  - 7. Use 3000-psi, 28-day compressive-strength concrete and reinforcement.

END OF SECTION 230500

## SECTION 230513 – COMMON MOTOR REQUIREMENTS FOR HVAC EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes general requirements for single-phase and polyphase, general-purpose, horizontal, small and medium, squirrel-cage induction motors for use on ac power systems up to 600 V and installed at equipment manufacturer's factory or shipped separately by equipment manufacturer for field installation.

#### 1.3 COORDINATION

- A. Coordinate features of motors, installed units, and accessory devices to be compatible with the following:
  - 1. Motor controllers.
  - 2. Torque, speed, and horsepower requirements of the load.
  - 3. Ratings and characteristics of supply circuit and required control sequence.
  - 4. Ambient and environmental conditions of installation location.

### PART 2 - PRODUCTS

#### 2.1 GENERAL MOTOR REQUIREMENTS

- A. Comply with requirements in this Section except when stricter requirements are specified in HVAC equipment schedules or Sections.
- B. Comply with NEMA MG 1 unless otherwise indicated.
- C. Comply with IEEE 841 for severe-duty motors.

#### 2.2 MOTOR CHARACTERISTICS

- A. Duty: Continuous duty at ambient temperature of 40 deg C and at altitude of 3300 feet above sea level.
- B. Capacity and Torque Characteristics: Sufficient to start, accelerate, and operate connected loads at designated speeds, at installed altitude and environment, with indicated operating sequence, and without exceeding nameplate ratings or considering service factor.

## 2.3 POLYPHASE MOTORS

- A. Description: NEMA MG 1, Design B, medium induction motor.
- B. Efficiency: Energy efficient, as defined in NEMA MG 1.
- C. Service Factor: 1.15.
- D. Multispeed Motors: Variable torque.
  - 1. For motors with 2:1 speed ratio, consequent pole, single winding.
  - 2. For motors with other than 2:1 speed ratio, separate winding for each speed.
- E. Multispeed Motors: Separate winding for each speed.
- F. Rotor: Random-wound, squirrel cage.
- G. Bearings: Regreasable, shielded, antifriction ball bearings suitable for radial and thrust loading.
- H. Temperature Rise: Match insulation rating.
- I. Insulation: Class F
- J. Code Letter Designation:
  - 1. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.
- K. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.

## 2.4 POLYPHASE MOTORS WITH ADDITIONAL REQUIREMENTS

- A. Motors Used with Reduced-Vo – COMMON MOTOR REQUIREMENTS Itage and Multispeed Controllers: Match wiring connection requirements for controller with required motor leads. Provide terminals in motor terminal box, suited to control method.
  - 1. Windings: Copper magnet wire with moisture-resistant insulation varnish, designed and tested to resist transient spikes, high frequencies, and short time rise pulses produced by pulse-width modulated inverters.
  - 2. Energy- and Premium-Efficient Motors: Class B temperature rise; Class F insulation.
  - 3. Inverter-Duty Motors: Class F temperature rise; Class H insulation.
  - 4. Thermal Protection: Comply with NEMA MG 1 requirements for thermally protected motors.
- B. Severe-Duty Motors: Comply with IEEE 841, with 1.15 minimum service factor.

## 2.5 SINGLE-PHASE MOTORS

- A. Motors larger than 1/20 hp shall be one of the following, to suit starting torque and requirements of specific motor application:
  - 1. Permanent-split capacitor.
  - 2. Split phase.

3. Capacitor start, inductor run.
  4. Capacitor start, capacitor run.
- B. Multispeed Motors: Variable-torque, permanent-split-capacitor type.
- C. Bearings: Prelubricated, antifriction ball bearings or sleeve bearings suitable for radial and thrust loading.
- D. Motors 1/20 HP and Smaller: Shaded-pole type.
- E. Thermal Protection: Internal protection to automatically open power supply circuit to motor when winding temperature exceeds a safe value calibrated to temperature rating of motor insulation. Thermal-protection device shall automatically reset when motor temperature returns to normal range.

PART 3 - EXECUTION (Not Applicable)

END OF SECTION 230513

## SECTION 230519 – METERS AND GAGES FOR HVAC PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

1. Thermometers.
2. Gages.
3. Thermowells
4. Test plugs.

#### 1.3 DEFINITIONS

- A. CR: Chlorosulfonated polyethylene synthetic rubber.
- B. EPDM: Ethylene-propylene-diene terpolymer rubber.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated; include performance curves.
- B. Shop Drawings: Schedule for thermometers and gages indicating manufacturer's number, scale range, and location for each.
- C. Product Certificates: For each type of thermometer and gage, signed by product manufacturer.

### PART 2 - PRODUCTS

#### 2.1 METAL-CASE, LIQUID-IN-GLASS THERMOMETERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Palmer - Wahl Instruments Inc.
  2. Trerice, H. O. Co.
  3. Weiss Instruments, Inc.
  4. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
- B. Case: Die-cast aluminum or brass, 9 inches long.

- C. Tube: Red or blue reading, mercury or organic-liquid filled, with magnifying lens.
- D. Tube Background: Satin-faced, nonreflective aluminum with permanently etched scale markings.
- E. Window: Glass or plastic.
- F. Connector: Adjustable type, 180 degrees in vertical plane, 360 degrees in horizontal plane, with locking device.
- G. Stem: Copper-plated steel, aluminum, or brass for thermowell installation and of length to suit installation.
- H. Accuracy: Plus or minus 1 percent of range or plus or minus 1 scale division to maximum of 1.5 percent of range.

## 2.2 THERMOWELLS

- A. Manufacturers: Same as manufacturer of thermometer being used.
- B. Description: Pressure-tight, socket-type metal fitting made for insertion into piping and of type, diameter, and length required to hold thermometer.

## 2.3 PRESSURE GAGES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. AMETEK, Inc.; U.S. Gauge Div.
  2. Ashcroft Commercial Instrument Operations; Dresser Industries; Instrument Div.
  3. Ernst Gage Co.
  4. Eugene Ernst Products Co.
  5. KOBOLD Instruments, Inc.
  6. Marsh Bellofram.
  7. Miljoco Corp.
  8. Noshok, Inc.
  9. Palmer - Wahl Instruments Inc.
  10. REO TEMP Instrument Corporation.
  11. Trerice, H. O. Co.
  12. Weiss Instruments, Inc.
  13. Weksler Instruments Operating Unit; Dresser Industries; Instrument Div.
  14. WIKA Instrument Corporation.
  15. Winters Instruments.
- B. Direct-Mounting, Dial-Type Liquid Filled Pressure Gages: Indicating-dial type complying with ASME B40.100.
  1. Case: Dry type, drawn steel or cast aluminum, 4-1/2-inch diameter.
  2. Pressure-Element Assembly: Bourdon tube, unless otherwise indicated.
  3. Pressure Connection: Brass, NPS 1/4, bottom-outlet type unless back-outlet type is indicated.
  4. Movement: Mechanical, with link to pressure element and connection to pointer.

5. Dial: Satin-faced, nonreflective aluminum with permanently etched scale markings.
6. Pointer: Red or other dark-color metal.
7. Window: Glass or plastic.
8. Fill: Glycerin
9. Ring: Metal.
10. Accuracy: Grade A, plus or minus 1 percent of middle half scale.
11. Vacuum-Pressure Range: 30-in. Hg of vacuum to 15 psig of pressure.
12. Range for Fluids under Pressure: Two times operating pressure.

C. Pressure-Gage Fittings:

1. Valves: NPS 1/4 brass or stainless-steel needle type.
2. Snubbers: ASME B40.5, NPS 1/4 brass bushing with corrosion-resistant, porous-metal disc of material suitable for system fluid and working pressure.

## 2.4 TEST PLUGS

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Flow Design, Inc.
2. MG Piping Products Co.
3. National Meter, Inc.
4. Peterson Equipment Co., Inc.
5. Sisco Manufacturing Co.
6. Trerice, H. O. Co.
7. Watts Industries, Inc.; Water Products Div.

B. Description: Corrosion-resistant brass or stainless-steel body with core inserts and gasketed and threaded cap, with extended stem for units to be installed in insulated piping.

C. Minimum Pressure and Temperature Rating: 500 psig at 200 deg F.

D. Core Inserts: One or two self-sealing rubber valves.

1. Insert material for air, water, oil, or gas service at 20 to 200 deg F shall be CR.
2. Insert material for air or water service at minus 30 to plus 275 deg F shall be EPDM.

## PART 3 - EXECUTION

### 3.1 THERMOMETER APPLICATIONS

A. Install liquid-in-glass thermometers in the following locations:

1. Inlet and outlet of each hydronic zone.
2. Inlet and outlet of each hydronic coil in air-handling units and unit ventilators.
3. Elsewhere as indicated on Drawings.

B. Provide the following temperature ranges for thermometers:

1. Water: 30 to 240 deg F, with 2-degree scale divisions.

### 3.2 GAGE APPLICATIONS

- A. Install dry-case-type pressure gages for discharge of each pressure-reducing valve and elsewhere as indicated on Drawings.

### 3.3 INSTALLATIONS

- A. Install direct-mounting thermometers and adjust vertical and tilted positions.
- B. Install thermowells with socket extending one-third of diameter of pipe and in vertical position in piping tees where thermometers are indicated.
- C. Install direct-mounting pressure gages in piping tees with pressure gage located on pipe at most readable position.
- D. Install needle-valve and snubber fitting in piping for each pressure gage.
- E. Install test plugs in tees in piping.

### 3.4 CONNECTIONS

- A. Install meters and gages adjacent to machines and equipment to allow service and maintenance for meters, gages, machines, and equipment.

END OF SECTION 230519

## SECTION 230523 - GENERAL-DUTY VALVES FOR PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

A. Section Includes:

1. Bronze ball valves.
2. Iron, grooved-end butterfly valves.
3. Bronze swing check valves.
4. Iron, grooved-end swing-check valves.
5. Gate Valves

B. Related Sections:

1. Division 23 HVAC piping Sections for specialty valves applicable to those Sections only.
2. Division 23 Section "Identification for HVAC Piping and Equipment" for valve tags and schedules.

#### 1.3 DEFINITIONS

- A. CWP: Cold working pressure.
- B. EPDM: Ethylene propylene copolymer rubber.
- C. NBR: Acrylonitrile-butadiene, Buna-N, or nitrile rubber.
- D. NRS: Non-rising stem.
- E. OS&Y: Outside screw and yoke.
- F. RS: Rising stem.
- G. SWP: Steam working pressure.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of valve indicated.

## 1.5 QUALITY ASSURANCE

- A. Source Limitations for Valves: Obtain each type of valve from single source from single manufacturer.
- B. ASME Compliance:
  - 1. ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
  - 2. ASME B31.1 for power piping valves.
  - 3. ASME B31.9 for building services piping valves.
- C. To assure uniformity and compatibility, all grooved end valves and adjoining couplings shall be the products of a single manufacturer.

## 1.6 DELIVERY, STORAGE, AND HANDLING

- A. Prepare valves for shipping as follows:
  - 1. Protect internal parts against rust and corrosion.
  - 2. Protect threads, flange faces, grooved ends, and weld ends.
  - 3. Set angle, gate, and globe valves closed to prevent rattling.
  - 4. Set ball and plug valves open to minimize exposure of functional surfaces.
  - 5. Set butterfly valves closed or slightly open.
  - 6. Set gate valves closed to prevent rattling.
- B. Use the following precautions during storage:
  - 1. Maintain valve end protection.
  - 2. Store valves indoors and maintain at higher than ambient dew point temperature. If outdoor storage is necessary, store valves off the ground in watertight enclosures.
- C. Use sling to handle large valves; rig sling to avoid damage to exposed parts. Do not use handwheels or stems as lifting or rigging points.

## PART 2 - PRODUCTS

### 2.1 GENERAL REQUIREMENTS FOR VALVES

- A. Refer to HVAC valve schedule articles for applications of valves.
- B. Valve Pressure and Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- C. Valve Sizes: Same as upstream piping unless otherwise indicated.
- D. Valve Actuator Types:
  - 1. Gear Actuator: For quarter-turn valves NPS 8 and larger.
  - 2. Handwheel: For valves other than quarter-turn types.
  - 3. Handlever: For quarter-turn valves NPS 6 and smaller.

4. Chainwheel: Device for attachment to valve handwheel, stem, or other actuator; of size and with chain for mounting height, as indicated in the "Valve Installation" Article.
- E. Valves in Insulated Piping: With 2-inch stem extensions and the following features:
  1. Ball Valves: With extended operating handle of non-thermal-conductive material, and protective sleeve that allows operation of valve without breaking the vapor seal or disturbing insulation.
  2. Butterfly Valves: With extended neck.
- F. Valve-End Connections:
  1. Flanged: With flanges according to ASME B16.1 for iron valves.
  2. Grooved: With grooved ends according to AWWA C606.
  3. Solder Joint: With sockets according to ASME B16.18.
  4. Threaded: With threads according to ASME B1.20.1.
- G. Valve Bypass and Drain Connections: MSS SP-45.

## 2.2 BRONZE BALL VALVES

- A. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim:
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Conbraco Industries, Inc.; Apollo Valves.
    - b. Milwaukee Valve Company.
    - c. NIBCO INC.
    - d. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
  2. Description:
    - a. Standard: MSS SP-110.
    - b. SWP Rating: 150 psig.
    - c. CWP Rating: 600 psig.
    - d. Body Design: Two piece.
    - e. Body Material: Bronze.
    - f. Ends: Threaded.
    - g. Seats: PTFE or TFE.
    - h. Stem: Bronze.
    - i. Ball: Chrome-plated brass.
    - j. Port: Full.
- B. Two-Piece, Full-Port, Brass Ball Valves:
  1. Manufacturers: Subject to compliance with requirements, provide:
    - a. Victaulic Company, Series P89.
  2. Description:
    - a. Size Range: NPS ½ through NPS 2.
    - b. CWP Rating: 300 psig.

- c. Body Design: Two piece.
- d. Body Material: Brass.
- e. Ends: Plain ends for use with Victaulic QuickVic™ SD Installation-Ready system.
- f. Seats: PTFE.
- g. Seals: Double EPDM O-ring.
- h. Stem: Chrome-plated brass.
- i. Ball: Chrome-plated brass.
- j. Port: Full.
- k. Handle: Zinc-plated carbon steel handle with orange vinyl grip

## 2.3 IRON, GROOVED-END BUTTERFLY VALVES

### A. 300 CWP, Iron, Grooved-End Butterfly Valves:

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Victaulic Company Vic®-300 MasterSeal™ and Vic®-300 AGS.
- 2. Description:
  - a. Standard: MSS SP-67, Type I.
  - b. CWP Rating: 300 psig.
  - c. Body Material: Coated, ductile iron.
  - d. Stem: Two-piece stainless steel.
  - e. Disc: Coated, ductile iron, offset from stem to provide complete 360-degree circumferential seating.
  - f. Seal: EPDM.
    - 1) Pressure responsive in sizes through NPS 12.
  - g. Design: Continuous 360 degree sealing.

## 2.4 BRONZE SWING CHECK VALVES

### A. Class 150, Bronze Swing Check Valves with Bronze Disc:

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. American Valve, Inc.
  - b. Crane Co.; Crane Valve Group; Crane Valves.
  - c. Milwaukee Valve Company.
  - d. NIBCO INC.
- 2. Description:
  - a. Standard: MSS SP-80, Type 3.
  - b. CWP Rating: 300 psig.
  - c. Body Design: Horizontal flow.
  - d. Body Material: ASTM B 62, bronze.
  - e. Ends: Threaded.
  - f. Disc: Bronze.

## 2.5 IRON, GROOVED-END SWING CHECK VALVES

### A. Iron, Grooved-End Spring-Assisted Swing Check Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Victaulic Company Series [716H] [716] [779] [W715].
2. Description:
  - a. NPS 2 to NPS 3 (DN 50 to DN 80), CWP Rating: 365 psig.
  - b. NPS 4 to NPS 12 (DN 100 to DN 300) CWP Rating: 300 psig.
  - c. NPS 14 to NPS 24 (DN 350 to DN 600) CWP Rating: 230 psig.
  - d. Body Material: ASTM A 536, ductile iron.
  - e. Seal: EPDM.
  - f. Disc and Seat: Spring operated.
    - 1) Elastomer-coated ductile iron with welded-in nickel seat. or
    - 2) Stainless steel with elastomer seat / seal.
  - g. Installation: Vertical or horizontal.

## 2.6 STAINLESS STEEL GATE VALVES

### A. Gate Valves, Flanged Ends - Iron, OS&Y, Class 300:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Chicago
  - b. Milwaukee Valve Company.
  - c. NIBCO INC.
  - d. Jamesbury
2. Standard: ASME B16.34.
3. CWP Rating, NPS 2-1/2 to NPS 12 (DN 65 to DN 300): 300 psig.
4. CWP Rating, NPS 14 to NPS 24 (DN 350 to DN 600): 500 psig.
5. Rated for full water submersion.
6. Body Material: ASTM A351, 316 Stainless Steel with bolted bonnet.
7. Ends: Flanged.
8. Trim: Stainless Steel.
9. Disc: 316 Stainless Steel Solid wedge.
10. Packing and Gasket: Asbestos free.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine valve interior for cleanliness, freedom from foreign matter, and corrosion. Remove special packing materials, such as blocks, used to prevent disc movement during shipping and handling.

- B. Operate valves in positions from fully open to fully closed. Examine guides and seats made accessible by such operations.
- C. Examine threads on valve and mating pipe for form and cleanliness.
- D. Examine mating flange faces for conditions that might cause leakage. Check bolting for proper size, length, and material. Verify that gasket is of proper size, that its material composition is suitable for service, and that it is free from defects and damage.
- E. Examine grooved ends for conditions that might cause leakage. Ends should be free from indentations or projections in the area from valve end to groove.
- F. Do not attempt to repair defective valves; replace with new valves.

### 3.2 VALVE INSTALLATION

- A. Install valves with unions, Victaulic coupling or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.
- E. Install chainwheels on operators for butterfly NPS 4 and larger and more than 96 inches above floor. Extend chains to 60 inches above finished floor.
- F. Install check valves for proper direction of flow and as follows:
  - 1. Swing Check Valves: In horizontal position with hinge pin level.
  - 2. Lift Check Valves: With stem upright and plumb.
  - 3. Grooved End Spring-Loaded Check Valves: In horizontal or vertical position, between Victaulic couplings.

### 3.3 ADJUSTING

- A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves if persistent leaking occurs.

### 3.4 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

- A. If valve applications are not indicated, use the following:
  - 1. Shutoff Service: Ball, butterfly valves.
  - 2. Pump-Discharge Check Valves:
    - a. NPS 2 and Smaller: Bronze swing check valves with bronze disc.
    - b. NPS 2-1/2 and Larger: Iron swing check valves with lever and weight or with spring or iron, center-guided, metal or resilient-seat check valves.

- B. If valves with specified SWP classes or CWP ratings are not available, the same types of valves with higher SWP classes or CWP ratings may be substituted.
- C. Select valves, except wafer types, with the following end connections:
  - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option is indicated in valve schedules below.
  - 2. For Steel Piping, NPS 2-1/2 and Larger: Flanged ends.
  - 3. For Grooved-End Steel Piping: Valve ends may be grooved.

### 3.5 HEATING & CHILLED WATER VALVE SCHEDULE

- A. Pipe NPS 2 and Smaller:
  - 1. Bronze Valves: May be provided with solder-joint or pressure sealed ends instead of threaded ends.
  - 2. Ball Valves: Two piece, full port, bronze with bronze trim.
  - 3. Bronze Swing Check Valves: Class 150, bronze disc.
- B. Pipe NPS 2-1/2 and Larger:
  - 1. Iron, Grooved-End butterfly valve Class 150.
  - 2. Iron, Grooved-End Check Valves, NPS 3 to NPS 12: 300 CWP.

### 3.6 STEAM & STEAM CONDENSATE VALVE SCHEDULE

- A. Pipe NPS 2 and Smaller:
  - 1. Stainless Steel Gate Valves: OS&Y, Class 300
- B. Pipe NPS 2-1/2 and Larger:
  - 1. Stainless Steel Gate Valves: OS&Y, Class 300

END OF SECTION 230523

## SECTION 230529 – HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following hangers and supports for HVAC system piping and equipment:
  - 1. Steel pipe hangers and supports.
  - 2. Trapeze pipe hangers.
  - 3. Metal framing systems.
  - 4. Thermal-hanger shield inserts.
  - 5. Fastener systems.
  - 6. Equipment supports.
- B. Related Sections include the following:
  - 1. Division 23 Section(s) "Metal Ducts" for duct hangers and supports.

#### 1.3 DEFINITIONS

- A. MSS: Manufacturers Standardization Society for The Valve and Fittings Industry Inc.
- B. Terminology: As defined in MSS SP-90, "Guidelines on Terminology for Pipe Hangers and Supports."

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Design supports for multiple pipes capable of supporting combined weight of supported systems, system contents, and test water.
- B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

#### 1.5 SUBMITTALS

- A. Product Data: For the following:
  - 1. Steel pipe hangers and supports.
  - 2. Thermal-hanger shield inserts.
  - 3. Powder-actuated fastener systems.

- B. Welding certificates.

## 1.6 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to ASME Boiler and Pressure Vessel Code: Section IX.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

### 2.2 STEEL PIPE HANGERS AND SUPPORTS

- A. Description: MSS SP-58, Types 1 through 58, factory-fabricated components. Refer to Part 3 "Hanger and Support Applications" Article for where to use specific hanger and support types.
- B. Manufacturers:
  - 1. AAA Technology & Specialties Co., Inc.
  - 2. Bergen-Power Pipe Supports.
  - 3. B-Line Systems, Inc.; a division of Cooper Industries.
  - 4. Carpenter & Paterson, Inc.
  - 5. Empire Industries, Inc.
  - 6. ERICO/Michigan Hanger Co.
  - 7. Globe Pipe Hanger Products, Inc.
  - 8. Grinnell Corp.
  - 9. GS Metals Corp.
  - 10. National Pipe Hanger Corporation.
  - 11. PHD Manufacturing, Inc.
  - 12. PHS Industries, Inc.
  - 13. Piping Technology & Products, Inc.
  - 14. Tolco Inc.
- C. Galvanized, Metallic Coatings: Pregalvanized or hot dipped.
- D. Nonmetallic Coatings: Plastic coating, jacket, or liner.
- E. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion for support of bearing surface of piping.

## 2.3 TRAPEZE PIPE HANGERS

- A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural-steel shapes with MSS SP-58 hanger rods, nuts, saddles, and U-bolts.

## 2.4 METAL FRAMING SYSTEMS

- A. Description: MFMA-3, shop- or field-fabricated pipe-support assembly made of steel channels and other components.

B. Manufacturers:

1. B-Line Systems, Inc.; a division of Cooper Industries.
2. ERICO/Michigan Hanger Co.; ERISTRUT Div.
3. GS Metals Corp.
4. Power-Strut Div.; Tyco International, Ltd.
5. Thomas & Betts Corporation.
6. Tolco Inc.
7. Unistrut Corp.; Tyco International, Ltd.

- C. Coatings: Manufacturer's standard finish, unless bare metal surfaces are indicated.

- D. Nonmetallic Coatings: Plastic coating, jacket, or liner.

## 2.5 THERMAL-HANGER SHIELD INSERTS

- A. Description: 100-psig minimum, compressive-strength insulation insert encased in sheet metal shield.

B. Manufacturers:

1. Carpenter & Paterson, Inc.
2. ERICO/Michigan Hanger Co.
3. PHS Industries, Inc.
4. Pipe Shields, Inc.
5. Rilco Manufacturing Company, Inc.

- C. Insulation-Insert Material for Cold Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate or ASTM C 552, Type II cellular glass with vapor barrier.

- D. Insulation-Insert Material for Hot Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate or ASTM C 552, Type II cellular glass.

- E. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.

- F. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.

- G. Insert Length: Extend 2 inches (50 mm) beyond sheet metal shield for piping operating below ambient air temperature.

## 2.6 FASTENER SYSTEMS

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

1. Manufacturers:

- a. Hilti, Inc.
- b. ITW Ramset/Red Head.
- c. Masterset Fastening Systems, Inc.
- d. MKT Fastening, LLC.
- e. Powers Fasteners.

## 2.7 EQUIPMENT SUPPORTS

- A. Description: Welded, shop- or field-fabricated equipment support made from structural-steel shapes.

## 2.8 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
1. Properties: Nonstaining, noncorrosive, and nongaseous.
  2. Design Mix: 5000-psi, 28-day compressive strength.

## PART 3 - EXECUTION

### 3.1 HANGER AND SUPPORT APPLICATIONS

- A. Specific hanger and support requirements are specified in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized, metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use padded hangers for piping that is subject to scratching.
- F. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:

1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated stationary pipes, NPS 1/2 to NPS 30.
  2. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes, NPS 3/4 to NPS 24, requiring clamp flexibility and up to 4 inches of insulation.
  3. Steel Pipe Clamps (MSS Type 4): For suspension of cold and hot pipes, NPS 1/2 to NPS 24, if little or no insulation is required.
  4. Pipe Hangers (MSS Type 5): For suspension of pipes, NPS 1/2 to NPS 4, to allow off-center closure for hanger installation before pipe erection.
  5. Adjustable, Swivel Split- or Solid-Ring Hangers (MSS Type 6): For suspension of noninsulated stationary pipes, NPS 3/4 to NPS 8.
  6. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 8.
  7. Adjustable Band Hangers (MSS Type 9): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 8.
  8. Adjustable, Swivel-Ring Band Hangers (MSS Type 10): For suspension of noninsulated stationary pipes, NPS 1/2 to NPS 2.
  9. Split Pipe-Ring with or without Turnbuckle-Adjustment Hangers (MSS Type 11): For suspension of noninsulated stationary pipes, NPS 3/8 to NPS 8.
  10. Extension Hinged or 2-Bolt Split Pipe Clamps (MSS Type 12): For suspension of noninsulated stationary pipes, NPS 3/8 to NPS 3.
  11. U-Bolts (MSS Type 24): For support of heavy pipes, NPS 1/2 to NPS 30.
  12. Clips (MSS Type 26): For support of insulated pipes not subject to expansion or contraction.
  13. Single Pipe Rolls (MSS Type 41): For suspension of pipes, NPS 1 to NPS 30, from 2 rods if longitudinal movement caused by expansion and contraction might occur.
- G. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers, NPS 3/4 to NPS 20.
  2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers, NPS 3/4 to NPS 20, if longer ends are required for riser clamps.
- H. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
  2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
  3. Swivel Turnbuckles (MSS Type 15): For use with MSS Type 11, split pipe rings.
  4. Malleable-Iron Sockets (MSS Type 16): For attaching hanger rods to various types of building attachments.
  5. Steel Weldless Eye Nuts (MSS Type 17): For 120 to 450 deg F piping installations.
- I. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
  2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction to attach to top flange of structural shape.
  3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
  4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.

5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
  6. C-Clamps (MSS Type 23): For structural shapes.
  7. Top-Beam Clamps (MSS Type 25): For top of beams if hanger rod is required tangent to flange edge.
  8. Side-Beam Clamps (MSS Type 27): For bottom of steel I-beams.
  9. Steel-Beam Clamps with Eye Nuts (MSS Type 28): For attaching to bottom of steel I-beams for heavy loads.
  10. Linked-Steel Clamps with Eye Nuts (MSS Type 29): For attaching to bottom of steel I-beams for heavy loads, with link extensions.
  11. Malleable Beam Clamps with Extension Pieces (MSS Type 30): For attaching to structural steel.
  12. Welded-Steel Brackets: For support of pipes from below, or for suspending from above by using clip and rod. Use one of the following for indicated loads:
    - a. Light (MSS Type 31): 750 lb.
    - b. Medium (MSS Type 32): 1500 lb.
    - c. Heavy (MSS Type 33): 3000 lb.
  13. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
  14. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.
  15. Horizontal Travelers (MSS Type 58): For supporting piping systems subject to linear horizontal movement where headroom is limited.
- J. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
  2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
  3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.
- K. Comply with MSS SP-69 for trapeze pipe hanger selections and applications that are not specified in piping system Sections.
- L. Comply with MFMA-102 for metal framing system selections and applications that are not specified in piping system Sections.
- M. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.
- 3.2 EQUIPMENT SUPPORTS
- A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.
  - B. Grouting: Place grout under supports for equipment and make smooth bearing surface.
  - C. Provide lateral bracing, to prevent swaying, for equipment supports.

### 3.3 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1 procedures for shielded metal arc welding, appearance and quality of welds, and methods used in correcting welding work, and with the following:
  - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
  - 2. Obtain fusion without undercut or overlap.
  - 3. Remove welding flux immediately.
  - 4. Finish welds at exposed connections so no roughness shows after finishing and contours of welded surfaces match adjacent contours.

### 3.4 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.

### 3.5 PAINTING

- A. Touch Up: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
  - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils (0.05 mm).
- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 230529

## SECTION 230553 – IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Equipment labels.
  - 2. Warning signs and labels.
  - 3. Pipe labels.
  - 4. Warning tags.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For color, letter style, and graphic representation required for each identification material and device.
- C. Equipment Label Schedule: Include a listing of all equipment to be labeled with the proposed content for each label.

#### 1.4 COORDINATION

- A. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- B. Coordinate installation of identifying devices with locations of access panels and doors.
- C. Install identifying devices before installing acoustical ceilings and similar concealment.

### PART 2 - PRODUCTS

#### 2.1 EQUIPMENT LABELS

- A. Metal Labels for Equipment:
  - 1. Material and Thickness: Brass, 0.032-inch, Stainless steel, 0.025-inch, Aluminum, 0.032-inch or anodized aluminum, 0.032-inch minimum thickness, and having predrilled or stamped holes for attachment hardware.

2. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
3. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
4. Fasteners: Stainless-steel rivets or self-tapping screws.
5. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

B. Plastic Labels for Equipment:

1. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, and having predrilled holes for attachment hardware.
2. Letter Color: Black.
3. Background Color: White.
4. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
5. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
6. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.
7. Fasteners: Stainless-steel rivets or self-tapping screws.
8. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.

C. Label Content: Include equipment's Drawing designation or unique equipment number, Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified.

D. Equipment Label Schedule: For each item of equipment to be labeled, on 8-1/2-by-11-inch bond paper. Tabulate equipment identification number and identify Drawing numbers where equipment is indicated (plans, details, and schedules), plus the Specification Section number and title where equipment is specified. Equipment schedule shall be included in operation and maintenance data.

## 2.2 WARNING SIGNS AND LABELS

- A. Material and Thickness: Multilayer, multicolor, plastic labels for mechanical engraving, 1/16 inch thick, and having predrilled holes for attachment hardware.
- B. Letter Color: Black.
- C. Background Color: Yellow.
- D. Maximum Temperature: Able to withstand temperatures up to 160 deg F.
- E. Minimum Label Size: Length and width vary for required label content, but not less than 2-1/2 by 3/4 inch.
- F. Minimum Letter Size: 1/4 inch for name of units if viewing distance is less than 24 inches, 1/2 inch for viewing distances up to 72 inches, and proportionately larger lettering for greater viewing distances. Include secondary lettering two-thirds to three-fourths the size of principal lettering.

- G. Fasteners: Stainless-steel rivets or self-tapping screws.
- H. Adhesive: Contact-type permanent adhesive, compatible with label and with substrate.
- I. Label Content: Include caution and warning information, plus emergency notification instructions.

## 2.3 PIPE LABELS

- A. General Requirements for Manufactured Pipe Labels: Preprinted, color-coded, with lettering indicating service, and showing flow direction.
- B. Pretensioned Pipe Labels: Precoiled, semirigid plastic formed to cover full circumference of pipe and to attach to pipe without fasteners or adhesive.
- C. Self-Adhesive Pipe Labels: Printed plastic with contact-type, permanent-adhesive backing.
- D. Pipe Label Contents: Include identification of piping service using same designations or abbreviations as used on Drawings, pipe size, and an arrow indicating flow direction.
  - 1. Flow-Direction Arrows: Integral with piping system service lettering to accommodate both directions, or as separate unit on each pipe label to indicate flow direction.
  - 2. Lettering Size: At least 1-1/2 inches high.

## 2.4 WARNING TAGS

- A. Warning Tags: Preprinted or partially preprinted, accident-prevention tags, of plasticized card stock with matte finish suitable for writing.
  - 1. Size: 3 by 5-1/4 inches minimum.
  - 2. Fasteners: Brass grommet and wire.
  - 3. Nomenclature: Large-size primary caption such as "DANGER," "CAUTION," or "DO NOT OPERATE."
  - 4. Color: Yellow background with black lettering.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Clean piping and equipment surfaces of substances that could impair bond of identification devices, including dirt, oil, grease, release agents, and incompatible primers, paints, and encapsulants.

### 3.2 EQUIPMENT LABEL INSTALLATION

- A. Install or permanently fasten labels on each major item of mechanical equipment.
- B. Locate equipment labels where accessible and visible.

### 3.3 PIPE LABEL INSTALLATION

- A. Locate pipe labels where piping is exposed or above accessible ceilings in finished spaces; machine rooms; accessible maintenance spaces such as shafts, tunnels, and plenums; and exterior exposed locations as follows:
1. Near each branch connection, excluding short takeoffs for fixtures and terminal units. Where flow pattern is not obvious, mark each pipe at branch.
  2. Near penetrations through walls, floors, ceilings, and inaccessible enclosures.
  3. At access doors, manholes, and similar access points that permit view of concealed piping.
  4. Near major equipment items and other points of origination and termination.
  5. Spaced at maximum intervals of 50 feet along each run. Reduce intervals to 25 feet in areas of congested piping and equipment.
  6. On piping above removable acoustical ceilings. Omit intermediately spaced labels.
- B. Pipe Label Color Schedule:
1. Heating Water Piping:
    - a. Background Color: Yellow.
    - b. Letter Color: Black.
  2. Chilled-Water Piping:
    - a. Background Color: Green.
    - b. Letter Color: White.
  3. Gas Piping:
    - a. Background Color: Yellow.
    - b. Letter Color: Black.
  4. Domestic-Water Piping:
    - a. Background Color: Green.
    - b. Letter Color: White.

### 3.4 WARNING-TAG INSTALLATION

- A. Write required message on, and attach warning tags to, equipment and other items where required.

END OF SECTION 230553

## SECTION 230593 – TESTING ADJUSTING. AND BALANCING FOR HVAC

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Balancing Air Systems:
    - a. Constant-volume air systems.
  - 2. Balancing Hydronic Piping Systems:
    - a. Constant-flow hydronic systems.
    - b. Primary-secondary hydronic systems.
    - c. Variable-flow hydronic systems

#### 1.3 DEFINITIONS

- A. AABC: Associated Air Balance Council.
- B. NEBB: National Environmental Balancing Bureau.
- C. TAB: Testing, adjusting, and balancing.
- D. TABB: Testing, Adjusting, and Balancing Bureau.
- E. TAB Specialist: An entity engaged to perform TAB Work.

#### 1.4 SUBMITTALS

- A. Qualification Data: Within 30 days of Contractor's Notice to Proceed, submit documentation that the TAB contractor and this Project's TAB team members meet the qualifications specified in "Quality Assurance" Article.
- B. Contract Documents Examination Report: Within 30 days of Contractor's Notice to Proceed, submit the Contract Documents review report as specified in Part 3.
- C. Strategies and Procedures Plan: Within 30 days of Contractor's Notice to Proceed, submit TAB strategies and step-by-step procedures as specified in "Preparation" Article.
- D. Certified TAB reports.
- E. Instrument calibration reports, to include the following:
  - 1. Instrument type and make.
  - 2. Serial number.
  - 3. Application.

4. Dates of use.
5. Dates of calibration.

## 1.5 QUALITY ASSURANCE

- A. TAB Contractor Qualifications: Engage a TAB entity certified by NEBB.
  1. TAB Field Supervisor: Employee of the TAB contractor and certified by NEBB.
  2. TAB Technician: Employee of the TAB contractor and who is certified by NEBB as a TAB technician.
- B. Certify TAB field data reports and perform the following:
  1. Review field data reports to validate accuracy of data and to prepare certified TAB reports.
  2. Certify that the TAB team complied with the approved TAB plan and the procedures specified and referenced in this Specification.
- C. TAB Report Forms: Use standard TAB contractor's forms approved by Commissioning Authority.
- D. Instrumentation Type, Quantity, Accuracy, and Calibration: As described in ASHRAE 111, Section 5, "Instrumentation."

## 1.6 PROJECT CONDITIONS

- A. Full Owner Occupancy: Owner will occupy the site and existing building during entire TAB period. Cooperate with Owner during TAB operations to minimize conflicts with Owner's operations.

## 1.7 COORDINATION

- A. Notice: Provide seven days' advance notice for each test. Include scheduled test dates and times.
- B. Perform TAB after leakage and pressure tests on air and water distribution systems have been satisfactorily completed.

## PART 2 - PRODUCTS (Not Applicable)

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems' designs that may preclude proper TAB of systems and equipment.

- B. Examine systems for installed balancing devices, such as test ports, gage cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are accessible.
  - C. Examine the approved submittals for HVAC systems and equipment.
  - D. Examine design data including HVAC system descriptions, statements of design assumptions for environmental conditions and systems' output, and statements of philosophies and assumptions about HVAC system and equipment controls.
  - E. Examine equipment performance data including fan and pump curves.
    - 1. Relate performance data to Project conditions and requirements, including system effects that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
    - 2. Calculate system-effect factors to reduce performance ratings of HVAC equipment when installed under conditions different from the conditions used to rate equipment performance. To calculate system effects for air systems, use tables and charts found in AMCA 201, "Fans and Systems," or in SMACNA's "HVAC Systems - Duct Design." Compare results with the design data and installed conditions.
  - F. Examine system and equipment installations and verify that field quality-control testing, cleaning, and adjusting specified in individual Sections have been performed.
  - G. Examine test reports specified in individual system and equipment Sections.
  - H. Examine HVAC equipment and filters and verify that bearings are greased, belts are aligned and tight, and equipment with functioning controls is ready for operation.
  - I. Examine terminal units, such as variable-air-volume boxes, and verify that they are accessible and their controls are connected and functioning.
  - J. Examine strainers. Verify that startup screens are replaced by permanent screens with indicated perforations.
  - K. Examine three-way valves for proper installation for their intended function of diverting or mixing fluid flows.
  - L. Examine heat-transfer coils for correct piping connections and for clean and straight fins.
  - M. Examine system pumps to ensure absence of entrained air in the suction piping.
  - N. Examine operating safety interlocks and controls on HVAC equipment.
  - O. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.
- 3.2 PREPARATION
- A. Prepare a TAB plan that includes strategies and step-by-step procedures.
  - B. Complete system-readiness checks and prepare reports. Verify the following:

1. Permanent electrical-power wiring is complete.
2. Hydronic systems are filled, clean, and free of air.
3. Automatic temperature-control systems are operational.
4. Equipment and duct access doors are securely closed.
5. Balance, smoke, and fire dampers are open.
6. Isolating and balancing valves are open and control valves are operational.
7. Ceilings are installed in critical areas where air-pattern adjustments are required and access to balancing devices is provided.
8. Windows and doors can be closed so indicated conditions for system operations can be met.

### 3.3 GENERAL PROCEDURES FOR TESTING AND BALANCING

- A. Perform testing and balancing procedures on each system according to the procedures contained in SMACNA's "HVAC Systems - Testing, Adjusting, and Balancing" and in this Section.
  1. Comply with requirements in ASHRAE 62.1-2004, Section 7.2.2, "Air Balancing."
- B. Cut insulation, ducts, pipes, and equipment cabinets for installation of test probes to the minimum extent necessary for TAB procedures.
  1. After testing and balancing, install test ports and duct access doors that comply with requirements in Division 23 Section "Air Duct Accessories."
  2. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish according to Division 23 Section "HVAC Insulation."
- C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.
- D. Take and report testing and balancing measurements in inch-pound (IP) units.

### 3.4 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

- A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.
- B. Prepare schematic diagrams of systems' "as-built" duct layouts.
- C. For variable-air-volume systems, develop a plan to simulate diversity.
- D. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.
- E. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.
- F. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.
- G. Verify that motor starters are equipped with properly sized thermal protection.
- H. Check dampers for proper position to achieve desired airflow path.

- I. Check for airflow blockages.
- J. Check condensate drains for proper connections and functioning.
- K. Check for proper sealing of air-handling-unit components.
- L. Verify that air duct system is sealed as specified in Division 23 Section "Metal Ducts."

### 3.5 PROCEDURES FOR CONSTANT-VOLUME AIR SYSTEMS

- A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.
  - 1. Measure total airflow.
    - a. Where sufficient space in ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow.
  - 2. Measure fan static pressures as follows to determine actual static pressure:
    - a. Measure outlet static pressure as far downstream from the fan as practical and upstream from restrictions in ducts such as elbows and transitions.
    - b. Measure static pressure directly at the fan outlet or through the flexible connection.
    - c. Measure inlet static pressure of single-inlet fans in the inlet duct as near the fan as possible, upstream from the flexible connection, and downstream from duct restrictions.
    - d. Measure inlet static pressure of double-inlet fans through the wall of the plenum that houses the fan.
  - 3. Measure static pressure across each component that makes up an air-handling unit, rooftop unit, and other air-handling and -treating equipment.
    - a. Report the cleanliness status of filters and the time static pressures are measured.
  - 4. Measure static pressures entering and leaving other devices, such as sound traps, heat-recovery equipment, and air washers, under final balanced conditions.
  - 5. Review Record Documents to determine variations in design static pressures versus actual static pressures. Calculate actual system-effect factors. Recommend adjustments to accommodate actual conditions.
  - 6. Obtain approval from Engineer for adjustment of fan speed higher or lower than indicated speed. Comply with requirements in Division 23 Sections for air-handling units for adjustment of fans, belts, and pulley sizes to achieve indicated air-handling-unit performance.
  - 7. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload will occur. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.
- B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows within specified tolerances.

1. Measure airflow of submain and branch ducts.
    - a. Where sufficient space in submain and branch ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow for that zone.
  2. Measure static pressure at a point downstream from the balancing damper, and adjust volume dampers until the proper static pressure is achieved.
  3. Remeasure each submain and branch duct after all have been adjusted. Continue to adjust submain and branch ducts to indicated airflows within specified tolerances.
- C. Measure air outlets and inlets without making adjustments.
1. Measure terminal outlets using a direct-reading hood or outlet manufacturer's written instructions and calculating factors.
- D. Adjust air outlets and inlets for each space to indicated airflows within specified tolerances of indicated values. Make adjustments using branch volume dampers rather than extractors and the dampers at air terminals.
1. Adjust each outlet in same room or space to within specified tolerances of indicated quantities without generating noise levels above the limitations prescribed by the Contract Documents.
  2. Adjust patterns of adjustable outlets for proper distribution without drafts.

### 3.6 GENERAL PROCEDURES FOR HYDRONIC SYSTEMS

- A. Prepare test reports with pertinent design data, and number in sequence starting at pump to end of system. Check the sum of branch-circuit flows against the approved pump flow rate. Correct variations that exceed plus or minus 5 percent.
- B. Prepare schematic diagrams of systems' "as-built" piping layouts.
- C. Prepare hydronic systems for testing and balancing according to the following, in addition to the general preparation procedures specified above:
  1. Open all manual valves for maximum flow.
  2. Check liquid level in expansion tank.
  3. Check makeup water-station pressure gage for adequate pressure for highest vent.
  4. Check flow-control valves for specified sequence of operation, and set at indicated flow.
  5. Set differential-pressure control valves at the specified differential pressure. Do not set at fully closed position when pump is positive-displacement type unless several terminal valves are kept open.
  6. Set system controls so automatic valves are wide open to heat exchangers.
  7. Check pump-motor load. If motor is overloaded, throttle main flow-balancing device so motor nameplate rating is not exceeded.
  8. Check air vents for a forceful liquid flow exiting from vents when manually operated.

### 3.7 PROCEDURES FOR CONSTANT-FLOW HYDRONIC SYSTEMS

- A. Measure water flow at pumps. Use the following procedures except for positive-displacement pumps:

1. Verify impeller size by operating the pump with the discharge valve closed. Read pressure differential across the pump. Convert pressure to head and correct for differences in gage heights. Note the point on manufacturer's pump curve at zero flow and verify that the pump has the intended impeller size.
  2. Check system resistance. With all valves open, read pressure differential across the pump and mark pump manufacturer's head-capacity curve. Adjust pump discharge valve until indicated water flow is achieved.
    - a. Monitor motor performance during procedures and do not operate motors in overload conditions.
  3. Verify pump-motor brake horsepower. Calculate the intended brake horsepower for the system based on pump manufacturer's performance data. Compare calculated brake horsepower with nameplate data on the pump motor. Report conditions where actual amperage exceeds motor nameplate amperage.
  4. Report flow rates that are not within plus or minus 10 percent of design.
- B. Measure flow at all automatic flow control valves to verify that valves are functioning as designed.
- C. Measure flow at all pressure-independent characterized control valves, with valves in fully open position, to verify that valves are functioning as designed.
- D. Set calibrated balancing valves, if installed, at calculated presettings.
- E. Measure flow at all stations and adjust, where necessary, to obtain first balance.
1. System components that have Cv rating or an accurately cataloged flow-pressure-drop relationship may be used as a flow-indicating device.
- F. Measure flow at main balancing station and set main balancing device to achieve flow that is 5 percent greater than indicated flow.
- G. Adjust balancing stations to within specified tolerances of indicated flow rate as follows:
1. Determine the balancing station with the highest percentage over indicated flow.
  2. Adjust each station in turn, beginning with the station with the highest percentage over indicated flow and proceeding to the station with the lowest percentage over indicated flow.
  3. Record settings and mark balancing devices.
- H. Measure pump flow rate and make final measurements of pump amperage, voltage, rpm, pump heads, and systems' pressures and temperatures including outdoor-air temperature.
- I. Measure the differential-pressure-control-valve settings existing at the conclusion of balancing.
- J. Check settings and operation of each safety valve. Record settings.
- 3.8 PROCEDURES FOR PRIMARY-SECONDARY HYDRONIC SYSTEMS
- A. Balance the primary circuit flow first and then balance the secondary circuits.

### 3.9 PROCEDURES FOR VARIABLE-FLOW HYDRONIC SYSTEMS

- A. Balance systems with automatic two- and three-way control valves by setting systems at maximum flow through heat-exchange terminals and proceed as specified above for hydronic systems.

### 3.10 PROCEDURES FOR BOILERS

- A. Hydronic Boilers: Measure and record entering- and leaving-water temperatures and water flow.

### 3.11 PROCEDURES FOR MOTORS

- A. Motors, 1/2 HP and Larger: Test at final balanced conditions and record the following data:
  - 1. Manufacturer's name, model number, and serial number.
  - 2. Motor horsepower rating.
  - 3. Motor rpm.
  - 4. Efficiency rating.
  - 5. Nameplate and measured voltage, each phase.
  - 6. Nameplate and measured amperage, each phase.
  - 7. Starter thermal-protection-element rating.
- B. Motors Driven by Variable-Frequency Controllers: Test for proper operation at speeds varying from minimum to maximum. Test the manual bypass of the controller to prove proper operation. Record observations including name of controller manufacturer, model number, serial number, and nameplate data.

### 3.12 PROCEDURES FOR CONDENSING UNITS

- A. Verify proper rotation of fans.
- B. Measure entering- and leaving-air temperatures.
- C. Record compressor data.

### 3.13 PROCEDURES FOR HEAT-TRANSFER COILS

- A. Measure, adjust, and record the following data for each water coil:
  - 1. Entering- and leaving-water temperature.
  - 2. Water flow rate.
  - 3. Water pressure drop.
  - 4. Dry-bulb temperature of entering and leaving air.
  - 5. Wet-bulb temperature of entering and leaving air for cooling coils.
  - 6. Airflow.
  - 7. Air pressure drop.
- B. Measure, adjust, and record the following data for each electric heating coil:

1. Nameplate data.
2. Airflow.
3. Entering- and leaving-air temperature at full load.
4. Voltage and amperage input of each phase at full load and at each incremental stage.
5. Calculated kilowatt at full load.
6. Fuse or circuit-breaker rating for overload protection.

C. Measure, adjust, and record the following data for each refrigerant coil:

1. Dry-bulb temperature of entering and leaving air.
2. Wet-bulb temperature of entering and leaving air.
3. Airflow.
4. Air pressure drop.
5. Refrigerant suction pressure and temperature.

### 3.14 TOLERANCES

A. Set HVAC system's air flow rates and water flow rates within the following tolerances:

1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus or minus 10 percent.
2. Air Outlets and Inlets: Plus or minus 10 percent.
3. Heating-Water Flow Rate: Plus or minus 10 percent.
4. Cooling-Water Flow Rate: Plus or minus 10 percent.

### 3.15 REPORTING

- A. Initial Construction-Phase Report: Based on examination of the Contract Documents as specified in "Examination" Article, prepare a report on the adequacy of design for systems' balancing devices. Recommend changes and additions to systems' balancing devices to facilitate proper performance measuring and balancing. Recommend changes and additions to HVAC systems and general construction to allow access for performance measuring and balancing devices.
- B. Status Reports: Prepare biweekly progress reports to describe completed procedures, procedures in progress, and scheduled procedures. Include a list of deficiencies and problems found in systems being tested and balanced. Prepare a separate report for each system and each building floor for systems serving multiple floors.

### 3.16 FINAL REPORT

- A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.
1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
  2. Include a list of instruments used for procedures, along with proof of calibration.
- B. Final Report Contents: In addition to certified field-report data, include the following:
1. Pump curves.
  2. Fan curves.

3. Manufacturers' test data.
4. Field test reports prepared by system and equipment installers.
5. Other information relative to equipment performance; do not include Shop Drawings and product data.

C. General Report Data: In addition to form titles and entries, include the following data:

1. Title page.
2. Name and address of the TAB contractor.
3. Project name.
4. Project location.
5. Architect's name and address.
6. Engineer's name and address.
7. Contractor's name and address.
8. Report date.
9. Signature of TAB supervisor who certifies the report.
10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
11. Summary of contents including the following:
  - a. Indicated versus final performance.
  - b. Notable characteristics of systems.
  - c. Description of system operation sequence if it varies from the Contract Documents.
12. Nomenclature sheets for each item of equipment.
13. Data for terminal units, including manufacturer's name, type, size, and fittings.
14. Notes to explain why certain final data in the body of reports vary from indicated values.
15. Test conditions for fans and pump performance forms including the following:
  - a. Settings for outdoor-, return-, and exhaust-air dampers.
  - b. Conditions of filters.
  - c. Cooling coil, wet- and dry-bulb conditions.
  - d. Face and bypass damper settings at coils.
  - e. Fan drive settings including settings and percentage of maximum pitch diameter.
  - f. Inlet vane settings for variable-air-volume systems.
  - g. Settings for supply-air, static-pressure controller.
  - h. Other system operating conditions that affect performance.

D. System Diagrams: Include schematic layouts of air and hydronic distribution systems. Present each system with single-line diagram and include the following:

1. Quantities of outdoor, supply, return, and exhaust airflows.
2. Water flow rates.
3. Duct, outlet, and inlet sizes.
4. Pipe and valve sizes and locations.
5. Terminal units.
6. Balancing stations.
7. Position of balancing devices.

E. Fan Test Reports: For supply, return, and exhaust fans, include the following:

1. Fan Data:
  - a. System identification.

- b. Location.
    - c. Make and type.
    - d. Model number and size.
    - e. Manufacturer's serial number.
    - f. Arrangement and class.
    - g. Sheave make, size in inches, and bore.
    - h. Center-to-center dimensions of sheave, and amount of adjustments in inches.
  2. Motor Data:
    - a. Motor make, and frame type and size.
    - b. Horsepower and rpm.
    - c. Volts, phase, and hertz.
    - d. Full-load amperage and service factor.
    - e. Sheave make, size in inches, and bore.
    - f. Center-to-center dimensions of sheave, and amount of adjustments in inches.
    - g. Number, make, and size of belts.
  3. Test Data (Indicated and Actual Values):
    - a. Total airflow rate in cfm.
    - b. Total system static pressure in inches wg.
    - c. Fan rpm.
    - d. Discharge static pressure in inches wg.
    - e. Suction static pressure in inches wg.
- F. Round, Flat-Oval, and Rectangular Duct Traverse Reports: Include a diagram with a grid representing the duct cross-section and record the following:
  1. Report Data:
    - a. System and air-handling-unit number.
    - b. Location and zone.
    - c. Traverse air temperature in deg F.
    - d. Duct static pressure in inches wg.
    - e. Duct size in inches.
    - f. Duct area in sq. ft..
    - g. Indicated air flow rate in cfm.
    - h. Indicated velocity in fpm.
    - i. Actual air flow rate in cfm.
    - j. Actual average velocity in fpm.
    - k. Barometric pressure in psig.
- G. Air-Terminal-Device Reports:
  1. Unit Data:
    - a. System and air-handling unit identification.
    - b. Location and zone.
    - c. Apparatus used for test.
    - d. Area served.
    - e. Make.
    - f. Number from system diagram.
    - g. Type and model number.
    - h. Size.

- i. Effective area in sq. ft..
  2. Test Data (Indicated and Actual Values):
    - a. Air flow rate in cfm.
    - b. Air velocity in fpm.
    - c. Preliminary air flow rate as needed in cfm.
    - d. Preliminary velocity as needed in fpm.
    - e. Final air flow rate in cfm.
    - f. Final velocity in fpm.
    - g. Space temperature in deg F.
- H. Pump Test Reports: Calculate impeller size by plotting the shutoff head on pump curves and include the following:
  1. Unit Data:
    - a. Unit identification.
    - b. Location.
    - c. Service.
    - d. Make and size.
    - e. Model number and serial number.
    - f. Water flow rate in gpm.
    - g. Water pressure differential in feet of head or psig.
    - h. Required net positive suction head in feet of head or psig.
    - i. Pump rpm.
    - j. Impeller diameter in inches.
    - k. Motor make and frame size.
    - l. Motor horsepower and rpm.
    - m. Voltage at each connection.
    - n. Amperage for each phase.
    - o. Full-load amperage and service factor.
    - p. Seal type.
  2. Test Data (Indicated and Actual Values):
    - a. Static head in feet of head or psig.
    - b. Pump shutoff pressure in feet of head or psig.
    - c. Actual impeller size in inches.
    - d. Full-open flow rate in gpm.
    - e. Full-open pressure in feet of head or psig.
    - f. Final discharge pressure in feet of head or psig.
    - g. Final suction pressure in feet of head or psig.
    - h. Final total pressure in feet of head or psig.
    - i. Final water flow rate in gpm.
    - j. Voltage at each connection.
    - k. Amperage for each phase.
- I. Instrument Calibration Reports:
  1. Report Data:
    - a. Instrument type and make.
    - b. Serial number.
    - c. Application.

- d. Dates of use.
- e. Dates of calibration.

### 3.17 INSPECTIONS

#### A. Initial Inspection:

1. After testing and balancing are complete, operate each system and randomly check measurements to verify that the system is operating according to the final test and balance readings documented in the final report.
2. Check the following for each system:
  - a. Measure airflow of at least 10 percent of air outlets.
  - b. Measure water flow of at least 5 percent of terminals.
  - c. Measure room temperature at each thermostat/temperature sensor. Compare the reading to the set point.
  - d. Verify that balancing devices are marked with final balance position.
  - e. Note deviations from the Contract Documents in the final report.

#### B. Final Inspection:

1. After initial inspection is complete and documentation by random checks verifies that testing and balancing are complete and accurately documented in the final report, request that a final inspection be made by Commissioning Authority.
2. The TAB contractor's test and balance engineer shall conduct the inspection in the presence of Commissioning Authority.
3. Commissioning Authority shall randomly select measurements, documented in the final report, to be rechecked. Rechecking shall be limited to either 10 percent of the total measurements recorded or the extent of measurements that can be accomplished in a normal 8-hour business day.
4. If rechecks yield measurements that differ from the measurements documented in the final report by more than the tolerances allowed, the measurements shall be noted as "FAILED."
5. If the number of "FAILED" measurements is greater than 10 percent of the total measurements checked during the final inspection, the testing and balancing shall be considered incomplete and shall be rejected.

#### C. TAB Work will be considered defective if it does not pass final inspections. If TAB Work fails, proceed as follows:

1. Recheck all measurements and make adjustments. Revise the final report and balancing device settings to include all changes; resubmit the final report and request a second final inspection.
2. If the second final inspection also fails, Owner may contract the services of another TAB contractor to complete TAB Work according to the Contract Documents and deduct the cost of the services from the original TAB contractor's final payment.

#### D. Prepare test and inspection reports.

3.18 ADDITIONAL TESTS

- A. Within 90 days of completing TAB, perform additional TAB to verify that balanced conditions are being maintained throughout and to correct unusual conditions.
- B. Seasonal Periods: If initial TAB procedures were not performed during near-peak summer and winter conditions, perform additional TAB during near-peak summer and winter conditions.

END OF SECTION 230593

## SECTION 230700 – HVAC INSULATION

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

- 1. Insulation Materials:
  - a. Flexible elastomeric.
  - b. Mineral fiber.
- 2. Adhesives.
- 3. Mastics.
- 4. Lagging adhesives.
- 5. Sealants.
- 6. Factory-applied jackets.
- 7. Field-applied jackets.
- 8. Tapes.
- 9. Securements.

#### 1.3 SUBMITTALS

- A. Product Data: For each type of product indicated. Include thermal conductivity, thickness, and jackets (both factory and field applied, if any).
- B. Shop Drawings:
  - 1. Detail application of protective shields, saddles, and inserts at hangers for each type of insulation and hanger.
  - 2. Detail insulation application at pipe expansion joints for each type of insulation.
  - 3. Detail insulation application at elbows, fittings, flanges, valves, and specialties for each type of insulation.
  - 4. Detail removable insulation at piping specialties, equipment connections, and access panels.
  - 5. Detail application of field-applied jackets.
  - 6. Detail application at linkages of control devices.
  - 7. Detail field application for each equipment type.
- C. Qualification Data: For qualified Installer.
- D. Material Test Reports: From a qualified testing agency acceptable to authorities having jurisdiction indicating, interpreting, and certifying test results for compliance of insulation

materials, sealers, attachments, cements, and jackets, with requirements indicated. Include dates of tests and test methods employed.

- E. Field quality-control reports.

#### 1.4 QUALITY ASSURANCE

- A. Installer Qualifications: Skilled mechanics who have successfully completed an apprenticeship program or another craft training program certified by the Department of Labor, Bureau of Apprenticeship and Training.
- B. Fire-Test-Response Characteristics: Insulation and related materials shall have fire-test-response characteristics indicated, as determined by testing identical products per ASTM E 84, by a testing and inspecting agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing and inspecting agency.
  - 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
  - 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

#### 1.5 DELIVERY, STORAGE, AND HANDLING

- A. Packaging: Insulation material containers shall be marked by manufacturer with appropriate ASTM standard designation, type and grade, and maximum use temperature.

#### 1.6 COORDINATION

- A. Coordinate size and location of supports, hangers, and insulation shields specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."

#### 1.7 SCHEDULING

- A. Schedule insulation application after pressure testing systems and, where required, after installing and testing heat tracing. Insulation application may begin on segments that have satisfactory test results.
- B. Complete installation and concealment of plastic materials as rapidly as possible in each area of construction.

### PART 2 - PRODUCTS

#### 2.1 INSULATION MATERIALS

- A. Comply with requirements in Part 3 schedule articles for where insulating materials shall be applied.

- B. Products shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.
- D. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- E. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IA or Type IB. For equipment applications, provide insulation with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. CertainTeed Corp.; Commercial Board.
    - b. Fibrex Insulations Inc.; FBX.
    - c. Johns Manville; 800 Series Spin-Glas.
    - d. Knauf Insulation; Insulation Board.
    - e. Manson Insulation Inc.; AK Board.
    - f. Owens Corning; Fiberglas 700 Series.
- F. Mineral-Fiber, Preformed Pipe Insulation:
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Fibrex Insulations Inc.; Coreplus 1200.
    - b. Johns Manville; Micro-Lok.
    - c. Knauf Insulation; 1000 Pipe Insulation.
    - d. Manson Insulation Inc.; Alley-K.
    - e. Owens Corning; Fiberglas Pipe Insulation.
  - 2. Type I, 850 deg F Materials: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 547, Type I, Grade A, with factory-applied ASJ. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
  - 3. Conductivity:  $0.28 \text{ Btu}\cdot\text{in.}/(\text{h}\cdot\text{ft}^2 \cdot ^\circ\text{F})$
- G. Mineral-Fiber, Pipe and Tank Insulation: Mineral or glass fibers bonded with a thermosetting resin. Semirigid board material with factory-applied ASJ complying with ASTM C 1393, Type II or Type IIIA Category 2, or with properties similar to ASTM C 612, Type IB. Nominal density is 2.5 lb/cu. ft. or more. Thermal conductivity (k-value) at 100 deg F is  $0.29 \text{ Btu}\cdot\text{in.}/\text{h}\cdot\text{sq. ft.}\cdot^\circ\text{F}$  or less. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Johns Manville.
    - b. Knauf Insulation.
    - c. Owens Corning.

## 2.2 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated, unless otherwise indicated.
- B. Flexible Elastomeric Adhesive: Comply with MIL-A-24179A, Type II, Class I.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Aeroflex USA Inc.; Aero seal.
    - b. Armacell LCC; 520 Adhesive.
    - c. Foster Products Corporation, H. B. Fuller Company; 85-75.
    - d. RBX Corporation; Rubatex Contact Adhesive.
- C. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; CP-82.
    - b. Foster Products Corporation, H. B. Fuller Company; 85-20.
    - c. ITW TACC, Division of Illinois Tool Works; S-90/80.
    - d. Marathon Industries, Inc.; 225.
    - e. Mon-Eco Industries, Inc.; 22-25.
- D. ASJ Adhesive, and FSK and PVDC Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; CP-82.
    - b. Foster Products Corporation, H. B. Fuller Company; 85-20.
    - c. ITW TACC, Division of Illinois Tool Works; S-90/80.
    - d. Marathon Industries, Inc.; 225.
    - e. Mon-Eco Industries, Inc.; 22-25.

## 2.3 MASTICS

- A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-C-19565C, Type II.
- B. Vapor-Barrier Mastic: Water based; suitable for indoor and outdoor use on below ambient services.
  - 1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Childers Products, Division of ITW; CP-35.
    - b. Foster Products Corporation, H. B. Fuller Company; 30-90.
    - c. ITW TACC, Division of Illinois Tool Works; CB-50.
    - d. Marathon Industries, Inc.; 590.
    - e. Mon-Eco Industries, Inc.; 55-40.
    - f. Vimasco Corporation; 749.

2. Water-Vapor Permeance: ASTM E 96, Procedure B, 0.013 perm at 43-mil dry film thickness.
3. Service Temperature Range: Minus 20 to plus 180 deg F.
4. Solids Content: ASTM D 1644, 59 percent by volume and 71 percent by weight.
5. Color: White.

C. Breather Mastic: Water based; suitable for indoor and outdoor use on above ambient services.

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Products, Division of ITW; CP-10.
  - b. Foster Products Corporation, H. B. Fuller Company; 35-00.
  - c. ITW TACC, Division of Illinois Tool Works; CB-05/15.
  - d. Marathon Industries, Inc.; 550.
  - e. Mon-Eco Industries, Inc.; 55-50.
  - f. Vimasco Corporation; WC-1/WC-5.
2. Water-Vapor Permeance: ASTM F 1249, 3 perms at 0.0625-inch dry film thickness.
3. Service Temperature Range: Minus 20 to plus 200 deg F.
4. Solids Content: 63 percent by volume and 73 percent by weight.
5. Color: White.

## 2.4 LAGGING ADHESIVES

A. Description: Comply with MIL-A-3316C Class I, Grade A and shall be compatible with insulation materials, jackets, and substrates.

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Products, Division of ITW; CP-52.
  - b. Foster Products Corporation, H. B. Fuller Company; 81-42.
  - c. Marathon Industries, Inc.; 130.
  - d. Mon-Eco Industries, Inc.; 11-30.
  - e. Vimasco Corporation; 136.
2. Fire-resistant, water-based lagging adhesive and coating for use indoors to adhere fire-resistant lagging cloths over duct, equipment, and pipe insulation.
3. Service Temperature Range: Minus 50 to plus 180 deg F.
4. Color: White.

## 2.5 SEALANTS

A. FSK and Metal Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Products, Division of ITW; CP-76-8.
  - b. Foster Products Corporation, H. B. Fuller Company; 95-44.
  - c. Marathon Industries, Inc.; 405.
  - d. Mon-Eco Industries, Inc.; 44-05.
  - e. Vimasco Corporation; 750.

2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: Aluminum.

B. ASJ Flashing Sealants, and Vinyl, PVDC, and PVC Jacket Flashing Sealants:

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
  - a. Childers Products, Division of ITW; CP-76.
2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: White.

## 2.6 FACTORY-APPLIED JACKETS

A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:

1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
2. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C 1136, Type II.

## 2.7 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C1136, Type I, unless otherwise indicated.
- B. FSK Jacket: Aluminum-foil-face, fiberglass-reinforced scrim with kraft-paper backing.
- C. PVC Jacket for indoor piping: High-impact-resistant, UV-resistant PVC complying with ASTM D1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.
1. Adhesive: As recommended by jacket material manufacturer.
  2. Color: White.
  3. Factory-fabricated fitting covers to match jacket if available; otherwise, field fabricate.
    - a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps and mechanical joints.

## 2.8 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.
- B. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Johns Manville; Zeston.
  - b. P.I.C. Plastics, Inc.; FG Series.
  - c. Proto PVC Corporation; LoSmoke.
  - d. Speedline Corporation; SmokeSafe.
2. Adhesive: As recommended by jacket material manufacturer.
3. Color: White.
4. Factory-fabricated fitting covers to match jacket if available; otherwise, field fabricate.
  - a. Shapes: 45- and 90-degree, short- and long-radius elbows, tees, valves, flanges, unions, reducers, end caps, soil-pipe hubs, traps, and mechanical joints.
5. Factory-fabricated tank heads and tank side panels.

## 2.9 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.
  1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0835.
    - b. Compac Corp.; 104 and 105.
    - c. Ideal Tape Co., Inc., an American Biltrite Company; 428 AWF ASJ.
    - d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.
  2. Width: 3 inches.
  3. Thickness: 11.5 mils.
  4. Adhesion: 90 ounces force/inch in width.
  5. Elongation: 2 percent.
  6. Tensile Strength: 40 lbf/inch in width.
  7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.
  1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0827.
    - b. Compac Corp.; 110 and 111.
    - c. Ideal Tape Co., Inc., an American Biltrite Company; 491 AWF FSK.
    - d. Venture Tape; 1525 CW, 1528 CW, and 1528 CW/SQ.
  2. Width: 3 inches.
  3. Thickness: 6.5 mils.
  4. Adhesion: 90 ounces force/inch in width.
  5. Elongation: 2 percent.
  6. Tensile Strength: 40 lbf/inch in width.
  7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.

- C. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive. Suitable for indoor and outdoor applications.
1. Products: Subject to compliance with requirements, provide one of the following:
    - a. Avery Dennison Corporation, Specialty Tapes Division; Fason 0555.
    - b. Compac Corp.; 130.
    - c. Ideal Tape Co., Inc., an American Biltrite Company; 370 White PVC tape.
    - d. Venture Tape; 1506 CW NS.
  2. Width: 2 inches.
  3. Thickness: 6 mils.
  4. Adhesion: 64 ounces force/inch in width.
  5. Elongation: 500 percent.
  6. Tensile Strength: 18 lbf/inch in width.

## 2.10 SECUREMENTS

### A. Bands:

1. Products: Subject to compliance with requirements, provide one of the following:
  - a. Childers Products; Bands.
  - b. PABCO Metals Corporation; Bands.
  - c. RPR Products, Inc.; Bands.
2. Stainless Steel: ASTM A 167 or ASTM A 240/A 240M, Type 304 or Type 316; 0.015 inch thick, 3/4 inch wide with wing seal.
3. Aluminum: ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with wing seal.

### B. Insulation Pins and Hangers:

1. Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch-diameter shank, length to suit depth of insulation indicated.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; CWP-1.
    - 2) GEMCO; CD.
    - 3) Midwest Fasteners, Inc.; CD.
    - 4) Nelson Stud Welding; TPA, TPC, and TPS.
2. Cupped-Head, Capacitor-Discharge-Weld Pins: Copper- or zinc-coated steel pin, fully annealed for capacitor-discharge welding, 0.135-inch-diameter shank, length to suit depth of insulation indicated with integral 1-1/2-inch galvanized carbon-steel washer.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; CWP-1.
    - 2) GEMCO; Cupped Head Weld Pin.
    - 3) Midwest Fasteners, Inc.; Cupped Head.

- 4) Nelson Stud Welding; CHP.
3. Metal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; Tactoo Insul-Hangers, Series T.
    - 2) GEMCO; Perforated Base.
    - 3) Midwest Fasteners, Inc.; Spindle.
  - b. Baseplate: Perforated, galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
  - c. Spindle: Copper- or zinc-coated, low carbon steel, fully annealed, 0.106-inch-diameter shank, length to suit depth of insulation indicated.
  - d. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
4. Nonmetal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate fastened to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) GEMCO; Nylon Hangers.
    - 2) Midwest Fasteners, Inc.; Nylon Insulation Hangers.
  - b. Baseplate: Perforated, nylon sheet, 0.030 inch thick by 1-1/2 inches in diameter.
  - c. Spindle: Nylon, 0.106-inch-diameter shank, length to suit depth of insulation indicated, up to 2-1/2 inches.
  - d. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
5. Self-Sticking-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; Tactoo Insul-Hangers, Series TSA.
    - 2) GEMCO; Press and Peel.
    - 3) Midwest Fasteners, Inc.; Self Stick.
  - b. Baseplate: Galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
  - c. Spindle: Copper- or zinc-coated, low carbon steel, fully annealed, 0.106-inch-diameter shank, length to suit depth of insulation indicated.
  - d. Adhesive-backed base with a peel-off protective cover.

6. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick, galvanized-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) AGM Industries, Inc.; RC-150.
    - 2) GEMCO; R-150.
    - 3) Midwest Fasteners, Inc.; WA-150.
    - 4) Nelson Stud Welding; Speed Clips.
  - b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.
7. Nonmetal Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick nylon sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
  - a. Products: Subject to compliance with requirements, provide one of the following:
    - 1) GEMCO.
    - 2) Midwest Fasteners, Inc.
- C. Staples: Outward-clinching insulation staples, nominal 3/4-inch-wide, stainless steel or Monel.
- D. Wire: 0.062-inch soft-annealed, stainless steel.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. C & F Wire.
    - b. Childers Products.
    - c. PABCO Metals Corporation.
    - d. RPR Products, Inc.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine substrates and conditions for compliance with requirements for installation and other conditions affecting performance of insulation application.
  1. Verify that systems and equipment to be insulated have been tested and are free of defects.
  2. Verify that surfaces to be insulated are clean and dry.
  3. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

- B. Surface Preparation: Clean and prepare surfaces to be insulated. Before insulating, apply a corrosion coating to insulated surfaces as follows:
  - 1. Stainless Steel: Coat 300 series stainless steel with an epoxy primer 5 mils thick and an epoxy finish 5 mils thick if operating in a temperature range between 140 and 300 deg F. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
  - 2. Carbon Steel: Coat carbon steel operating at a service temperature between 32 and 300 deg F with an epoxy coating. Consult coating manufacturer for appropriate coating materials and application methods for operating temperature range.
- C. Coordinate insulation installation with the trade installing heat tracing. Comply with requirements for heat tracing that apply to insulation.

### 3.3 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of equipment, ducts and fittings, and piping including fittings, valves, and specialties.
- B. Install insulation materials, forms, vapor barriers or retarders, jackets, and thicknesses required for each item of equipment, duct system, and pipe system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Do not weld brackets, clips, or other attachment devices to piping, fittings, and specialties.
- G. Keep insulation materials dry during application and finishing.
- H. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- I. Install insulation with least number of joints practical.
- J. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
  - 1. Install insulation continuously through hangers and around anchor attachments.
  - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
  - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
  - 4. Cover inserts with jacket material matching adjacent pipe insulation. Install shields over jacket, arranged to protect jacket from tear or puncture by hanger, support, and shield.

- K. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- L. Install insulation with factory-applied jackets as follows:
  - 1. Draw jacket tight and smooth.
  - 2. Cover circumferential joints with 3-inch-wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
  - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Install insulation with longitudinal seams at bottom of pipe. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 2 inches o.c.
    - a. For below ambient services, apply vapor-barrier mastic over staples.
  - 4. Cover joints and seams with tape as recommended by insulation material manufacturer to maintain vapor seal.
  - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct and pipe flanges and fittings.
- M. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- N. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- O. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.
- P. For above ambient services, do not install insulation to the following:
  - 1. Vibration-control devices.
  - 2. Testing agency labels and stamps.
  - 3. Nameplates and data plates.
  - 4. Manholes.
  - 5. Handholes.
  - 6. Cleanouts.

### 3.4 PENETRATIONS

- A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.
  - 1. Seal penetrations with flashing sealant.
  - 2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
  - 3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
  - 4. Seal jacket to roof flashing with flashing sealant.

- B. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.
1. Seal penetrations with flashing sealant.
  2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
  3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.
  4. Seal jacket to wall flashing with flashing sealant.
- C. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- D. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Install insulation continuously through penetrations of fire-rated walls and partitions. Terminate insulation at fire damper sleeves for fire-rated wall and partition penetrations. Externally insulate damper sleeves to match adjacent insulation and overlap duct insulation at least 2 inches.
1. Comply with requirements in Division 7 Section "Through-Penetration Firestop Systems" for firestopping and fire-resistive joint sealers.
- E. Insulation Installation on Pumps:
1. Fabricate metal boxes lined with insulation. Fit boxes around pumps and coincide box joints with splits in pump casings. Fabricate joints with outward bolted flanges. Bolt flanges on 6-inch centers, starting at corners. Install 3/8-inch diameter fasteners with wing nuts. Alternatively, secure the box sections together using a latching mechanism.
  2. Fabricate boxes from stainless steel, at least 0.040 inch thick.
  3. For below ambient services, install a vapor barrier at seams, joints, and penetrations. Seal between flanges with replaceable gasket material to form a vapor barrier.

### 3.5 GENERAL PIPE INSULATION INSTALLATION

- A. Requirements in this article generally apply to all insulation materials except where more specific requirements are specified in various pipe insulation material installation articles.
- B. Insulation Installation on Fittings, Valves, Strainers, Flanges, and Unions:
1. Install insulation over fittings, valves, strainers, flanges, unions, and other specialties with continuous thermal and vapor-retarder integrity, unless otherwise indicated.
  2. Insulate pipe elbows using preformed fitting insulation or mitered fittings made from same material and density as adjacent pipe insulation. Each piece shall be butted tightly against adjoining piece and bonded with adhesive. Fill joints, seams, voids, and irregular surfaces with insulating cement finished to a smooth, hard, and uniform contour that is uniform with adjoining pipe insulation.
  3. Insulate tee fittings with preformed fitting insulation or sectional pipe insulation of same material and thickness as used for adjacent pipe. Cut sectional pipe insulation to fit. Butt each section closely to the next and hold in place with tie wire. Bond pieces with adhesive.
  4. Insulate valves using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe

- diameter, whichever is thicker. For valves, insulate up to and including the bonnets, valve stuffing-box studs, bolts, and nuts. Fill joints, seams, and irregular surfaces with insulating cement.
5. Insulate strainers using preformed fitting insulation or sectional pipe insulation of same material, density, and thickness as used for adjacent pipe. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker. Fill joints, seams, and irregular surfaces with insulating cement. Insulate strainers so strainer basket flange or plug can be easily removed and replaced without damaging the insulation and jacket. Provide a removable reusable insulation cover. For below ambient services, provide a design that maintains vapor barrier.
  6. Insulate flanges and unions using a section of oversized preformed pipe insulation. Overlap adjoining pipe insulation by not less than two times the thickness of pipe insulation, or one pipe diameter, whichever is thicker.
  7. Cover segmented insulated surfaces with a layer of finishing cement and coat with a mastic. Install vapor-barrier mastic for below ambient services and a breather mastic for above ambient services. Reinforce the mastic with fabric-reinforcing mesh. Trowel the mastic to a smooth and well-shaped contour.
  8. For services not specified to receive a field-applied jacket except for flexible elastomeric and polyolefin, install fitted PVC cover over elbows, tees, strainers, valves, flanges, and unions. Terminate ends with PVC end caps. Tape PVC covers to adjoining insulation facing using PVC tape.
  9. Label the outside insulation jacket of each union with the word "UNION." Match size and color of pipe labels.
- C. Insulate instrument connections for thermometers, pressure gages, pressure temperature taps, test connections, flow meters, sensors, switches, and transmitters on insulated pipes, vessels, and equipment. Shape insulation at these connections by tapering it to and around the connection with insulating cement and finish with finishing cement, mastic, and flashing sealant.
- D. Install removable insulation covers at locations indicated. Installation shall conform to the following:
1. Make removable flange and union insulation from sectional pipe insulation of same thickness as that on adjoining pipe. Install same insulation jacket as adjoining pipe insulation.
  2. When flange and union covers are made from sectional pipe insulation, extend insulation from flanges or union long at least two times the insulation thickness over adjacent pipe insulation on each side of flange or union. Secure flange cover in place with stainless-steel or aluminum bands. Select band material compatible with insulation and jacket.
  3. Construct removable valve insulation covers in same manner as for flanges except divide the two-part section on the vertical center line of valve body.
  4. When covers are made from block insulation, make two halves, each consisting of mitered blocks wired to stainless-steel fabric. Secure this wire frame, with its attached insulation, to flanges with tie wire. Extend insulation at least 2 inches over adjacent pipe insulation on each side of valve. Fill space between flange or union cover and pipe insulation with insulating cement. Finish cover assembly with insulating cement applied in two coats. After first coat is dry, apply and trowel second coat to a smooth finish.
  5. Unless a PVC jacket is indicated in field-applied jacket schedules, finish exposed surfaces with a metal jacket.

### 3.6 FLEXIBLE ELASTOMERIC INSULATION INSTALLATION

- A. Seal longitudinal seams and end joints with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- B. Insulation Installation on Pipe Flanges:
  - 1. Install pipe insulation to outer diameter of pipe flange.
  - 2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.
  - 3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with cut sections of sheet insulation of same thickness as pipe insulation.
  - 4. Secure insulation to flanges and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- C. Insulation Installation on Pipe Fittings and Elbows:
  - 1. Install mitered sections of pipe insulation.
  - 2. Secure insulation materials and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.
- D. Insulation Installation on Valves and Pipe Specialties:
  - 1. Install preformed valve covers manufactured of same material as pipe insulation when available.
  - 2. When preformed valve covers are not available, install cut sections of pipe and sheet insulation to valve body. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
  - 3. Install insulation to flanges as specified for flange insulation application.
  - 4. Secure insulation to valves and specialties and seal seams with manufacturer's recommended adhesive to eliminate openings in insulation that allow passage of air to surface being insulated.

### 3.7 MINERAL-FIBER INSULATION INSTALLATION

- A. Insulation Installation on Straight Pipes and Tubes:
  - 1. Secure each layer of preformed pipe insulation to pipe with wire or bands and tighten bands without deforming insulation materials.
  - 2. Where vapor barriers are indicated, seal longitudinal seams, end joints, and protrusions with vapor-barrier mastic and joint sealant.
  - 3. For insulation with factory-applied jackets on above ambient surfaces, secure laps with outward clinched staples at 6 inches o.c.
  - 4. For insulation with factory-applied jackets on below ambient surfaces, do not staple longitudinal tabs but secure tabs with additional adhesive as recommended by insulation material manufacturer and seal with vapor-barrier mastic and flashing sealant.
- B. Insulation Installation on Pipe Flanges:
  - 1. Install preformed pipe insulation to outer diameter of pipe flange.
  - 2. Make width of insulation section same as overall width of flange and bolts, plus twice the thickness of pipe insulation.

3. Fill voids between inner circumference of flange insulation and outer circumference of adjacent straight pipe segments with mineral-fiber blanket insulation.
4. Install jacket material with manufacturer's recommended adhesive, overlap seams at least 1 inch, and seal joints with flashing sealant.

C. Insulation Installation on Pipe Fittings and Elbows:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed insulation elbows and fittings are not available, install mitered sections of pipe insulation, to a thickness equal to adjoining pipe insulation. Secure insulation materials with wire or bands.

D. Insulation Installation on Valves and Pipe Specialties:

1. Install preformed sections of same material as straight segments of pipe insulation when available.
2. When preformed sections are not available, install mitered sections of pipe insulation to valve body.
3. Arrange insulation to permit access to packing and to allow valve operation without disturbing insulation.
4. Install insulation to flanges as specified for flange insulation application.

### 3.8 FIELD-APPLIED JACKET INSTALLATION

- A. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless-steel bands 12 inches o.c. and at end joints.
- B. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications, install with longitudinal seams along top and bottom of tanks and vessels. Seal with manufacturer's recommended adhesive.
  1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.

### 3.9 FINISHES

- A. Flexible Elastomeric Thermal Insulation: After adhesive has fully cured, apply two coats of insulation manufacturer's recommended protective coating.

### 3.10 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
  1. Inspect field-insulated equipment, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to one location for each type of equipment defined in the

"Equipment Insulation Schedule" Article. For large equipment, remove only a portion adequate to determine compliance.

2. Inspect pipe, fittings, strainers, and valves, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to three locations of straight pipe, three locations of threaded fittings, three locations of welded fittings, two locations of threaded strainers, two locations of welded strainers, three locations of threaded valves, and three locations of flanged valves for each pipe service defined in the "Piping Insulation Schedule, General" Article.

- C. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

### 3.11 PIPING INSULATION SCHEDULE, GENERAL

- A. Acceptable preformed pipe and tubular insulation materials and thicknesses are identified for each piping system and pipe size range. If more than one material is listed for a piping system, selection from materials listed is Contractor's option.
- B. Items Not Insulated: Unless otherwise indicated, do not install insulation on the following:
  1. Drainage piping located in crawl spaces.
  2. Underground piping.
  3. Chrome-plated pipes and fittings unless there is a potential for personnel injury.

### 3.12 INDOOR PIPING INSULATION SCHEDULE

- A. Heating-Hot-Water Supply and Return, 200 Deg F and below:
  1. NPS 1-1/2 and Larger: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe, Type I: 2 inch thick.
  2. NPS 1-1/4 and Smaller: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe, Type I: 1-1/2 inch thick.
- B. Chilled Water and Brine, above 40 Deg F:
  1. NPS 12 and Smaller: Insulation shall be one of the following:
    - a. Mineral-Fiber, Preformed Pipe, Type I: 2 inches thick.
- C. Make-up-Water:
  1. NPS 1 and Smaller: Insulation shall be one of the following:
    - a. Mineral-Fiber, Preformed Pipe, Type I: 1 inches thick.
- D. Domestic Cold Water:
  1. NPS 1 and Smaller: Insulation shall be one of the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
  2. NPS 1-1/4 and Larger: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.

- E. Domestic Hot and Recirculated Hot Water:
  - 1. NPS 3/4 and Smaller: Insulation shall be one of the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.
  - 2. NPS 1 and Larger: Insulation shall be the following:
    - a. Mineral-Fiber, Preformed Pipe Insulation, Type I: 1 inch thick.

### 3.13 EQUIPMENT INSULATION SCHEDULE

- A. Insulation materials and thicknesses are identified below. If more than one material is listed for a type of equipment, selection from materials listed is Contractor's option.
- B. Insulate indoor and outdoor equipment in paragraphs below that is not factory insulated.
- C. Heating-hot-water air-separator insulation shall be one of the following:
  - 1. Mineral-Fiber Board: 1-1/2 inches thick and 2-lb/cu. ft. nominal density.
  - 2. Mineral-Fiber Pipe and Tank: 1-1/2 inches thick.
- D. Chilled-water pump insulation shall be the following:
  - 1. Mineral-Fiber Board: 2 inches thick and 2-lb/cu. ft. nominal density.

END OF SECTION 230700

## SECTION 230900 - INSTRUMENTATION AND CONTROL FOR HVAC

### PART 1 - GENERAL

#### 1.1 GENERAL REQUIREMENTS

- A. This section describes the automation criteria for a unified automation and analytics platform to support the operational objectives of the project. This platform shall hereafter be referred to as the Building Automation System (BAS). The Division 23 Contractor shall be responsible for providing this user interface system(s) where specified herein and ensuring interoperability of all systems, including those provided by other sections if applicable. The Division 23 Contractor shall have direct responsibility for the BAS elements of the systems as defined herein.
- B. This Section includes control equipment, software and installation for HVAC systems and components, including control components for terminal heating and cooling units.
- C. The control system shall be an extension of the existing Siemens Desigo CC Building Automation System and all controllers and software shall match existing or be the latest version of existing system.

#### 1.2 SYSTEM DESCRIPTION

- A. The primary function of the Building Automation System (BAS) shall be the provision of the information management software platform for daily operations of the building and all sub-systems. This includes but is not limited to the reporting of alarm and event functions, real time and historical operational and energy related information, data exchange with cloud-based analytics, and overall monitoring and management of the building systems.

#### 1.3 SCOPE OF WORK

- A. The BAS and associated subsystems described herein shall be the responsibility of the Division 23 contractor for execution directly under the prime contractor or contracted directly with the owner.
- B. The Division 23 Contractor shall provide software materials from multiple specifications (e.g. manufacture or purchase both the Building Automation System (BAS) and Fire Alarm (FA) system) if required, with sole responsibility for coordinating integration requirements between systems identified herein and the BAS.
- C. The installation of the control system software shall be performed under the direct supervision of the controls manufacturer with the shop drawings, flow diagrams, bill of materials, component designation, or identification number and sequence of operation all bearing the name of the manufacturer.

#### 1.4 QUALITY ASSURANCE

- A. The Contractor shall directly supervise installation and startup of the system.

- B. The Contractor shall be responsible for providing all specified hardware and software as specified herein.
- C. Comply with ASHRAE 135-2010 BACnet: A Data Communication Protocol for Building Automation and Control Networks.
- D. The building management station must support the BACnet/SC standard.
- E. Provide written approvals and certifications after installation has been completed.
- F. The Contractor shall have service facilities for the BAS within 60 miles of project site.

## 1.5 COORDINATION

- A. Coordination with Controls Specified in other Sections or Divisions. Other sections and/or divisions of this specification include controls and control devices that are to be part of or interfaced to the BAS specified in this section. These controls shall be integrated into the system and coordinated by the BAS contractor.

## PART 2 - PRODUCTS

### 2.1 SYSTEM DESCRIPTION

- A. The Building Automation System (BAS) contractor shall furnish and install a networked System Management Platform and that provides the system operator(s) a single point of entry for users to operate, monitor and optimize building automation, fire safety and security systems or a combination thereof.
- B. All information comes together at the management level. The management level is the graphical, interactive interface for the operator to the automation station and the integrated plants and plant parts. System operation must be based on a simplified approach. The operator can display, query, process, save, or print any plant information via the peripheral units at the management level. The plants are displayed in synoptic images and the values and states are presented and displayed dynamically. Special programs are used for higher control, optimization functions, maintenance and energy management.
- C. Smart Score System for Smart Building
  - 1. The building management system must be an accredited solution according to the following programs to be used as a Smart System for Smart Buildings.
    - a. WiredScore, Accredited Solution
    - b. UL SPIRE - Smart System Rating Program, Certification
- D. SCADA Platform
  - 1. The building management system must be based on a SCADA platform that is compatible with the BACnet revision 20 and the B-XAWS (Cross-Domain Advanced Operator Workstation) profile. It must permit the integration of any building installation including HVAC and lighting.
- E. Multi-discipline

1. The building management system must be able to handle natively different disciplines in a building: Building Automation, Power Management, Fire Safety, Industrial PLC's, Access Control, Intrusion, Video.
  2. The disciplines must allow distribution across independent servers if required. The scope of access for controlling and monitoring discipline data must allow customization per user in every client station.
  3. Each management station of the system must be able to be assigned one or more disciplines, allowing customizable single or multiple discipline access mode.
- F. Long Term Storage
1. The building management system must be able to store and archive data for a period of more than 10 years, allowing as an option segregation of stored data in different groups that can be tuned individually with different recording frequencies. Remounting offline archived data must also be allowed.
- G. The System Management Platform shall be a flexible, full client-server architecture allowing scalability from small and medium to large and complex systems. The platform shall be customizable.
- H. The System Management Platform shall be installed on one single computer, with full server and client functionality. The installed system shall have the capability to allow Web, Windows App or Flex Clients to be added on separate hardware.
- I. Additional system connections, if required, shall have the ability to be made through systems installed with the system platform Front End Processors (FEP) configurations.
- J. System platform shall allow Web interfaces to provide the operator(s) an increased flexibility for operation and future extensions, e.g. mobile applications for tablets and smart phones.

## 2.2 BUILDING MANAGEMENT SYSTEM MANUFACTURERS

- A. Acceptable Manufacturers:
1. Siemens – Siemens Desigo™ CC.
  2. System to be a direct and seamless integration into existing Siemens Desigo™ CC V9.0 system on the campus. Contact: John Radetich Tel: 215-206-4594 Email: [john.radetich@siemens.com](mailto:john.radetich@siemens.com).
  3. System Management Platform shall support connectivity with the following:
    - a. Cerberus DMS
    - b. Desigo CC Compact BA
    - c. Desigo CC Compact Electrical Applications
    - d. Desigo CC Compact Validated Monitoring
    - e. Desigo CC Connect

## 2.3 SYSTEM REQUIREMENTS

- A. All networked control products provided for this project shall be comprised of an industry standard open protocol internetwork. Communication involving control components (i.e. all types of controllers and operator interfaces) shall conform to ASHRAE 135-2010 BACnet standard. Networks and protocols proprietary to one company or distributed by one company are prohibited.
- B. Siemens Control Instruments

#### A. AUTOMATIC CONTROL VALVES

1. Select valves to fail safe in normally open or closed position as shown on contract drawings. When normally closed or normally open valve position is not shown valves shall fail as is the normal practice and necessary for freeze, humidity, fire, or temperature protection.
2. Select two-way valves for liquids to have equal percentage characteristics. Size valve operators to close valves against pump shut off head. Size for maximum 3 PSI drop. Size head for minimum 1 PSI drop.
3. Automatic control valves shall be arranged for proportioning control and shall be equipped with modulating plugs for the rated capacities as shown on the Drawings. Valve operators and trim shall have adequate capacity to meet maximum operating system pressures.
4. Provide two-way or three-way valves as detailed on the Contract Drawings or as required by the Sequence of Operation.
5. Actuators: Provide actuators, sized by the manufacturer, of sufficient size and power to operate the valve under all conditions and to close the valve tight against maximum differential pressure.
  - a. Comply with requirements of "Actuators" paragraph of this section.

#### B. ACTUATORS

1. General: Provide electric motor driven actuators (operators) arranged "fail safe" in the event of power failure. Operators to be quiet in operation and function within a range of 85 to 100% input power potential.
2. Electronic damper actuators shall be Belimo or Siemens.
  - a. The actuator shall be direct coupled over the shaft, enabling it to be mounted directly to the shaft without the need for connecting linkage. Single bolt or set screw type fasteners are not acceptable.
  - b. The actuator shall have electronic overload or digital rotation sensing circuitry to prevent damage to the actuator throughout the rotation of the actuator. Mechanical end switches or magnetic clutch to deactivate the actuator at the end of rotation are not acceptable.
  - c. For power-failure/safety applications, an internal mechanical, spring return mechanism shall be built into the actuator housing. Non-mechanical forms of fail- safe are not acceptable.

- d. All spring return actuators shall be capable of both clockwise or counterclockwise spring return operation by simply changing the mounting orientation.
- e. Proportional actuators shall accept a 0 to 10 VDC or 4 to 20 mA control signal over their operating range. An actuator capable of accepting a pulse width modulating control signal and providing full proportional operation is acceptable. All actuators shall provide a position feedback signal.
- f. All 24 VAC/DC actuators shall operate on Class 2 wiring and shall not require more than 10 VA for AC or more than 8 watts for DC applications. Actuators operating on 120 VAC power shall not require more than 10 VA. Actuators operating on 230 VAC power shall not require more than 11 VA.
- g. Dampers shall fail safe in normally open or closed position as shown on contract drawings. When normally closed or normally open damper position is not shown dampers shall fail as is the normal practice and necessary for freeze, humidity, fire, or temperature protection.
- h. All non-spring return actuators shall have an external manual gear release to allow manual positioning of the damper when the actuator is not powered. Spring return actuators with more than 60 in-lb torque capacity shall have a manual crank for this purpose.

### 3. Damper Actuator Mounting

- a. If located outside the duct or casing, mount operators on a 14 gauge reinforced support plate arranged to allow insulation between the support plate and the face of the duct or casing.
  - b. Brace damper operators rigid to show no deflection or movement over the full range of the damper stroke.
4. Automatic Dampers for Telecommunication Room Fire Suppression Agent Isolation shall be rated Class 1 at 4" pressure and 200 fpm velocity, with fast acting operators. Dampers and operators shall meet the requirements of NFPA 2001 and UL Standard 555S. Dampers shall be initiated by signal from existing FM-200 system controls.

## C. SYSTEM ACCURACY

1. Accuracy and Stability: Equipment shall be selected for the appropriate range of the application. Equipment selected with ranges in excess of the application will be replaced at the Contractor's expense. Unless otherwise specified or called for on the Drawings, the minimum system accuracy shall be in accordance with the following:
  2. Temperature
    - a. Space temperature with a range of 50 to 85° F plus or minus 0.5° F for continued space; 30 to 130° F plus or minus 1° F for unconditioned space.
    - b. Duct temperature with a range of 44 to 140° F plus or minus 0.5° F.
    - c. Outside Air (OA) temperature with a range of minus 30 to plus 130° F, plus or minus 1° F; with a subrange of plus 30 to plus 100° F, plus or minus 0.5° F.
    - d. Water temperature with a range of 33 to 100° F, plus or minus 0.5° F; the range of 100 to 250° F, plus or minus 1.0°F; and water temperature for the purpose of

performing BTU calculations using differential temperatures to plus or minus 0.5

3. Humidity: Accuracy shall be 3% of full scale. Sensors to have single point calibration.
4. Pressure: Pressure with a range for the specific application plus or minus 1.0% of range.
5. Flow: Flow with a range for the specific application plus or minus 2.0% of range, and flows for the purpose of BTU calculations to plus or minus 1.0% of range
6. Power kWh and kW demand with a range for the specific application plus or minus 1.0% of reading.
7. An analog value input to the system's equipment via an analog input shall be displayed with a maximum error of 0.5%
8. Analog Input Resolution: The minimum analog value resolution shall be one quarter of the accuracy tolerance value specified. Resolution shall be defined as the accuracy tolerance value specified. Resolution shall be defined as the least measured value difference between two adjacent values, in engineering units, that can be distinguished one from the other. Provide signal conditioning to improve analog input resolution, if required.

#### D. SENSORS AND OTHER DEVICES

##### 1. Temperature Sensors:

- a. Temperature sensors shall be provided for space, duct, fluid, and outside air sensing. All temperature sensors shall be accurate to .5 shall have a demonstrated stability of .45 year.
- b. Temperature sensors shall be solid state thin film wire wound platinum RTDs, Current Loop, or Integrated. Siemens QAM Temperature Sensors or approved equal.
- c. Room temperature sensors shall be located and installed as shown on Drawings.

##### 2. Humidity Sensors:

- a. Electronic Humidity Transmitters: Electronic humidity transmitters shall produce a linear 4-20 MA signal over a range of 10 to 90% RH. Siemens QFA Humidity sensor or approved equal.
- b. Provide a duct mounted humidity transmitter for air handler. Install humidity transmitter in return air ducts entering each air handler. Siemens QFM Humidity sensor or approved equal.

##### 3. Pressure Sensors:

- a. Electronic static and differential pressure transmitters shall be stainless steel diaphragm type, with a variable capacitance electrode to produce a linear signal over the appropriate input range. Input ranges shall be available from 0.1" WC to 25" WC and transmitters shall be selected for 150% of the design pressure. Both zero and span shall be field adjustable. Accuracy shall be 1% of full scale over the selected range.
- b. Smoke detectors shall be tied into the fire alarm system for alarm reporting and directly hard wire connected to the fan starters for automatic shutdown on alarm occurrences.
- c. Low limit thermostats (freezestats) shall be provided for all air handlers with hot water and/or chilled water coils as stated on the drawings, and shall be hard wired to shut down their respective unit should the temperature at any point on its sensing element fall below 35. Provide 1 foot of sensing element for each 1 sq. ft. of duct cross section. Freezestat shall be wired to directly shutdown the fan on alarm occurrence. Freezestat shall be field adjustable.

4. Differential Pressure Switches:

- a. Binary differential pressure sensors shall be used to indicate pump and fan operation, proof of flow and for indicating high pressure drop across filters. These sensors shall be of diaphragm type and shall be adjustable and furnished in ranges compatible with their service.

5. Current Sensing Relays:

- a. Solid state switch shall operate when current level sensed by internal current transformer exceeds the threshold value set by the adjustable setpoint. Internal circuits shall be totally powered by induction from the line being monitored.

6. Relays:

- a. All relays, except lighting control relays, shall be rated at double the design voltage and current service, mounted on a circuit board and wired to numbered terminal strips.
- b. Start/Stop relay modules shall provide either momentary or maintained switching action as appropriate for the motor being started.

7. Enclosures:

- a. Enclosures shall be dust tight and furnished with hinged locking doors. Provide an engraved nameplate on the face of the panel clearly describing its function. All devices located within the enclosure shall be clearly labeled. All wiring within the panel shall be in accordance with NEMA, UL standard, NEC and local codes. Details and proposed mounting location of each enclosure shall be submitted prior to construction. All enclosures shall be factory prewired and pre-piped to terminal strips prior to arrival at job site.
- b. Provide wiring diagram mounted inside door with plastic protective covering.

8. Flow Switches

- a. Water flow switches will be of the paddle type equipped with SPDT contacts

9. Thermometers and Gauges:

- a. All piping systems shall be provided by the Mechanical Contractor.
- b. The Mechanical Contractor shall furnish and install duct pressure gauges and thermometers at all locations in the duct work where temperature and/or pressure transmitters are installed.

10. Flow Sensors

- a. Provide flow sensors for measuring liquid flow in piping and air flow in ductwork where shown on the Drawings or required by the sequence of operation.
- b. Flow sensor output shall be compatible with controller served.
- c. Duct Airflow Measuring Station (AFMS) shall have a multiport, sensing tube station.

- 1) Casing: Galvanized-steel frame.

- 2) Flow Straightener: Aluminum honeycomb, 3/4-inch (20-mm) parallel cell, 3 inches (75 mm) deep. Provide where straight duct run requirement can not be met.
- 3) Each duct or opening mounted AFMS shall consist of one to four sensor probes and a single, remote transmitter.
- 4) Each sensor probe shall consist of one to eight independent sensor nodes.
- 5) Each sensor node shall consist of two hermetically sealed bead-in-glass thermistors.

#### E. WIRING

1. Wiring shall be in accordance with Specification 260000, Low Voltage Electrical Power Conductors and Cables.

#### F. AIR QUALITY SENSORS WITH TEMPERATURE SENSOR, CO2 SENSOR AND HUMIDITY SENSOR

1. Air quality sensors with temperature sensor, co2 sensor and humidity sensor shall be Siemens QPA2062 or approved equal.
2. Technical details:
  - a. Ambient temperature, operation: 0...50 °C
  - b. Connection, electrical: Screw terminals
  - c. Operating voltage: 24 VAC, 15...35 VDC
  - d. Analog outputs: 0-10V / 4-20mA (selectable)
  - e. Analog output, signal: DC 0...5 V, DC 0...10 V, DC 4...20 mA
3. Measurement accuracy: Temperature: +/-1.4°F, Humidity: +/-2% between 10-90% RH; +/-3% outside this range, , Air Quality: +/-50 ppm + 2% of measured value
4. Measuring range, temperature: 32 to122°F, -35...35 °C
5. Measurement range humidity: 0 to 95 % r.h.
6. Measuring range, CO2: 0 to 2000 ppm
7. Dimensions (W x H x D): 90 x 100 x 36 mm

### 2.4 APPLICATIONS

- A. The System Management Platform for Building Automation Systems shall support the following:
  1. Graphically operate and monitor the building automation system and take control of HVAC equipment.
  2. Act by manually switching devices from auto to manual mode.
  3. Detect, visualize, and acknowledge/reset faults and alarms.
  4. Collect, visualize, and compare online and offline Trend data.
  5. Create schedules to automate the operation of the building and set up exceptions, which override regular schedules.
  6. Compose and configure report definitions to produce a variety of performance reports the building.
  7. Store and retrieve system activity data, view data logs.
  8. Create and execute automated reactions between the networked systems.
  9. Send out automatic remote notifications via email, SMS, and pagers.

B. Main Feature Support

1. User Profiles
  - a. Individual, specific or user defined views must be adjustable for the plant overview. The views must cover various electrical and mechanical installations or follow geographic or organizational criteria and permit a customized, hierarchy view that depicts the management station, control systems, plant geographic layout as well as relationship of the mechanical facilities.
2. User Privileges
  - a. The building management system must allow users to define, change, or delete predefined reactions as per their user privileges.
3. Graphics
  - a. The Graphics editor shall provide an AutoCAD importing tool that allows the user to select and manipulate layers of AutoCAD drawings both during and after the import process.
  - b. Standardized graphic libraries shall be provided. Library elements shall have the ability to be customized to the particular project.
  - c. Operating Interface to CAD System:
    - 1) The user interface must allow users access to various system diagrams and floor plans using graphical depictions, menu selections, and data point assignments.
    - 2) The graphics software must also permit the import of CAD symbols (DWG, DXF format) or scanned images for use in the system.
  - d. Graphics Symbols and Standards
    - 1) Plant graphics must meet the ergonomic needs of the operator. The displayed graphic symbols must correspond to the generally valid standard for HVAC symbols (DIN EN 62424 (VDE0810-24)) and ASHRAE guidelines. The symbols must be supported as two- and three-dimensional graphics.
4. Textual Viewer
  - a. Both panel-based and workstation-based trending shall be provided to support control systems without embedded Trend capabilities.
  - b. Trend data shall be stored in a Microsoft SQL Server database.
  - c. The Trend Comparison View allows users to time-shift the Trend View to compare data at different times for quick analysis of changing conditions.
5. Trend Viewer
  - a. Both panel-based and workstation-based trending shall be provided to support control systems without embedded Trend capabilities.
  - b. Trend data shall be stored in a Microsoft SQL Server database.
  - c. The Trend Comparison View shall allow users to time-shift the Trend View to compare data at different times for quick analysis of changing conditions.
6. Long Term Storage and archiving
  - a. System Management Platform shall allow the ability to maintain extensive amount of historic data online, also providing support for on-line data archiving and on-demand re-mounting.
7. Predefined Macros
  - a. Macros shall include predefined lists of commands that enable a user to send out a group of commands to specified devices with a single action. Some macros can be started manually while others may be part of schedules defined for time-based functions or automatic reactions.
  - b. Macros shall have the ability to be used by the system to perform multiple command actions. These predefined system macros are applied to specific control actions, such as block commands to fire control panels and system backup functions.
8. Scripting

- a. Provide a Script Editor to create sophisticated and powerful script programs based on JavaScript language. Scripts can be executed on demand or automatically by the system based on trigger conditions.
9. Reports
  - a. The System Management Platform reporting tool includes standard reporting templates (for example Status, Event or Configuration templates) and allows a user to create fully configurable reports with custom logos, headers, footers, and layouts that include tabular and graphical system information. Reports can be scheduled and saved in CSV or PDF formats for future use and/or programmed to be sent via email to pre-configured recipients (for example, every Monday morning at 8.00 AM, a report with all alarms occurred over the previous seven days is created and sent to the Facility Manager).
10. Notifications
  - a. System shall have the ability to be configured to automatically or manually send out notifications in case of an alarm.
    - 1) Notification shall include 3 functional levels with a seamless upgrade possibility:
    - 2) Reno: shall support notifications via Email, SMS and Pager to max. 100 persons
    - 3) Reno plus: shall support advanced alerting (e.g. multi-level escalation, active/inactive setting of recipients, recipient time-zones, etc.) and supports notifications to more than 100 recipients
    - 4) MNS: shall support mass notification system supporting multiple input and output channels to alert many people
11. Mobile App
  - a. The System Management Platform app shall allow an operator view and handle the alarms and objects of the integrated building management platform System Management Platform. Mobile App connects via System Management Platform Web Services and consume Web Service sessions.
12. Video Surveillance
  - a. Video Surveillance in System Management Platform shall allow the operator to monitor and operate the video systems. Typical video surveillance workflows are supported, including display of live video streams, PTZ and preset operations, recording, tagging and recording bookmarks, search and replay and multi-camera operations for operating procedures, camera groups and camera sequences.
  - b. Continuous monitoring of cameras, (logical) video monitors, archiving and recording devices allow fast response to video events shall be supported.
  - c. Shall provide remote-control video capabilities allow the management of monitor walls and the sharing of video information and operations across the system. Each client can handle multiple video displays, providing support for flexible layouts and typical multi-monitor deployments.
13. Building Information Modeling (BIM)
  - a. The building management system must natively support Building Information Modeling (BIM) technology to perform the following actions:
    - 1) Display visual and data information from Building Automation components such as room controllers, field devices etc., in a 3D view.
    - 2) Display the 3D model of the building:
      - a) Allow operators to rotate, zoom in and zoom out the mode
      - b) Allow manual navigation through the 3D model, using the mouse cursor
      - c) Support simplified navigation with single mouse click to enter through doors, windows, and up/down staircases
      - d) Allow navigation from a system object via the browser to the associated equipment in the BIM view and vice versa

- e) Allow selection of BIM equipment and provide current (runtime) values and status properties. Commanding of objects shall be supported as well via the operating pane (such as switching on a light)
  - 3) Display 2D floor plan(s) of the building
    - a) Show the selected room in focus (zoom view)
    - b) Show various room statuses as colored carpets
    - c) Show current room values (runtime values) directly on the floor plan
    - d) Allow selection of a room or a segment
  - 4) Display\* room status in the 3D building view
    - a) Display the room operating mode (such as comfort, pre-comfort, etc.)
    - b) Display the presence detectors statuses
    - c) Display window states (open or closed) in a clear graphical format
    - d) Display the temperature status of a room
    - e) Display the lights' state
    - f) Display the positioning state of the blinds
  - 5) Provide a summary of all active events that are present in a selected area (such as a floor)
  - 6) Show the location of the building in Google maps (where applicable)
  - 7) Display the datasheet(s) and/or documentation of the selected equipment or field device, if relevant properties are present in the BIM data.
  - 8) Supported Data formats:
    - a) IFC4
    - b) IFC2x3
- C. Eco Monitoring
- 1. System shall support the green leaf concept by providing real-time monitoring and reporting of the HVAC equipment performance from an economic and ecological point of view. It shall display the quality of operation with a green leaf in Graphics and identifies unnecessary energy consumption. It shall allow the user to optimize the operation in order to reduce energy consumption and wear and tear of components without affecting comfort in a negative manner.
- D. Flexible Room Management
- 1. System shall allow the user to manage the office layout of a floor on demand. The systems Flexible Room Management editor, rooms can be re-assigned to floor segments. In addition, Central Function applications permit and support centralized control and coordination of defined groups, including a façade for blinds or multiple floors for lights. The user shall have ability to command, monitor or adjust elements of the Central Functions groups from a single vantage point.
- E. Energy and Power Management
- 1. Energy and Power Management (EPMS) must be part of the Building Management System (BMS) software.
  - 2. Operational and engineering data from EPMS must be in the same database as those of the BMS.
  - 3. The energy management system must be certified in accordance with ISO 50001 and thus meet the international standard for energy management systems.
  - 4. The following functions must use the same workflow, not requiring separate training or additional login:
    - a. Trending
    - b. Custom Graphics generation
    - c. Alarms management
    - d. Logs

- e. User management with various authorization levels
- f. Scripting
- g. Help

## 2.5 Management Station for Danger Management

- A. System shall allow for use with fire safety and security systems and allows users to:
  - 1. Visualize and handle events (for example, acknowledge, silence, and reset)
  - 2. Graphically monitor and control life safety and security systems
  - 3. Know where to start as the highest-priority events are highlighted
  - 4. Maintain continuous situational awareness of all fire panels with the graphical Node Map dashboard
  - 5. Directly navigate (with just one click) to the triggering element of an event
  - 6. Quickly navigate to custom operator instructions and graphical display of event locations
  - 7. Store and retrieve fire alarm system activity data
  - 8. Distribute fire, access, video and intrusion monitoring and control capabilities across a network of the system management clients
  - 9. Provide Operating Procedure checklists to guide the operator, under stressful conditions, in handling significant events
  - 10. Display multiple video streams
  - 11. Send out automatic remote notifications via email, SMS, and pagers
  - 12. Include and exclude (isolate/de-isolate) system devices
  - 13. View and schedule automatic history reports
  - 14. Provide "Ready To Arm" check for Intrusion

## 2.6 Management Station for the Electrical Interface

- A. User management station for systems of the electrical market, mainly KNX systems, allows users to:
  - 1. Graphically operate and monitor the managed systems and take control of specific equipment.
  - 2. Edit the scenario settings defined in the macro/reactions or scripts, to adapt them with the project usage needs.
  - 3. Create schedules to automate the operation of these systems and set up exceptions, which override regular schedules.
  - 4. Compose and configure report definitions to produce a variety of activity and energy performance reports.
  - 5. Detect, visualize, and acknowledge/reset faults and alarms.
  - 6. Collect, visualize, and compare online and offline Trend data.
  - 7. Interact between different managed systems that belong to different disciplines of the building and that are connected using different protocols.
  - 8. Open for extension with other 3rd party products like Hotel Management Systems.
  - 9. Easy and quick import of hierarchy and configuration configured in ETS.

## 2.7 Management Station for multiple Platform Interfaces

- A. Supports the combined control and management of building automation and danger management disciplines on a single management system allow for interaction between the following facilities:
  - 1. Unauthorized entry detected by the Intrusion system, initiates lighting and focuses the camera on the location.

2. Deteriorating weather conditions, like a storm, cause sending a centralized command to the room systems, opening all blinds, and informing about window contact status.
3. After successful access control authentication, access to the room is granted, Lights are activated, and HVAC systems switched to occupied mode.
4. Temporary noxious emissions, for example, from helicopter landing or vehicles at a loading dock, cause outside air dampers to close, stopping fresh air intake.
5. Scheduled activation for entire building modes (for example, night mode sets lights off, blinds and HVAC plants to unoccupied mode, perimeter security, camera positions, lifts to base position).
6. Under peak energy consumption conditions, inform the user and offer assisted procedures to optimize building equipment.
7. Built-in applications for vertical transportation systems manufactured by Schindler Ltd. (for example, monitor elevator status, call a lift, treat passenger alarms and faults, lifts and escalator dynamic visualization).

## 2.8 Open Platform

- A. BAS platform shall support an open platform by design and supports a variety of standard protocols and interfaces for field network integrations. User platform shall provide data to external applications and services.

## 2.9 Open Integrated Systems Support

- A. User management system shall support the following:
  1. Standard protocol support for building automation, fire safety and security systems.
  2. IT compliant and IT environment enabled system.
  3. Normalization and management of data from multiple sources.
  4. Extended application development and support for simple and complex systems.

## 2.10 Standard Protocols Support

- A. System shall support the following:
  1. System Management Platform communicates with field network devices to monitor and command information by using the following standard protocols:
  2. BACnet and BACnet/SC
  3. OPC DA (Data Access) and OPC UA (Unified Architecture)
  4. Modbus TCP
  5. SNMP
  6. M-Bus
  7. KNX and KNX Secure
  8. S7 and S7 PLUS and S7 secure communication
  9. IEC 61850

## 2.11 Subsystem Integration SORIS Support

- A. System shall support Southbound Open RESTful Integration Service (SORIS). System shall provide an open integration framework for System Management Platform that is easy to work with interoperability between computer systems on the internet: Developers shall have the ability to use the SORIS SDK to create SORIS adapters in Java or C# that map to the foreign system's protocol or interface. For security reasons, stage 1 adapters shall be deployed locally

on the System Management Platform server or FEPs. They shall have the ability to be deployed on other Windows, Linux or embedded device hosts inside the intranet via secure https communication and a VPN.

#### 2.12 Web Services NORIS Support

- A. System shall support Northbound Open RESTful Integration Service (NORIS). System shall allow external applications to read and write real time data as well as access events or historical values, by using the provided REST (Representational State Transfer) web service interfaces, e.g. NORIS. Web Services can be used for applications such as Enterprise Software, Energy Management services, Facility Management systems or Mobile Apps.

#### 2.13 OPC Server

- A. System shall allow Enterprise applications or other management systems to access real time values from integrated subsystems via OPC. The System Management Platform OPC Server supports the OPC DA (Data Access) specification. In addition, an OPC UA wrapper provides OPC UA Clients access to the exposed data.

#### 2.14 BACnet Server

- A. System shall allow 3rd party applications or other management systems to access real time values from integrated subsystems via BACnet. The BACnet Server complements the northbound interfaces of System Management Platform, and it is used to expose System Management Platform data, over a BACnet/IP network.
- B. The BACnet Server shall act as a gateway for non-BACnet network devices integrated to System Management Platform, to be exposed over a BACnet IP network, as BACnet objects.

#### 2.15 Fire Detection System, BACnet-based

- 1. BACnet-based fire detection systems supporting BACnet BIBB AE-LS-B as well as objects LifeSafetyPoint and LifeSafetyZone as per the PICS (Protocol Implementation Conformance Statement) document must be able to be integrated for best deployment of a building management system. The following functions must be supported:
  - a. Alarms and events from the fire detection system must be identified clearly and unambiguously.
  - b. Signaling device states must be displayed as per the BACnet standard.
  - c. Instruction texts must be able to be added to detectors and zones.
  - d. Situational and floor plans as well as dynamic symbols must be used for visualization.
  - e. A technical hierarchy, e.g. building, building part, zone, detector, must be provided to the operator for ease of operation.

#### 2.16 IEC 61850

- 1. A native integration with an electrical power network via IEC 61850 protocol must be supported.

#### 2.17 Modbus

1. The management station must support communication to Modbus TCP/IP devices and sub systems directly from the management station.
- 2.18 KNX
1. The management station must support native communication to KNX devices, via KNX/IP protocol through KNX IP Routers, or KNX IP interfaces and gateways.
  - 2.
- 2.19 Event Management
- A. User management system shall support Event Management (also called event or alarm handling) refers to the various actions and steps that users take to respond to an event (e.g. smoke alarm) that occurs. Such actions shall include, acknowledging the alarm, investigating its cause, resetting the alarm once the problem has been resolved, and filling out a report form.
- 2.20 Security
- A. Cybersecurity Certification
    1. The building management system must be implemented in accordance with the internationally recognized standards for industrial security ISA/IEC 62443, developed by the International Society of Automation (ISA) and adopted by the International Electrotechnical Commission (IEC).
      - a. The provider organization must have secure development processes certified to IEC 62443-4-1 Maturity Level 3 (ML3) or higher.
      - b. The building management system must be certified to IEC 62443-4-2 Security Level 2 (SL2) or higher.
  - B. Cybersecurity Guidelines
    1. Cybersecurity guidelines must be available to support secure commissioning and deployment of the building management system. The guidelines must describe how the system needs to be configured to foster secure operation of the products and solutions in the intended operating environment. The cybersecurity hardening guidelines must be maintained throughout the product lifecycle.
  - C. Cybersecurity Penetration Test
    1. Cybersecurity penetration test results based on Open Web Application Security Project (OWASP) Application Security Verification Standard for systems with sensitive data (OWASP ASVS Level 2) must be available.
  - D. Access Protection
    1. Different people maintain and operate the plant. Passwords must be assigned to authorized persons to guarantee transparency for tracking or authorization purposes. A minimum of four different rights must be assignable.
      - a. Administrator.
      - b. Program and graphics creation.
      - c. Operation to change or adjust setpoints.
      - d. Guest.
  - E. Windows Authentication
    1. The building management control system password management must meet the customer's IT guidelines. In other words, the customer's corporate standard also applies

to the BAC system. Therefore, password management and the associated properties must comply with standard Windows log on and "track" the operator on each workstation.

## 2.21 Certifications and Approval

### A. System shall support the following:

1. System Management Platform shall be tested against a wide range of domain- and country-specific norms and standards, including:
  - a. BACnet Revision 1.15, certified by BACnet Testing Laboratory as BACnet Advanced Workstation Software (BTL B-AWS)
  - b. AMEV recommendation BACnet 2011 compliant with Management Operation Unit (MOU-B) profile
  - c. OPC DA V2.05a and V3.0 Server, certified by the OPC Foundation certification program
  - d. ISO500001 certification of Powermanager EM
  - e. UL listed to UL864 10th edition Standard for Control Units and Accessories for command and control when installed on a UL864 approved computer
  - f. ULC listed to ULC-S527-11 3rd edition for command and control when installed on a ULC-S527 approved computer
  - g. UL listed to UL2572 for Mass Notification (for monitoring only when installed on a UL2572 approved computer)
  - h. ULC listed to ULC-S576 for Mass Notification (for monitoring only when installed on a UL2572 approved computer)
  - i. UL listed to UL-294 7th edition Standard for Safety - Access Control System Units
  - j. Support of pharmaceutical industry regulatory requirements, such as US FDA 21CFR Part 11, GMP Annex 11 or similar.

## 2.22 BACnet Secure Connect (BACnet/SC)

### A. The building management station must support the BACnet/SC standard and allow:

1. Support for any type of BACnet vendor using BACnet Secure Connect
2. Support for dual network deployment (e.g., both SC networks and BACnet standard networks can be deployed)
3. Handling of certificates for BACnet/SC
4. Support for certificate notifications (e.g., Certificate expiry)

## 2.23 BACnet Communication

- A. The Operator Workstation Software shall be capable of BACnet IP communications.
- B. The Operator Workstation Software shall have demonstrated interoperability during at least one BTL Interoperability Workshop.
- C. The Operator Workstation Software shall have demonstrated compliance to BTL B-AWS device classification through BTL listing as specified in ANSI/ASHRAE 135 under revision 1.13 or higher.
- D. The BAS software shall meet the BACnet device profile of an Advanced Workstation Server (B-AWS) and Operator Workstation (B-OWS) and shall support the following BACnet BIBBs:
  1. Data Sharing
    - a. DS-RP-A Data Sharing-ReadProperty-A
    - b. DS-RP-B Data Sharing-ReadProperty-B
    - c. DS-RPM-A Data Sharing-ReadPropertyMultiple-A

- d. DS-RPM-B Data Sharing-ReadPropertyMultiple-B
- e. DS-WP-A Data Sharing-WriteProperty-A
- f. DS-WP-B Data Sharing-WriteProperty-B
- g. DS-WPM-A Data Sharing-WritePropertyMultiple-A
- h. DS-COV-A Data Sharing-ChangeofValue-A
- i. DS-COVP-A Data Sharing – ChangeofValueProperty-A
- j. DS-V-A Data Sharing - View - A
- k. DS-AV-A Data Sharing - Advanced View - A
- l. DS-M-A Data Sharing - Modify - A
- m. DS-AM-A Data Sharing - Advanced Modify - A
- 2. Scheduling
  - a. SCHED-VM-A Scheduling-View and Modify-A
  - b. SCHED-AVM-A Scheduling-Advanced View and Modify-A
  - c. SCHED-WS-A Scheduling-Weekly Schedule-A
- 3. Alarm and Event Management
  - a. AE-N-A Alarm and Event-Notification-A
  - b. AE-ACK-A Alarm and Event-ACK-A
  - c. AE-LS-A Alarm and Event-LifeSafety - A
  - d. AE-VM-A Alarm and Event Management - View and Modify - A
  - e. AE-AVM-A Alarm and Event Management - Advanced View and Modify - A
  - f. AE-VN-A Alarm and Event Management - View Notifications - A
  - g. AE-AVN-A Alarm and Event Management - Advanced View Notifications – A
  - h. AE-AS-A Alarm and Event – Alarm Summary View –A
  - i. AE-ELV-A Alarm and Event –Event Log view – A
  - j. AE-ELVM-S Alarm and Event – Event Log View and Modify – A
  - k. AE-ASUM-A Alarm and Event – Alarm Summary –A
  - l. AE-ESUM-A Alarm and Event – Enrollment Summary –A
  - m. AE-INFO-A Alarm and Event – Information-A
- 4. Trending
  - a. T-AMVRA-A Trending-Automated Multiple Value Retrieval-A
  - b. T-V-A Trending-Viewing and Modifying Trends-A
  - c. T-ATR-A Trending-Automated Trend Retrieval-A
  - d. T-AVM-A Trending-Advanced View and Modify –A
  - e. T-A-A – Trending – Archival - A
- 5. Network Management
  - a. NM-CE-A Network Management-Connection Establishment-A
- 6. Device Management
  - a. DM-DDB-A Device Management-Dynamic Device Binding-A
  - b. DM-DDB-B Device Management-Dynamic Device Binding-B
  - c. DM-DOB-A Device Management-Dynamic Object Binding-A
  - d. DM-DOB-B Device Management-Dynamic Object Binding-B
  - e. DM-DCC-A Device Management-DeviceCommunicationControl-A
  - f. DM-TM-A Device Management-Text Message-A
  - g. DM-MTS-A Device Management-Manual Time Synchronization-A
  - h. DM-ATS-A Device Management-Automatic Time Synchronization-A
  - i. DM-TS-A Device Management-TimeSynchronization-A
  - j. DM-UTC-A Device Management-UTCTimeSynchronization-A
  - k. DM-RD-A Device Management-ReinitializeDevice-A
  - l. DM-BR-A Device Management-Backup and Restore-A
  - m. DM-LM-A Device Management-List Manipulation-A
  - n. DM-LM-B Device Management-List Manipulation-B
  - o. DM-OCD-A Device Management-Object Creation and Deletion-A
  - p. DM-ANM-A Device Management-Automatic Network Mapping-A
  - q. DM-ADM-A Device Management-Automatic Device Mapping-A
- 7. The BAS Server and Workstations shall support the following Data Link Layers:

- a. BACnet IP Annex J
  - b. BACnet IP Annex J Foreign Device
  - c. ISO 8802-3, Ethernet (Clause 7)
8. The BAS Server and Workstations shall be able to interact with all of the BACnet objects in the controllers. In addition, the software shall be able to support the following objects as they relate to features in the workstation software:
- a. Calendar
  - b. Command
  - c. Event Enrollment
  - d. Notification Class
  - e. Schedule
  - f. Trend Log
  - g. Trend Log Multiple
- D. The BAS Server and Workstations shall support transmitting and receiving segmented messages.
- E. The BAS Server and Workstation shall have the capability to be the BACnet/IP Broadcast Management Device (BBMD) and support foreign devices.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. The Contractor is responsible for delivering the hardware to the installation site, unloading and securing the hardware if delivered prior to installation.
- B. The Contractor shall ensure that all components specified or required to complete the installation satisfactorily are included, are compatible with each other, and are compatible with the conditions of installation and expected use.
- C. The Contractor shall ensure the overall effective operation and accuracy of individual parts and of the whole system.
- D. Install per manufacturer's recommendations.
- E. Equipment
  1. Temperature sensing sells:
    - a. Provide list with shop drawing of well locations to mechanical contractor
  2. Locate temperature sensors, humidity sensors, thermostats and humidistats for room control in tamper proof boxes or behind security grilles, or where shown on Drawings.
    - a. Locate sensor and/or stat on wall within room so it is capable of sensing true space conditions.
    - b. Prior to installation, coordinate sensor and/or thermostat locations with DOA.
  3. Mount local control panel enclosures at convenient locations adjacent to equipment served.
    - a. Mount all relays, PE switches, pressure switches, etc., internal to the temperature control panels
    - b. Tag each instrument corresponding to symbols used on control diagrams.

- c. Make fully compensated capillaries connected to instruments of sufficient length to allow them to be run in neat and workmanlike manner and placed in such position so that they will not obstruct service on equipment controlled.
  4. Mounting of field microprocessors on air handling units shall not be allowed.
- F. Identification: Label or code each field wire or pneumatic tube at each end, and each controller and controller device.
1. Identification shall be permanent, robust, not subject to fading, and flameproof.
  2. Permanently mark terminal blocks at wire termination points.
  3. Identify each control device with an engraved laminated phenolic nameplate, white on black, lettering not less than 1/8" height, on 1 1/2" by 1" tag and brass interlocked chain secured to the control device. Name shall correspond with identification on the shop drawings.
  4. Identify sensors, controllers, relays, either mounted in local or central control panels, or remote mounted with a similar name tag as specified above. Attach to or adjacent to controllers with stainless steel or brass screws or rivets. Adhesives will not be acceptable. Do not attach to removable controller covers.
- G. Pipe Work: Mount strap-on sensors using helical screw stainless steel band clamp for strap-on thermostats, aquastats and other temperature switches on new piping for unit heaters and fan coil units after the pipe is cleaned to bright metal. Strap-on sensor may be used on piping up to 2 1/2" diameter. On pipe 3 inches and larger use pipe wells.
- H. Pipe Wells: Install pipe well above the horizontal to retain liquid heat transfer fluid in the well.
- I. Valves: Install valves in piping with stems as vertical as possible but in no case more than 45 degrees from vertical. For soldered or welded connections, remove valve internals before mounting.
- J. Electric Valves: Wire electric valves in accordance with NFPA 70 with not less than 2 feet of flexible liquid tight connector with watertight bushings at the valve actuator. Brace conduit to the building structure.
- K. Pressure and Temperature Sensors: Install pressure and temperature sensors as follows:
1. Locate pressure and temperature sensing points sufficiently downstream from the control device to increase control loop time constant and minimize hunting.
  2. Locate shut-off valves and 3-valve bypasses as specified in "Sensors" paragraph of this Section.
  3. Locate sensors where accessible for maintenance and replacement.
  4. Do not cover or conceal sensors with insulation.
- L. Pressure Sensors for VFD operated supply and return fans: Install pressure temperature sensors as follows:
1. Locate pressure sensors approximately 2/3 of the total duct run distance from the controlled fan. Whenever main supply ductwork branches select the best sensor location subject to Engineer's approval. Whenever supply air is conveyed thru separate ducts, provide pressure sensor for each duct. Readings will be averaged out for control purpose.
  2. Locate sensors where accessible for maintenance and replacement.
  3. Do not cover or conceal sensors with insulation.

M. Space Sensors: Install space sensors as follows:

1. Space sensor including space thermostats, aspirating thermostats, humidistats, pressure or differential pressure sensors shall be enclosed in cast brushed aluminum or 16 gauge brushed and ground stainless steel enclosures. Enclosures shall be tamperproof. Setpoint adjustment or settings shall not be visible or adjustable from outside sensors enclosure. Sensors shall be securely mounted and rigid.
2. Locate room thermostats and other room sensors approximately 60 inches above the floor on inside wall where they will respond to average conditions in the space.
3. Sensors mounted on outside walls, if unavoidable, shall be mounted on factory made insulated brushed stainless steel bases.

8. Pressure Indicators: Provide each controller inside local field cabinets with instrumentation, pressure gauges, to show, at the controller location the condition of input power supply, input controller signal and branch line signal. Indicators shall be permanently mounted.

N. Duct Sensors: Select duct sensor locations to properly sense average air conditions, minimize vibration, avoid dead air spaces, and within velocity limits required by the manufacturer.

1. Provide velocity shields where required.
2. Securely mount or clamp averaging elements, maximum 3' on centers to the leaving side of coils and equipment. Insulate averaging elements from equipment and protect from vibration.
3. Provide separate duct flanges for each sensing device.
4. Provide gaskets or sealant where elements penetrate duct walls.
5. Mount sensor to allow easy removal and servicing without disturbing insulation or vapor barrier. Mount on stand-off brackets to avoid condensation.
6. Coordinate the location for duct access doors downstream from each duct sensor.

O. Pipe Sensors: Provide wells for all sensors and indicators measuring temperatures in pressure vessels and piping.

1. Wells shall be stainless steel or bronze to match media requirements.
2. Verify working pressure of sensor wells.
3. Do not install wells in extension couplings.
4. Where pipe diameters are smaller than the well length, provide wells at piping elbow or tees to affect flow across the entire well area.
5. Wells may face upstream or downstream.
6. Angle wells to retain thermal fluid within the well.
7. Should wells restrict cross sectional pipe area to less than 70% free area, provide pipe increases at the well not less than 50% pipe diameter.

### 3.2 GRAPHICS REQUIREMENTS

- A. Follow Graphical Interface Requirements.

### 3.3 SYSTEM START UP

- A. Provide a factory authorized technician of the system to verify the installation, test the system, provide initial programming/set-up requirements and train the Owner on proper operation and maintenance of the system. Before requesting start-up services, the Contractor shall verify that:
1. The system has been fully installed in accordance with manufacturer's installation instructions.
  2. Network connections have been checked for connectivity.

3. Proper notification of the impending start-up has been provided.

### 3.4 TRAINING

- A. Provide a formal, on-site 16-hour training program for technical and administrative operating personnel, including operating, troubleshooting, servicing, and preventative maintenance of the systems installed and/or integrated as part of this specific project.
- B. Instruction shall be conducted by a manufacturer's training / inspection representative, supported by training manuals and shall utilize the actual system being provided.
- C. Provide instruction for up to four technical and four administrative personnel over the period of the warranty.
- D. Classes must be flexibly scheduled to accommodate training for the Owner's personnel. The Contractor shall schedule training with the Owner at least seven (7) days in advance of the training.

### 3.5 WARRANTY

- A. Software environment shall include 1-year warranty.

### 3.6 DEMOLITION

- A. Remove controls, which do not remain as part of the building automation system, all associated abandoned wiring and conduit, and all associated pneumatic tubing.
- B. The Owner shall inform the BMS Contractor of any equipment, which is to be removed, that shall remain the property of the Owner. All other equipment, which is removed, shall be disposed of by the BMS Contractor.

### 3.7 CLEANING

- A. The contractor shall clean up all debris resulting from their activities daily. The contractor shall remove all cartons, containers, crates, etc., under his/her control as soon as their contents have been removed. Waste shall be collected and placed in a designated location.
- B. At the completion of work in any area, the contractor shall clean all work, equipment, etc., keeping it free from dust, dirt, and debris, etc.
- C. At the completion of work, all equipment furnished under this section shall be checked for paint damage, and any factory finished paint that has been damaged shall be repaired to match the adjacent areas. Any cabinet or enclosure that has been deformed shall be replaced with new material and repainted to match the adjacent areas.

### 3.8 IDENTIFICATION

- A. Cables: Identify all control wires with labeling tape or sleeves using either words, letters, or numbers that can be exactly cross referenced with asbuilt drawings.

- B. Enclosures: All field enclosures, other than controllers, shall be identified with a bakelite nameplate. The lettering shall be in white against a black or blue background.
- C. Junction Boxes: Junction box covers shall be marked to indicate that they are a part of the BAS system.
- D. Field Devices: All I/O field devices (except space sensors) that are not mounted within FIPs shall be identified with name plates. All I/O field devices inside FIPs shall be labeled.

### 3.9 DEVICE LOCATIONS

- A. Project Drawings: The location of sensors is per mechanical and architectural drawings.
- B. Space Sensors: Space humidity or temperature sensors shall be mounted away from machinery generating heat, direct light, and diffuser air streams.
- C. Outside Air Conditions: Outdoor air sensors shall be mounted on the northerly facing directly in the outside air. Install these sensors such that the effects of heat radiated from the building or sunlight is minimized.
- D. Enclosures: Field enclosures shall be located immediately adjacent to the controller panel(s) to which it is being interfaced.

### 3.10 SYSTEM TESTING

- A. Upon completion of the control device installation, the BMS contractor shall load all system software and startup the system. The BMS contractor shall perform all necessary calibration, testing and de-bugging and perform all required operational checks to insure that the system is functioning in full accordance with these specifications.
- B. Manufacturer's Field Service: A directly employed factory authorized & trained service technician shall inspect, test, and adjust field assembled components and equipment installation, including connections, and to assist in field testing. Report results in writing.
- C. Expertise: The BMS shall be set up and checked by factory trained competent technicians skilled in the setting and adjustment of the BMS/DDC equipment used in this project. These technicians are to be experienced in the type of HVAC systems associated with this project. The BMS contractor shall perform tests to verify proper performance of components, routines, and points. Repeat tests until proper performance results. This testing shall include a point-by-point log to validate 100 percent of the input and output points of the DDC system operation.
- D. Point-to-Point Checkout: Each I/O device (both field mounted as well as those located in field interface panels) shall be inspected and verified for proper installation and functionality. A checkout sheet itemizing each device shall be filled out, dated, and approved by the BMS contractor for submission to the owner or owner's representative.
- E. Controller and Workstation Checkout: A field checkout of all controllers and front end equipment (computers, printers, modems, etc.) shall be conducted to verify proper operation of both hardware and software. A checkout sheet itemizing each device and a description of the associated tests shall be prepared and submitted to the owner or owner's representative by the completion of the project. All approved submitted sequences shall be tested by the control contractor before acceptance testing described below.

- F. Control Device Verification:
1. Verify that instruments are installed before calibration, testing, and loop or leak checks.
  2. Check instruments for proper location and accessibility.
  3. Check instrument installation for direction of flow, elevation, orientation, insertion depth, and other applicable considerations.
  4. Check flow instruments. Inspect tag number and line and bore size and verify that inlet side is identified and that meters are installed correctly.
  5. Check pressure instruments, piping slope, installation of valve manifold, and self-contained pressure regulators.
  6. Check temperature instruments and material and length of sensing elements.
  7. Check control valves. Verify that they are in correct direction.
  8. Verify that DDC controller power supply is from emergency power supply, if applicable. Verify that wires at control panels are tagged with their service designation and approved tagging system. Verify that spare I/O capacity has been provided. Verify that DDC controllers are protected from power supply surges. Replace damaged or malfunctioning controls and equipment and repeat testing procedures.
- G. Calibrating and Adjusting
1. Initial Setpoints: Adjust initial temperature and humidity set points.
  2. Calibrate instruments: Make three point calibration test for both linearity and accuracy for each analog instrument. Calibrate equipment and procedures using manufacturer's written recommendations and instruction manuals. Use test equipment with accuracy at least double that of instrument being calibrated.
  3. Control System Inputs and Outputs:
    - a. Check analog inputs at 0, 50, and 100 percent of span.
    - b. Check analog outputs using milliampere meter at 0, 50, and 100 percent output.
    - c. Check digital inputs using jumper wire.
    - d. Check digital outputs using ohmmeter to test for contact making or breaking.
  4. Flow: Set differential pressure flow transmitters for 0 and 100 percent values with 3 point calibration accomplished at 50, 90, and 100 percent of span. Manually operate flow switches to verify that they make or break contact.
  5. Pressure: Calibrate pressure transmitters at 0, 50, and 100 percent of span. Calibrate pressure switches to make or break contacts, with adjustable differential set at minimum.
  6. Temperatures: Calibrate resistance temperature transmitters at 0, 50, and 100 percent of span using a precision resistance source. Calibrate temperature switches to make or break contacts.
  7. Dampers and Valves: Stroke and adjust control valves and dampers without positioners, following the manufacturer's recommended procedure, so that valve or damper is 100 percent open and closed. Stroke and adjust control valves and dampers with positioners, following manufacturer's recommended procedure, so that valve and damper is 0, 50, and 100 percent closed.
- H. Provide diagnostic and test instruments for calibration and adjustment of system.
- I. Provide written description of procedures and equipment for calibrating each type of instrument. Submit procedures review and approval before initiating startup procedures.
- J. The BMS acceptance shall be contingent upon completion and review of all corrected deficiencies. The system shall not be accepted until all forms and checklists completed as part of the demonstration are submitted and approved as required in Part 1, "Submittals."
- K. All application software shall be verified and compared against the sequences of operation. Control loops shall be exercised by inducing a setpoint shift of at least 10 percent and observing whether the system successfully returns the process variable to setpoint. Record all test results and attach to the Test Results Sheet.

- L. Test each alarm in the system and validate that the system generates the appropriate alarm message, that the message appears at all prescribed destinations (workstations or printers), and that any other related actions occur as defined (i.e., graphic panels are invoked, reports are generated, etc.). Submit a Test Results Sheet to the owner.
- M. Perform an operational test of each unique graphic display and report to verify that the item exists, that the appearance and content are correct, and that any special features work as intended. Submit a Test Results Sheet to the owner.
- N. Perform an operational test of each third party interface that has been included as part of the automation system. Verify that all points are properly polled, that alarms have been configured, and that any associated graphics and reports have been completed. If the interface involves a file transfer over Ethernet, test any logic that controls the transmission of the file, and verify the content of the specified information.
- O. At the completion of the Acceptance Testing, this BMS contractor shall demonstrate the sequence of operations for each system to the Architect or his representative.

### 3.11 BMS ACCEPTANCE

- A. All tests described in this specification shall have been performed to the satisfaction of both the engineer and owner prior to the acceptance of the control system as meeting the requirements of completion. Any tests that cannot be performed due to circumstances beyond the control of the contractor may be exempt from the completion requirements if stated as such in writing by the engineer. Such tests shall then be performed as part of the warranty.

### 3.12 BMS OPERATOR TRAINING

- A. During system commissioning and at such time acceptable performance of the Control System hardware and software has been established, the BMS contractor shall provide onsite operator instruction to the owner's operating personnel. Operator instruction shall be done during normal working hours and shall be performed by a competent representative familiar with the system hardware, software, and accessories.
- B. The BMS contractor shall provide 8 total hours of comprehensive training in multiple sessions for system orientation, product maintenance and troubleshooting, programming, and engineering.
  - 1. These classes are to be spread out during the 1st year warranty period.
  - 2. The first class starting after final commissioning and the last class is to be in the last month of 1 year warranty period.
- C. Training Personnel: A BMS representative who is factory trained and authorized to provide such service shall provide training to the Owner's personnel. The training shall include instruction of the owners' designated personnel on the operation and maintenance of the entire BMS. This orientation shall, at a minimum, consist of a review of the project asbuilt drawings, The BMS software layout and naming conventions and a walk through of the facility to identify panel and device locations

### 3.13 WARRANTY

- A. Equipment, materials, and workmanship incorporated into the work shall be warranted for a period of one year from the time of system acceptance.
- B. Remote Connectivity: The Owner shall provide all Internet Service Provider services and connections (Full time high speed ISP connection recommended for remote site access (i.e., T1, ADSL, cable modem)) for the BMS Contractor to perform BMS warranty response work. This connection shall be maintained throughout the warranty period at the Owner's cost for remote site warranty access and support. The BMS contractor shall identify the specific connection requirements in a shop drawing submittal.
- C. Occupancy Adjustments: When requested by the owner within 12 months of date of Substantial Completion: Provide remote adjustment to the system to suit actual occupied conditions. Provide up to three site visits during normal occupancy hours for this purpose.
- D. Material Warranty Repair &/or replacement: Within this period, upon notice by the Owner, any defects in the BMS due to faulty materials, methods of installation or workmanship shall be promptly repaired or replaced by the BMS contractor at no expense to the Owner.
- E. Maintenance of Computer Software Programs: The BMS contractor shall maintain all software during the standard first year warranty period. All factory upgrades to software during the first year warranty period shall be added to the systems, when they become available, at no additional cost.
- F. Service Period: Non-warranty service calls by the owner shall be addressed within 24 hours. Non-warranty service, replacement or repair are not to be considered as part of routine maintenance.
- G. Service Documentation: A copy of the service report associated with each owner initiated service call shall be provided to the owner.
- H. BMS System Access: The Owner shall grant to the BMS Contractor reasonable access to the BMS during the warranty period. Remote access to the BMS (for the purpose of diagnostics and troubleshooting, via the Internet, during the warranty period) shall be allowed.

### 3.14 OPERATION & MAINTENANCE MANUALS

- A. See Division 1 for requirements. O&M manuals shall include the following elements, as a minimum:
  - 1. Asbuilt control drawings for all equipment.
  - 2. Asbuilt Network Communications Diagram.
  - 3. General description and specifications for all components.
  - 4. Completed Performance Verification sheets.
  - 5. Completed Controller Checkout/Calibration Sheets.

### 3.15 PROTECTION

- A. Protect installed products until completion of project.
- B. Touch up, repair, or replace damaged products before Substantial Completion.

END OF SECTION 230900

## SECTION 231123 - FACILITY NATURAL-GAS PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Pipes, tubes, and fittings.
  - 2. Piping specialties.
  - 3. Piping and tubing joining materials.
  - 4. Valves.
  - 5. Pressure regulators.
  - 6. Mechanical sleeve seals.

#### 1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct shafts, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Minimum Operating-Pressure Ratings:
  - 1. Piping and Valves: 100 psig minimum unless otherwise indicated.
  - 2. Service Regulators: 100 psig minimum unless otherwise indicated.
  - 3. Minimum Operating Pressure of Service Meter: As required by utility company specifications.
- B. Natural-Gas System Pressures within Buildings: Primary pressure is 2 psig or less.

#### 1.5 SUBMITTALS

- A. Product Data: For each type of the following:

1. Piping specialties.
  2. Corrugated, stainless-steel tubing with associated components.
  3. Valves. Include pressure rating, capacity, settings, and electrical connection data of selected models.
  4. Pressure regulators. Indicate pressure ratings and capacities.
  5. Service meters. Indicate pressure ratings and capacities. Include bypass fittings.
  6. Dielectric fittings.
  7. Mechanical sleeve seals.
  8. Escutcheons.
- B. Shop Drawings: For facility natural-gas piping layout. Include plans, piping layout and elevations, sections, and details for fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to building structure. Detail location of anchors, alignment guides, and expansion joints and loops.
1. Shop Drawing Scale: 1/4 inch per foot.
  2. Detail mounting, supports, and valve arrangements for service meter assembly and pressure regulator assembly.
- C. Coordination Drawings: Plans and details, drawn to scale, on which natural-gas piping is shown and coordinated with other installations, using input from installers of the items involved.
- D. Site Survey: Plans, drawn to scale, on which natural-gas piping is shown and coordinated with other services and utilities.
- E. Qualification Data: For qualified professional engineer.
- F. Welding certificates.
- G. Field quality-control reports.
- H. Operation and Maintenance Data: For pressure regulators to include in emergency, operation, and maintenance manuals.
- 1.6 QUALITY ASSURANCE
- A. Steel Support Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
  - B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.
  - C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- 1.7 DELIVERY, STORAGE, AND HANDLING
- A. Handling Flammable Liquids: Remove and dispose of liquids from existing natural-gas piping according to requirements of authorities having jurisdiction.

- B. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- C. Store and handle pipes and tubes having factory-applied protective coatings to avoid damaging coating, and protect from direct sunlight.

## 1.8 PROJECT CONDITIONS

- A. Perform site survey, research public utility records, and verify existing utility locations. Contact utility-locating service for area where Project is located.
- B. Interruption of Existing Natural-Gas Service: Do not interrupt natural-gas service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide purging and startup of natural-gas supply according to requirements indicated:
  - 1. Notify Owner no fewer than five days in advance of proposed interruption of natural-gas service.
  - 2. Do not proceed with interruption of natural-gas service without Owner's written permission.

## 1.9 COORDINATION

- A. Coordinate sizes and locations of concrete bases with actual equipment provided.
- B. Coordinate requirements for access panels and doors for valves installed concealed behind finished surfaces. Comply with requirements in Division 08 Section "Access Doors and Frames."

## PART 2 - PRODUCTS

### 2.1 PIPES, TUBES, AND FITTINGS

- A. Steel Pipe: ASTM A 53/A 53M, black steel, Schedule 40, Type E or S, Grade B.
  - 1. Malleable-Iron Threaded Fittings: ASME B16.3, Class 150, standard pattern.
  - 2. Wrought-Steel Welding Fittings: ASTM A 234/A 234M for butt welding and socket welding.
  - 3. Unions: ASME B16.39, Class 150, malleable iron with brass-to-iron seat, ground joint, and threaded ends.
  - 4. Forged-Steel Flanges and Flanged Fittings: ASME B16.5, minimum Class 150, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
    - a. Material Group: 1.1.
    - b. End Connections: Threaded or butt welding to match pipe.
    - c. Lapped Face: Not permitted underground.
    - d. Gasket Materials: ASME B16.20, metallic, flat, asbestos free, aluminum o-rings, and spiral-wound metal gaskets.

- e. Bolts and Nuts: ASME B18.2.1, carbon steel aboveground and stainless steel underground.
- 5. Protective Coating for Underground Piping: Factory-applied, three-layer coating of epoxy, adhesive, and PE.
  - a. Joint Cover Kits: Epoxy paint, adhesive, and heat-shrink PE sleeves.

## 2.2 PIPING SPECIALTIES

- A. Weatherproof Vent Cap: Cast- or malleable-iron increaser fitting with corrosion-resistant wire screen, with free area at least equal to cross-sectional area of connecting pipe and threaded-end connection.

## 2.3 JOINING MATERIALS

- A. Joint Compound and Tape: Suitable for natural gas.
- B. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.

## 2.4 MANUAL GAS SHUTOFF VALVES

- A. See "Aboveground Manual Gas Shutoff Valve Schedule" Articles for where each valve type is applied in various services.
- B. General Requirements for Metallic Valves, NPS 2 and Smaller: Comply with ASME B16.33.
  - 1. CWP Rating: 125 psig .
  - 2. Threaded Ends: Comply with ASME B1.20.1.
  - 3. Dryseal Threads on Flare Ends: Comply with ASME B1.20.3.
  - 4. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  - 5. Listing: Listed and labeled by an NRTL acceptable to authorities having jurisdiction for valves 1 inch and smaller.
  - 6. Service Mark: Valves 1-1/4 inches to NPS 2 shall have initials "WOG" permanently marked on valve body.
- C. General Requirements for Metallic Valves, NPS 2-1/2 and Larger: Comply with ASME B16.38.
  - 1. CWP Rating: 125 psig .
  - 2. Flanged Ends: Comply with ASME B16.5 for steel flanges.
  - 3. Tamperproof Feature: Locking feature for valves indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  - 4. Service Mark: Initials "WOG" shall be permanently marked on valve body.
- D. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim: MSS SP-110.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. BrassCraft Manufacturing Company; a Masco company.
    - b. Conbraco Industries, Inc.; Apollo Div.
    - c. Lyall, R. W. & Company, Inc.
    - d. McDonald, A. Y. Mfg. Co.
  2. Body: Bronze, complying with ASTM B 584.
  3. Ball: Chrome-plated bronze.
  4. Stem: Bronze; blowout proof.
  5. Seats: Reinforced TFE; blowout proof.
  6. Packing: Threaded-body packnut design with adjustable-stem packing.
  7. Ends: Threaded, flared, or socket as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  8. CWP Rating: 600 psig.
  9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- E. Bronze Plug Valves: MSS SP-78.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. McDonald, A. Y. Mfg. Co.
    - b. Lee Brass Company.
  2. Body: Bronze, complying with ASTM B 584.
  3. Plug: Bronze.
  4. Ends: Threaded, socket, or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
  5. Operator: Square head or lug type with tamperproof feature where indicated.
  6. Pressure Class: 125 psig.
  7. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
  8. Service: Suitable for natural-gas service with "WOG" indicated on valve body.
- F. Cast-Iron, Lubricated Plug Valves: MSS SP-78.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Flowserve.
    - b. Homestead Valve; a division of Olson Technologies, Inc.
    - c. McDonald, A. Y. Mfg. Co.
    - d. Milliken Valve Company.
    - e. Mueller Co.; Gas Products Div.
    - f. R&M Energy Systems, A Unit of Robbins & Myers, Inc.
  2. Body: Cast iron, complying with ASTM A 126, Class B.
  3. Plug: Bronze or nickel-plated cast iron.
  4. Seat: Coated with thermoplastic.
  5. Stem Seal: Compatible with natural gas.

6. Ends: Threaded or flanged as indicated in "Underground Manual Gas Shutoff Valve Schedule" and "Aboveground Manual Gas Shutoff Valve Schedule" Articles.
7. Operator: Square head or lug type with tamperproof feature where indicated.
8. Pressure Class: 125 psig.
9. Listing: Valves NPS 1 and smaller shall be listed and labeled by an NRTL acceptable to authorities having jurisdiction.
10. Service: Suitable for natural-gas service with "WOG" indicated on valve body.

## 2.5 PRESSURE REGULATORS

### A. General Requirements:

1. Single stage and suitable for natural gas.
2. Steel jacket and corrosion-resistant components.
3. Elevation compensator.
4. End Connections: Threaded for regulators NPS 2 and smaller; flanged for regulators NPS 2-1/2 and larger.

### B. Line Pressure Regulators: Comply with ANSI Z21.80.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Actaris.
  - b. American Meter Company.
  - c. Eclipse Combustion, Inc.
  - d. Fisher Control Valves and Regulators; Division of Emerson Process Management.
  - e. Invensys.
  - f. Maxitrol Company.
  - g. Richards Industries; Jordan Valve Div.
2. Body and Diaphragm Case: Cast iron or die-cast aluminum.
3. Springs: Zinc-plated steel; interchangeable.
4. Diaphragm Plate: Zinc-plated steel.
5. Seat Disc: Nitrile rubber resistant to gas impurities, abrasion, and deformation at the valve port.
6. Orifice: Aluminum; interchangeable.
7. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
8. Single-port, self-contained regulator with orifice no larger than required at maximum pressure inlet, and no pressure sensing piping external to the regulator.
9. Pressure regulator shall maintain discharge pressure setting downstream, and not exceed 150 percent of design discharge pressure at shutoff.
10. Overpressure Protection Device: Factory mounted on pressure regulator.
11. Atmospheric Vent: Factory- or field-installed, stainless-steel screen in opening if not connected to vent piping.
12. Maximum Inlet Pressure: 2 psig.

### C. Appliance Pressure Regulators: Comply with ANSI Z21.18.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Canadian Meter Company Inc.
  - b. Eaton Corporation; Controls Div.

- c. Harper Wyman Co.
  - d. Maxitrol Company.
  - e. SCP, Inc.
- 
2. Body and Diaphragm Case: Die-cast aluminum.
  3. Springs: Zinc-plated steel; interchangeable.
  4. Diaphragm Plate: Zinc-plated steel.
  5. Seat Disc: Nitrile rubber.
  6. Seal Plug: Ultraviolet-stabilized, mineral-filled nylon.
  7. Factory-Applied Finish: Minimum three-layer polyester and polyurethane paint finish.
  8. Regulator may include vent limiting device, instead of vent connection, if approved by authorities having jurisdiction.
  9. Maximum Inlet Pressure: 2 psig.

## 2.6 DIELECTRIC FITTINGS

### A. Dielectric Unions:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Capitol Manufacturing Company.
  - b. Central Plastics Company.
  - c. Hart Industries International, Inc.
  - d. McDonald, A. Y. Mfg. Co.
  - e. Watts Regulator Co.; Division of Watts Water Technologies, Inc.
  - f. Wilkins; Zurn Plumbing Products Group.
2. Minimum Operating-Pressure Rating: 150 psig.
3. Combination fitting of copper alloy and ferrous materials.
4. Insulating materials suitable for natural gas.
5. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

### B. Dielectric Flanges:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Capitol Manufacturing Company.
  - b. Central Plastics Company.
  - c. Watts Regulator Co.; Division of Watts Water Technologies, Inc.
  - d. Wilkins; Zurn Plumbing Products Group.
2. Minimum Operating-Pressure Rating: 150 psig.
3. Combination fitting of copper alloy and ferrous materials.
4. Insulating materials suitable for natural gas.
5. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

### C. Dielectric-Flange Kits:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Advance Products & Systems, Inc.
  - b. Calpico Inc.
  - c. Central Plastics Company.
  - d. Pipeline Seal and Insulator, Inc.
2. Minimum Operating-Pressure Rating: 150 psig.
3. Companion-flange assembly for field assembly.
4. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or PE bolt sleeves, phenolic washers, and steel backing washers.
5. Insulating materials suitable for natural gas.
6. Combination fitting of copper alloy and ferrous materials with threaded, brazed-joint, plain, or welded end connections that match piping system materials.

## 2.7 SLEEVES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.

## 2.8 MECHANICAL SLEEVE SEALS

- A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Calpico Inc.
    - c. Metraflex Company (The).
    - d. Pipeline Seal and Insulator, Inc.
  2. Sealing Elements: EPDM interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe and sleeve.
  3. Pressure Plates: Carbon steel.
  4. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating of length required to secure pressure plates to sealing elements. Include one nut and bolt for each sealing element.

## 2.9 ESCUTCHEONS

- A. General Requirements for Escutcheons: Manufactured wall and ceiling escutcheons and floor plates, with ID to fit around pipe or tube, and OD that completely covers opening.
- B. Split-Casting, Cast-Brass Escutcheons: With concealed hinge and set screw.

1. Finish: Polished chrome-plated.
- C. Split-Plate, Stamped-Steel Escutcheons: With exposed-rivet hinge, set screw or spring clips, and chrome-plated finish.
- D. Split-Casting, Floor-Plate Escutcheons: Cast brass with concealed hinge and set screw.
- 2.10 GROUT
- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
1. Characteristics: Post-hardening, volume adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
  2. Design Mix: 5000-psi, 28-day compressive strength.
  3. Packaging: Premixed and factory packaged.

### PART 3 - EXECUTION

#### 3.1 EXAMINATION

- A. Examine roughing-in for natural-gas piping system to verify actual locations of piping connections before equipment installation.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

#### 3.2 PREPARATION

- A. Close equipment shutoff valves before turning off natural gas to premises or piping section.
- B. Inspect natural-gas piping according to the International Fuel Gas Code to determine that natural-gas utilization devices are turned off in piping section affected.
- C. Comply with the International Fuel Gas Code requirements for prevention of accidental ignition.

#### 3.3 OUTDOOR PIPING INSTALLATION

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Steel Piping with Protective Coating:
1. Apply joint cover kits to pipe after joining to cover, seal, and protect joints.
  2. Repair damage to PE coating on pipe as recommended in writing by protective coating manufacturer.
  3. Replace pipe having damaged PE coating with new pipe.
- C. Install fittings for changes in direction and branch connections.

- D. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
  - 1. Install steel pipe for sleeves smaller than 6 inches in diameter.
  - 2. Install cast-iron "wall pipes" for sleeves 6 inches and larger in diameter.
- E. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.
- F. Install pressure gage downstream from each service regulator. Pressure gages are specified in Division 23 Section "Meters and Gages for HVAC Piping."

### 3.4 INDOOR PIPING INSTALLATION

- A. Comply with the International Fuel Gas Code for installation and purging of natural-gas piping.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Arrange for pipe spaces, chases, slots, sleeves, and openings in building structure during progress of construction, to allow for mechanical installations.
- D. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- E. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- F. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- G. Locate valves for easy access.
- H. Install natural-gas piping at uniform grade of 2 percent down toward drip and sediment traps.
- I. Install piping free of sags and bends.
- J. Install fittings for changes in direction and branch connections.
- K. Install escutcheons at penetrations of interior walls, ceilings, and floors.
  - 1. New Piping:
    - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type. Retain one of first two subparagraphs below.
    - b. Piping at Ceiling Penetrations in Finished Spaces: Split-casting, cast-brass type with polished chrome-plated finish.

- c. Piping at Ceiling Penetrations in Finished Spaces: Split-plate, stamped-steel type with concealed hinge and set screw.
  - d. Piping in Unfinished Service Spaces: One-piece, cast-brass type with polished chrome-plated finish.
  - e. Piping in Equipment Rooms: One-piece, cast-brass type.
  - f. Piping in Equipment Rooms: One-piece, stamped-steel type with set screw or spring clips.
- L. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping."
- M. Verify final equipment locations for roughing-in.
- N. Comply with requirements in Sections specifying gas-fired appliances and equipment for roughing-in requirements.
- O. Drips and Sediment Traps: Install drips at points where condensate may collect, including service-meter outlets. Locate where accessible to permit cleaning and emptying. Do not install where condensate is subject to freezing.
- 1. Construct drips and sediment traps using tee fitting with bottom outlet plugged or capped. Use nipple a minimum length of 3 pipe diameters, but not less than 3 inches long and same size as connected pipe. Install with space below bottom of drip to remove plug or cap.
- P. Extend relief vent connections for service regulators, line regulators, and overpressure protection devices to outdoors and terminate with weatherproof vent cap.
- Q. Conceal pipe installations in walls, pipe spaces, utility spaces, above ceilings, below grade or floors, and in floor channels unless indicated to be exposed to view.
- R. Concealed Location Installations: Except as specified below, install concealed natural-gas piping and piping installed under the building in containment conduit constructed of steel pipe with welded joints as described in Part 2. Install a vent pipe from containment conduit to outdoors and terminate with weatherproof vent cap.
- 1. Above Accessible Ceilings: Natural-gas piping, fittings, valves, and regulators may be installed in accessible spaces without containment conduit.
  - 2. In Floors: Install natural-gas piping with welded or brazed joints and protective coating in cast-in-place concrete floors. Cover piping to be cast in concrete slabs with minimum of 1-1/2 inches of concrete. Piping may not be in physical contact with other metallic structures such as reinforcing rods or electrically neutral conductors. Do not embed piping in concrete slabs containing quick-set additives or cinder aggregate.
  - 3. In Floor Channels: Install natural-gas piping in floor channels. Channels must have cover and be open to space above cover for ventilation.
  - 4. In Walls or Partitions: Protect tubing installed inside partitions or hollow walls from physical damage using steel striker barriers at rigid supports.
    - a. Exception: Tubing passing through partitions or walls does not require striker barriers.
  - 5. Prohibited Locations:

- a. Do not install natural-gas piping in or through circulating air ducts, clothes or trash chutes, chimneys or gas vents (flues), ventilating ducts, or dumbwaiter or elevator shafts.
  - b. Do not install natural-gas piping in solid walls or partitions.
- S. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.
  - T. Connect branch piping from top or side of horizontal piping.
  - U. Install unions in pipes NPS 2 and smaller, adjacent to each valve, at final connection to each piece of equipment. Unions are not required at flanged connections.
  - V. Do not use natural-gas piping as grounding electrode.
  - W. Install strainer on inlet of each line-pressure regulator and automatic or electrically operated valve.
  - X. Install pressure gage upstream and downstream from each line regulator. Pressure gages are specified in Division 23 Section "Meters and Gages for HVAC Piping."

### 3.5 VALVE INSTALLATION

- A. Install manual gas shutoff valve for each gas appliance ahead of corrugated stainless-steel tubing, aluminum, or copper connector.
- B. Install underground valves with valve boxes.
- C. Install regulators and overpressure protection devices with maintenance access space adequate for servicing and testing.

### 3.6 PIPING JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Threaded Joints:
  - 1. Thread pipe with tapered pipe threads complying with ASME B1.20.1.
  - 2. Cut threads full and clean using sharp dies.
  - 3. Ream threaded pipe ends to remove burrs and restore full inside diameter of pipe.
  - 4. Apply appropriate tape or thread compound to external pipe threads unless dryseal threading is specified.
  - 5. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- D. Welded Joints:
  - 1. Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators.

2. Bevel plain ends of steel pipe.
3. Patch factory-applied protective coating as recommended by manufacturer at field welds and where damage to coating occurs during construction.

### 3.7 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for pipe hangers and supports specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."
- B. Install hangers for horizontal steel piping with the following maximum spacing and minimum rod sizes:
  1. NPS 1 and Smaller: Maximum span, 96 inches; minimum rod size, 3/8 inch.
  2. NPS 1-1/4: Maximum span, 108 inches; minimum rod size, 3/8 inch.
  3. NPS 1-1/2 and NPS 2: Maximum span, 108 inches; minimum rod size, 3/8 inch.
  4. NPS 2-1/2 to NPS 3-1/2: Maximum span, 10 feet; minimum rod size, 1/2 inch.
  5. NPS 4 and Larger: Maximum span, 10 feet; minimum rod size, 5/8 inch.

### 3.8 CONNECTIONS

- A. Connect to utility's gas main according to utility's procedures and requirements.
- B. Install natural-gas piping electrically continuous, and bonded to gas appliance equipment grounding conductor of the circuit powering the appliance according to NFPA 70.
- C. Install piping adjacent to appliances to allow service and maintenance of appliances.
- D. Connect piping to appliances using manual gas shutoff valves and unions. Install valve within 72 inches of each gas-fired appliance and equipment. Install union between valve and appliances or equipment.
- E. Sediment Traps: Install tee fitting with capped nipple in bottom to form drip, as close as practical to inlet of each appliance.

### 3.9 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
  1. Test, inspect, and purge natural gas according to the International Fuel Gas Code and authorities having jurisdiction.
- C. Natural-gas piping will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

### 3.10 PAINTING

- A. Comply with requirements in Division 09 painting Sections for painting interior and exterior natural-gas piping.
- B. Paint exposed, exterior metal piping, valves, service regulators, service meters and meter bars, earthquake valves, and piping specialties, except components, with factory-applied paint or protective coating.
  - 1. Alkyd System: MPI EXT 5.1D.
    - a. Prime Coat: Alkyd anticorrosive metal primer.
    - b. Intermediate Coat: Exterior alkyd enamel matching topcoat.
    - c. Topcoat: Exterior alkyd enamel flat.
    - d. Color: Gray.
- C. Damage and Touchup: Repair marred and damaged factory-applied finishes with materials and by procedures to match original factory finish.

### 3.11 INDOOR PIPING SCHEDULE

- A. Aboveground, piping NPS 2 and smaller shall be the following:
  - 1. Steel pipe with malleable-iron fittings and threaded joints.
- B. Aboveground, piping NPS 2-1/2 and larger shall be the following:
  - 1. Steel pipe with steel welded fittings and welded joints.

### 3.12 OUTDOOR PIPING SCHEDULE

- A. Underground natural-gas piping shall be one of the following:
  - 1. Steel pipe with wrought-steel fittings and welded joints, or mechanical couplings. Coat pipe and fittings with protective coating for steel piping.
- B. Aboveground natural-gas piping shall be one of the following:
  - 1. Steel pipe with malleable-iron fittings and threaded joints.
  - 2. Steel pipe with wrought-steel fittings and welded joints.
  - 3. Exterior gas piping to be coated or painted as specified in Section 3.10 above.
- C. Branch Piping in Cast-in-Place Concrete to Single Appliance: Annealed-temper copper tube with wrought-copper fittings and flared joints. Install piping embedded in concrete with no joints in concrete.
- D. Containment Conduit: Steel pipe with wrought-steel fittings and welded joints. Coat pipe and fittings with protective coating for steel piping.

END OF SECTION 231123

## SECTION 232113 – HYDRONIC PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes pipe and fitting materials, joining methods, special-duty valves, and specialties for the following:
  - 1. Hot-water heating piping.
  - 2. Chilled-water piping.
  - 3. Condensate-drain piping.
  - 4. Blowdown-drain piping.
  - 5. Air-vent piping.
  - 6. Safety-valve-inlet and -outlet piping.
  - 7. Domestic water piping.
  - 8. Back-flow preventers.
- B. Related Sections include the following:
  - 1. Division 23 Section "Hydronic Pumps" for pumps, motors, and accessories for hydronic piping.

#### 1.3 DEFINITIONS

- A. PTFE: Polytetrafluoroethylene.
- B. RTRF: Reinforced thermosetting resin (fiberglass) fittings.
- C. RTRP: Reinforced thermosetting resin (fiberglass) pipe.

#### 1.4 PERFORMANCE REQUIREMENTS

- A. Hydronic piping components and installation shall be capable of withstanding the following minimum working pressure and temperature:
  - 1. Hot-Water Heating Piping: 125 psig at 200 deg F.
  - 2. Makeup-Water Piping: 80 psig at 150 deg F.
  - 3. Condensate-Drain Piping: 150 deg F.
  - 4. Blowdown-Drain Piping: 200 deg F.
  - 5. Air-Vent Piping: 200 deg F.
  - 6. Safety-Valve-Inlet and -Outlet Piping: Equal to the pressure of the piping system to which it is attached.

## 1.5 SUBMITTALS

- A. Product Data: For each type of the following:
  - 1. Plastic pipe and fittings with solvent cement.
  - 2. Pressure-seal fittings.
  - 3. Valves. Include flow and pressure drop curves based on manufacturer's testing for calibrated-orifice balancing valves and automatic flow-control valves.
  - 4. Air control devices.
  - 5. Chemical treatment.
  - 6. Hydronic specialties.
- B. Shop Drawings: Detail, at 1/4 scale, the piping layout, fabrication of pipe anchors, hangers, supports for multiple pipes, alignment guides, expansion joints and loops, and attachments of the same to the building structure. Detail location of anchors, alignment guides, and expansion joints and loops.
- C. Grooved joint couplings and fittings shall be referred to on drawings and product submittals, and be identified by the manufacturer's listed model or series designation.
- D. Welding certificates.
- E. Qualification Data: For Installer.
- F. Field quality-control test reports.
- G. Operation and Maintenance Data: For air control devices, hydronic specialties, and special-duty valves to include in emergency, operation, and maintenance manuals.
- H. Water Analysis: Submit a copy of the water analysis to illustrate water quality available at Project site.

## 1.6 QUALITY ASSURANCE

- A. Installer Qualifications:
  - 1. Installers of Pressure-Sealed Joints: Installers shall be certified by the pressure-seal joint manufacturer as having been trained and qualified to join piping with pressure-seal pipe couplings and fittings.
- B. Steel Support Welding: Qualify processes and operators according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- C. Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX.
  - 1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
  - 2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- D. ASME Compliance: Comply with ASME B31.9, "Building Services Piping," for materials, products, and installation. Safety valves and pressure vessels shall bear the appropriate ASME

label. Fabricate and stamp air separators and expansion tanks to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 01.

- E. All grooved couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be of the same manufacturer as the grooved components.
  - 1. All castings used for couplings housings, fittings, or valve and specialty bodies shall be date stamped for quality assurance and traceability.

## PART 2 - PRODUCTS

### 2.1 COPPER TUBE AND FITTINGS

- A. Drawn-Temper Copper Tubing: ASTM B 88, Type L.
- B. Annealed-Temper Copper Tubing: ASTM B 88, Type K.
- C. DWV Copper Tubing: ASTM B 306, Type DWV.
- D. Wrought-Copper Fittings: ASME B16.22.
  - 1. Grooved-End Copper Fittings: ASME B16.22 wrought copper and ASTM B 75, copper tube or ASME B16.18 and ASTM B 584, bronze casting. Manufactured to copper tube dimensions. (Flaring of tube or fitting ends to accommodate alternate sized couplings is not permitted.) Basis of Design: Victaulic Copper Connection.
  - 2. Grooved-End-Tube Couplings: Rigid pattern with offsetting angle-pattern bolt pads, unless otherwise indicated; gasketed fitting. Ductile-iron housing with keys matching copper-tube and fitting grooves, EPDM-HP center-leg gasket with pipe stop to ensure proper groove engagement, alignment, and pipe insertion depth, rated for minimum 230 deg F for use with housing, and ASTM A449 compliant steel bolts and nuts. Installation-Ready, for direct stab installation without field disassembly. Basis of Design: Victaulic Style 607.
  - 3. Flaring of tube or fitting ends to accommodate alternate sized couplings is not permitted.
- E. Wrought-Copper Unions: ASME B16.22.
- F. Copper or Bronze Pressure-Seal Fittings:
  - 1. Manufacturers: All boiler venting shall be furnished by the boiler manufacturer. Subject to compliance with requirements, provide products by one of the following:
    - a. Mueller Industries, Inc
    - b. Nibco Inc.
    - c. Viega LLC
  - 2. Housing: Copper.
  - 3. O-Rings and Pipe Stops: EPDM.
  - 4. Tools: Manufacturer's special tools.
  - 5. Minimum 200-psig working-pressure rating at 250 deg F.

### 2.2 STEEL PIPE AND FITTINGS

- A. Steel Pipe: ASTM A 53/A 53M, black steel with plain ends; type, grade, and wall thickness as indicated in Part 3 "Piping Applications" Article.

- B. Cast-Iron Threaded Fittings: ASME B16.4; Classes 125 and 250 as indicated in Part 3 "Piping Applications" Article.
- C. Malleable-Iron Threaded Fittings: ASME B16.3, Classes 150 and 300 as indicated in Part 3 "Piping Applications" Article.
- D. Malleable-Iron Unions: ASME B16.39; Classes 150, 250, and 300 as indicated in Part 3 "Piping Applications" Article.
- E. Installation-Ready™ fittings for Schedule 10 through Schedule 80 plain end carbon steel piping in sizes NPS ½" thru 2" (DN15 thru DN50), rated for working pressure of 300 psi (2065 kPa). Fittings shall consist of a ductile iron housing with Installation-Ready™ ends, gasket liner, zinc-electroplated steel bolts and nuts, and 300 series stainless steel retainer. Basis of Design: Victaulic QuickVic™ SD.
- F. Cast-Iron Pipe Flanges and Flanged Fittings: ASME B16.1, Classes 25, 125, and 250; raised ground face, and bolt holes spot faced as indicated in Part 3 "Piping Applications" Article.
- G. Wrought-Steel Fittings: ASTM A 234/A 234M, wall thickness to match adjoining pipe.
- H. Wrought Cast- and Forged-Steel Flanges and Flanged Fittings: ASME B16.5, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
  - 1. Material Group: 1.1.
  - 2. End Connections: Butt welding.
  - 3. Facings: Raised face.
- I. Grooved Mechanical-Joint Fittings and Couplings:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Victaulic Company.
  - 1. Operating Conditions: -30° F through +250° F temperature range according to gasket or valve lining selected and working pressure as shown in manufacturer's current product specification.
  - 2. Couplings
    - a. Two segments, cast of ductile iron conforming to ASTM A 536. Alkyd enamel coating for black steel piping systems. Galvanized finish for galvanized piping systems. Couplings designed to engage and lock grooved or shouldered piping and fitting ends.
      - b. Sizes 2 inches through 12 inches: Coupling housings cast with torque-absorber and shift-limiting offsetting, angle pattern bolt pads to provide system rigidity and support and hanging in accordance with ANSI B31.1 and B31.9, and to prevent mis-assembly due to overshift. Housings cast with alignment indicator notch for visual proper alignment to adjoining fitting. Installation-Ready™, for direct stab installation without field disassembly, with grade EHP center-leg gasket with pipe stop to ensure proper groove engagement, alignment, and pipe insertion depth. suitable for water service to +250 deg F. Basis of Design: Victaulic Style -107V.

- c. Flexible Type: For use in locations where vibration attenuation and stress relief are required, and for the elimination of flexible connectors. Victaulic Installation-Ready Style 177 or Style 77.
  - d. AGS two-segment couplings for pipe sizes 14" and larger, with wide-width FlushSeal® gasket and lead-in chamfer on housing key. Basis of Design: Victaulic Style W07 (rigid) and Style W77 (flexible).
3. Gaskets composed of elastomer properties as designated by ASTM D 2000. Gaskets for water service Grade "E" EPDM, with green color code.
  4. Coupling Assembly: Housing clamps in two parts, single C-shaped gasket, two ASTM A449 electroplated steel bolts as required to assemble housing clamps.
  5. Fittings: Full flow type fittings with grooves designed to accept couplings of the same manufacturer. ASTM A 536 cast ductile iron, ASTM A234 forged steel, or ASTM A53 factory-fabricated carbon steel, galvanized for galvanized piping systems.
    - a. QuickVic 2" through 12" (DN50 through DN300); ASTM A536 Grade 65-45-12 ductile iron with Victaulic Original Grooved System (OGS) grooved ends, stiffening ribs, and alignment indicators, orange coated or hot dipped galvanized as per ASTM A123, working pressure 400-psi (2758-kPa). Victaulic QuickVic™ V10 (90-deg), V11 (45-deg), and V20 (tee).

## 2.3 PLASTIC PIPE AND FITTINGS

- A. PVC Plastic Pipe: ASTM D 1785, Schedules 40 and 80, plain ends as indicated in Part 3 "Piping Applications" Article.
- B. PVC Plastic Pipe Fittings: Socket-type pipe fittings, ASTM D 2466 for Schedule 40 pipe; ASTM D 2467 for Schedule 80 pipe.
- C. Victaulic Company PGS-300 Piping system may be used where approved IPS size PVC pipe is approved for use. Pipe and fittings shall be cut grooved to Victaulic's PGS-300 groove specification.

## 2.4 JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  1. ASME B16.21, nonmetallic, flat, asbestos free, 1/8-inch maximum thickness unless thickness or specific material is indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
- B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

- D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for joining copper with copper; or BA9-1, silver alloy for joining copper with bronze or steel.
- F. Welding Filler Metals: Comply with AWS D10.12/D10.12M for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- G. Grooved Joint Lubricants: If required, lubricate gasket in accordance with the manufacturer's published instructions with lubricant approved for the gasket elastomer and fluid media. Basis of Design: Victaulic Vic-Lube.
- H. Solvent Cements for Joining Plastic Piping:
  - 1. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
    - a. PVC solvent cement shall have a VOC content of 510 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
    - b. Adhesive primer shall have a VOC content of 550 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
    - c. Solvent cement and adhesive primer shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- I. Gasket Material: Thickness, material, and type suitable for fluid to be handled and working temperatures and pressures.

## 2.5 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric-Flange Insulating Kits:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Advance Products & Systems, Inc.
    - b. Pipeline Seal and Insulator, Inc.
  - 2. Description:
    - a. Nonconducting materials for field assembly of companion flanges.
    - b. Pressure Rating: 150 psig.
    - c. Gasket: Neoprene or phenolic.
    - d. Bolt Sleeves: Phenolic or polyethylene.
    - e. Washers: Phenolic with steel backing washers.
- C. Dielectric Nipples:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - a. Victaulic Company of America.
2. Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig minimum working pressure at 225 deg F.
3. Copper-silicon casting conforming to UNS C87850 with grooved and/or threaded ends. UL classified in accordance with ANSI / NSF-61 for potable water service. Basis of Design: Victaulic Style 647.

## 2.6 VALVES

- A. Gate, Globe, Check, Ball, and Butterfly Valves: Comply with requirements specified in Division 23 Section "General-Duty Valves for HVAC Piping."
- B. Automatic Temperature-Control Valves, Actuators, and Sensors: Comply with requirements specified in Division 23 Section "Instrumentation and Control for HVAC."
- C. Bronze, Y-Pattern Calibrated-Orifice, Balancing Valves:
  1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
    - a. Victaulic/Tour & Andersson
      - 1) 300 PSI Series 786, 787 & 78K (soldered or threaded ends).
      - 2) 250 PSI Series 788 & 789 (flanged or grooved ends).
    - b. Armstrong.
    - c. Wheatley.
  2. Use for throttling in water service 1/2" to 16".
  3. Provide valves of Y-Pattern design suitable for water temperatures to 250°F. Provide valves with provision for connecting a portable differential pressure meter. Each meter connection to have pressure/temperature readout points.
  4. Construct valves up to 2" of pressure die cast nonporous Ametal® copper alloy providing dielectric protection and 2-1/2" and over of ductile iron body and Ametal® non ferrous copper alloy internal components.
  5. Valves to be omnidirectional without affecting flow measurement and shall provide precise flow measurement, precision flow balancing, positive shut-off with no drip seat.
  6. Construct valves so that 4, 8, 12, 16, 20 or 22 full turns of handwheel provides maximum setting with hidden memory feature and tamper proof balancing setting.
  7. Coil Components: Install with balancing valves 2" and smaller, Victaulic Series 78U union port fitting, Series 78Y strainer/ball valve or Series 78T union/ball valve combination. Victaulic Series 799 or Series 79V with ATC valve.
  8. Provide TA CM 73M computerized flow reading kit compatible with valve flow reading kits to be handed over to the owner.

## 2.7 AIR CONTROL DEVICES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Amtrol, Inc.
  2. Armstrong Pumps, Inc.
  3. Bell & Gossett Domestic Pump; a division of ITT Industries.
  4. Taco.
- B. Manual Air Vents:
1. Body: Bronze.
  2. Internal Parts: Nonferrous.
  3. Operator: Screwdriver or thumbscrew.
  4. Inlet Connection: NPS 1/2.
  5. Discharge Connection: NPS 1/8.
  6. CWP Rating: 150 psig.
  7. Maximum Operating Temperature: 225 deg F.
- C. Automatic Air Vents:
1. Body: Bronze or cast iron.
  2. Internal Parts: Nonferrous.
  3. Operator: Noncorrosive metal float.
  4. Inlet Connection: NPS 1/2.
  5. Discharge Connection: NPS 1/4.
  6. CWP Rating: 150 psig.
  7. Maximum Operating Temperature: 240 deg F.
- D. Bladder-Type ASME Expansion Tanks:
1. Tank: Welded steel, rated for 125-psig working pressure and 375 deg F maximum operating temperature. Factory test after taps are fabricated and supports installed and are labeled according to ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.
  2. Bladder: Securely sealed into tank to separate air charge from system water to maintain required expansion capacity.
  3. Air-Charge Fittings: Schrader valve, stainless steel with EPDM seats.
- E. Inline Air Separators:
1. Tank: Welded steel; ASME constructed and labeled for 125-psig minimum working pressure and 375 deg F maximum operating temperature.
  2. Air Collector Tube: Perforated stainless steel, constructed to direct released air into expansion tank.
  3. Inlet and Outlet Connections: Threaded for NPS 2 and smaller; flanged connections for NPS 2-1/2 and larger.
  4. Blowdown Connection: Threaded.
  5. Size: Match system flow capacity.

## 2.8 HYDRONIC PIPING SPECIALTIES

- A. Y-Pattern Strainers:

1. Body:
    - a. ASTM A 126, Class B, cast iron with bolted cover and bottom drain connection.
    - b. ASTM A 536, Grade 65-45-12, ductile iron with coupled cover.
  2. End Connections: Threaded ends for NPS 2 and smaller; flanged ends for NPS 2-1/2 and larger. Grooved end Y-pattern strainer, Victaulic 732, also acceptable.
  3. Strainer Screen: 40-mesh startup strainer, and perforated stainless-steel basket with 50 percent free area.
  4. CWP Rating: 300 psig.
- B. Grooved End T-Type Strainer. 2" through 24" sizes, 300 PSI ductile iron body or factory-manufactured from ASTM A53 steel pipe with T-bolt hinged closure, Type 304 stainless steel perforated metal removable baskets. Victaulic Style 730.
- C. Stainless-Steel Bellow, Flexible Connectors:
1. Body: Stainless-steel bellows with woven, flexible, bronze, wire-reinforcing protective jacket.
  2. End Connections: Threaded or flanged to match equipment connected.
  3. Performance: Capable of 3/4-inch misalignment.
  4. CWP Rating: 150 psig.
  5. Maximum Operating Temperature: 250 deg F.
  6. Three Victaulic flexible type couplings may be used in lieu of a flexible connector for vibration attenuation at equipment connections in applicable piping systems. The couplings shall be placed in close proximity to the source of the vibration.
- D. Suction Diffuser – Grooved/Flanged End. Rated to 300 psi (2065 kPa). Ductile iron (ASTM A-536) body. 304 stainless steel frame and perforated sheet diffuser with 5/32" (4,0mm) diameter holes 3" – 24" inlet sizes. Removable 20 mesh 304 stainless steel start-up prefilter, outlets for pressure/temperature drain connections, and base support boss. Victaulic Series 731-D and AGS W731-D.
- E. Triple-Duty Valve:
1. Angle or straight pattern.
  2. Grooved ends.
  3. 300-psig pressure rating, ductile-iron body, pump-discharge fitting.
  4. Drain plug and bronze-fitted shutoff, balancing, and non-slam check valve features.
  5. Brass gage ports with integral check valve and orifice for flow measurement.
  6. Victaulic Triple Service Valve Assembly with Series 779 non-slam check and Vic-300 MasterSeal butterfly valve.
- F. Manufactured grooved end vibration isolation drop for air handling unit coil supply and return connections in sizes 2" through 6" (DN50 though DN150) to accommodate isolation, straining, balancing, and drainage. Orange enamel coated drop, consisting of ASTM A53 carbon steel pipe spool(s), Victaulic #20 (straight) and #25 (reducing) tees or Style 920/920N Mechanical-T fittings, with base end cap with drain outlet and DZR brass drain valve. Supply connections include a Vic-300 MasterSeal butterfly valve and Style 732 Y-pattern strainer with PT ports, and the return connection includes a Series 787 or 789 circuit balancing valve. Installation-ready, with flexible couplings to accommodate vibration attenuation and stress relief, rated for working pressure to 300-psig (2068-kPa). Basis of Design: Victaulic Series 385
- G. Manufactured grooved end outlet fitting all-in-one assembly for fluid distribution. Outlet fitting shall consist of an ASTM A53, Grade B, standard weight pipe spool with required outlet connections. Grooved ends roll grooved to Victaulic OGS or AGS dimensions, with enamel coating or galvanized to project requirements. Basis of Design: Victaulic No. 26 and W26.

## 2.9 BACKFLOW PREVENTERS

- A. Reduced-Pressure-Principle Backflow Preventers to be installed at incoming domestic water service and at any branch lines to mechanical equipment.
1. Standard: ASSE 1013.
  2. Operation: Continuous-pressure applications.
  3. Pressure Loss: 12 psig maximum, through middle third of flow range.
  4. Size: Varies.
  5. Design Flow Rate: Varies
  6. Selected Unit Flow Range Limits: Varies.
  7. Pressure Loss at Design Flow Rate: 15 psig for sizes NPS 2 and smaller; 15 psig for NPS 2-1/2 and larger.
  8. Body: Bronze for NPS 2 and smaller; cast iron with interior lining that complies with AWWA C550 or that is FDA approved for NPS 2-1/2 and larger.
  9. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
  10. Configuration: Designed for horizontal, straight-through flow.
  11. Accessories:
    - a. Valves NPS 2 and Smaller: Ball type with threaded ends on inlet and outlet.
    - b. Valves NPS 2-1/2 and Larger: Outside-screw and yoke-gate type with flanged ends on inlet and outlet.
    - c. Air-Gap Fitting: ASME A112.1.2, matching backflow-preventer connection.

## PART 3 - EXECUTION

### 3.1 PIPING APPLICATIONS

- A. Hot-water heating piping, aboveground, NPS 2 and smaller, shall be the following:
1. Type L, drawn-temper copper tubing, wrought-copper fittings, and soldered or pressure-seal joints.
- B. Hot-water heating piping, aboveground, NPS 2-1/2 and larger, shall be any of the following:
1. Schedule 40 steel pipe; grooved, mechanical joint coupling and fittings; and grooved, mechanical joints.
- C. Chilled-water and Condenser-water piping, aboveground, NPS 2 and smaller, shall be the following:
1. Type L, drawn-temper copper tubing, wrought-copper fittings, and soldered or pressure-seal joints.
- D. Chilled-water and Condenser-water piping, aboveground, NPS 2-1/2 and larger, shall be any of the following:
1. Schedule 40 steel pipe; grooved, mechanical joint coupling and fittings; and grooved, mechanical joints.
- E. Aboveground domestic water piping shall be one of the following:
1. Hard copper tube, ASTM B 88, Type L (ASTM B 88M, Type B) cast- or wrought- copper solder-joint fittings; and soldered joints.

2. Hard copper tube, ASTM B 88, Type L (ASTM B 88M, Type B); copper pressure-seal-joint fittings; and pressure-sealed joints.
- F. Condensate-Drain Piping: Type DWV, drawn-temper copper tubing, wrought-copper fittings, and soldered or pressure-seal joints for all indoor piping.
  - G. Blowdown-Drain Piping: Same materials and joining methods as for piping specified for the service in which blowdown drain is installed.
  - H. Air-Vent Piping:
    1. Inlet: Same as service where installed with metal-to-plastic transition fittings for plastic piping systems according to the piping manufacturer's written instructions.
    2. Outlet: Type K, annealed-temper copper tubing with pressure-sealed or flared joints.
  - I. Safety-Valve-Inlet and -Outlet Piping for Hot-Water Piping: Same materials and joining methods as for piping specified for the service in which safety valve is installed with metal-to-plastic transition fittings for plastic piping systems according to the piping manufacturer's written instructions.

### 3.2 VALVE APPLICATIONS

- A. Install shutoff-duty valves at each branch connection to supply mains, and at supply connection to each piece of equipment.
- B. Install calibrated-orifice, balancing valves at each branch connection to return main.
- C. Install calibrated-orifice, balancing valves in the return pipe of each heating or cooling terminal.
- D. Install check valves at each pump discharge and elsewhere as required to control flow direction.
- E. Install safety valves at hot-water generators and elsewhere as required by ASME Boiler and Pressure Vessel Code. Install drip-pan elbow on safety-valve outlet and pipe without valves to the outdoors; and pipe drain to nearest floor drain or as indicated on Drawings. Comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1, for installation requirements.
- F. Install pressure-reducing valves at makeup-water connection to regulate system fill pressure.

### 3.3 PIPING INSTALLATIONS

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicate piping locations and arrangements if such were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- B. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.

- D. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping to permit valve servicing.
- F. Install piping at indicated slopes.
- G. Install piping free of sags and bends.
- H. Install fittings for changes in direction and branch connections.
- I. Install piping to allow application of insulation.
- J. Select system components with pressure rating equal to or greater than system operating pressure.
- K. Install groups of pipes parallel to each other, spaced to permit applying insulation and servicing of valves.
- L. Install drains, consisting of a tee fitting, NPS 3/4 ball valve, and short NPS 3/4 threaded nipple with cap, at low points in piping system mains and elsewhere as required for system drainage.
- M. Install piping at a uniform grade of 0.2 percent upward in direction of flow.
- N. Reduce pipe sizes using eccentric reducer fitting installed with level side up.
- O. Install branch connections to mains using mechanically formed tee fittings in main pipe, with the branch connected to the bottom of the main pipe. For up-feed risers, connect the branch to the top of the main pipe.
- P. Install valves according to Division 23 Section "General-Duty Valves for HVAC Piping."
- Q. Install unions in piping, NPS 2 and smaller, adjacent to valves, at final connections of equipment, and elsewhere as indicated.
- R. Install flanges in piping, NPS 2-1/2 and larger, at final connections of equipment and elsewhere as indicated.
- S. Unions or flanges for servicing and disconnect are not required in installations using grooved joint couplings.
- T. Install strainers on inlet side of each control valve, pressure-reducing valve, solenoid valve, in-line pump, and elsewhere as indicated. Install NPS 3/4 nipple and ball valve in blowdown connection of strainers NPS 2 and larger. Match size of strainer blowoff connection for strainers smaller than NPS 2.
- U. Install expansion loops, expansion joints, anchors, and pipe alignment guides as specified in Division 23 Section "Expansion Fittings and Loops for HVAC Piping."
- V. Identify piping as specified in Division 23 Section "Identification for HVAC Piping and Equipment."

### 3.4 HANGERS AND SUPPORTS

- A. Hanger, support, and anchor devices are specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment." Comply with the following requirements for maximum spacing of supports.
- B. Install the following pipe attachments:
1. Adjustable steel clevis hangers for individual horizontal piping less than 20 feet long.
  2. Adjustable roller hangers and spring hangers for individual horizontal piping 20 feet or longer.
  3. Pipe Roller: MSS SP-58, Type 44 for multiple horizontal piping 20 feet or longer, supported on a trapeze.
  4. Spring hangers to support vertical runs.
  5. Provide copper-clad hangers and supports for hangers and supports in direct contact with copper pipe.
  6. On plastic pipe, install pads or cushions on bearing surfaces to prevent hanger from scratching pipe.
- C. Install hangers for steel piping with the following maximum spacing and minimum rod sizes:
1. NPS 3/4: Maximum span, 7 feet; minimum rod size, 1/4 inch.
  2. NPS 1: Maximum span, 7 feet; minimum rod size, 1/4 inch.
  3. NPS 1-1/2: Maximum span, 9 feet; minimum rod size, 3/8 inch.
  4. NPS 2: Maximum span, 10 feet; minimum rod size, 3/8 inch.
  5. NPS 2-1/2: Maximum span, 11 feet; minimum rod size, 3/8 inch.
  6. NPS 3: Maximum span, 10 feet; minimum rod size, 3/8 inch.
  7. NPS 4: Maximum span, 10 feet; minimum rod size, 1/2 inch.
  8. NPS 6: Maximum span, 10 feet; minimum rod size, 1/2 inch.
- D. Install hangers for drawn-temper copper piping with the following maximum spacing and minimum rod sizes:
1. NPS 3/4: Maximum span, 5 feet; minimum rod size, 1/4 inch.
  2. NPS 1: Maximum span, 6 feet; minimum rod size, 1/4 inch.
  3. NPS 1-1/2: Maximum span, 8 feet; minimum rod size, 3/8 inch.
  4. NPS 2: Maximum span, 8 feet; minimum rod size, 3/8 inch.
  5. NPS 2-1/2: Maximum span, 9 feet; minimum rod size, 3/8 inch.
  6. NPS 3: Maximum span, 10 feet; minimum rod size, 3/8 inch.
- E. Plastic Piping Hanger Spacing: Space hangers according to pipe manufacturer's written instructions for service conditions. Avoid point loading. Space and install hangers with the fewest practical rigid anchor points.
- F. Support vertical runs at roof, at each floor, and at 10-foot intervals between floors.

### 3.5 PIPE JOINT CONSTRUCTION

- A. Join pipe and fittings according to the following requirements and Division 23 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.

- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- E. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- F. Welded Joints: Construct joints according to AWS D10.12/D10.12M, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- G. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- H. Grooved Joints: Assemble joints with coupling and gasket, lubricant, and bolts. Cut or roll grooves in ends of pipe based on pipe and coupling manufacturer's written instructions for pipe wall thickness. Use grooved-end fittings and rigid, grooved-end-pipe couplings unless flexibility is required. The gasket style and elastomeric material (grade) shall be verified as suitable for the intended service. Gaskets shall be molded and produced by the grooved coupling manufacturer. Grooved coupling manufacturer's factory trained field representative shall provide on-site training for contractor's field personnel in the proper use of grooving tools, application of groove, and installation of grooved piping products. Factory trained representative shall periodically visit the jobsite to ensure best practices in grooved product installation are being followed. Contractor shall remove and replace any improperly installed products.
- I. Pressure-Sealed Joints: Use manufacturer-recommended tool and procedure. Leave insertion marks on pipe after assembly.

### 3.6 HYDRONIC SPECIALTIES INSTALLATION

- A. Install manual air vents at high points in piping, at heat-transfer coils, and elsewhere as required for system air venting.
- B. Install automatic air vents at high points of system piping in mechanical equipment rooms only. Manual vents at heat-transfer coils and elsewhere as required for air venting.
- C. Install tangential air separator in pump suction. Install blowdown piping with gate or full-port ball valve; extend full size to nearest floor drain.
- D. Install expansion tanks on the floor. Vent and purge air from hydronic system, and ensure tank is properly charged with air to suit system Project requirements.

### 3.7 TERMINAL EQUIPMENT CONNECTIONS

- A. Sizes for supply and return piping connections shall be the same as or larger than equipment connections.
- B. Install control valves in accessible locations close to connected equipment.
- C. Install bypass piping with globe valve around control valve. If parallel control valves are installed, only one bypass is required.
- D. Install ports for pressure gages and thermometers at coil inlet and outlet connections according to Division 23 Section "Meters and Gages for HVAC Piping."

### 3.8 CLEANING

- A. Clean and disinfect potable domestic water piping as follows:
  - 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
  - 2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
    - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
    - b. Fill and isolate system according to either of the following:
      - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
      - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
    - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
    - d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedures if biological examination shows contamination.
- B. Prepare and submit reports of purging and disinfecting activities.
- C. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

### 3.9 FIELD QUALITY CONTROL

- A. Prepare hydronic piping according to ASME B31.9 and as follows:
  - 1. Leave joints, including welds, uninsulated and exposed for examination during test.
  - 2. Provide temporary restraints for expansion joints that cannot sustain reactions due to test pressure. If temporary restraints are impractical, isolate expansion joints from testing.
  - 3. Flush hydronic piping systems with clean water; then remove and clean or replace strainer screens.

4. Isolate equipment from piping. If a valve is used to isolate equipment, its closure shall be capable of sealing against test pressure without damage to valve. Install blinds in flanged joints to isolate equipment.
  5. Install safety valve, set at a pressure no more than one-third higher than test pressure, to protect against damage by expanding liquid or other source of overpressure during test.
- B. Perform the following tests on hydronic piping:
1. Use ambient temperature water as a testing medium unless there is risk of damage due to freezing. Another liquid that is safe for workers and compatible with piping may be used.
  2. While filling system, use vents installed at high points of system to release air. Use drains installed at low points for complete draining of test liquid.
  3. Isolate expansion tanks and determine that hydronic system is full of water.
  4. Subject piping system to hydrostatic test pressure that is not less than 1.5 times the system's working pressure. Test pressure shall not exceed maximum pressure for any vessel, pump, valve, or other component in system under test. Verify that stress due to pressure at bottom of vertical runs does not exceed 90 percent of specified minimum yield strength or 1.7 times "SE" value in Appendix A in ASME B31.9, "Building Services Piping."
  5. After hydrostatic test pressure has been applied for at least 10 minutes, examine piping, joints, and connections for leakage. Eliminate leaks by tightening, repairing, or replacing components, and repeat hydrostatic test until there are no leaks.
  6. Prepare written report of testing.
- C. Perform the following before operating the system:
1. Open manual valves fully.
  2. Inspect pumps for proper rotation.
  3. Set makeup pressure-reducing valves for required system pressure.
  4. Inspect air vents at high points of system and determine if all are installed and operating freely (automatic type), or bleed air completely (manual type).
  5. Set temperature controls so all coils are calling for full flow.
  6. Inspect and set operating temperatures of hydronic equipment, such as boilers, chillers, cooling towers, to specified values.
  7. Verify lubrication of motors and bearings.

END OF SECTION 232113

## SECTION 232123 – HYDRONIC PUMPS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Separately coupled, base-mounted, end-suction centrifugal pumps.
  - 2. Close coupled, in-line centrifugal pumps.
  - 3. Automatic condensate pump units.
  - 4. Variable speed controllers

#### 1.3 DEFINITIONS

- A. Buna-N: Nitrile rubber.
- B. EPT: Ethylene propylene terpolymer.
- C. ECM: Electronically commutated motor.
- D. EPDM: Ethylene propylene diene monomer.
- E. EPR: Ethylene propylene rubber.
- F. EPT: Ethylene propylene terpolymer.
- G. FKM: Fluoroelastomer polymer.
- H. HI: Hydraulic Institute.
- I. NBR: Nitrile rubber or Buna-N.
- J. ODP: Open, drip proof.
- K. TEFC: Totally enclosed, fan-cooled.
- L. TENV: Totally enclosed, non-ventilated.
- M. VFD: Variable-frequency controller.

#### 1.4 SUBMITTALS

- A. **Product Data:** Include certified performance curves and rated capacities, operating characteristics, furnished specialties, final impeller dimensions, and accessories for each type of product indicated. Indicate pump's operating point on curves.
- B. **Shop Drawings:** Show pump layout and connections. Include setting drawings with templates for installing foundation and anchor bolts and other anchorages.
  - 1. **Wiring Diagrams:** Power, signal, and control wiring.
- C. **Operation and Maintenance Data:** For pumps to include in emergency, operation, and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. **Source Limitations:** Obtain hydronic pumps through one source from a single manufacturer.
- B. **Product Options:** Drawings indicate size, profiles, and dimensional requirements of hydronic pumps and are based on the specific system indicated. Refer to Division 01 Section "Product Requirements."
- C. **Electrical Components, Devices, and Accessories:** Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- D. **UL Compliance:** Comply with UL 778 for motor-operated water pumps.

#### 1.6 DELIVERY, STORAGE, AND HANDLING

- A. **Manufacturer's Preparation for Shipping:** Clean flanges and exposed machined metal surfaces and treat with anticorrosion compound after assembly and testing. Protect flanges, pipe openings, and nozzles with wooden flange covers or with screwed-in plugs.
- B. Store pumps in dry location.
- C. Retain protective covers for flanges and protective coatings during storage.
- D. Protect bearings and couplings against damage from sand, grit, and other foreign matter.
- E. Comply with pump manufacturer's written rigging instructions.

#### 1.7 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 03.

## 1.8 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
  - 1. Mechanical Seals: One mechanical seal(s) for each pump.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:
  - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

### 2.2 SEPARATELY COUPLED, BASE-MOUNTED, END-SUCTION CENTRIFUGAL PUMPS

- A. Manufacturers:
  - 1. Armstrong.
  - 2. Bell & Gossett
  - 3. Taco, Inc.
- B. Description: Factory-assembled and -tested, centrifugal, overhung-impeller, separately coupled, end-suction pump as defined in HI 1.1-1.2 and HI 1.3; designed for base mounting, with pump and motor shafts horizontal. Rate pump for 175-psig minimum working pressure and a continuous water temperature of 200 deg F.
- C. Pump Construction:
  - 1. Casing: Radially split, cast iron, with replaceable bronze wear rings, threaded gage tappings at inlet and outlet, drain plug at bottom and air vent at top of volute, and flanged connections
  - 2. Impeller: ASTM B 584, cast bronze; statically and dynamically balanced, keyed to shaft, and secured with a locking cap screw. Trim impeller to match specified performance.
  - 3. Pump Shaft: Steel, with copper-alloy shaft sleeve.
  - 4. Mechanical Seal: Carbon rotating ring against a ceramic seat held by a stainless-steel spring, and Buna-N bellows and gasket.
  - 5. Packing Seal: Stuffing box, with a minimum of four rings of graphite-impregnated braided yarn with bronze lantern ring between center two graphite rings, and bronze packing gland.
  - 6. Pump Bearings: Grease-lubricated ball bearings contained in cast-iron housing with grease fittings.
- D. Shaft Coupling: Molded rubber insert and interlocking spider capable of absorbing vibration.
- E. Coupling Guard: Dual rated; ANSI B15.1, Section 8; OSHA 1910.219 approved; steel; removable; attached to mounting frame.

- F. Mounting Frame: Welded-steel frame and cross members, factory fabricated from ASTM A 36/A 36M channels and angles. Fabricate to mount pump casing, coupling guard, and motor.
- A. Motor: Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  - 1. Enclosure : Totally enclosed, fan cooled.
  - 2. NEMA Premium Efficient motors as defined in NEMA MG 1.
  - 3. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
  - 4. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.
  - 5. Variable-speed motor.

### 2.3 CLOSE COUPLED, IN-LINE CENTRIFUGAL PUMPS

- A. Manufacturers:
  - 1. Armstrong.
  - 2. Bell & Gossett.
  - 3. Taco, Inc..
- B. Description: Taco 1900 series or approved equal. Factory-assembled and -tested, centrifugal, overhung-impeller, horizontal, close-coupled, in-line pump as defined in HI 14.1, HI 14.2 and HI 14.3; designed for installation with motor shaft mounted horizontally.
- C. Pump Construction:
  - 1. Casing: Radially split, cast iron, with replaceable bronze wear rings, threaded gage tappings at inlet and outlet, and threaded companion-flange connections.
  - 2. Impeller: ASTM B 584, cast bronze; statically and dynamically balanced, keyed to shaft, and secured with a locking cap screw. Trim impeller to match specified performance.
  - 3. Pump Shaft: Type 416 Steel.
  - 1. Seal: Mechanical seal consisting of carbon rotating ring against a ceramic seat held by a stainless steel spring, and EPDMrubber bellows and gasket. Include water slinger on shaft between motor and seal.
- D. Shaft Coupling: Axially split spacer coupling.
- E. Motor: Comply with NEMA designation, temperature rating, service factor, and efficiency requirements for motors specified in Section 230513 "Common Motor Requirements for HVAC Equipment."
  - 1. Enclosure : Totally enclosed, fan cooled.
  - 2. NEMA Premium Efficient motors as defined in NEMA MG 1.
  - 3. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
  - 4. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.
  - 5. Variable-speed ECM motor.

## 2.4 AUTOMATIC CONDENSATE PUMP UNITS

- A. Manufacturers: Subject to compliance with requirements, provide products by the following:
1. Beckett Corporation.
  2. Hartell Pumps Div.; Milton Roy Co.
  3. Little Giant Pump Co.
- B. Description: Packaged units with corrosion-resistant pump, plastic tank with cover, plenum rated and automatic controls. Include factory- or field-installed check valve and a hard-wired power connection.

## 2.5 VARIABLE FREQUENCY CONTROLLERS

- A. Description: PWM, VFC; listed and labeled as a complete unit and arranged to provide variable speed of an NEMA MG 1, Design B, 3-phase induction motor by adjusting output voltage and frequency.
1. Provide unit suitable for operation of standard-efficiency motor as defined by NEMA MG 1.
- B. Design and Rating: Match load type such as fans, blowers, and pumps; and type of connection used between motor and load such as direct or through a power-transmission connection.
- C. Furnish and install Variable Speed Pumping System TECHNOLOGIC Intelligent Pump Controller with Integrated Bypass as manufactured by ITT Bell & Gossett or approved equal.
- D. Output Rating: 3-phase; 6 to 60 Hz, with voltage proportional to frequency throughout voltage range
- E. PROTECTIVE FEATURES:
1. The VFD shall convert incoming fixed frequency three- phase AC power into an adjustable frequency and voltage for controlling the speed of three-phase AC motors. The motor current shall closely approximate a sine wave. Motor voltage shall be varied with frequency to maintain desired motor magnetization current suitable for the driven load and to eliminate the need for motor de-rating.
  2. When properly sized, the VFD shall allow the motor to produce full rated power at rated motor voltage, current, and speed without using the motor's service factor.
  3. The VFD shall maintain a fundamental (displacement) power factor near unity regardless of speed or load.
  4. The VFD shall have a dual 5% impedance DC link reactor on the positive and negative rails of the DC bus to minimize power line harmonics and protect the VFD from power line transients. The chokes shall be non-saturating. VFDs with saturating (non-linear) DC link reactors shall require an additional 3% AC line reactor to provide acceptable harmonic performance at full load, where harmonic performance is most critical.
  5. The VFD's full load output current rating shall meet or exceed NEC Table 430-150. The VFD shall be able to provide full rated output current continuously, 110% of rated current for 60 seconds and 120% of rated torque for up to 0.5 second while starting.
  6. A programmable automatic energy optimization selection feature shall be provided standard in the VFD. This feature shall automatically and continuously monitor the motor's speed and load to adjust the applied voltage to maximize energy savings.
  7. Output power circuit switching shall be able to be accomplished without interlocks or damage to the VFD.

8. An automatic motor adaptation algorithm shall measure motor stator resistance and reactance to optimize performance and efficiency. It shall not be necessary to run the motor or de-couple the motor from the load to perform the test.
9. Galvanic isolation shall be provided between the VFD's power circuitry and control circuitry to ensure operator safety and to protect connected electronic control equipment from damage caused by voltage spikes, current surges, and ground loop currents. VFDs not including either galvanic or optical isolation on both analog I/O and discrete digital I/O shall include additional isolation modules.
10. VFD shall minimize the audible motor noise through the use of an adjustable carrier frequency. The carrier frequency shall be automatically adjusted to optimize motor and VFD operation while reducing motor noise. VFDs with fixed carrier frequency are not acceptable.
11. A minimum of Class 20 12t electronic motor overload protection for single motor applications shall be provided. Overload protection shall automatically compensate for changes in motor speed.
12. Protection against input transients, loss of AC line phase, output short circuit, output ground fault, over voltage, under voltage, VFD over temperature and motor over temperature. The VFD shall display all faults in plain language. Codes are not acceptable.
13. Protect VFD from input phase loss. The VFD should be able to protect itself from damage and indicate the phase loss condition. During an input phase loss condition, the VFD shall be able to be programmed to either trip off while displaying an alarm, issue a warning while running at reduced output capacity, or issue a warning while running at full commanded speed. This function is independent of which input power phase is lost.
14. Protect from under voltage. The VFD shall provide full rated output with an input voltage as low as 90% of the nominal. The VFD will continue to operate with reduced output, without faulting, with an input voltage as low as 70% of the nominal voltage.
15. Protect from over voltage. The VFD shall continue to operate without faulting with a momentary input voltage as high as 130% of the nominal voltage.
16. The VFD shall incorporate a programmable motor preheat feature to keep the motor warm and prevent condensation build up in the motor when it is stopped in a damp environment by providing the motor stator with a controlled level of current.
17. VFD shall include a "signal loss detection" algorithm with adjustable time delay to sense the loss of an analog input signal. It shall also include a programmable time delay to eliminate nuisance signal loss indications. The functions after detection shall be programmable.
18. VFD shall function normally when the keypad is removed while the VFD is running. No warnings or alarms shall be issued as a result of removing the keypad.
19. VFD shall catch a rotating motor operating forward or reverse up to full speed without VFD fault or component damage.
20. Selectable over-voltage control shall be provided to protect the drive from power regenerated by the motor while maintaining control of the driven load.
21. VFD shall include current sensors on all three output phases to accurately measure motor current, protect the VFD from output short circuits, output ground faults, and act as a motor overload. If an output phase loss is detected, the VFD will trip off and identify which of the output phases is low or lost.
22. If the temperature of the VFD's heat sink rises to 80°C, the VFD shall automatically reduce its carrier frequency to reduce the heat sink temperature. It shall also be possible to program the VFD so that it reduces its output current limit value if the VFD's temperature becomes too high.
23. In order to ensure operation during periods of overload, it must be possible to program the VFD to automatically reduce its output current to a programmed value during periods of excessive load. This allows the VFD to continue to run the load without tripping.

24. The VFD shall have temperature controlled cooling fan(s) for quiet operation, minimized losses, and increased fan life. At low loads or low ambient temperatures, the fan(s) may be off even when the VFD is running.
25. The VFD shall store in memory the last 10 alarms. A description of the alarm, and the date and time of the alarm shall be recorded.
26. When used with a pumping system, the VFD shall be able to detect no-flow situations, dry pump conditions, and operation off the end of the pump curve. It shall be programmable to take appropriate protective action when one of the above situations is detected.

#### F. INTERFACE FEATURES

1. Hand, Off and Auto keys shall be provided to start and stop the VFD and determine the source of the speed reference. It shall be possible to either disable these keys or password protect them from undesired operation.
2. There shall be an "Info" key on the keypad. The Info key shall include "on-line" context sensitive assistance for programming and troubleshooting.
3. The VFD shall be programmable to provide a digital output signal to indicate whether the VFD is in Hand or Auto mode. This is to alert the Building Automation System whether the VFD is being controlled locally or by the Building Automation System.
4. Password protected keypad with alphanumeric, graphical, backlit display can be remotely mounted. Two levels of password protection shall be provided to guard against unauthorized parameter changes.
5. All VFDs shall have the same customer interface. The keypad and display shall be identical and interchangeable for all sizes of VFDs.
6. To set up multiple VFDs, it shall be possible to upload all setup parameters to the VFD's keypad, place that keypad on all other VFDs in turn and download the setup parameters to each VFD. To facilitate setting up VFDs of various sizes, it shall be possible to download from the keypad only size independent parameters. Keypad shall provide visual indication of copy status.
7. Display shall be programmable to communicate in multiple languages including English, Spanish and French.
8. A red FAULT light, a yellow WARNING light and a green POWER-ON light shall be provided. These indications shall be visible both on the keypad and on the VFD when the keypad is removed.
9. A quick setup menu with factory preset typical HVAC parameters shall be provided on the VFD. The VFD shall also have individual Fan, Pump, and Compressor menus specifically designed to facilitate start-up of these applications.
10. The VFD's PID controller shall be able to actively adjust its setpoint based on flow. This allows the VFD to compensate for a pressure feedback sensor which is located near the output of the pump rather than out in the controlled system.
11. Floating point control interface shall be provided to increase/decrease speed in response to contact closures.
12. Five simultaneous meter displays shall be available. They shall include at a minimum, frequency, motor current, motor voltage, VFD output power, VFD output energy, VFD temperature in degrees, among others.
13. Programmable Sleep Mode shall be able to stop the VFD. When its output frequency drops below set "sleep" level for a specified time, when an external contact commands that the VFD go into Sleep Mode, or when the VFD detects a no-flow situation, the VFD may be programmed to stop. When the VFD's speed is being controlled by its PID controller, it shall be possible to program a "wake-up" feedback value that will cause the VFD to start. To avoid excessive starting and stopping of the driven equipment, it shall be possible to program a minimum run time before sleep mode can be initiated and a minimum sleep time for the VFD.

14. A run permissive circuit shall be provided to accept a "system ready" signal to ensure that the VFD does not start until dampers or other auxiliary equipment are in the proper state for VFD operation. The run permissive circuit shall also be capable of initiating an output "run request" signal to indicate to the external equipment that the VFD has received a request to run.
15. VFD shall be programmable to display feedback signals in appropriate units, such as inches of water column (in-wg), pressure per square inch (psi) or temperature (°F).
16. VFD shall be programmable to sense the loss of load. The VFD shall be programmable to signal this condition via a keypad warning, relay output and/or over the serial communications bus. To ensure against nuisance indications, this feature must be based on motor torque, not current, and must include a proof timer to keep brief periods of no load from falsely triggering this indication.

G. STANDARD INPUTS AND OUTPUTS

1. Four dedicated, programmable digital inputs shall be provided for interfacing with the systems control and safety interlock circuitry.
2. Two terminals shall be programmable to act as either as digital outputs or additional digital inputs.
3. Two programmable relay outputs, Form C 240 V AC, 2 A, shall be provided for remote indication of VFD status.
  - a. Each relay shall have an adjustable on delay / off delay time.
4. Two programmable analog inputs shall be provided that can be either direct-or-reverse acting.
  - a. Each shall be independently selectable to be used with either an analog voltage or current signal.
  - b. The maximum and minimum range of each shall be able to be independently scalable from 0 to 10 Vdc and 0 to 20 mA.
  - c. A programmable low-pass filter for either or both of the analog inputs must be included to compensate for noise.
  - d. The VFD shall provide front panel meter displays programmable to show the value of each analog input signal for system set-up and troubleshooting,
5. One programmable analog current output (0/4 to 20 mA) shall be provided for indication of VFD status. This output shall be programmable to show the reference or feedback signal supplied to the VFD and for VFD output frequency, current and power. It shall be possible to scale the minimum and maximum values of this output.
6. It shall be possible through serial bus communications to read the status of all analog and digital inputs of the VFD.
7. It shall be possible to command all digital and analog output through the serial communication bus.
8. Optional Control and Monitoring Inputs and Outputs
  - a. It shall be possible to add optional modules to the
  - b. VFD in the field to expand its analog and digital inputs and outputs.
  - c. These modules shall use rigid connectors to plug into the VFD's control card.
  - d. The VFD shall automatically recognize the option module after it is powered up. There shall be no need to manually configure the module.
  - e. Modules may include such items as:
    - 1) Additional digital outputs, including relay outputs
    - 2) Additional digital inputs
    - 3) Additional analog outputs
    - 4) Additional analog inputs, including Ni or Pt temperature sensor inputs
9. It shall be possible through serial bus communications to control the status of all optional analog and digital outputs of the VFD.
10. A real-time clock shall be an integral part of the VFD.
  - a. It shall be possible to use this to display the current date and time on the VFD's display.

- b. Ten programmable time periods, with individually selectable ON and OFF functions shall be available. The clock shall also be programmable to control start/stop functions, constant speeds, PID parameter setpoints and output relays. It shall be possible to program unique events that occur only during normal work days, others that occur only on non-work days, and others that occur on specific days or dates. The manufacturer shall provide free PC-based software to set up the calendar for this schedule.
  - c. All VFD faults shall be time stamped to aid troubleshooting.
  - d. It shall be possible to program maintenance reminders based on date and time, VFD running hours, or VFD operating hours.
  - e. The real-time clock shall be able to time and date stamp all faults recorded in the VFD fault log.
11. The VFD shall be able to store load profile data to assist in analyzing the system demand and energy consumption over time.
  12. The VFD shall include a sequential logic controller to provide advanced control interface capabilities. This shall include:
    - a. Comparators for comparing VFD analog values to programmed trigger values
    - b. Logic operators to combine up to three logic expressions using Boolean algebra.
    - c. Delay timers
    - d. A 20-step programmable structure
  13. The VFD shall include a Cascade Controller which allows the VFD to operate in closed loop set point (PID) control mode one motor at a controlled speed and control the operation of 3 additional constant speed motor starters.

#### H. SERIAL COMMUNICATIONS

1. The VFD shall include a standard EIA-485 communications port and capabilities to be connected to the following serial communication protocols at no additional cost and without a need to install any additional hardware or software in the VFD:
  - a. BACnet
2. VFD shall have standard USB port for direct connection of Personal Computer (PC) to the VFD. The manufacturer shall provide no-charge PC software to allow complete setup and access of the VFD and logs of VFD operation through the USB port. It shall be possible to communicate to the VFD through this USB port without interrupting VFD communications to the building management system.
3. The VFD shall have provisions for an optional 24 V DC back-up power interface to power the VFD's control card. This is to allow the VFD to continue to communicate to the building automation system even if power to the VFD is lost.

#### I. ADJUSTMENTS

1. The VFD shall have a manually adjustable carrier frequency that can be adjusted in 0.5 kHz increments to allow the user to select the desired operating characteristics. The VFD shall also be programmable to automatically reduce its carrier frequency to avoid tripping due to thermal loading.
2. Four independent setups shall be provided.
3. Four preset speeds per setup shall be provided for a total of 16.
4. Each setup shall have two programmable ramp up and ramp down times. Acceleration and deceleration ramp times shall be adjustable over the range from 1 to 3,600 seconds.
5. Each setup shall be programmable for a unique current limit value. If the output current from the VFD reaches this value, any further attempt to increase the current produced by the VFD will cause the VFD to reduce its output frequency to reduce the load on the VFD. If desired, it shall be possible to program a timer which will cause the VFD to trip off after a programmed time period.
6. If the VFD trips on one of the following conditions, the VFD shall be programmable for automatic or manual reset: external interlock, under-voltage, over-voltage, current limit, over temperature, and VFD overload.

7. The number of restart attempts shall be selectable from 0 through 20 or infinitely and the time between attempts shall be adjustable from 0 through 600 seconds.
8. An automatic "start delay" may be selected from 0 to 120 seconds. During this delay time, the VFD shall be programmable to either apply no voltage to the motor or apply a DC braking current if desired.
9. Four programmable critical frequency lockout ranges to prevent the VFD from operating the load at a speed that causes vibration in the driven equipment shall be provided. Semi-automatic setting of lockout ranges shall simplify the set-up.

#### J. BYPASS

1. The Bypass Package shall be built, mounted and tested by the VFD manufacturer. The VFD manufacturer's warranty shall apply to the entire assembly as shipped. Bypass Panel shall carry a UL / C-UL Enclosed Industrial Control Panel label.
2. Bypass Package shall be marked for 100,000 amp short circuit current rating.
3. The enclosure rating of the VFD w/ Bypass Package shall be consistent with the VFD rating of either NEMA/UL type 1 or NEMA/UL type 12, as required for the installation location and/or as called for on the schedule.
4. Three-Contactor Bypass Package shall be provided that allows operation of the motor via line power in the event of a failure of the VFD. Motor control selection shall be through either a VFD output contactor or a bypass contactor that are electrically interlocked to ensure that both contactors are not energized simultaneously. A third contactor, the drive input contactor, shall be supplied as standard. This allows the powering of the VFD with the motor off or operating in bypass mode for testing, programming and troubleshooting purposes.
5. The Contactor bypass shall include the following interface and control features:
  - a. Bypass or VFD selection shall be via the VFD keypad. This feature shall be allowed via a separate optional 24vdc power supply, supplied as part of the bypass option, which allows the logic control and keypad of the VFD and bypass to remain active without power being supplied to the VFD itself. The 24vdc power supply shall operate off of any two legs of the AC line and shall maintain power on the loss of any one of the AC lines.
  - b. Selection of Bypass or VFD operation shall be by any one of the following: Manually via the VFD keypad, remotely via a contact closure from the BMS system, commanded over the communication network or automatic bypass operation based on VFD programming.
  - c. There shall be complete common start/stop command when operating in either Bypass or VFD mode. While operating in Bypass mode, the keypad shall allow the selection of Hand or Remote motor starting. In Hand and Bypass modes, pushing the keypad start button shall initiate motor operation via line power. When in Remote and Bypass modes are selected the motor shall start just as it would have in VFD and Remote mode.
  - d. Selectable Run Permissive logic shall operate in either VFD or bypass operation. When activated, any command to start the motor, in either Hand Bypass, Remote Bypass, Hand VFD or Remote VFD shall not start the motor.
  - e. Bypass package shall include an External Safety interlock that will disable motor operation in either bypass or VFD when open.
  - f. The bypass must include a programmable time delay of 0 to 60 seconds before the initiation of bypass operation. When transferring from VFD to bypass modes, the time delay starts after the motor has decelerated to zero speed. This delay allows the BAS to prepare for bypass operating.
  - g. Communication of the following bypass package conditions shall be available via serial communications:
    - Running from VFD
    - Running from bypass
    - Motor not running

- External trip
  - Contactor fault
  - Bypass control logic fault
  - Permissive open
  - Overload trip
- h. Service and maintenance of the VFD shall be possible without posing extreme hazard to personnel while operating the motor in bypass mode. Drive-in-a-box and similar designs that do not allow for safe maintenance of the VFD will not be allowed.
- i. The VFD fault log shall monitor bypass fault conditions and store with all other faults. These shall include safety trips, overload trips and contactor malfunctioning.
6. PROTECTIVE FEATURES
- a. Main input disconnect shall be provided that removes power from both the bypass and VFD.
- b. Main input motor rated fuses that protect the entire package.
- c. VFD only fast acting input fuses shall be provided. Packages that include only main input motor rated fusing.
- d. Overload protection shall be supplied in bypass mode.
- e. This overload shall supply minimum class 20 protection as well as wide adjustable current setting for complete motor protection when operating on line power.
- f. Overload protection shall include phase loss and phase imbalance protection.
- g. Visual indication of an overload trip condition shall be displayed on the VFD keypad.
- h. Resetting an overload trip condition shall not require the opening of the enclosure door for safety reasons and shall be accomplished via a digital input, door mounted device (drive keypad), or over the serial communications.
- i. Low voltage contactor operation shall be maintained to 70% the of packages nominally rated voltage. This will ensure VFD operation on low voltage conditions that would otherwise be interrupted due to contactor dropout.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine equipment foundations and anchor-bolt locations for compliance with requirements for installation tolerances and other conditions affecting performance of work.
- B. Examine roughing-in for piping systems to verify actual locations of piping connections before pump installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 CONCRETE BASES

- A. Install concrete bases of dimensions indicated for pumps and controllers. Refer to Division 23 Section "Common Work Results for HVAC."
1. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around full perimeter of base.
2. For supported equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete floor.

3. Place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  4. Install anchor bolts to elevations required for proper attachment to supported equipment.
- B. Cast-in-place concrete materials and placement requirements are specified in Division 03.

### 3.3 PUMP INSTALLATION

- A. Comply with HI 1.4.
- B. Install pumps with access for periodic maintenance including removal of motors, impellers, couplings, and accessories.
- C. Independently support pumps and piping so weight of piping is not supported by pumps and weight of pumps is not supported by piping.
- D. Install continuous-thread hanger rods and spring hangers with vertical-limit stop of sufficient size to support pump weight. Vibration isolation devices are specified in Division 23 Section "Vibration Controls for HVAC Piping and Equipment." Fabricate brackets or supports as required. Hanger and support materials are specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."
- E. Set base-mounted pumps on concrete foundation. Disconnect coupling before setting. Do not reconnect couplings until alignment procedure is complete.
1. Support pump baseplate on rectangular metal blocks and shims, or on metal wedges with small taper, at points near foundation bolts to provide a gap of 3/4 to 1-1/2 inches between pump base and foundation for grouting.
  2. Adjust metal supports or wedges until pump and driver shafts are level. Check coupling faces and suction and discharge flanges of pump to verify that they are level and plumb.
- F. Automatic Condensate Pump Units: Install units for collecting condensate and extend to open drain.

### 3.4 ALIGNMENT

- A. Align pump and motor shafts and piping connections after setting on foundation, grout has been set and foundation bolts have been tightened, and piping connections have been made.
- B. Comply with pump and coupling manufacturers' written instructions.
- C. Adjust pump and motor shafts for angular and offset alignment by methods specified in HI 1.1-1.5, "Centrifugal Pumps for Nomenclature, Definitions, Application and Operation"
- D. After alignment is correct, tighten foundation bolts evenly but not too firmly. Completely fill baseplate with nonshrink, nonmetallic grout while metal blocks and shims or wedges are in place. After grout has cured, fully tighten foundation bolts.

### 3.5 CONNECTIONS

- A. Piping installation requirements are specified in other Division 23 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to machine to allow service and maintenance.
- C. Connect piping to pumps. Install valves that are same size as piping connected to pumps.
- D. Install suction and discharge pipe sizes equal to or greater than diameter of pump nozzles.
- E. Install triple-duty valve on discharge side of pumps.
- F. Install Y-type strainer, suction diffuser and shutoff valve on suction side of pumps.
- G. Install flexible connectors on suction and discharge sides of base-mounted pumps between pump casing and valves.
- H. Install pressure gages on pump suction and discharge, at integral pressure-gage tapping, or install single gage with multiple input selector valve.
- I. Install check valve and gate or ball valve on each condensate pump unit discharge.
- J. Install electrical connections for power, controls, and devices.
- K. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- L. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.6 STARTUP SERVICE

- A. Engage a factory-authorized service representative to perform startup service.
  - 1. Complete installation and startup checks according to manufacturer's written instructions.
  - 2. Check piping connections for tightness.
  - 3. Clean strainers on suction piping.
  - 4. Perform the following startup checks for each pump before starting:
    - a. Verify bearing lubrication.
    - b. Verify that pump is free to rotate by hand and that pump for handling hot liquid is free to rotate with pump hot and cold. If pump is bound or drags, do not operate until cause of trouble is determined and corrected.
    - c. Verify that pump is rotating in the correct direction.
  - 5. Prime pump by opening suction valves and closing drains, and prepare pump for operation.
  - 6. Start motor.
  - 7. Open discharge valve slowly.

3.7 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain hydronic pumps. Refer to Division 01 Section "Demonstration and Training."

END OF SECTION 232123

## SECTION 232213 - STEAM AND CONDENSATE HEATING PIPING

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes pipe and fittings for LP and HP steam and condensate piping:
- B. Related Requirements:
  - 1. Section 232216 "Steam and Condensate Piping Specialties" for strainers, flash tanks, special-duty valves, steam traps, thermostatic air vents and vacuum breakers, and steam and condensate meters.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For RTRP and RTRF and adhesive.
- B. Delegated-Design Submittal:
  - 1. Design calculations and detailed fabrication and assembly of pipe anchors and alignment guides, hangers and supports for multiple pipes, expansion joints and loops, and attachments of the same to the building structure.
  - 2. Locations of pipe anchors and alignment guides and expansion joints and loops.
  - 3. Locations of and details for penetrations, including sleeves and sleeve seals for exterior walls, floors, basement, and foundation walls.
  - 4. Locations of and details for penetration and firestopping for fire- and smoke-rated wall and floor and ceiling assemblies.

#### 1.4 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Piping layout, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:
  - 1. Suspended ceiling components.
  - 2. Other building services.
  - 3. Structural members.
- B. Qualification Data: For Installer.
- C. Welding certificates.
- D. Field quality-control reports.

## 1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."

## 1.6 STEAM AND CONDENSATE PIPE WELDING

- A. Scope: Provide liquid penetrant examination (PT) of the completed root pass for all butt welds in high-alloy chrome-moly piping systems including, but not limited to:
  - 1. ASTM A335 P11
  - 2. Matching fittings per ASTM A234 WP11
  - 3. Forged components per ASTM A182 F11
- B. Examination shall be performed prior to deposition of subsequent weld metal.
- C. References:
  - 1. ASME Section V – NDE methods
  - 2. ASME Section IX – WPS/PQR qualification
  - 3. ASME B31.1 – Acceptance criteria
  - 4. ASTM E165 – Liquid Penetrant Examination
- D. Examination Requirements
  - 1. Extent of Examination
    - a. 100% of all butt weld root passes.
    - b. Includes shop and field welds.
    - c. Applies to longitudinal and circumferential welds.
  - 2. Examination Timing
    - a. Root pass shall be visually inspected and allowed to cool to ambient temperature.
    - b. PT shall be completed before hot pass or fill passes are deposited.
    - c. No further welding shall proceed until root pass is accepted.
- E. Procedure
  - 1. Method
    - a. Solvent-removable visible or fluorescent penetrant method.
    - b. Procedure qualified in accordance with ASME Section V.
  - 2. Surface Preparation
    - a. Remove slag, oxide scale, and spatter.
    - b. No wire brushing with carbon steel brushes.
    - c. Use stainless steel brushes dedicated to chrome-moly service.
    - d. Surface shall be clean and dry.
  - 3. Dwell and Development
    - a. Penetrant dwell time per manufacturer recommendation.
    - b. Developer application uniform and continuous.
- F. Acceptance Criteria
  - 1. Acceptance criteria shall comply with:
    - a. ASME B31.1, Table 136.4.1 (Surface Examination)
  - 2. Rejectable indications include:
    - a. Any linear indication
    - b. Rounded indications exceeding code limits
    - c. Any crack indication regardless of size
  - 3. All rejectable indications shall be removed by grinding and re-welded in accordance with approved WPS. Repaired areas shall be re-examined by PT.

## G. Personnel Qualifications

1. Examiners shall be certified to:
  - a. ASNT SNT-TC-1A Level II or III or
  - b. ACCP Level II or higher

## H. Welding Requirements

1. Preheat
  - a. Preheat shall comply with approved WPS and material requirements (typically 300–400°F for P11/P22).
2. Interpass Temperature
  - a. Maintain within WPS limits.
3. Post Weld Heat Treatment (PWHT)
  - a. PWHT required where mandated by thickness and code.
  - b. PWHT shall not be performed until:
    - 1) Root-pass PT is accepted
    - 2) Final weld PT/UT (if required) is accepted

## 1.7 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressures and temperatures unless otherwise indicated:
  1. LP Steam Piping: 7.5 psig.
  2. HP Steam Piping: 150 psig
  3. Condensate Piping: 150 psig (kPa)> at 250 deg F.
  4. Blowdown-Drain Piping: Equal to pressure of the piping system to which it is attached.
  5. Air-Vent and Vacuum-Breaker Piping: Equal to pressure of the piping system to which it is attached.
  6. Safety-Valve-Inlet and -Outlet Piping: Equal to pressure of the piping system to which it is attached.

## 1.8 STEEL PIPE AND FITTINGS

- A. Chrome Moly Alloy Seamless Pipe: ASTM A335 / ASME SA335 Grade P11; and welded and flanged joints, and Schedule as indicated in piping applications articles.
- B. Chrome Moly Alloy Threaded Fittings: ASTM A234 WP11; Classes 150 and 300 as indicated in piping applications articles.
- C. Chrome Moly Alloy Unions: ASTM A234 WP11; Classes 150, 250, and 300 as indicated in piping applications articles.
- D. Chrome Moly Alloy Flanges and Flanged Fittings: ASME B16.5, including bolts, nuts, and gaskets of the following material group, end connections, and facings:
  1. Material Group: 1.1.
  2. End Connections: Butt welding.
  3. Facings: Raised face.

## 1.9 JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
  - 1. ASME B16.21, nonmetallic, flat, asbestos free, 1/8-inch (3.2-mm) maximum thickness unless otherwise indicated.
    - a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
    - b. Narrow-Face Type: For raised-face, Class 250 steel flanges.
- B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- C. Welding Filler Metals: Comply with AWS D10.12M/D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- D. Welding Materials: Comply with Section II, Part C, of ASME Boiler and Pressure Vessel Code for welding materials appropriate for wall thickness and for chemical analysis of pipe being welded.

## PART 2 - EXECUTION

### 2.1 LP STEAM PIPING APPLICATIONS

- A. LP Steam Piping, NPS 2 (DN 50) and Smaller: Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11 fittings; and welded and flanged joints.
- B. LP Steam Piping, NPS 2-1/2 and Larger: Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11, Class 300 fittings, flanges, and flange fittings; and welded and flanged joints.
- C. Condensate piping above grade, NPS 2 and smaller, shall be the following:
  - 1. Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11 fittings, flanges, and Class 300 flange fittings; and welded and flanged joints.

### 2.2 HP STEAM PIPING APPLICATIONS

- A. HP Steam Piping, NPS 2 and Smaller Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11 Class 300 fittings; and welded and flanged joints.
- B. HP Steam Piping, NPS 2-1/2 through NPS 12 Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11 Class 300 fittings, flanges, and flange fittings; and welded and flanged joints.
- C. Condensate piping, NPS 4 and smaller, shall be the following:

1. Schedule 80, ASTM A335 / ASME SA335 Grade P11 Chrome Moly Alloy Seamless Pipe; ASTM A234 WP11 fittings; and welded and flanged joints.

## 2.3 ANCILLARY PIPING APPLICATIONS

- A. Blowdown-Drain Piping: Same materials and joining methods as for piping specified for the service in which blowdown drain is installed.
- B. Vacuum-Breaker Piping: Outlet, same as service where installed.
- C. Safety-Valve-Inlet and -Outlet Piping: Same materials and joining methods as for piping specified for the service in which safety valve is installed.

## 2.4 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- B. Install piping in concealed locations unless otherwise indicated and except in equipment rooms and service areas.
- C. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless otherwise indicated.
- D. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- E. Install piping to permit valve servicing.
- F. Install piping free of sags and bends.
- G. Install fittings for changes in direction and branch connections.
- H. Install piping to allow application of insulation.
- I. Select system components with pressure rating equal to or greater than system operating pressure.
- J. Install groups of pipes parallel to each other, spaced to permit applying insulation and servicing of valves.
- K. Install drains, consisting of a tee fitting, NPS 3/4 full port-ball valve, and short NPS 3/4 threaded nipple with cap, at low points in piping system mains and elsewhere as required for system drainage.
- L. Install steam supply piping at a minimum uniform grade of 0.2 percent downward in direction of steam flow.
- M. Install condensate return piping at a minimum uniform grade of 0.4 percent downward in direction of condensate flow.
- N. Reduce pipe sizes using eccentric reducer fitting installed with level side down.

- O. Install branch connections to mains using mechanically formed tee fittings in main pipe, with the branch connected to top of main pipe.
- P. Install valves according to Section 230523 "General Duty Valves for HVAC Piping,"
- Q. Install unions in piping, NPS 2 and smaller, adjacent to valves, at final connections of equipment, and elsewhere as indicated.
- R. Install flanges in piping, NPS 2-1/2 and larger, at final connections of equipment and elsewhere as indicated.
- S. Install shutoff valve immediately upstream of each dielectric fitting.
- T. Install strainers on supply side of control valves, pressure-reducing valves, traps, and elsewhere as indicated. Install NPS 3/4 nipple and full port ball valve in blowdown connection of strainers NPS 2 and larger. Match size of strainer blowoff connection for strainers smaller than NPS 2.
- U. Comply with requirements in Section 230516 "Expansion Fittings and Loops for HVAC Piping" for installation of expansion loops, expansion joints, anchors, and pipe alignment guides.
- V. Comply with requirements in Section 230553 "Identification for HVAC Piping and Equipment" for identifying piping.
- W. Install drip legs at low points and natural drainage points such as ends of mains, bottoms of risers, and ahead of pressure regulators, and control valves.
  - 1. On straight runs with no natural drainage points, install drip legs at intervals not exceeding 300 feet.
  - 2. Size drip legs same size as main. In steam mains NPS 6 and larger, drip leg size can be reduced, but to no less than NPS 4.
- X. Install sleeves for piping penetrations of walls, ceilings, and floors. Comply with requirements for sleeves specified in Section 230500.
- Y. Install escutcheons for piping penetrations of walls, ceilings, and floors. Comply with requirements for escutcheons specified in Section 230500.

## 2.5 STEAM AND CONDENSATE PIPING SPECIALTIES INSTALLATION

- A. Comply with requirements in Section 232216 "Steam and Condensate Piping Specialties" for installation requirements for strainers, flash tanks, special-duty valves, steam traps, thermostatic air vents and vacuum breakers, and steam and condensate meters.

## 2.6 HANGERS AND SUPPORTS

- A. Comply with requirements in Section 230529 "Hangers and Supports for HVAC Piping and Equipment" for installation of hangers and supports. Comply with requirements below for maximum spacing.
- B. Comply with requirements in Section 230548 "Vibration and Seismic Controls for HVAC" for seismic restraints.

- C. Install the following pipe attachments:
1. Adjustable steel clevis hangers for individual horizontal piping less than 20 feet long.
  2. Adjustable roller hangers and spring hangers for individual horizontal piping 20 feet or longer.
  3. Pipe Roller: MSS SP-58, Type 44 for multiple horizontal piping 20 feet or longer, supported on a trapeze.
  4. Spring hangers to support vertical runs.
- D. Install hangers for steel steam supply piping with the following maximum spacing:
1. NPS 3/4 (DN 20): Maximum span, 9 feet (2.7 m).
  2. NPS 1 (DN 25): Maximum span, 9 feet (2.7 m).
  3. NPS 1-1/2 (DN 40): Maximum span, 12 feet (3.7 m).
  4. NPS 2 (DN 50): Maximum span, 13 feet (4 m).
  5. NPS 2-1/2 (DN 65): Maximum span, 14 feet (4.3 m).
  6. NPS 3 (DN 80) and Larger: Maximum span, 15 feet (4.6 m).
- E. Install stainless steel hangers and supports for steel steam condensate piping with the following maximum spacing:
1. NPS 3/4 (DN 20): Maximum span, 7 feet (2.1 m).
  2. NPS 1 (DN 25): Maximum span, 7 feet (2.1 m).
  3. NPS 1-1/2 (DN 40): Maximum span, 9 feet (2.7 m).
  4. NPS 2 (DN 50): Maximum span, 10 feet (3 m).
  5. NPS 2-1/2 (DN 65): Maximum span, 11 feet (3.4 m).
  6. NPS 3 (DN 80) and Larger: Maximum span, 12 feet ((3.7 m).)
- F. Fiberglass Piping Hanger Spacing: Space hangers according to pipe manufacturer's written instructions for service conditions. Avoid point loading. Space and install hangers with the fewest practical rigid anchor points.

## 2.7 PIPE JOINT CONSTRUCTION

- A. Ream ends of pipes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- C. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
  2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- D. Welded Joints: Construct joints according to AWS D10.12M/D10.12, using qualified processes and welding operators according to "Quality Assurance" Article.
- E. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.

- F. Fiberglass Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

## 2.8 TERMINAL EQUIPMENT CONNECTIONS

- A. Size for supply and return piping connections shall be the same as or larger than equipment connections.
- B. Install traps and control valves in accessible locations close to connected equipment.
- C. Install bypass piping with globe valve around control valve. If parallel control valves are installed, only one bypass is required.
- D. Install vacuum breakers downstream from control valve, close to coil inlet connection.
- E. Install a drip leg at coil outlet.

## 2.9 FIELD QUALITY CONTROL

- A. Prepare steam and condensate piping according to ASME B31.1, "Power Piping," and ASME B31.9, "Building Services Piping," and as follows:
  - 1. Leave joints, including welds, uninsulated and exposed for examination during test.
  - 2. Provide temporary restraints for expansion joints that cannot sustain reactions due to test pressure. If temporary restraints are impractical, isolate expansion joints from testing.
  - 3. Flush system with clean water. Clean strainers.
  - 4. Isolate equipment from piping. If a valve is used to isolate equipment, its closure shall be capable of sealing against test pressure without damage to valve. Install blinds in flanged joints to isolate equipment.
- B. Perform the following tests and inspections:
  - 1. Use ambient temperature water as a testing medium unless there is risk of damage due to freezing. Another liquid that is safe for workers and compatible with piping may be used.
  - 2. Subject piping system to hydrostatic test pressure that is not less than 1.5 times the working pressure. Test pressure shall not exceed maximum pressure for any vessel, pump, valve, or other component in system under test. Verify that stress due to pressure at bottom of vertical runs does not exceed 90 percent of specified minimum yield strength.
  - 3. After hydrostatic test pressure has been applied for at least 10 minutes, examine piping, joints, and connections for leakage. Eliminate leaks by tightening, repairing, or replacing components, and repeat hydrostatic test until there are no leaks.
- C. Prepare test and inspection reports.

END OF SECTION 232213

## SECTION 232216 - STEAM AND CONDENSATE PIPING SPECIALTIES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section includes the following piping specialties for LP and HP steam and condensate piping:
  - 1. Strainers.
  - 2. Safety valves.
  - 3. Pressure-reducing valves.
  - 4. Steam traps.
  - 5. Thermostatic air vents and vacuum breakers.

#### 1.3 ACTION SUBMITTALS

- A. Product Data: For each type of the following:
  - 1. Pressure-reducing and safety valve.
  - 2. Steam trap.
  - 3. Air vent and vacuum breaker.

#### 1.4 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For valves, safety valves, pressure-reducing valves, steam traps, air vents, and vacuum breakers, to include in emergency, operation, and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. Pipe Welding: Qualify procedures and operators according to the following:
  - 1. ASME Compliance: Safety valves and pressure vessels shall bear the appropriate ASME label. Fabricate and stamp flash tanks to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.

## PART 2 - PRODUCTS

### 2.1 PERFORMANCE REQUIREMENTS

- A. Components and installation shall be capable of withstanding the following minimum working pressures and temperatures unless otherwise indicated:
1. HP Steam Piping: 50 psig.
  2. LP Steam Piping: 7.5 psig.
  3. Condensate Piping: 50 psig (kPa)> at 250 deg F.
  4. Air-Vent and Vacuum-Breaker Piping: Equal to pressure of the piping system to which it is attached.
  5. Safety-Valve-Inlet and -Outlet Piping: Equal to pressure of the piping system to which it is attached.

### 2.2 VALVES

- A. Gate, Globe, Check, Ball, and Butterfly Valves: Comply with requirements specified in Section 230523 "General Duty Valves for HVAC Piping."
- B. Stop-Check Valves for hydronic piping:
1. Body and Bonnet: Malleable iron.
  2. End Connections: Flanged.
  3. Disc: Cylindrical with removable liner and machined seat.
  4. Stem: Brass alloy.
  5. Packing: Polytetrafluoroethylene-impregnated packing with two-piece packing gland assembly.
  6. Pressure Class: 250.
- C. Stop-Check Valves for steam and steam condensate piping:
1. Body and Bonnet: 316 Stainless Steel.
  2. End Connections: Flanged or Socket Welded.
  3. Disc: Cylindrical with removable liner and machined seat.
  4. Spring: Stainless Steel
  5. Packing: Fluorocarbon polymer packing with two-piece packing gland assembly.
  6. Pressure Class: 300.

### 2.3 STRAINERS

- A. Y-Pattern Strainers for hydronic piping:
1. Body: ASTM A 126, Class B cast iron, with bolted cover and bottom drain connection.
  2. End Connections: Threaded ends for strainers NPS 2 (DN 50) and smaller; flanged ends for strainers NPS 2-1/2 (DN 65) and larger.
  3. Strainer Screen: Stainless-steel, 40-mesh strainer, or perforated stainless-steel basket.
  4. Tapped blowoff plug.
  5. CWP Rating: 250-psig (1725-kPa) working steam pressure.
- B. Y-Pattern Strainers for steam and steam condensate piping:
1. Body: ASTM A 351 CF8M, 316 Stainless Steel, with bottom drain connection.

2. End Connections: Socket weld ends for strainers NPS 2 (DN 50) and smaller; flanged ends for strainers NPS 2-1/2 (DN 65) and larger.
3. Strainer Screen: Stainless-steel, 40-mesh strainer, or perforated stainless-steel basket.
4. Tapped blowoff plug.
5. CWP Rating: 1000-psig -psig working steam pressure.

## 2.4 SAFETY VALVES

### A. Bronze Safety Valves: ASME labeled.

1. Disc Material: Forged copper alloy.
2. End Connections: Threaded inlet and outlet.
3. Spring: Fully enclosed steel spring with adjustable pressure range and positive shutoff, factory set and sealed.
4. Pressure Class: 250.
5. Drip-Pan Elbow: Cast iron and having threaded inlet and outlet with threads complying with ASME B1.20.1.
6. Size and Capacity: As required for equipment according to ASME Boiler and Pressure Vessel Code.

### B. Cast-Iron Safety Valves: ASME labeled.

1. Disc Material: Forged copper alloy with bronze nozzle.
2. End Connections: Raised-face flanged inlet and threaded or flanged outlet connections.
3. Spring: Fully enclosed cadmium-plated steel spring with adjustable pressure range and positive shutoff, factory set and sealed.
4. Pressure Class: 250.
5. Drip-Pan Elbow: Cast iron and having threaded inlet, outlet, and drain, with threads complying with ASME B1.20.1.
6. Exhaust Head: Cast iron and having threaded inlet and drain, with threads complying with ASME B1.20.1.
7. Size and Capacity: As required for equipment according to ASME Boiler and Pressure Vessel Code.

## 2.5 PRESSURE-REDUCING VALVES

### A. Pilot-Operated Regulating Valves

1. Manufacturers: Subject to compliance with requirements, provide product by one of the following:
  - a. Spence.
  - b. Watson McDaniel

### B. ASME labeled.

### C. Size, Capacity, and Pressure Rating: Factory set for inlet and outlet pressures indicated.

### D. Description: Pilot-actuated, diaphragm type, with adjustable pressure range and positive shutoff.

### E. Body: Cast iron.

- F. End Connections: Threaded connections for valves NPS 2 and smaller and flanged connections for valves NPS 2-1/2 and larger.
- G. Trim: Hardened stainless steel.
- H. Head and Seat: Replaceable, main head stem guide fitted with flushing and pressure-arresting device cover over pilot diaphragm.
- I. Gaskets: Non-asbestos materials.
- J. Diaphragm: Stainless Steel
- K. External Tubing: Stainless Steel

## 2.6 STEAM TRAPS

### A. Thermostatic Traps:

1. Body: Stainless Steel angle-pattern body with integral union tailpiece and screw-in cap.
2. Trap Type: Balanced-pressure.
3. Bellows: Stainless steel or monel.
4. Head and Seat: Replaceable, hardened stainless steel.
5. Pressure Class: 125.

### B. Thermodynamic Traps:

1. Body: Stainless steel with screw-in cap.
2. End Connections: Threaded.
3. Disc and Seat: Stainless steel.
4. Maximum Operating Pressure: 600 psig.

### C. Float and Thermostatic Traps:

1. Body and Bolted Cap: Stainless steel.
2. End Connections: Flanged.
3. Float Mechanism: Replaceable, stainless steel.
4. Head and Seat: Hardened stainless steel.
5. Trap Type: Balanced pressure.
6. Thermostatic Bellows: Stainless steel or monel.
7. Thermostatic air vent capable of withstanding 45 deg F (25 deg C) of superheat and resisting water hammer without sustaining damage.
8. Vacuum Breaker: Thermostatic with phosphor bronze bellows, and stainless-steel cage, valve, and seat.
9. Maximum Operating Pressure: 600 psig.

### D. Inverted Bucket Traps:

1. Body and Cap: Stainless steel.
2. End Connections: Threaded.
3. Head and Seat: Stainless steel.
4. Valve Retainer, Lever, and Guide Pin Assembly: Stainless steel.
5. Bucket: Brass or stainless steel.
6. Strainer: Integral stainless-steel inlet strainer within the trap body.
7. Air Vent: Stainless-steel thermostatic vent.

8. Pressure Rating: 250 psig (1725 kPa).

## 2.7 THERMOSTATIC AIR VENTS AND VACUUM BREAKERS

- A. Thermostatic Air Vents:
  1. Body: Stainless steel.
  2. End Connections: Threaded.
  3. Float, Valve, and Seat: Stainless steel.
  4. Thermostatic Element: Phosphor bronze bellows in a stainless-steel cage.
  5. Pressure Rating: 125 psig.
  6. Maximum Temperature Rating: 350 deg F.
- B. Vacuum Breakers:
  1. Body: Stainless steel.
  2. End Connections: Threaded.
  3. Sealing Ball, Retainer, Spring, and Screen: Stainless steel.
  4. O-Ring Seal: EPR.
  5. Pressure Rating: 125 psig.
  6. Maximum Temperature Rating: 350 deg F.

## PART 3 - EXECUTION

### 3.1 VALVE APPLICATIONS

- A. Install shutoff duty valves at branch connections to steam supply mains, at steam supply connections to equipment, and at the outlet of steam traps.
- B. Install safety valves on pressure-reducing stations and elsewhere as required by ASME Boiler and Pressure Vessel Code. Install safety-valve discharge piping, without valves, to nearest floor drain or as indicated on Drawings. Comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1, for installation requirements.

### 3.2 PIPING INSTALLATION

- A. Install piping to permit valve servicing.
- B. Install drains, consisting of a tee fitting, NPS 3/4 (DN 20) full port-ball valve, and short NPS 3/4 (DN 20) threaded nipple with cap, at low points in piping system mains and elsewhere as required for system drainage.
- C. Install valves according to Section 230523.
- D. Install unions in piping, NPS 2 and smaller, adjacent to valves, at final connections of equipment, and elsewhere as indicated.
- E. Install flanges in piping, NPS 2-1/2 and larger, at final connections of equipment and elsewhere as indicated.
- F. Install shutoff valve immediately upstream of each dielectric fitting.

- G. Install strainers on supply side of control valves, pressure-reducing valves, traps, and elsewhere as indicated. Install NPS 3/4 (DN 20) nipple and full port ball valve in blowdown connection of strainers NPS 2 (DN 50) and larger. Match size of strainer blowoff connection for strainers smaller than NPS 2 (DN 50).

### 3.3 STEAM-TRAP INSTALLATION

- A. Install steam traps in accessible locations as close as possible to connected equipment.
- B. Install full-port ball valve, strainer, and union upstream from trap; install union, check valve, and full-port ball valve downstream from trap unless otherwise indicated.

### 3.4 PRESSURE-REDUCING VALVE INSTALLATION

- A. Install pressure-reducing valves in accessible location for maintenance and inspection.
- B. Install bypass piping around pressure-reducing valves, with globe valve equal in size to area of pressure-reducing valve seat ring, unless otherwise indicated.
- C. Install gate valves on both sides of pressure-reducing valves.
- D. Install unions or flanges on both sides of pressure-reducing valves having threaded- or flanged-end connections, respectively.
- E. Install pressure gages on low-pressure side of pressure-reducing valves after the bypass connection according to Section 230519 "Meters and Gages for HVAC Piping."
- F. Install strainers upstream for pressure-reducing valve.
- G. Install safety valve downstream from pressure-reducing valve station.

### 3.5 SAFETY VALVE INSTALLATION

- A. Install safety valves according to ASME B31.1, "Power Piping"; and ASME B31.9, "Building Services Piping."
- B. Pipe safety-valve discharge without valves to atmosphere outside the building.
- C. Install drip-pan elbow fitting adjacent to safety valve and pipe drain connection to nearest floor drain.
- D. Install exhaust head with drain to waste, on vents equal to or larger than NPS 2-1/2 (DN 65).

### 3.6 TERMINAL EQUIPMENT CONNECTIONS

- A. Install traps and control valves in accessible locations close to connected equipment.
- B. Install bypass piping with globe valve around control valve. If parallel control valves are installed, only one bypass is required.

- C. Install vacuum breakers downstream from control valve, close to coil inlet connection.

END OF SECTION 232216

## SECTION 232223 – STEAM CONDENSATE PUMPS

### PART 1 - GENERAL

#### 1.1 SUMMARY

- A. Section Includes:
1. Pressure-powered steam condensate pumps.

#### 1.2 DEFINITIONS

- A. PPE: Polyphenylene ether.
- B. PPO: Polyphenylene oxide.

#### 1.3 ACTION SUBMITTALS

- A. Product Data:
1. For each type of steam condensate pump.
    - a. Include certified performance curves and rated capacities, operating characteristics, furnished specialties, and accessories.
    - b. Indicate pump's operating point on curves.
    - c. Include receiver capacity and material.
- B. Shop Drawings: For each pump/receiver.
1. Show pump layout and connections.
  2. Include setting drawings with templates for installing foundation and anchor bolts and other anchorages.
  3. Include diagrams for power, signal, and control wiring.

#### 1.4 INFORMATIONAL SUBMITTALS

1. Basis for Certification: Indicate whether withstand certification is based on actual test of assembled components or on calculation.
2. Dimensioned Outline Drawings of Equipment Unit: Identify center of gravity and locate and describe mounting and anchorage provisions.
3. Detailed description of equipment anchorage devices on which the certification is based and their installation requirements.

#### 1.5 CLOSEOUT SUBMITTALS

- A. Operation and Maintenance Data: For pumps.
1. Indicate actual installed items by marking submittals with an arrow or box.

## PART 2 - PRODUCTS

### 2.1 SOURCE LIMITATIONS

- A. Obtain each type of pump from single source from single manufacturer.

### 2.2 PERFORMANCE REQUIREMENTS

- A. ASME Compliance: Fabricate and label steam condensate receivers to comply with ASME Boiler and Pressure Vessel Code: Section VIII, Division 1.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by an NRTL, and marked for intended location and use.
- C. ASHRAE/IES 90.1 Compliance: Applicable requirements in ASHRAE/IES 90.1, "Section 6 - Heating, Ventilating, and Air Conditioning."

### 2.3 PRESSURE-POWERED STEAM CONDENSATE PUMPS

- A. Manufacturers:
  - 1. Armstrong Fluid Technology.
  - 2. Spirax Sarco.
  - 3. Watson McDaniel.
- B. Description: Factory-fabricated, simplex, pressure-powered pumps with float-operated valve controls, valves, piping connections, and accessories suitable for pumping steam condensate using steam.
- C. Pump Body: Stainless Steel, ASME rated to 125 psig.
- D. Piping Connections: Threaded or flanged; for steam condensate inlet, outlet, operating medium, vent, and indicated accessories.
- E. Level Gauge: Glass site gauge with shutoff cocks.
- F. Valves: Manufacturer's standard check valves on inlet and outlet.
- G. Internal Parts: Stainless steel float, springs, and actuating mechanism.
- H. Valve Seals: Replaceable from exterior.
- I. Receiver:
  - 1. Factory skid-mounted on steel supports.
  - 2. Material; Type 316 stainless steel.
  - 3. Threaded or flanged piping connections.
  - 4. Water-level gauge and dial thermometer.
  - 5. Pressure gauge at pump discharge.
  - 6. Bronze fitting isolation valve between pump and receiver.
  - 7. Lifting eyebolts.

- 8. Inlet vent and an overflow.
- J. Pipe: ASTM A53/A53M, Type S, Grade B stainless steel .
- K. Fittings: Stainless steel, ASTM A312 with wall thickness to match adjacent pipe.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine equipment foundations and anchor-bolt locations for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for piping systems to verify actual locations of piping connections before pump installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION OF STEAM CONDENSATE PUMPS

- A. Install pumps to provide access for periodic maintenance, including removing motors, impellers, couplings, and accessories.
- B. Support pumps and piping separately so piping is not supported by pumps.
- C. Install thermometers and pressure gauges.
- D. Equipment Mounting:
  - 1. Install pumps on cast-in-place concrete equipment base(s). Comply with requirements for equipment bases and foundations specified in Section 230500 "Cast-in-Place Concrete."

### 3.3 PIPING CONNECTIONS

- A. Comply with requirements for piping specified in Section 232213 "Steam and Condensate Piping" and Section 232216 "Steam and Condensate Heating Piping Specialties."
- B. Where installing piping adjacent to machine, allow space for service and maintenance.
- C. Install a globe and check valve at inlet of each pump and a gate and check valve at pump outlet.
- D. Install pressure gauge at each pump discharge.
- E. Pipe drain to nearest floor drain for overflow and drain piping connections.
- F. Install full-size vent piping to outdoors, terminating in 180-degree elbow.

### 3.4 CONTROL CONNECTIONS

- A. Install control and electrical power wiring to field-mounted control devices.
- B. Connect control wiring in accordance with Section 260523 "Control-Voltage Electrical Power Cables."

### 3.5 SYSTEM STARTUP

- A. Engage a factory-authorized service representative to perform startup service.
  - 1. Complete installation and startup checks in accordance with manufacturer's written instructions.
  - 2. Clean strainers.
  - 3. Adjust steam condensate pump controls.
  - 4. Adjust pump controls for automatic start, stop, and alarm operation.
  - 5. Perform the following operational checks before starting:
    - a. Set float switches to operate at proper levels.
    - b. Check motors for proper rotation.
    - c. Test pump controls and demonstrate compliance with requirements.
    - d. Replace damaged or malfunctioning pump controls and equipment.
    - e. Verify that pump controls are correct for required application.
  - 6. Start steam condensate pumps in accordance with manufacturer's written startup instructions.

### 3.6 DEMONSTRATION

- A. Train Owner's maintenance personnel to adjust, operate, and maintain steam condensate pumps.

END OF SECTION 232223

## SECTION 233113 – METAL DUCTS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:

- 1. Single-wall rectangular ducts and fittings.
- 2. Sheet metal materials.
- 3. Sealants and gaskets.
- 4. Hangers and supports.

- B. Related Sections:

- 1. Division 23 Section "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing requirements for metal ducts.
- 2. Division 23 Section "Air Duct Accessories" for dampers, sound-control devices, duct-mounting access doors and panels, turning vanes, and flexible ducts.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. Delegated Duct Design: Duct construction, including sheet metal thicknesses, seam and joint construction, reinforcements, and hangers and supports, shall comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and performance requirements and design criteria indicated in "Duct Schedule" Article.
- B. Structural Performance: Duct hangers and supports shall withstand the effects of gravity loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- C. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2013.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of the following products:

- 1. Liners and adhesives.
- 2. Sealants and gaskets.
- 3. Seismic-restraint devices.

- B. Shop Drawings:

1. Fabrication, assembly, and installation, including plans, elevations, sections, components, and attachments to other work.
2. Factory- and shop-fabricated ducts and fittings.
3. Dimensions of main duct runs from building grid lines.
4. Fittings.
5. Reinforcement and spacing.
6. Seam and joint construction.
7. Penetrations through fire-rated and other partitions.
8. Equipment installation based on equipment being used on Project.
9. Hangers and supports, including methods for duct and building attachment and vibration isolation.

## 1.5 QUALITY ASSURANCE

- A. Welding Qualifications: Qualify procedures and personnel according to the following:
  1. AWS D1.1/D1.1M, "Structural Welding Code - Steel," for hangers and supports.
  2. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum," for aluminum supports.
  3. AWS D9.1M/D9.1, "Sheet Metal Welding Code," for duct joint and seam welding.
- B. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and System Start-Up."
- C. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6.4.4 - "HVAC System Construction and Insulation."

## PART 2 - PRODUCTS

### 2.1 SINGLE-WALL RECTANGULAR DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated. Ductwork shall be mechanical fastened and sealed. Mechanical fasteners for use with flexible non-metallic air ducts shall comply with UL 181B and shall be marked "181 B-C".
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-4, "Transverse (Girth) Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 1-5, "Longitudinal Seams - Rectangular Ducts," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 2, "Fittings and Other Construction," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

## 2.2 SHEET METAL MATERIALS

- A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
  - 1. Galvanized Coating Designation: G60.
  - 2. Finishes for Surfaces Exposed to View: Mill phosphatized.
- C. Reinforcement Shapes and Plates: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
  - 1. Where black- and galvanized-steel shapes and plates are used to reinforce aluminum ducts, isolate the different metals with butyl rubber, neoprene, or EPDM gasket materials.
- D. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

## 2.3 SEALANT AND GASKETS

- A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.
- B. Two-Part Tape Sealing System:
  - 1. Tape: Woven cotton fiber impregnated with mineral gypsum and modified acrylic/silicone activator to react exothermically with tape to form hard, durable, airtight seal.
  - 2. Tape Width: 3 inches.
  - 3. Sealant: Modified styrene acrylic.
  - 4. Water resistant.
  - 5. Mold and mildew resistant.
  - 6. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
  - 7. Service: Indoor and outdoor.
  - 8. Service Temperature: Minus 40 to plus 200 deg F.
  - 9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum.
  - 10. For indoor applications, use sealant that has a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
  - 11. Tape shall comply with UL 181B and shall be marked "181 B-FX".
- C. Water-Based Joint and Seam Sealant:
  - 1. Application Method: Brush on.
  - 2. Solids Content: Minimum 65 percent.
  - 3. Shore A Hardness: Minimum 20.
  - 4. Water resistant.
  - 5. Mold and mildew resistant.
  - 6. VOC: Maximum 75 g/L (less water).
  - 7. Maximum Static-Pressure Class: 10-inch wg, positive and negative.

8. Service: Indoor or outdoor.
  9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.
  10. Sealant shall comply with UL 181B and shall be marked "181 B-M".
- D. Flanged Joint Sealant: Comply with ASTM C 920.
1. General: Single-component, acid-curing, silicone, elastomeric.
  2. Type: S.
  3. Grade: NS.
  4. Class: 25.
  5. Use: O.
  6. For indoor applications, use sealant that has a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- E. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.

## 2.4 HANGERS AND SUPPORTS

- A. Hanger Rods for Noncorrosive Environments: Cadmium-plated steel rods and nuts.
- B. Hanger Rods for Corrosive Environments: Electrogalvanized, all-thread rods or galvanized rods with threads painted with zinc-chromate primer after installation.
- C. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 4-1, "Rectangular Duct Hangers Minimum Size."
- D. Steel Cables for Galvanized-Steel Ducts: Galvanized steel complying with ASTM A 603.
- E. Steel Cables for Stainless-Steel Ducts: Stainless steel complying with ASTM A 492.
- F. Steel Cable End Connections: Cadmium-plated steel assemblies with brackets, swivel, and bolts designed for duct hanger service; with an automatic-locking and clamping device.
- G. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.
- H. Trapeze and Riser Supports:
  1. Supports for Galvanized-Steel Ducts: Galvanized-steel shapes and plates.
  2. Supports for Stainless-Steel Ducts: Stainless-steel shapes and plates.
  3. Supports for Aluminum Ducts: Aluminum or galvanized steel coated with zinc chromate.

## PART 3 - EXECUTION

### 3.1 DUCT INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations.

Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and Coordination Drawings.

- B. Install ducts according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" unless otherwise indicated.
- C. Install ducts with fewest possible joints.
- D. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.
- E. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.
- F. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.
- G. Install ducts with a clearance of 1 inch, plus allowance for insulation thickness.
- H. Route ducts to avoid passing through transformer vaults and electrical equipment rooms and enclosures.
- I. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.
- J. Where ducts pass through fire-rated interior partitions and exterior walls, install fire dampers. Comply with requirements in Division 23 Section "Air Duct Accessories" for fire and smoke dampers.
- K. Protect duct interiors from moisture, construction debris and dust, and other foreign materials. Comply with SMACNA's "Duct Cleanliness for New Construction Guidelines."

### 3.2 INSTALLATION OF EXPOSED DUCTWORK

- A. Protect ducts exposed in finished spaces from being dented, scratched, or damaged.
- B. Trim duct sealants flush with metal. Create a smooth and uniform exposed bead. Do not use two-part tape sealing system.
- C. Grind welds to provide smooth surface free of burrs, sharp edges, and weld splatter. When welding stainless steel with a No. 3 or 4 finish, grind the welds flush, polish the exposed welds, and treat the welds to remove discoloration caused by welding.
- D. Maintain consistency, symmetry, and uniformity in the arrangement and fabrication of fittings, hangers and supports, duct accessories, and air outlets.
- E. Repair or replace damaged sections and finished work that does not comply with these requirements.

### 3.3 DUCT SEALING

- A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in "Duct Schedule" Article according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- B. Seal ducts to the following seal classes according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible":
  - 1. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
  - 2. Outdoor, Exhaust Ducts: Seal Class C.
  - 3. Outdoor, Return-Air Ducts: Seal Class C.
  - 4. Conditioned Space, Exhaust Ducts: Seal Class B.

### 3.4 HANGER AND SUPPORT INSTALLATION

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 4, "Hangers and Supports."
- B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.
  - 1. Where practical, install concrete inserts before placing concrete.
  - 2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.
  - 3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
  - 4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
  - 5. Do not use powder-actuated concrete fasteners for seismic restraints.
- C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 4-1, "Rectangular Duct Hangers Minimum Size," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.
- D. Hangers Exposed to View: Threaded rod and angle or channel supports.
- E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.
- F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

### 3.5 CONNECTIONS

- A. Make connections to equipment with flexible connectors complying with Division 23 Section "Air Duct Accessories."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for branch, outlet and inlet, and terminal unit connections.

### 3.6 PAINTING

- A. Paint interior of metal ducts that are visible through registers and grilles and that do not have duct liner. Apply one coat of flat, black, latex paint over a compatible galvanized-steel primer. Paint materials and application requirements are specified in Division 09 painting Sections.

### 3.7 START UP

- A. Air Balance: Comply with requirements in Division 23 Section "Testing, Adjusting, and Balancing for HVAC."

### 3.8 DUCT SCHEDULE

#### A. Exhaust Ducts:

- 1. Ducts Connected to Fans Exhausting (ASHRAE 62.1, Class 1 and 2) Air:
  - a. Pressure Class: Negative 1-inch wg.
  - b. Minimum SMACNA Seal Class: B if negative pressure, and A if positive pressure.
  - c. SMACNA Leakage Class for Rectangular: 12.
- 2. Ducts Connected to Equipment Not Listed Above:
  - a. Pressure Class: Positive or negative 2-inch wg.
  - b. Minimum SMACNA Seal Class: B if negative pressure, and A if positive pressure.
  - c. SMACNA Leakage Class for Rectangular: 6.

#### B. Intermediate Reinforcement:

- 1. Galvanized-Steel Ducts: Galvanized steel.

#### C. Elbow Configuration:

- 1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Elbows."
  - a. Velocity 1000 fpm or Lower:
    - 1) Radius Type RE 1 with minimum 0.5 radius-to-diameter ratio and two vanes.
    - 2) Mitered Type RE 4 with vanes.
- 2. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Elbows."
  - a. Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
  - b. Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.
  - c. Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-3, "Vanes and Vane Runners," and Figure 2-4, "Vane Support in Elbows."

END OF SECTION 233113

## SECTION 233300 – AIR DUCT ACCESSORIES

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Backdraft and pressure relief dampers.
  - 2. Flange connectors.
  - 3. Turning vanes.
  - 4. Flexible connectors.
  - 5. Duct accessory hardware.

#### 1.3 SUBMITTALS

- A. Shop Drawings: For duct accessories. Include plans, elevations, sections, details and attachments to other work.
  - 1. Detail duct accessories fabrication and installation in ducts and other construction. Include dimensions, weights, loads, and required clearances; and method of field assembly into duct systems and other construction. Include the following:
    - a. Special fittings.
    - b. Manual volume damper installations.
    - c. Wiring Diagrams: For power, signal, and control wiring.

#### 1.4 QUALITY ASSURANCE

- A. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," and with NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems."
- B. Comply with AMCA 500-D testing for damper rating.

### PART 2 - PRODUCTS

#### 2.1 MATERIALS

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise

indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.

- B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
  - 1. Galvanized Coating Designation: G60.
  - 2. Exposed-Surface Finish: Mill phosphatized.
- C. Reinforcement Shapes and Plates: Galvanized-steel reinforcement where installed on galvanized sheet metal ducts; compatible materials for aluminum and stainless-steel ducts.
- D. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

## 2.2 BACKDRAFT AND PRESSURE RELIEF DAMPERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Greenheck Fan Corporation.
  - 2. Pottorff Company
  - 3. Ruskin Company.
- B. Description: Gravity balanced.
- C. Maximum Air Velocity: 2000 fpm.
- D. Maximum System Pressure: 1-inch wg.
- E. Frame: 0.052-inch thick, galvanized sheet steel, with welded corners and mounting flange.
- F. Blades: Multiple single-piece blades, center-pivoted, maximum 6-inch width, 0.025-inch- thick, roll-formed aluminum with sealed edges.
- G. Blade Action: Parallel.
- H. Blade Seals: Neoprene, mechanically locked.
- I. Blade Axles:
  - 1. Material: Nonferrous metal.
  - 2. Diameter: 0.20 inch.
- J. Tie Bars and Brackets: Galvanized steel.
- K. Return Spring: Adjustable tension.
- L. Bearings: Steel ball or synthetic pivot bushings.
- M. Accessories:
  - 1. Adjustment device to permit setting for varying differential static pressure.
  - 2. Counterweights and spring-assist kits for vertical airflow installations.

3. Electric actuators.
4. Chain pulls.
5. Screen Mounting: Front mounted in sleeve.
  - a. Sleeve Thickness: 20-gage minimum.
  - b. Sleeve Length: 6 inches minimum.
6. Screen Material: Galvanized steel.
7. Screen Type: Insect.
8. 90-degree stops.

## 2.3 FLANGE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Ductmate Industries, Inc.
  2. Nexus PDQ; Division of Shilco Holdings Inc.
  3. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Description: Add-on or roll-formed, factory-fabricated, slide-on transverse flange connectors, gaskets, and components.
- C. Material: Galvanized steel.
- D. Gage and Shape: Match connecting ductwork.

## 2.4 TURNING VANES

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  1. Ductmate Industries, Inc.
  2. Duro Dyne Inc.
  3. SEMCO Incorporated.
- B. Manufactured Turning Vanes for Metal Ducts: Curved blades of galvanized sheet steel; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.
  1. Acoustic Turning Vanes: Fabricate airfoil-shaped aluminum extrusions with perforated faces and fibrous-glass fill.
- C. Manufactured Turning Vanes for Nonmetal Ducts: Fabricate curved blades of resin-bonded fiberglass with acrylic polymer coating; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.
- D. General Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figures 2-3, "Vanes and Vane Runners," and 2-4, "Vane Support in Elbows."
- E. Vane Construction: Double wall.

- F. Vane Construction: Single wall for ducts up to 48 inches wide and double wall for larger dimensions.

## 2.5 FLEXIBLE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Ductmate Industries, Inc.
  - 2. Duro Dyne Inc.
  - 3. Ventfabrics, Inc.
  - 4. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Materials: Flame-retardant or noncombustible fabrics.
- C. Coatings and Adhesives: Comply with UL 181, Class 1.
- D. Metal-Edged Connectors: Factory fabricated with a fabric strip 3-1/2 inches wide attached to 2 strips of 2-3/4-inch wide, 0.028-inch thick, galvanized sheet steel or 0.032-inch thick aluminum sheets. Provide metal compatible with connected ducts.
- E. Indoor System, Flexible Connector Fabric: Glass fabric double coated with neoprene.
  - 1. Minimum Weight: 26 oz./sq. yd..
  - 2. Tensile Strength: 480 lbf/inch in the warp and 360 lbf/inch in the filling.
  - 3. Service Temperature: Minus 40 to plus 200 deg F.
- F. Outdoor System, Flexible Connector Fabric: Glass fabric double coated with weatherproof, synthetic rubber resistant to UV rays and ozone.
  - 1. Minimum Weight: 24 oz./sq. yd..
  - 2. Tensile Strength: 530 lbf/inch in the warp and 440 lbf/inch in the filling.
  - 3. Service Temperature: Minus 50 to plus 250 deg F.
- G. Thrust Limits: Combination coil spring and elastomeric insert with spring and insert in compression, and with a load stop. Include rod and angle-iron brackets for attaching to fan discharge and duct.
  - 1. Frame: Steel, fabricated for connection to threaded rods and to allow for a maximum of 30 degrees of angular rod misalignment without binding or reducing isolation efficiency.
  - 2. Outdoor Spring Diameter: Not less than 80 percent of the compressed height of the spring at rated load.
  - 3. Minimum Additional Travel: 50 percent of the required deflection at rated load.
  - 4. Lateral Stiffness: More than 80 percent of rated vertical stiffness.
  - 5. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
  - 6. Elastomeric Element: Molded, oil-resistant rubber or neoprene.
  - 7. Coil Spring: Factory set and field adjustable for a maximum of 1/4-inch movement at start and stop.

## 2.6 DUCT ACCESSORY HARDWARE

- A. Instrument Test Holes: Cast iron or cast aluminum to suit duct material, including screw cap and gasket. Size to allow insertion of pitot tube and other testing instruments and of length to suit duct-insulation thickness.
- B. Adhesives: High strength, quick setting, neoprene based, waterproof, and resistant to gasoline and grease.

## PART 3 - EXECUTION

### 3.1 INSTALLATION

- A. Install duct accessories according to applicable details in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts and in NAIMA AH116, "Fibrous Glass Duct Construction Standards," for fibrous-glass ducts.
- B. Install duct accessories of materials suited to duct materials; use galvanized-steel accessories in galvanized-steel and fibrous-glass ducts, stainless-steel accessories in stainless-steel ducts, and aluminum accessories in aluminum ducts.
- C. Install backdraft dampers at inlet of exhaust fans or exhaust ducts as close as possible to exhaust fan unless otherwise indicated.
- D. Install test holes at fan inlets and outlets and elsewhere as indicated.
- E. Install flexible connectors to connect ducts to equipment.
- F. Install duct test holes where required for testing and balancing purposes.
- G. Provide remote damper operators where ever volume dampers are installed above an inaccessible hard ceiling.

### 3.2 ADJUSTMENT, CALIBRATION, AND TESTING

- A. Description:
  - 1. Calibrate each instrument installed that is not factory calibrated and provided with calibration documentation.
  - 2. Provide a written description of proposed field procedures and equipment for calibrating each type of instrument. Submit procedures before calibration and adjustment.
  - 3. For each analog instrument, make a three-point test of calibration for both linearity and accuracy.
  - 4. Equipment and procedures used for calibration shall meet instrument manufacturer's recommendations.
  - 5. Provide diagnostic and test equipment for calibration and adjustment.
  - 6. Field instruments and equipment used to test and calibrate installed instruments shall have accuracy at least twice the instrument accuracy being calibrated. For example, an installed instrument with an accuracy of 1 percent shall be checked by an instrument with an accuracy of 0.5 percent.

7. Calibrate each instrument according to instrument instruction manual supplied by manufacturer.
8. If after-calibration-indicated performance cannot be achieved, replace out-of-tolerance instruments.
9. Comply with field-testing requirements and procedures indicated by ASHRAE Guideline 11, "Field Testing of HVAC Control Components," in the absence of specific requirements, and to supplement requirements indicated.

### 3.3 FIELD QUALITY CONTROL

#### A. Tests and Inspections:

1. Operate dampers to verify full range of movement.
2. Inspect locations of access doors and verify that purpose of access door can be performed.
3. Inspect turning vanes for proper and secure installation.

END OF SECTION 233300

## SECTION 233423 – HVAC POWER VENTILATORS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Ceiling mounted ventilators.

#### 1.3 PERFORMANCE REQUIREMENTS

- A. Project Altitude: Base fan-performance ratings on actual Project site elevations.
- B. Operating Limits: Classify according to AMCA 99.

#### 1.4 SUBMITTALS

- A. Product Data: For each type of product indicated. Include rated capacities, operating characteristics, and furnished specialties and accessories. Also include the following:
  - 1. Certified fan performance curves with system operating conditions indicated.
  - 2. Certified fan sound-power ratings.
  - 3. Motor ratings and electrical characteristics, plus motor and electrical accessories.
  - 4. Material thickness and finishes, including color charts.
  - 5. Dampers, including housings, linkages, and operators.
  - 6. Fan speed controllers.
- B. Shop Drawings: Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 2. Wiring Diagrams: For power, signal, and control wiring.
- C. Coordination Drawings: Reflected ceiling plans and other details, drawn to scale, on which the following items are shown and coordinated with each other, using input from Installers of the items involved:
  - 1. Roof framing and support members relative to duct penetrations.
  - 2. Ceiling suspension assembly members.
  - 3. Size and location of initial access modules for acoustical tile.
  - 4. Ceiling-mounted items including light fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings.

- D. Field quality-control reports.
- E. Operation and Maintenance Data: For power ventilators to include in emergency, operation, and maintenance manuals.

#### 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. AMCA Compliance: Fans shall have AMCA-Certified performance ratings and shall bear the AMCA-Certified Ratings Seal.
- C. UL Standards: Power ventilators shall comply with UL 705. Power ventilators for use for restaurant kitchen exhaust shall also comply with UL 762.

#### 1.6 COORDINATION

- A. Coordinate size and location of structural-steel support members.
- B. Coordinate sizes and locations of concrete bases with actual equipment provided.

#### 1.7 MAINTENANCE MATERIAL SUBMITTALS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.

#### 1.8 WARRANTY

- A. Manufacturer shall provide, at no additional cost, a standard parts warranty that covers a period of two years from substantial completion. This warrants that all products are free from defects in material and workmanship and shall meet the capacities and ratings set forth in the equipment manufacturer's catalog and bulletins.

### PART 2 - PRODUCTS

#### 2.1 CEILING-MOUNTED VENTILATORS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Greenheck.
  - 2. Loren Cook Company.
  - 3. Penn Barry.
- B. Housing: Steel, lined with acoustical insulation.

- C. Fan Wheel: Polypropylene steel, Centrifugal wheels directly mounted on motor shaft. Fan shrouds, motor, and fan wheel shall be removable for service.
- D. Grille: Aluminum, louvered grille with flange on intake and thumbscrew attachment to fan housing.
- E. Electrical Requirements: Junction box for electrical connection on housing and receptacle for motor plug-in.
- F. Accessories:
  - 1. Motor Mounted Speed Dial: Solid-state control to reduce speed from 100 to less than 50 percent.
  - 2. Isolation: Rubber-in-shear vibration isolators.
  - 3. Integral back-draft damper.

## 2.2 MOTORS

- A. Comply with requirements in Division 23 Section "Motors."
- B. Enclosure Type: Totally enclosed, fan cooled.
- C. ECM Type: Comply with requirements in Division 23 Section "Motors."

## 2.3 SOURCE QUALITY CONTROL

- A. Sound-Power Level Ratings: Comply with AMCA 301, "Methods for Calculating Fan Sound Ratings from Laboratory Test Data." Factory test fans according to AMCA 300, "Reverberant Room Method for Sound Testing of Fans." Label fans with the AMCA-Certified Ratings Seal.
- B. Fan Performance Ratings: Establish flow rate, pressure, power, air density, speed of rotation, and efficiency by factory tests and ratings according to AMCA 210, "Laboratory Methods of Testing Fans for Rating."

## 2.4 INSTALLATION

- A. Install power ventilators level and plumb.
- B. Ceiling Units: Suspend units from structure; use steel wire or metal straps.
- C. Support suspended units from structure using threaded steel rods and spring hangers with vertical-limit stops having a static deflection of 1 inch.
- D. Install units with clearances for service and maintenance.
- E. Label units according to requirements specified in Division 23 Section "Identification for HVAC Piping and Equipment."

## 2.5 CONNECTIONS

- A. Duct installation and connection requirements are specified in other Division 23 Sections. Drawings indicate general arrangement of ducts and duct accessories. Make final duct connections with flexible connectors. Flexible connectors are specified in Division 23 Section "Air Duct Accessories."
- B. Install ducts adjacent to power ventilators to allow service and maintenance.
- C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- D. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

## 2.6 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
  - 1. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.
- B. Tests and Inspections:
  - 1. Verify that shipping, blocking, and bracing are removed.
  - 2. Verify that unit is secure on mountings and supporting devices and that connections to ducts and electrical components are complete. Verify that proper thermal-overload protection is installed in motors, starters, and disconnect switches.
  - 3. Verify that cleaning and adjusting are complete.
  - 4. Disconnect fan drive from motor, verify proper motor rotation direction, and verify fan wheel free rotation and smooth bearing operation. Reconnect fan drive system, align and adjust belts, and install belt guards.
  - 5. Adjust belt tension.
  - 6. Adjust damper linkages for proper damper operation.
  - 7. Verify lubrication for bearings and other moving parts.
  - 8. Verify that manual and automatic volume control and fire and smoke dampers in connected ductwork systems are in fully open position.
  - 9. Disable automatic temperature-control operators, energize motor and adjust fan to indicated rpm, and measure and record motor voltage and amperage.
  - 10. Shut unit down and reconnect automatic temperature-control operators.
  - 11. Remove and replace malfunctioning units and retest as specified above.
- C. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
- D. Prepare test and inspection reports.

## 2.7 ADJUSTING

- A. Adjust damper linkages for proper damper operation.
- B. Adjust belt tension.

- C. Comply with requirements in Division 23 Section "Testing, Adjusting, and Balancing for HVAC" for testing, adjusting, and balancing procedures.
- D. Replace fan and motor pulleys as required to achieve design airflow.
- E. Lubricate bearings.

END OF SECTION 233423

## SECTION 235100 - BREECHINGS, CHIMNEYS, AND STACKS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. This Section includes the following:
  - 1. Listed Special Gas vents.

#### 1.3 SUBMITTALS

- A. Product Data: For the following:
  - 1. Special gas vents.
- B. Shop Drawings: For vents, breechings, chimneys, and stacks. Include plans, elevations, sections, details, and attachments to other work.
  - 1. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, methods of field assembly, components, hangers and seismic restraints, and location and size of each field connection.
- C. Warranty: Special warranty specified in this Section.

#### 1.4 QUALITY ASSURANCE

- A. Source Limitations: Obtain listed system components through one source from a single manufacturer.
- B. Certified Sizing Calculations: Manufacturer shall certify venting system sizing calculations.

#### 1.5 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace components of venting system that fail in materials or workmanship within specified warranty period. Failures include, but are not limited to, structural failures caused by expansion and contraction.
  - 1. Warranty Period: 15 years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 LISTED SPECIAL GAS VENTS

- A. Manufacturers: All boiler venting shall be furnished by the boiler manufacturer. Subject to compliance with requirements, provide products by one of the following:
  - 1. Heat-Fab, Inc.
  - 2. Metal-Fab, Inc.
  - 3. Selkirk Inc.; Selkirk Metalbestos and Air Mate.
- B. Description: Double-wall metal vents tested according to UL 1738 and rated for 480 deg F continuously, with positive or negative flue pressure complying with NFPA 211.
- C. Construction: Inner shell and outer jacket separated by at least a 1-inch airspace.
- D. Inner Shell: ASTM A 959, Type 29-4C stainless steel.
- E. Outer Jacket: Stainless steel.
- F. Accessories: Tees, elbows, increasers, draft-hood connectors, terminations, adjustable roof flashings, storm collars, support assemblies, thimbles, firestop spacers, and fasteners; fabricated from similar materials and designs as vent-pipe straight sections; all listed for same assembly.
  - 1. Termination: Stack cap designed to exclude minimum 90 percent of rainfall.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas and conditions for compliance with requirements for installation tolerances and other conditions affecting performance of work.
  - 1. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 APPLICATION

- A. Listed Special Gas Vent: Boiler Vents.

### 3.3 INSTALLATION OF LISTED VENTS AND CHIMNEYS

- A. Locate to comply with minimum clearances from combustibles and minimum termination heights according to product listing or NFPA 211, whichever is most stringent.
- B. Seal between sections of positive-pressure vents and grease exhaust ducts according to manufacturer's written installation instructions, using sealants recommended by manufacturer.

- C. Support vents at intervals recommended by manufacturer to support weight of vents and all accessories, without exceeding appliance loading.
- D. Slope breechings down in direction of appliance, with condensate drain connection at lowest point piped to nearest drain.
- E. Lap joints in direction of flow.
- F. Connect base section to foundation using anchor lugs of size and number recommended by manufacturer.
- G. Join sections with acid-resistant joint cement to provide continuous joint and smooth interior finish.
- H. Erect stacks plumb to finished tolerance of no more than 1 inch out of plumb from top to bottom.

#### 3.4 CLEANING

- A. After completing system installation, including outlet fittings and devices, inspect exposed finish. Remove burrs, dirt, and construction debris and repair damaged finishes.
- B. Clean breechings internally, during and after installation, to remove dust and debris. Clean external surfaces to remove welding slag and mill film. Grind welds smooth and apply touchup finish to match factory or shop finish.
- C. Provide temporary closures at ends of breechings, chimneys, and stacks that are not completed or connected to equipment.

END OF SECTION 235100

## SECTION 235216 – CONDENSING BOILERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section, including General and Supplementary Conditions and Division 01 Specification Sections.

#### 1.2 SUMMARY

- A. This Section includes packaged, factory-fabricated and -assembled, gas-fired, fire-tube condensing boilers, trim and accessories for generating hot water.

#### 1.3 SUBMITTALS

- A. Product Data: Include performance data, operating characteristics, furnished specialties and accessories.
  - 1. Prior to flue vent installation, engineered calculations and drawings must be submitted to Architect/Engineer to thoroughly demonstrate that size and configuration conform to recommended size, length and footprint for each submitted boiler.
- B. Efficiency Curves: At a minimum, submit efficiency curves for 100%, 50%, and 7% input firing rates at incoming water temperatures ranging from 80°F to 160°F.
- C. Pressure Drop Curve. Submit pressure drop curve for flows ranging from 0 GPM to maximum value of boiler
  - 1. If submitted material is different from that of the design basis, boiler manufacture shall incur all costs associated with reselection of necessary pumps. Possible differences include, but are not limited to, the pump type, pump pad size, electrical characteristics and piping changes.
- D. Shop Drawings: For boilers, boiler trim and accessories, include:
  - Plans, elevations, sections, details and attachments to other work
  - Wiring Diagrams for power, signal and control wiring
- E. Source Quality Control Test Reports: Reports shall be included in submittals.
- F. Field Quality Control Test Reports: Reports shall be included in submittals.
- G. Operation and Maintenance Data: Data to be included in boiler emergency, operation and maintenance manuals.
- H. Warranty: Special warranty specified in this Section

I. Other Informational Submittals:

1. ASME Stamp Certification and Report: Submit "A," "S," or "PP" stamp certificate of authorization, as required by authorities having jurisdiction, and document hydrostatic testing of piping external to boiler.

1.4 QUALITY ASSURANCE

- A. Electrical Components, Devices and Accessories: Boilers must be listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. I=B=R Performance Compliance: Condensing boilers must be rated in accordance with applicable federal testing methods and verified by AHRI as capable of achieving the energy efficiency and performance ratings as tested within prescribed tolerances.
- C. ASME Compliance: Condensing boilers must be constructed in accordance with ASME Boiler and Pressure Vessel Code, Section IV "Heating Boilers".
- D. ASHRAE/IESNA 90.1 Compliance: Boilers shall have minimum efficiency according to "Gas and Oil Fired Boilers - Minimum Efficiency Requirements."
- E. DOE Compliance: Minimum efficiency shall comply with 10 CFR 430, Subpart B, Appendix N, "Uniform Test Method for Measuring the Energy Consumption of Furnaces and Boilers."
- F. UL Compliance: Boilers must be tested for compliance with UL 795, "Commercial-Industrial Gas Heating Equipment." Boilers shall be listed and labeled by a testing agency acceptable to authorities having jurisdiction.
- G. NOx Emission Standards: When installed and operated in accordance with manufacturer's instructions, condensing boilers shall comply with the NOx emission standards outlined in South Coast Air Quality Management District (SCAQMD), Rule 1146.1; and the Texas Commission on Environmental Quality (TCEQ), Title 30, Chapter 117, Rule 117.465.

1.5 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases.

1.6 WARRANTY

- A. Standard Warranty: Boilers shall include manufacturer's standard form in which manufacturer agrees to repair or replace components of boilers that fail in materials or workmanship within specified warranty period.
  1. Warranty Period for Fire-Tube Condensing Boilers
    - a. The pressure vessel/heat exchanger shall carry a 10-year from substantial completion, prorated, limited warranty against any failure due to condensate corrosion, thermal stress, mechanical defects or workmanship.
    - b. Manufacturer labeled control panels are conditionally warranted against failure for (2) two years from substantial completion.

- c. All other components, with the exception of the igniter and flame detector, are conditionally guaranteed against any failure for 2 years from substantial completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Basis-of-Design Product: Subject to compliance with requirements, provide AERCO International, Benchmark 2000 or a comparable product by one of the following:
  1. Fulton
  2. Viessmann Manufacturing Co. (US) Inc.
- B. Other comparable products by the other manufacturers listed above if submitted other than the basis of design product must meet or exceed all performance and capacity criteria of the basis of design product. This will be reviewed in detail by Engineer during the submittal process.

### 2.2 CONSTRUCTION

- A. Description: Boiler shall be natural gas fired, fully condensing, fire tube design. Power burner shall have full modulation (the minimum firing rate shall not exceed 100,000 BTU/HR input. Boilers that have an input greater than 100,000 BTU/Hr at minimum fire will not be considered) and discharge into a positive pressure vent. Boiler efficiency shall increase with decreasing load (output), while maintaining setpoint. Boiler shall be factory-fabricated, factory-assembled and factory-tested, fire-tube condensing boiler with heat exchanger sealed pressure-tight, built on a steel base, including insulated jacket, flue-gas vent, combustion-air intake connections, water supply, return and condensate drain connections, and controls.
- B. Heat Exchanger: The heat exchanger shall be constructed of 439 stainless steel fire tubes and tubesheets, with a one-pass combustion gas flow design. The fire tubes shall be 5/8" OD, with no less than 0.049" wall thickness. The upper and lower stainless steel tubesheet shall be no less than 0.25" thick. The pressure vessel/heat exchanger shall be welded construction. The heat exchanger shall be ASME stamped for a working pressure not less than 150 psig. Access to the tubesheets and heat exchanger shall be available by burner and exhaust manifold removal. Minimum access opening shall be no less than 10-inch diameter.
- C. Pressure Vessel: The pressure vessel shall have a maximum water volume of 40 gallons. The boiler water pressure drop shall not exceed 3 psig at 170 gpm. The boiler water connections shall be 4-inch flanged 150-pound, ANSI rated. The pressure vessel shall be constructed of SA53 carbon steel, with a 0.25-inch thick wall and 0.50-inch thick upper head. Inspection openings in the pressure vessel shall be in accordance with ASME Section IV pressure vessel code. The boiler shall be designed so that the thermal efficiency increases as the boiler firing rate decreases.
- D. Modulating Air/Fuel Valve and Burner: The boiler burner shall be capable of a 20-to-1 turndown ratio of the firing rate without loss of combustion efficiency or staging of gas valves. The burner shall produce less than 20 ppm of NO<sub>x</sub> corrected to 3% excess oxygen. The burner shall be metal-fiber mesh covering a stainless-steel body with spark ignition and flame rectification. All burner material exposed to the combustion zone shall be of stainless-steel construction. There shall be no moving parts within the burner itself. A modulating air/fuel valve shall meter the air and fuel input. The modulating motor must be linked to both the gas valve body and air valve

body with a single linkage. The linkage shall not require any field adjustment. A variable frequency drive (VFD), controlled cast aluminum pre-mix blower shall be used to ensure the optimum mixing of air and fuel between the air/fuel valve and the burner.

- E. Minimum boiler efficiencies shall be as follows at a 20 degree delta-T:

<b>EWT</b>	<b>100% Fire</b>	<b>50% Fire</b>	<b>7% Fire</b>
160 °F	87%	87%	87%
140 °F	87%	88%	88%
120 °F	89%	89%	90%
100 °F	93%	95%	95%
80 °F	96%	97%	98%

- F. Exhaust Manifold: The exhaust manifold shall be of corrosion resistant cast aluminum or 316 stainless steel with an 12-inch diameter flue connection. The exhaust manifold shall have a collecting reservoir and a gravity drain for the elimination of condensation.
- G. Blower: The boiler shall include a variable-speed, DC centrifugal fan to operate during the burner firing sequence and pre-purge the combustion chamber.
1. Motors: Blower motors shall comply with requirements specified in Division 23 Section "Common Motor Requirements for HVAC Equipment."
    - a. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require a motor to operate in the service factor range above 1.0.
- H. Ignition: Ignition shall be via spark ignition with 100 percent main-valve shutoff and electronic flame supervision.
- I. The boiler's manufacturer recommended annual replacement parts shall cost no more than \$200 to the end customer.
- J. The boiler shall be designed such that the combustion air is drawn from the inside of the boiler enclosure, decoupling it from the combustion air supply and preheating the air to increase efficiency.
- K. Enclosure: The sheet metal enclosure shall be fully removable, allowing for easy access during servicing.
- L. O2 sensor located in the Combustion Chamber: The boiler shall be equipped with an Oxygen sensor. The sensor shall be located in the boiler combustion chamber. Boilers without Oxygen sensor or boilers with an Oxygen sensor in the exhaust shall not be acceptable due to measurement estimation and performance accuracy.

## 2.3 CONTROLS

- A. The boiler shall have an integrated boiler control that is capable of operating the boiler and associated accessories including but not limited to: its pumps, valves and dampers.
1. The control shall have a 5 inch color touch screen display as well as six function buttons that are separate from the display. User shall have the ability to navigate the menus via touchscreen or navigation buttons. Controls not equipped with navigation button options shall not be permitted.
  2. The control shall be equipped with a multi-color linear LED light to indicate the level of firing and/or air/fuel valve position.
  3. The control shall display two temperatures using two dedicated three-digit seven-segment displays.
  4. The control shall offer an Enable/Disable toggle switch as well as two buttons for Testing and Resetting the Low Water Cutoff.
- B. The Manager designated boiler control shall be capable of the following functions without the need for additional external controls:
1. Sequence up to 16 boilers,
  2. Control boiler variable speed or single speed pumps and/or modulating motorized valves,
  3. Operate or modulate a variable or single speed system pump or rotate two system pumps,
  4. Control and communicate with up to 6 SmartPlate domestic water heaters and their domestic hot water pump,
  5. The control shall connect to other plant boiler controls using RS485 and communicate using Modbus protocol.
  6. The control system shall be segregated into three components: "Edge [ij]" Control Panel, Power Panel and Input/Output Connection Box. The entire system shall be Underwriters Laboratories recognized.
- C. The control panel shall consist of seven individual circuit boards using surface-mount technology in a single enclosure. Each board shall be individually field replaceable. These circuit boards shall include:
- D. A microcontroller board with integrated 5 inch touchscreen color display providing the user interface.
1. A 7-segment display board. This board includes two 3-digit 7-segment displays. These displays shall be used to view a variety of temperature sensor values and operating and startup function status.
  2. An Interface board connects the microcontroller board to internal components using ribbon cables.
  3. An electric low-water cutoff board connects to the test and manual reset functions on the microcontroller board.
  4. A power supply board is designed to provide the different DC voltages to the rest of the boards. It also acts as voltage regulator and reduce power noise.
  5. An ignition and combustion board. This board controls the air/fuel valve and Safety Shutoff Valve, flame status and ignition transformer
  6. A connector board used to connect all external electrical connection.
- E. Combination plant: The managing boiler control shall be capable of setting and managing a combination plant that consist of up to two groups of boilers, their swing boilers and swing valves. The control shall be capable of performing all the listed features without the need for any additional controls. The use of additional controls to achieve any of these functionalities shall be prohibited to simplify installation and plant management. The combination plant control shall have the following capabilities:

1. The control shall operate one group of boilers for heating and another group of boilers for domestic hot water using plate heat exchangers or indirect tanks.
  2. The control shall manage and rotate the lead boiler in each of the two groups independent of the other group.
  3. The control shall be capable of managing one or two swing boilers and their motorized swing valves to direct the output of the swing boiler(s) to one of the two groups based on the plant priority settings. The control shall also connect to the header and return sensors for each of the two groups of boilers and use those values to manage the set point for each group.
  4. The control shall offer two independent logics that run simultaneously managing each group of boilers. Each boiler group logic shall have its temperature values, setpoints, PID and feedback parameters that is independent of the other group settings and parameters.
- F. System Pump lead/lag rotation: The control shall be capable of operating two system pumps. It shall rotate the lead pump based on user time setting. The use of an external pump lead-lag control shall not be permitted unless function is performed by building management system.
- G. Variable Speed Pump: The control shall be capable of modulating a variable speed pump. It shall modulate the pump based on the boiler firing rate, the boiler plant firing rate, or based on the return header temperature differential from supply water temperature on a primary secondary piping application.
- H. Minimum number of boiler plant open valves: The control shall manage the minimum number of boiler motorized valves to reduce variable speed pump flow and energy used. The control shall offer a setting to control the number of valves open during low load and standby operation. Manufacturers without this feature shall offer additional pump controller and a smaller single speed pump to run during the low load and standby periods.
- I. Control settings transfer using USB: The control shall simplify and significantly lessen startup and boiler setting time by being able to use a USB flash drive to copy settings from one boiler to another boiler. Installers shall use successfully preconfigured boiler settings in their portfolio to newly installed boilers.
- J. Combustion calibration: The control shall offer at least 5 calibration points. The use of less than 5 calibration points is not permitted to improve overall system efficiency under all firing rates. Each combustion calibration point shall operate with 5 to 7% O<sub>2</sub> levels to improve operating efficiency. Deviating away from these values shall not be acceptable.
- K. Assisted Combustion Calibration: The control shall offer an assisted combustion calibration feature to help reduce setup time and improve setup accuracy. The assisted combustion calibration shall adjust the O<sub>2</sub> level at each calibration point to help keep O<sub>2</sub> level within allowable efficiency. The control shall log, date and time stamp the calibrated point combustion values of O<sub>2</sub> and allow the user to log NO<sub>x</sub>, CO and flame strength. The control shall check these values against manufacturer allowable combustion values and color identify values out of manufacturer acceptable ranges. As an additional capability, the control shall also have the ability to perform manual combustion calibration. Not having Assisted Combustion Calibration function shall be prohibited.
- L. Valve Balancing: To help simplify installation and as part of a boiler plant, the control shall be capable of controlling an electronic modulating motorized valve for each of the boilers using the manager boiler control. It shall have a built-in logic to provide a maximum flow using an adjustable valve opening percentage point for each boiler. The control shall be capable of closing any valve that has an off boiler. If all boilers are off, the control shall keep at minimum one valve open to protect pumps.

- M. Building Automation: The control shall be able to communicate to Building Management Systems using BACnet and Modbus without the use of external gateways. The control shall be able to communicate over each of the two protocols using IP as well as RS485. The use of external gateways is not acceptable. The control shall be able to communicate to the building management system using:
1. BACnet MS/TP and BACnet IP/Ethernet. When communicating over BACnet IP, the control shall offer an additional layer of IP security by mapping all control BACnet IP communication to the BACnet server's IP and MAC addresses. Not having this level of security shall deem the IP communication insecure and shall not be acceptable.
  2. Modbus RTU and Modbus IP.
- N. Unit and Plant Status: The control shall provide a quick view of the unit status and plant status.
1. The unit status screen shall provide temperature setpoint, all water inlet and outlet and supply air and exhaust temperature sensors' values. It shall also provide unit current and target firing rates. Additional screens shall display unit run hours, cycle count and average cycles per hour.
  2. The plant status screens shall provide plant temperature setpoint, plant water supply and return temperatures, outdoor temperature and domestic hot water setpoint and current temperatures. Additionally, a status screen shall show the boiler status of each plant unit, plant firing rate.
  3. Unit and Plant event history: The manager control shall display the last 500 historical events per plant or 200 historical events for single unit installations.
- O. Software update: The control shall be capable of field software updates without a need for hardware component(s) replacement. This shall be performed either using software on a USB flash drive or via Internet connection. The software update mechanism shall be performed by a trained technician. The software update menus shall be secured using a password level. After the software update, the control shall retain all of its prior field settings.
- P. Copy settings from one boiler to the other: To significantly reduce installation time by reducing long repetitive work, the control shall have the capability of saving its settings to a USB flash drive. In addition, the control shall have the ability of copying new settings from a flash drive.
- Q. Programmable Inputs and Outputs: The control shall be equipped with multiple relay and analog outputs and dry contact and analog inputs. Each shall be field programmable to meet installation needs. The following I/O options shall be available:
1. Relay outputs: There shall be two output relays that are programmable. The following relay functions shall be selectable:
    - a. Swing Valve 2
    - b. System Pump
    - c. Summer Pump
    - d. Multi-temperature pump
    - e. Pump2
    - f. Louver
  2. Inputs and interlocks: The following control functions shall be available:
    - a. Flow input
    - b. Damper end switch input
    - c. Louver end switch input
  3. Analog output: There shall be three analog outputs that are programmable. The control shall have configurable analog outputs that can be used as one of the following options:
    - a. Boiler pump
    - b. Domestic hot water variable speed pump
    - c. Valve
    - d. Fire rate

4. Analog input: There shall be three analog inputs that are programmable. The control shall have configurable analog inputs that can be used as one of the following options:
  - a. Remote setpoint
  - b. Smart Plate valve position
  - c. Domestic hot water variable speed pump flow
  
- R. Backup boiler: The control shall be able to operate a lower efficiency back up boiler during peak periods when main plant boilers are at or close to peak load.
  
- S. Communication with SmartPlate: The control shall be capable of controlling and monitoring one or multiple plate heat exchanger(s). It shall be able to:
  1. Change the domestic hot water temperature setpoint and read its current temperatures.
  2. Monitor 3-way valve position.
  3. Control the operation of the domestic hot water pump.
  
- T. The controls shall annunciate boiler and sensor status and include extensive self-diagnostic capabilities.
  
- U. The control panel shall incorporate:
  1. Setpoint High Limit: Setpoint high limit allows for a selectable maximum boiler outlet temperature and acts as temperature limiting governor. Setpoint limit is based on a PID function that automatically limits firing rate to maintain outlet temperature within a 0 to 10 degree selectable band from the desired maximum boiler outlet temperature.
  2. Setpoint Low Limit: Allow for a selectable minimum operating temperature.
  3. Failsafe Mode: Failsafe mode allows the boiler to switch its mode to operate from an internal setpoint if its external control signal is lost, rather than shut off. This is a selectable mode, enabling the control can to shut off the unit upon loss of external signal, if so desired.
  
- V. The boiler control system shall incorporate the following additional features for enhanced external system interface:
  1. System start temperature feature
  2. Pump delay timer
  3. Auxiliary start delay timer
  4. Auxiliary temperature sensor
  5. Analog output feature to enable simple monitoring of temperature setpoint, outlet temperature or fire rate
  6. Remote interlock circuit
  7. Delayed interlock circuit
  8. Easy Setup by providing simplified menu quick settings to expedite plant and boiler setup
  9. Delta-T Limiter
  10. Freeze protection
  11. Fault relay for remote fault alarm
  12. Warm-weather shutdown
  13. The control shall offer multi-level user security access using different passwords. For additional security, the passwords shall expire if control display was not touched for an extended period 30 minutes.
  
- W. Each boiler shall include an electric, single-seated combination safety shutoff valve/regulator with proof of closure switch in its gas train. Each boiler shall incorporate dual over-temperature protection with manual reset, in accordance with ASME Section IV and CSD 1.
  
- X. O<sub>2</sub>-Trim or AERtrim: Each boiler shall be equipped with the patented AERtrim system, an advanced O<sub>2</sub>-trim system for condensing boiler applications. The system shall utilize a low cost reliable automotive O<sub>2</sub> sensor that measures and monitors the oxygen content of the exhaust

gases. The system shall adjust the blower speed to maintain optimal air-fuel ratios in the event of any site condition changes (air density, gas pressure, BTU content, etc.). The system shall have the following capabilities:

1. Self-Diagnostics
    - a. System Status and Error Messages
    - b. When excessive trimming is occurring
    - c. When O<sub>2</sub> sensor has fallen out of calibration
  2. Adjustable parameter settings
    - a. O<sub>2</sub> target and range to meet site requirements
    - b. Schedule daily or weekly self-diagnostics
  3. Output of O<sub>2</sub> information shall be displayed on the Edge [ii] control panel.
  4. The O<sub>2</sub> sensor shall be installed through the unit's burner plate and measure the oxygen content directly within the unit's combustion chamber.
  5. Boilers without an equivalent O<sub>2</sub> trim will be deemed unacceptable. Due to the moisture content of flue gases from condensing boilers, placing the O<sub>2</sub> sensor in the exhaust manifold or stack will be deemed unacceptable.
  6. Boilers which require their O<sub>2</sub> sensor be changed annually will be deemed unacceptable.
- Y. Each boiler shall be onAER ready with a standard Ethernet port and include a 5 year onAER subscription at no additional charge. AERCO's onAER service grants the user online access to real time operation and status of their system plant from any computer, tablet or mobile device along with the following capabilities:
1. Efficiency status and trends
  2. O<sub>2</sub> levels
  3. Efficiency and performance optimization tips
  4. Preventative Maintenance alerts and scheduling
  5. Predictive Maintenance algorithms.
  6. Warning and error messages
  7. Weekly or monthly performance and status reports
  8. Manage multiple boiler plants or buildings
  9. Customizable dashboard
  10. Add email contacts for alerts and reports, including local AERCO trained technicians
  11. Manage and store startup, maintenance and service documentation
  12. The boiler manufacturer shall be able to provide a network hub or a network switch to connect up 16 boilers to an online network.
- Z. Each boiler shall have integrated Boiler Sequencing Technology (BST), capable of multi-unit sequencing with lead-lag functionality and parallel operation. The system will incorporate the following capabilities:
1. Efficiently sequence 2-to-16 units on the same system to meet load requirement.
  2. Integrated control and wiring for seamless installation of optional modulating motorized valve. When valves are utilized, the system shall operate one motorized valve per unit as an element of load sequencing. Valves shall close with decreased load as units turn off, with all valves open under no-load conditions.
  3. Automatically rotate lead/lag amongst the units on the chain and monitor run hours per unit and balance load in an effort to equalize run hours among active units.
  4. Option to manually designate lead and last boiler
  5. Designated manager control, used to display and adjust key system parameters.
  6. Automatic bump-less transfer of master function to next unit on the chain in case of designated master unit failure; master/slave status shall be shown on the individual unit displays.
- AA. For boiler plants greater than 16 units, the Boiler Manufacturer shall supply as part of the boiler package a completely integrated AERCO Control System (ACS) to control all operation and energy input of the multiple boiler heating plant. The ACS shall be comprised of a

microprocessor based control utilizing the MODBUS protocol to communicate with the Boilers via the RS-485 port. One ACS controller shall have the ability to operate up to 32 AERCO boilers.

1. The controller shall have the ability to vary the firing rate and energy input of each individual boiler throughout its full modulating range to maximize the condensing capability and thermal efficiency output of the entire heating plant. The ACS shall control the boiler outlet header temperature within +2°F. The controller shall be a PID type controller and uses Ramp Up/Ramp Down control algorithm for accurate temperature control with excellent variable load response. The ACS controller shall provide contact closure for auxiliary equipment such as system pumps and combustion air inlet dampers based upon outdoor air temperature.
2. The ACS shall have the following anti-cycling features:
  - a. Manual designation of lead boiler and last boiler.
  - b. Lead boiler rotation at user-specified time interval.
  - c. Delay the firing/shutting down of boilers when header temperature within a predefined dead band.
3. When set on Internal Setpoint Mode, temperature control setpoint on the ACS shall be fully field adjustable from 50°F to 190°F in operation. When set on Indoor/Outdoor Reset Mode, the ACS will operate on an adjustable inverse ratio in response to outdoor temperature to control the main header temperature. Reset ratio shall be fully field adjustable from 0.3 to 3.0 in operation. When set on 4ma to 20ma Temperature Control Mode, the ACS will operate the plant to vary header temperature setpoint linearly as an externally applied 4-20 ma signal is supplied.
4. When set on MODBUS Temperature Control Mode, the ACS will operate the plant to vary header temperature setpoint as an external communication utilizing the MODBUS protocol is supplied via the RS-232 port. The ACS controller shall have a vacuum fluorescent display for monitoring of all sensors and interlocks. Non-volatile memory backup of all control parameters shall be internally provided as standard. The controller will automatically balance the sequence of operating time on each boiler by a first-on first-off mode and provide for setback and remote alarm contacts. Connection between central ACS system and individual boilers shall be twisted pair low voltage wiring, with the boilers 'daisy-chained' for ease of installation.

## 2.4 ELECTRICAL POWER

- A. Controllers, Electrical Devices and Wiring: Electrical devices and connections are specified in Division 26 sections.
- B. Single-Point Field Power Connection: Factory-installed and factory-wired switches, motor controllers, transformers and other electrical devices shall provide a single-point field power connection to the boiler.

## 2.5 VENTING

- A. The exhaust vent must be UL Listed for use with Category IV appliances and compatible with operating temperatures up to 230°F, condensing flue gas service. UL-listed vents of AI 29-4C stainless steel must be used with boilers as specified in Division 23 "Breechings, Chimneys and Stacks."
- B. The minimum exhaust vent duct size for each boiler is 8-inch diameter.
- C. Combustion-Air Intake: Boilers shall be capable of drawing combustion air from the outdoors via a Schedule 40 PVC duct connected between the boiler and the outdoors.

- D. The minimum sealed combustion air duct size for each boiler is 8-inch diameter.
- E. Follow guidelines specified in manufacturer's venting guide.

## 2.6 SOURCE QUALITY CONTROL

- A. Burner and Hydrostatic Test: Factory adjust burner to eliminate excess oxygen, carbon dioxide, oxides of nitrogen emissions and carbon monoxide in flue gas, and to achieve combustion efficiency. Perform hydrostatic testing.
- B. Test and inspect factory-assembled boilers, before shipping, according to ASME Boiler and Pressure Vessel Code.
  - 1. If boilers are not factory assembled and fire-tested, the local vendor is responsible for all field assembly and testing.
- C. Allow Owner access to source quality-control testing of boilers. Notify Architect fourteen days in advance of testing.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Before boiler installation examine roughing-in for concrete equipment bases, anchor-bolt sizes and locations and piping and electrical connections to verify actual locations, sizes and other conditions affecting boiler performance, maintenance and operations.
  - 1. Final boiler locations indicated on Drawings are approximate. Determine exact locations before roughing-in for piping and electrical connections.
- B. Examine mechanical spaces for suitable conditions where boilers will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 BOILER INSTALLATION

- A. Install boilers level on concrete bases. Concrete base is specified in Division 23 Section "Common Work Results for HVAC."
- B. Install gas-fired boilers according to NFPA 54.
- C. Assemble and install boiler trim.
- D. Install electrical devices furnished with boiler but not specified to be factory mounted.
- E. Install control wiring to field-mounted electrical devices.

### 3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 23 sections. Drawings indicate general arrangement of piping, fittings and specialties.
- B. Install piping adjacent to boiler to permit service and maintenance.
- C. Install piping from equipment drain connection to nearest floor drain. Piping shall be at least full size of connection. Provide an isolation valve if required.
- D. Connect gas piping to boiler gas-train inlet with unions. Piping shall be at least full size of gas train connection. Provide a reducer if required.
- E. Connect hot-water piping to supply and return boiler tapplings with shutoff valve and union or flange at each connection.
- F. Install piping from safety relief valves to nearest floor drain.
- G. Boiler Venting
  - 1. Install flue venting kit and combustion-air intake.
  - 2. Connect venting full size to boiler connections. Comply with requirements in Division 23 Section "Breechings, Chimneys and Stacks."
- H. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- I. Connect wiring according to Division 26 Section "Electrical Power Conductors and Cables."

### 3.4 CONCRETE BASES

- A. Install concrete bases of dimensions indicated and/or required for boilers.
  - 1. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around full perimeter of base.
  - 2. For supported equipment, install epoxy-coated anchor bolts that extend through concrete base and anchor into structural concrete floor.
  - 3. Place and secure anchorage devices. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
  - 4. Install anchor bolts to elevations required for proper attachment to supported equipment.

### 3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
  - 1. Manufacturer's Field Service: Engage a factory-authorized and factory-employed service representative to inspect components, assemblies and equipment installations, including connections, and to assist in testing.
- B. Tests and Inspections
  - 1. Perform installation and startup checks according to manufacturer's written instructions.

2. Perform hydrostatic test. Repair leaks and retest until no leaks exist.
3. Start units to confirm proper motor rotation and unit operation. Adjust air-fuel ratio and combustion.
4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
  - a. Check and adjust initial operating set points and high- and low-limit safety set points of fuel supply, water level and water temperature.
  - b. Set field-adjustable switches and circuit-breaker trip ranges as indicated.
- C. Remove and replace malfunctioning units and retest as specified above.
- D. Occupancy Adjustments: When requested within 2 months of date of Substantial Completion, provide on-site assistance adjusting system to suit actual occupied conditions. Provide up to two visits to Project during other than normal occupancy hours for this purpose.
- E. Performance Tests:

The boiler manufacturer is expected to provide partial load thermal efficiency curves. These thermal efficiency curves must include at least three separate curves at various BTU input levels. If these curves are not available, it is the responsibility of the boiler manufacturer to complete the following performance tests:

1. Engage a factory-authorized and factory-employed service representative to inspect component assemblies and equipment installations, including connections, and to conduct performance testing.
2. Boilers shall comply with performance requirements indicated, as determined by field performance tests. Adjust, modify, or replace equipment to comply.
3. Perform field performance tests to determine capacity and efficiency of boilers.
  - a. Test for full capacity.
  - b. Test for boiler efficiency at [low fire 20, 40, 60, 80, 100, 80, 60, 40 and 20] percent of full capacity. Determine efficiency at each test point.
4. Repeat tests until results comply with requirements indicated.
5. Provide analysis equipment required to determine performance.
6. Provide temporary equipment and system modifications necessary to dissipate the heat produced during tests if building systems are not adequate.
7. Notify Architect in advance of test dates.
8. Document test results in a report and submit to Architect.

### 3.5 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain boilers at time of start-up.

3.6 START-UP AND SUPERVISION:

- A. The boiler management panel/system and boilers as here-in-before described shall be supplied and installed under the continuous supervision of a qualified specialist regularly employed in this capacity by the manufacturer factory representative. The contractor shall allow in his bid not less than two (2) days per boiler of service time for inspection during construction, start-up time, programming and testing by the manufacturer's authorized service representative. Due to safety of operation only the local factory authorized manufacturer shall start up the boiler.

3.7 CONTROL WIRING:

The contractor shall provide and install all control wiring from the central control center to the field components as required. All wiring shall be in accordance with local and national electrical codes. All wiring shall be in aluminum conduit.

3.8 MECHANICAL WORK:

Any mechanical or piping work required to accomplish installation of field devices shall be provided by the contractor as a requirement of this contract. All work shall be accomplished in accordance with local codes and requirements and executed by individuals certified to perform the work.

3.9 POWER WIRING:

All power wiring required to complete the installation and provide for a fully operational system shall be provided by the EC for this project. All work shall be accomplished in accordance with local codes and requirements and executed by individuals certified to perform the work.

END OF SECTION 235216

## SECTION 235218 – WALL MOUNTED CONDENSING BOILERS

### PART 1 – GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract apply to this Section, including General and Supplementary Conditions and Division 01 Specification Sections.

#### 1.2 SUMMARY

- A. Packaged, modulating, sealed combustion, power-vented, high efficiency gas-fired boiler(s) with stainless steel fire-tube heat exchangers that use outside air for combustion (direct vent).
- B. Furnish and install a combustion management system to regulate, fire, control, and monitor the boilers. All hardware, software, sensing and accessory control devices shall be provided as required to accomplish the Sequence of Operation and Point List included in this section of the specification whether or not listed specifically elsewhere in this or other sections of the specification.
- C. The system shall be designed and fabricated to allow for control of a multiple condensing boilers as part of this project.

#### 1.3 SUBMITTALS

- A. Product Data: Include performance data, operating characteristics, furnished specialties and accessories.
  - 1. Prior to flue vent installation, engineered calculations and drawings must be submitted to Architect/Engineer to thoroughly demonstrate that size and configuration conform to recommended size, length and footprint for each submitted boiler.
- B. Efficiency Curves: At a minimum, submit efficiency curves for 100%, 50%, and 20% input firing rates at incoming water temperatures ranging from 80°F to 160°F.
- C. Pressure Drop Curve. Submit pressure drop curve for flows ranging from 0 GPM to maximum value of boiler
  - 1. If submitted material is different from that of the design basis, boiler manufacture shall incur all costs associated with reselection of necessary pumps. Possible differences include, but are not limited to, the pump type, pump pad size, electrical characteristics and piping changes.
- D. Shop Drawings: For boilers, boiler trim and accessories, include:
  - Plans, elevations, sections, details and attachments to other work

#### Wiring Diagrams for power, signal and control wiring

- E. Source Quality Control Test Reports: Reports shall be included in submittals.
- F. Field Quality Control Test Reports: Reports shall be included in submittals.
- G. Operation and Maintenance Data: Data to be included in boiler emergency, operation and maintenance manuals.
- H. Warranty: Special warranty specified in this Section
- I. Other Informational Submittals:
  - 1. ASME Stamp Certification and Report: Submit "A," "S," or "PP" stamp certificate of authorization, as required by authorities having jurisdiction, and document hydrostatic testing of piping external to boiler.

#### 1.4 QUALITY ASSURANCE

- A. Electrical Components, Devices and Accessories: Boilers must be listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. I=B=R Performance Compliance: Condensing boilers must be rated in accordance with applicable federal testing methods and verified by AHRI as capable of achieving the energy efficiency and performance ratings as tested within prescribed tolerances.
- C. ASME Compliance: Condensing boilers must be constructed in accordance with ASME Boiler and Pressure Vessel Code, Section IV "Heating Boilers".
- D. ASHRAE/IESNA 90.1 Compliance: Boilers shall have minimum efficiency according to "Gas and Oil Fired Boilers - Minimum Efficiency Requirements."
- E. DOE Compliance: Minimum efficiency shall comply with 10 CFR 430, Subpart B, Appendix N, "Uniform Test Method for Measuring the Energy Consumption of Furnaces and Boilers."
- F. UL Compliance: Boilers must be tested for compliance with UL 795, "Commercial-Industrial Gas Heating Equipment." Boilers shall be listed and labeled by a testing agency acceptable to authorities having jurisdiction.
- G. NOx Emission Standards: Boiler(s) shall have an independent laboratory rating of < 20 PPM for Oxides of Nitrogen (NOx) to meet the requirements of South Coast Air Quality Management District in Southern California and the requirements of Texas Commission on Environmental Quality.

#### 1.5 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases.

## 1.6 WARRANTY

- A. Standard Warranty: Boilers shall include manufacturer's standard form in which manufacturer agrees to repair or replace components of boilers that fail in materials or workmanship within specified warranty period.
1. Warranty Period for Fire Tube Condensing Boilers

The pressure vessel/heat exchanger shall carry a 10-years from substantial completion, prorated, limited warranty against any failure due to condensate corrosion, thermal stress, mechanical defects or workmanship.

All other parts are conditionally warranted against failure for one year from substantial completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
1. Weil Mclain
  2. Buderus
  3. Aerco

### 2.2 CONSTRUCTION

- A. Boiler(s) heat exchanger:
1. Fire-tube stainless steel heat exchanger.
  2. The boiler must have non-metallic condensate collector to capture condensate from both, the vent system and heat exchanger.
  3. Factory Assembled and Tested.
  4. Boiler(s) main components: The combustion chamber will be sealed and located at the top which will be of counter flow design to assure that sediment and any lime that might form will fall to the bottom away from the crown sheet area.
  5. Boiler(s) shall be supplied with a gas valve designed with negative pressure regulation (fan venturi effect "pulls" gas through valve rather than gas pressure "pushing" gas through valve). Negative pressure regulation enables the boiler to operate in a safe condition at 3.5" W.C. inlet gas pressure. The inlet natural gas pressure to the boiler gas valve should be a minimum of 3.5" W.C. and a maximum of 14" W.C. If inlet gas pressure exceeds 13" W.C., a 100% lock-up type gas pressure regulator of adequate size must be installed in gas supply piping and adjusted to prevent pressure in excess of 13" W.C.
  6. The burner shall be premix combustion type, made with stainless steel and a woven metal fiber outer covering to provide a wide range of modulating firing rates.
  7. The boiler shall be equipped with a variable speed blower system capable of modulating the boiler firing rate.
  8. The boiler shall be equipped with a device capable of controlling the air/fuel ratio through a 10 to 1 turndown ratio.
  9. The control system shall have an electronic display for boiler set-up, boiler status, and boiler diagnostics.
- A. Venting and Combustion Air

1. Boiler(s) must be capable of using outside air piped directly to boiler for combustion. Inlet and termination of these pipes must be connected to either through-the-roof or sidewall terminations as recommended by the manufacturer.
  2. Internal vent pipe must be non-metallic.
  3. The boiler shall be direct vent using Polypropylene for exhaust and PVC for combustion air intake.
- B. Boiler Trim
1. All electrical components to be of a high quality.
  2. Water boiler(s) controls furnished:
    - a. High limit temperature control with manual reset (190 degrees F maximum allowable boiler water temperature).
    - a. Combination pressure-temperature gauge. Gauge dial clearly marked and easy to read.
    - b. ASME certified pressure relief valve set to relieve at 80 PSIG maximum.
    - c. Flue gas, outlet water temperature, and return water temperature sensors.
    - d. Low water protection with manual reset.
    - e. Built-in freeze protection.
  3. Boiler Control to be UL 353 Listed with:
    - a. Built-in MODBUS communication.
    - b. 4 circulator contacts.
    - c. Auxiliary input/output capability.
    - d. Variable temperature zones that require no mixing valves.
    - e. 3 thermostat inputs.
    - f. Outdoor reset for each priority.
    - g. Zone and priority based setup options.
    - h. 2 Network and 2 local priorities available on each cascaded boiler.
    - i. Flue gas, outlet water temperature, and return water temperature sensors.
    - j. LCD display and 5 button interface.
    - k. Alarm contact that triggers during manual lockout, flame failure, high temperature limit and low water cut off.
    - l. Remote modulation capable of interfacing with Building Automation Systems and Multiple Boiler Systems.
    - m. Ability to control additional heat demand.
- C. Boiler Manuals
1. The boiler(s) shall be provided with complete instruction manuals, including:
    - (a) Boiler Installation Manual.
    - (b) User's Manual.

## 2.1 MOTORS

- A. Refer to Division 23 Section "Motors" for factory-installed motors.

- B. Boiler Blower Motor: Blower motor shall be externally mounted for ease of service. There shall be no requirement to remove covers or gas train components to remove the blower motor.

## 2.2 SOURCE QUALITY CONTROL

- A. Test and inspect boilers according to the ASME Boiler and Pressure Vessel Code, Section IV. Boilers shall be test fired in the factory with a report attached permanently to the exterior cabinet of the boiler for field reference.

## 2.3 ELECTRICAL POWER

- B. Controllers, Electrical Devices and Wiring: Electrical devices and connections are specified in Division 26 sections.
- C. Single-Point Field Power Connection: Factory-installed and factory-wired switches, motor controllers, transformers and other electrical devices shall provide a single-point field power connection to the boiler.

## 2.4 SOURCE QUALITY CONTROL

- A. Burner and Hydrostatic Test: Factory adjust burner to eliminate excess oxygen, carbon dioxide, oxides of nitrogen emissions and carbon monoxide in flue gas, and to achieve combustion efficiency. Perform hydrostatic testing.
- B. Test and inspect factory-assembled boilers, before shipping, according to ASME Boiler and Pressure Vessel Code.
  - 1. If boilers are not factory assembled and fire-tested, the local vendor is responsible for all field assembly and testing.
- C. Allow Owner access to source quality-control testing of boilers. Notify Architect fourteen days in advance of testing.

# PART 3 - EXECUTION

## 3.1 EXAMINATION

- A. Before boiler installation examine roughing-in for concrete equipment bases, anchor-bolt sizes and locations and piping and electrical connections to verify actual locations, sizes and other conditions affecting boiler performance, maintenance and operations.
  - 1. Final boiler locations indicated on Drawings are approximate. Determine exact locations before roughing-in for piping and electrical connections.
- B. Examine mechanical spaces for suitable conditions where boilers will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

## 3.2 BOILER INSTALLATION

- A. Install boilers level on concrete bases. Concrete base is specified in Division 23 Section "Common Work Results for HVAC."

- B. Install gas-fired boilers according to NFPA 54.
- C. Assemble and install boiler trim.
- D. Install electrical devices furnished with boiler but not specified to be factory mounted.
- E. Install control wiring to field-mounted electrical devices.

### 3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 23 sections. Drawings indicate general arrangement of piping, fittings and specialties.
- B. Install piping adjacent to boiler to permit service and maintenance.
- C. Install piping from equipment drain connection to nearest floor drain. Piping shall be at least full size of connection. Provide an isolation valve if required.
- D. Connect gas piping to boiler gas-train inlet with unions. Piping shall be at least full size of gas train connection. Provide a reducer if required.
- E. Connect hot-water piping to supply and return boiler tapplings with shutoff valve and union or flange at each connection.
- F. Install piping from safety relief valves to nearest floor drain.
- G. Boiler Venting
  - 1. Install flue venting kit and combustion-air intake.
  - 2. Connect venting full size to boiler connections with Schedule 40 CPVC flue and Schedule 40 PVC intake piping per contract drawings.
- H. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- I. Connect wiring according to Division 26 Section "Electrical Power Conductors and Cables."

### 3.4 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
  - 1. Manufacturer's Field Service: Engage a factory-authorized and factory-employed service representative to inspect components, assemblies and equipment installations, including connections, and to assist in testing.
- B. Tests and Inspections:
  - 1. Perform installation and startup checks according to manufacturer's written instructions.
  - 2. Leak Test: Hydrostatic test. Repair leaks and retest until no leaks exist.
  - 3. Operational Test: Start units to confirm proper motor rotation and unit operation. Adjust air-fuel ratio and combustion.

4. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
  - a. Check and adjust initial operating set points and high- and low-limit safety set points of fuel supply, water level, and water temperature.
  - b. Set field-adjustable switches and circuit-breaker trip ranges as indicated.
- C. Remove and replace malfunctioning units and retest as specified above.
- D. On completion of the burner system start up - the installing contractor will complete the "Burner Start Up Information and Test Data" form and "Control Settings" form (both attached) and deliver to the Specifying Engineer.

### 3.5 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain boilers.

### 3.6 CONTROL WIRING:

- A. The contractor shall provide and install all control wiring from the central control center to the field components as required. All wiring shall be in accordance with local and national electrical codes. All wiring shall be in aluminum conduit.

### 3.8 MECHANICAL WORK:

- A. Any mechanical or piping work required to accomplish installation of field devices shall be provided by the contractor as a requirement of this contract. All work shall be accomplished in accordance with local codes and requirements and executed by individuals certified to perform the work.

### 3.9 POWER WIRING:

- A. All power wiring required to complete the installation and provide for a fully operational system shall be provided by the EC for this project. All work shall be accomplished in accordance with local codes and requirements and executed by individuals certified to perform the work.

END OF SECTION 235216

## SECTION 238239 – UNIT HEATERS

### PART 1 - GENERAL

#### 1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

#### 1.2 SUMMARY

- A. Section Includes:
  - 1. Propeller unit heaters with hot-water coils.
  - 2. Wall heaters with propeller fans and electric-resistance heating coils.

#### 1.3 DEFINITIONS

- A. BAS: Building automation system.
- B. CWP: Cold working pressure.
- C. PTFE: Polytetrafluoroethylene plastic.
- D. TFE: Tetrafluoroethylene plastic.

#### 1.4 SUBMITTALS

- A. Product Data: Include rated capacities, operating characteristics, furnished specialties, and accessories for each product indicated.
- B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 1. Plans, elevations, sections, and details.
  - 2. Location and size of each field connection.
  - 3. Details of anchorages and attachments to structure and to supported equipment.
  - 4. Equipment schedules to include rated capacities, operating characteristics, furnished specialties, and accessories.
  - 5. Location and arrangement of piping valves and specialties.
  - 6. Location and arrangement of integral controls.
  - 7. Wiring Diagrams: Power, signal, and control wiring.
- C. Field quality-control test reports.
- D. Operation and Maintenance Data: For unit heaters to include in emergency, operation, and maintenance manuals.

## 1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- B. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1-2004, Section 5 - "Systems and Equipment" and Section 7 - "Construction and Startup."
- C. ASHRAE/IESNA 90.1 Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6 - "Heating, Ventilating, and Air-Conditioning."

## PART 2 - PRODUCTS

### 2.1 HOT WATER PROPELLER UNIT HEATERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Reznor.
  - 2. Sigma
  - 3. Rittling.
- B. Description: An assembly including casing, coil, fan, and motor in horizontal discharge configuration with adjustable discharge louvers.
- C. Comply with UL 2021.
- D. Comply with UL 823.
- E. Cabinet: Removable panels for maintenance access to controls.
- F. Cabinet Finish: Manufacturer's standard baked enamel applied to factory-assembled and -tested propeller unit heater before shipping.
- G. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2004.
- H. Discharge Louver: Adjustable fin diffuser for horizontal units and conical diffuser for vertical units.
- I. General Coil Requirements: Test and rate hot-water propeller unit heater coils according to ASHRAE 33.
- J. Hot-Water Coil: Copper tube, minimum 0.025-inch wall thickness, with mechanically bonded aluminum fins spaced no closer than 0.1 inch and rated for a minimum working pressure of 200 psig and a maximum entering-water temperature of 325 deg F, with manual air vent. Test for leaks to 350 psig underwater.
- K. Fan: Propeller type with aluminum wheel directly mounted on motor shaft in the fan venturi.

- L. Fan Motors: Comply with requirements in Division 23 Section "Common Motor Requirements for HVAC Equipment."
  - 1. Motor Type: Permanently lubricated.
- M. Control devices and operational sequences are specified in Division 23 Sections "Instrumentation and Control for HVAC" and "Sequence of Operations for HVAC Controls." Refer to these sections for additional requirements for unit manufacturer provided controls and ATC contractor provided controls.

## 2.2 WALL HEATERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Berko Electric Heating; a division of Marley Engineered Products.
  - 2. Chromalox, Inc.; a division of Emerson Electric Company.
  - 3. Marley Electric Heating; a division of Marley Engineered Products.
  - 4. QMark Electric Heating; a division of Marley Engineered Products.
- B. Description: An assembly including chassis, electric heating coil, fan, motor, and controls. Comply with UL 2021.
- C. Cabinet:
  - 1. Front Panel: Stamped-steel louver, with removable panels fastened with tamperproof fasteners, and tamperproof thermostat.
  - 2. Finish: Baked enamel over baked-on primer with manufacturer's standard color selected by Architect, applied to factory-assembled and -tested wall and ceiling heaters before shipping.
  - 3. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
- D. Surface-Mounting Cabinet Enclosure: Steel with finish to match cabinet.
- E. Electric-Resistance Heating Coil: Nickel-chromium heating wire, free from expansion noise and hum, embedded in magnesium oxide refractory and sealed in corrosion-resistant metallic sheath. Terminate elements in stainless-steel, machine-staked terminals secured with stainless-steel hardware, and limit controls for high temperature protection. Provide integral circuit breaker for overcurrent protection.
- F. Fan: Aluminum propeller directly connected to motor.
  - 1. Motor: Permanently lubricated, multispeed. Comply with requirements in Division 23 Section "Common Motor Requirements for HVAC Equipment."
- G. Controls: Unit-mounted tamper resistant thermostat.
- H. Electrical Connection: Factory wire motors and controls for a single field connection with disconnect switch.

## PART 3 - EXECUTION

### 3.1 EXAMINATION

- A. Examine areas to receive unit heaters for compliance with requirements for installation tolerances and other conditions affecting performance.
- B. Examine roughing-in for piping and electrical connections to verify actual locations before unit heater installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### 3.2 INSTALLATION

- A. Install wall boxes in finished wall assembly; seal and weatherproof. Joint-sealant materials and applications are specified in Division 07 Section "Joint Sealants."
- B. Install propeller unit heaters level and plumb.
- C. Suspend propeller unit heaters from structure with all-thread hanger rods and spring hangers with vertical-limit stop. Hanger rods and attachments to structure are specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment."
- D. Install wall-mounting thermostats and switch controls in electrical outlet boxes at heights to match lighting controls. Verify location of thermostats and other exposed control sensors with Drawings and room details before installation.
- E. Suspend propeller unit heaters from structure with all-thread hanger rods and spring hangers with vertical-limit stop. Hanger rods and attachments to structure are specified in Division 23 Section "Hangers and Supports for HVAC Piping and Equipment." Vibration hangers are specified in Division 23 Section "Vibration and Controls for HVAC Piping and Equipment."

### 3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 23 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Install piping adjacent to machine to allow service and maintenance.
- C. Connect piping to cabinet unit heater's factory, hot-water piping package. Install the piping package if shipped loose.
- D. Comply with safety requirements in UL 1995.
- E. Unless otherwise indicated, install union and gate or ball valve on supply-water connection and union and calibrated balancing valve on return-water connection of unit heater. Hydronic specialties are specified in Division 23 Section "Hydronic Piping."
- F. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."

- G. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

### 3.4 FIELD QUALITY CONTROL

- A. **Manufacturer's Field Service:** Engage a factory-authorized service representative to inspect, test, and adjust field-assembled components and equipment installation, including connections, and to assist in field testing. Report results in writing.
- B. Perform the following field tests and inspections and prepare test reports:
  - 1. **Operational Test:** After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.
  - 2. Operate electric heating elements through each stage to verify proper operation and electrical connections.
  - 3. Test and adjust controls and safety devices. Replace damaged and malfunctioning controls and equipment.
- C. Remove and replace malfunctioning units and retest as specified above.

### 3.5 ADJUSTING

- A. Adjust initial temperature set points.
- B. **Occupancy Adjustments:** When requested within 12 months of date of Substantial Completion, provide on-site assistance in adjusting system to suit actual occupied conditions. Provide up to two visits to Project during other-than-normal occupancy hours for this purpose.

### 3.6 DEMONSTRATION

- A. Engage a factory-authorized service representative to train Owner's maintenance personnel to adjust, operate, and maintain cabinet unit heaters. Refer to Division 01 Section "Demonstration and Training."

END OF SECTION 238239