


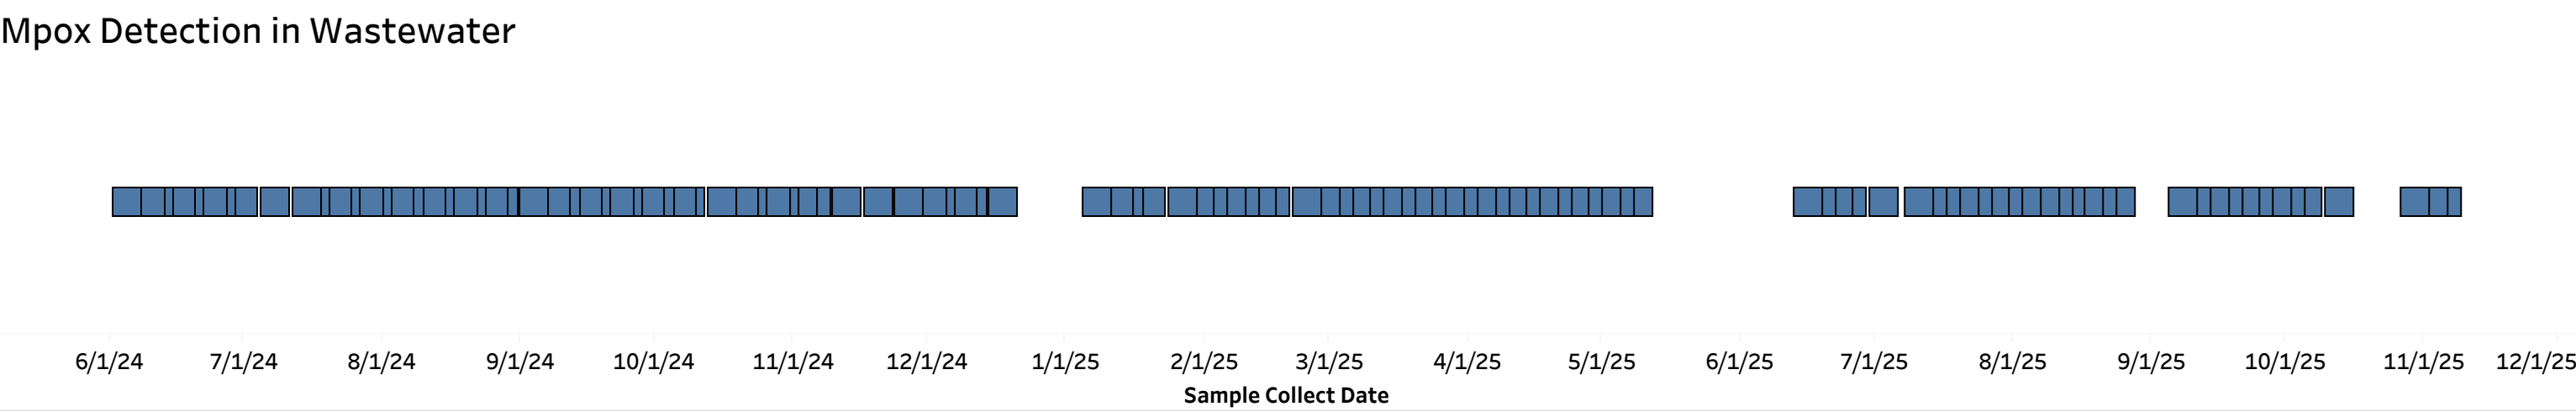
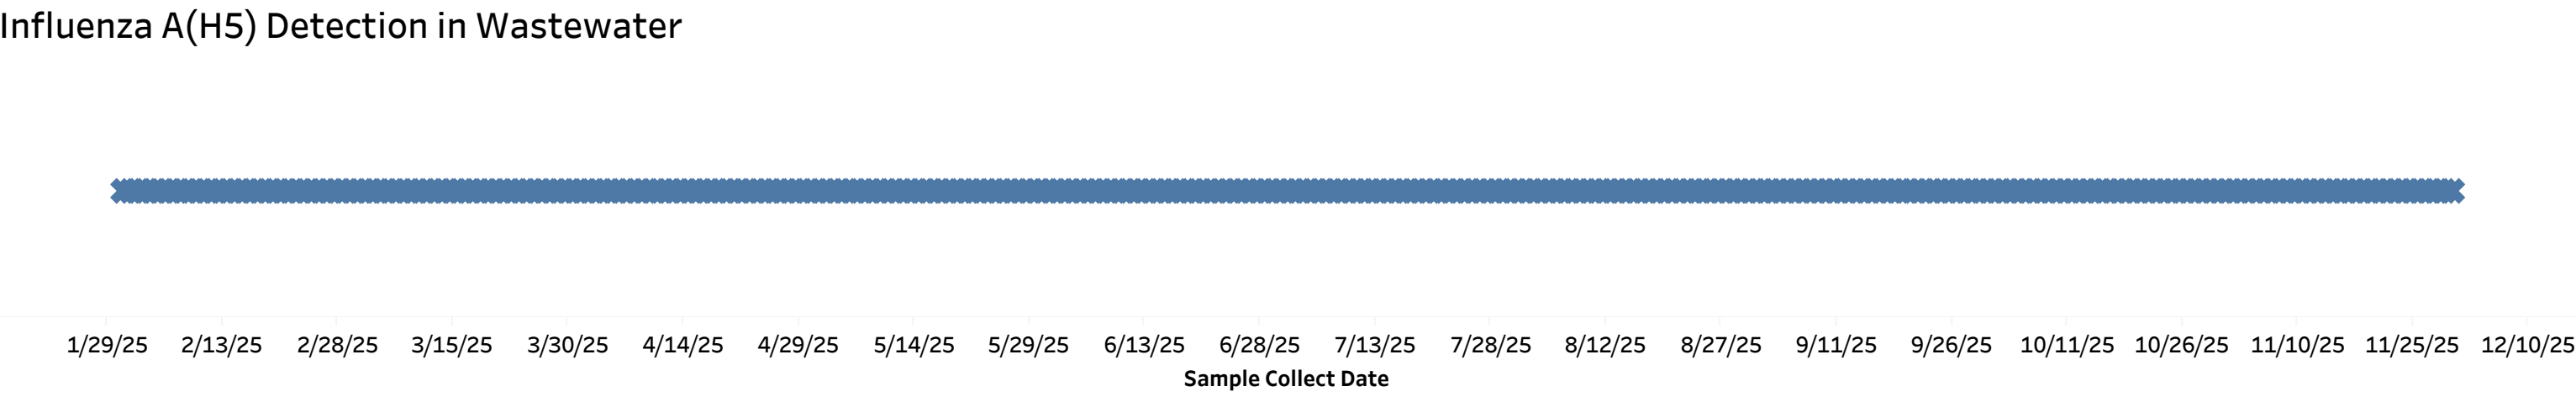
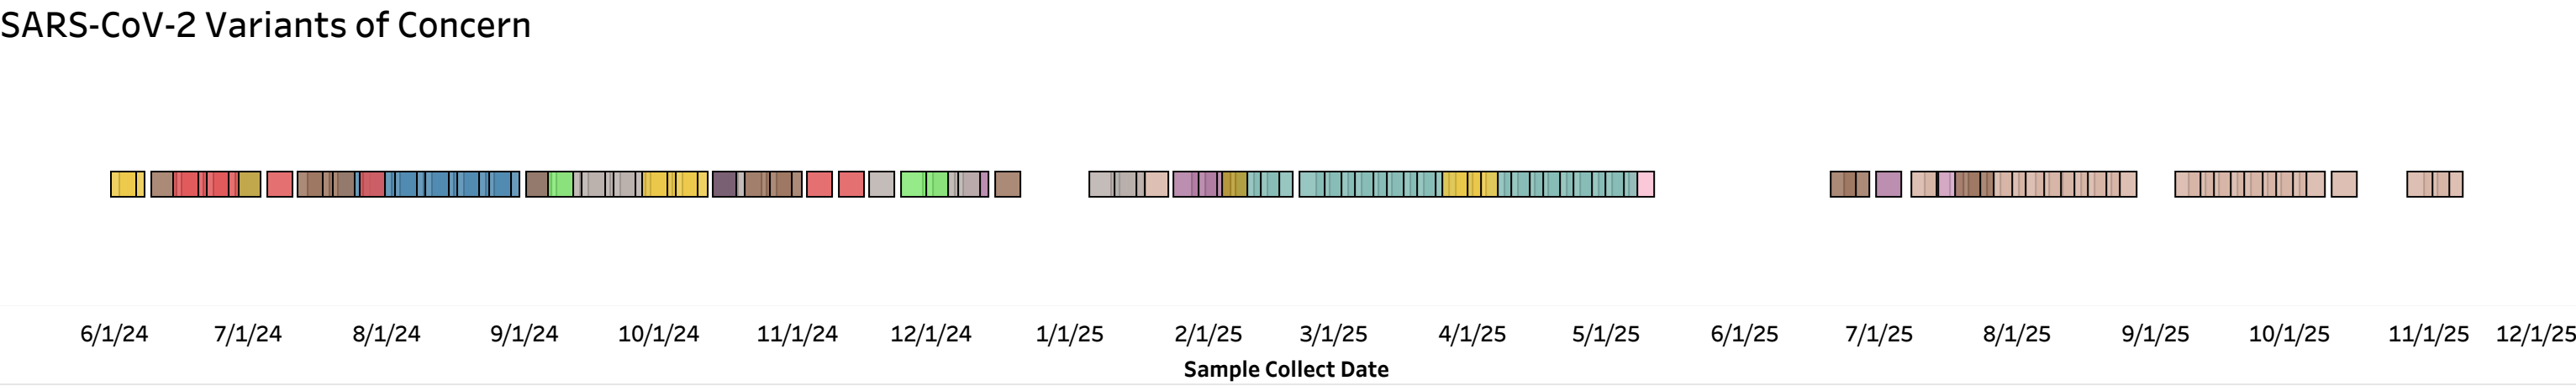


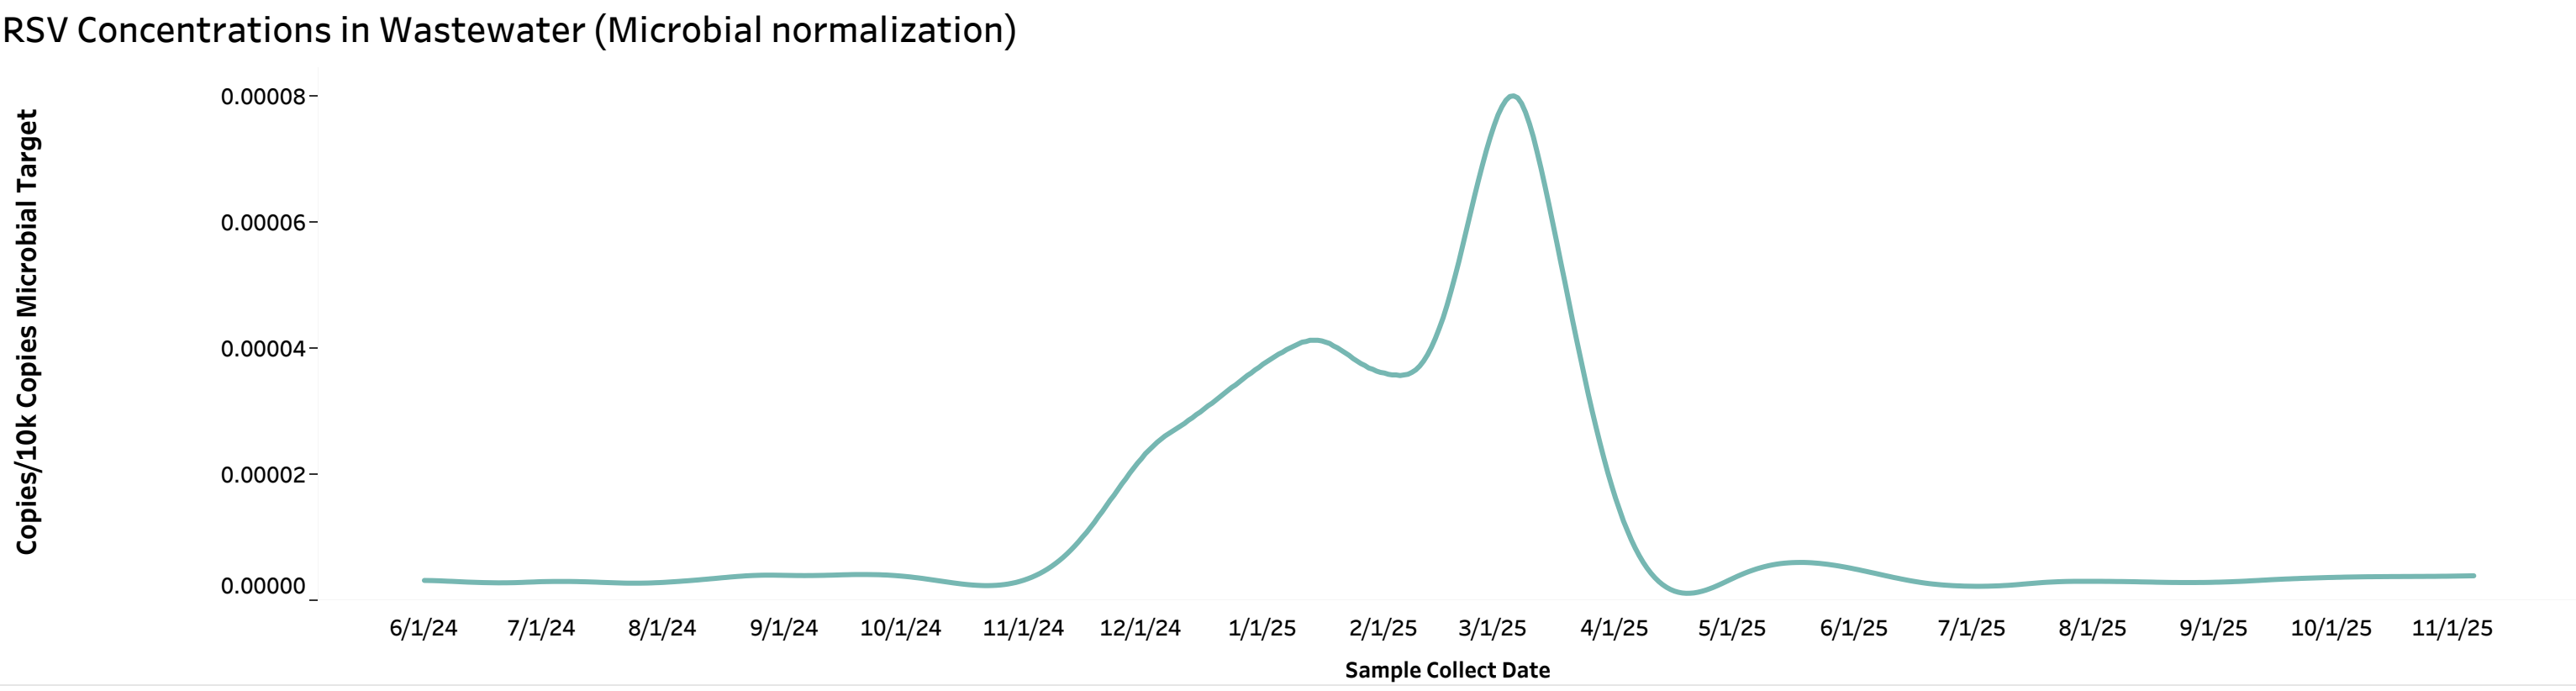

New Jersey Department of Health Wastewater Surveillance
Testing Results

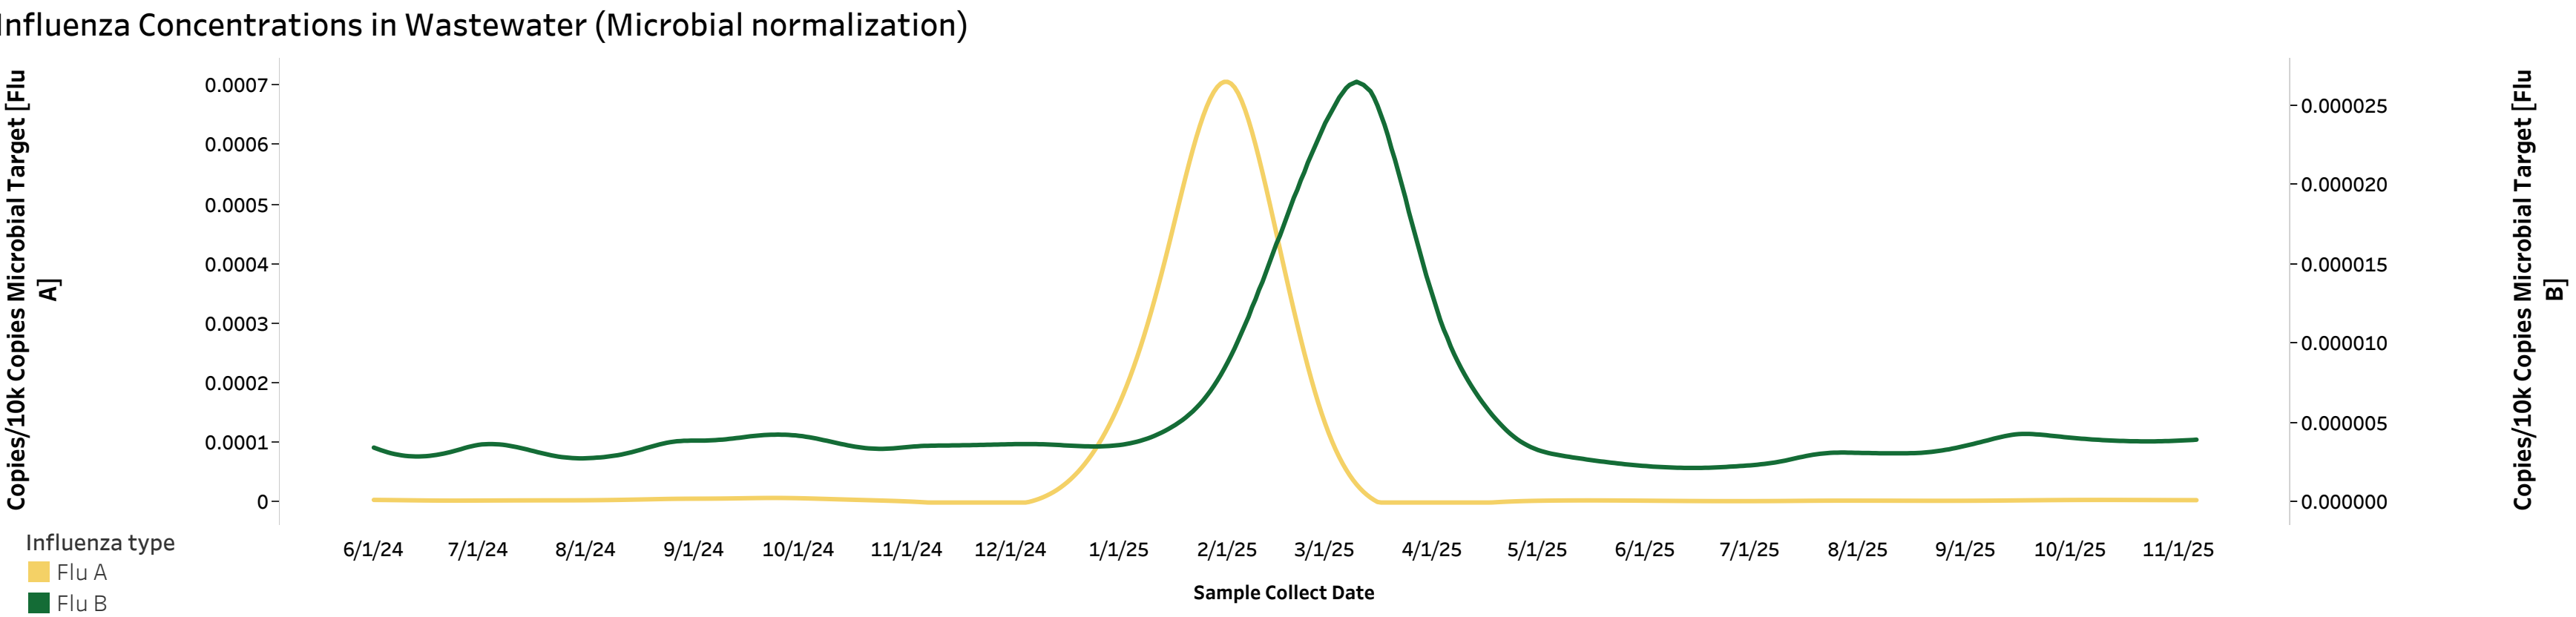

Site Name: Rowan University	Counties Served: Gloucester	Population Served: 18,000
First Sample Date: 10/2/2023	Most Recent Sample Date: 11/6/2025	

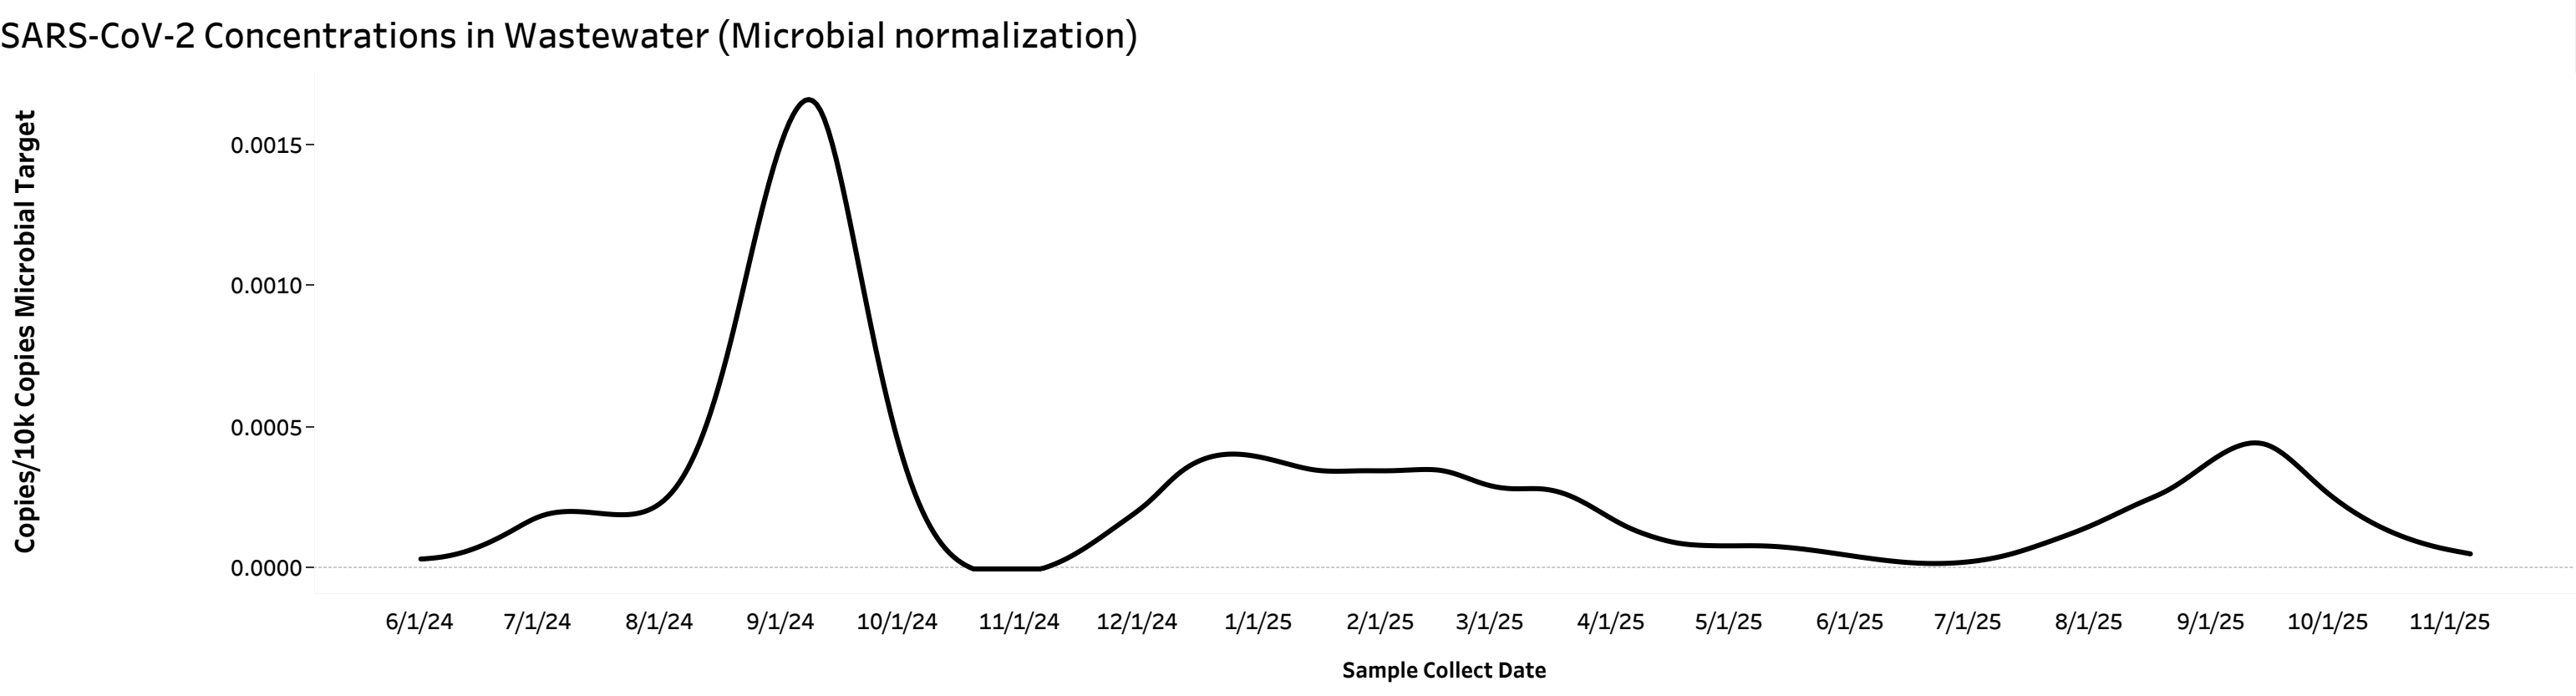

- Dominant Variants
- JN.1
 - KP.1.1.3
 - KP.2
 - KP.3
 - KP.3.1.1
 - LB.1
 - BA.2.86
 - JN.1.16
 - LP.8.1
 - MC.10.1
 - NW.1
 - XEC
 - XEC.4
 - XFC
 - XFG

H5 Detection

Not Detected

Detected

Mpox detection

Not Detected

Detected