New Jersey Department of Health Wastewater Surveillance Testing Results

Site Name:	Counties Served:	Population Served:
Rowan University	Gloucester	18,000

First Sample Date:	Most Recent Sample Date:
10/2/2023	2/9/2026

SARS-CoV-2 Concentrations in Wastewater (Microbial normalization)

Influenza Concentrations in Wastewater (Microbial normalization)

Influenza type
Flu A
Flu B

RSV Concentrations in Wastewater (Microbial normalization)

SARS-CoV-2 Variants of Concern
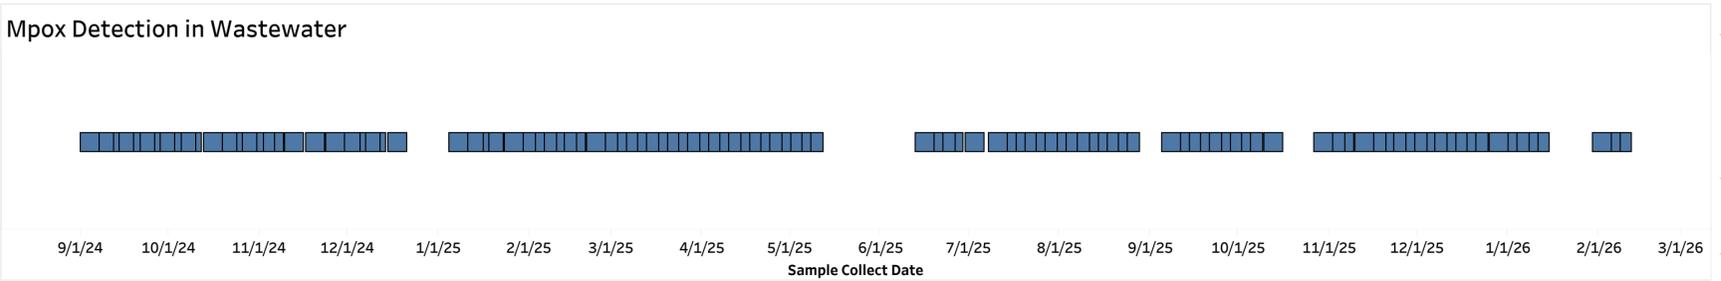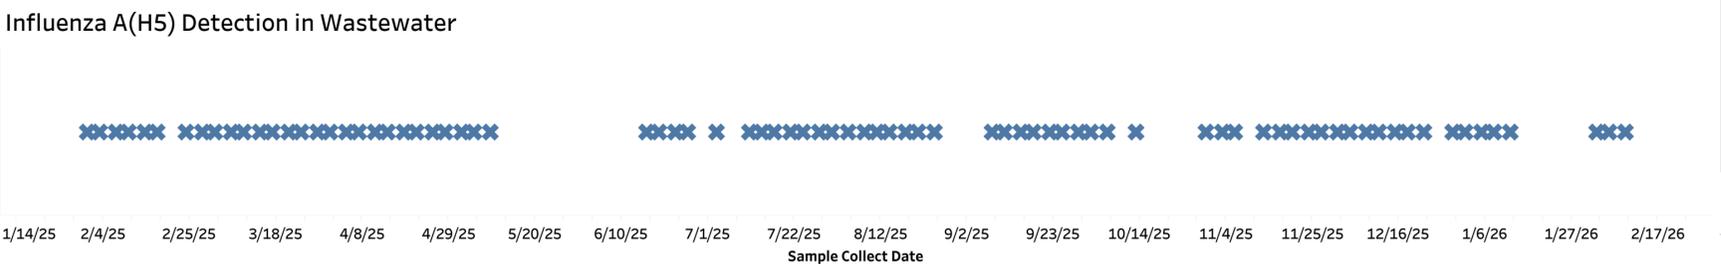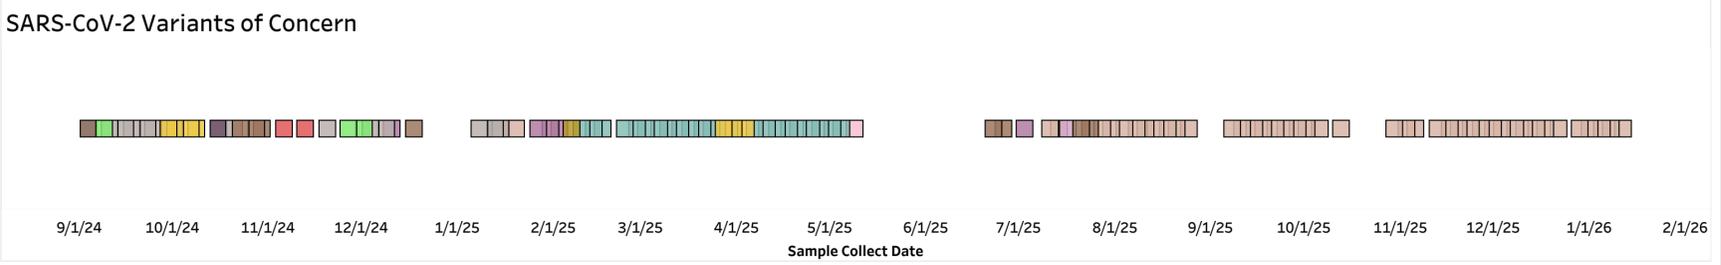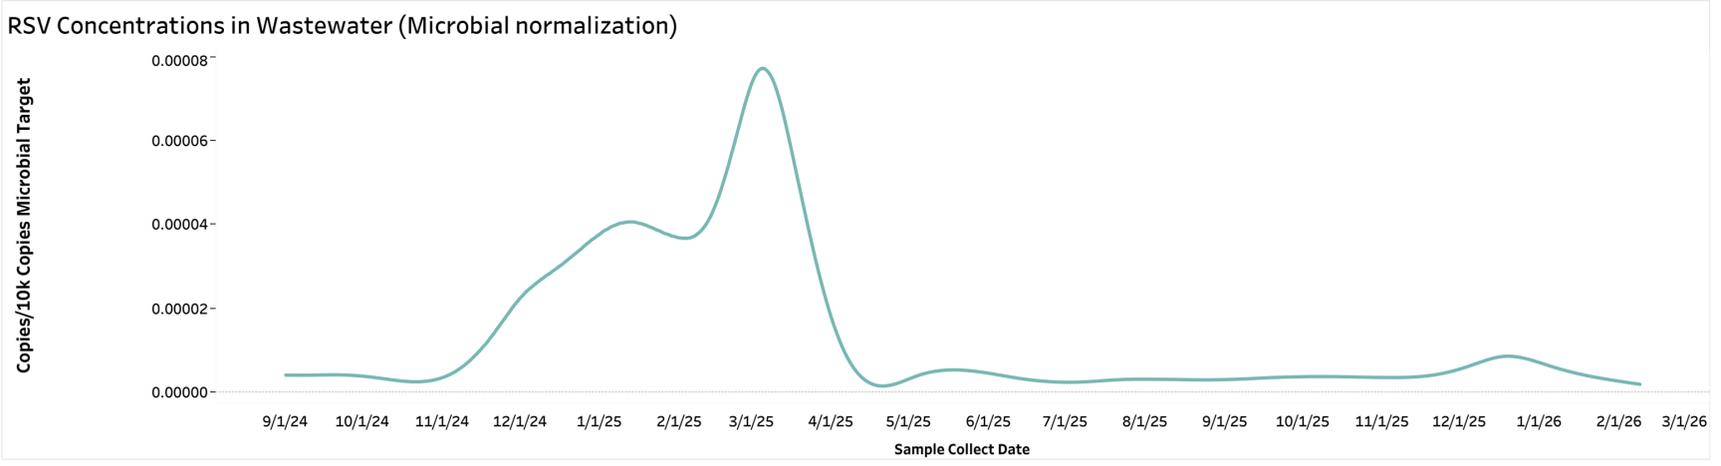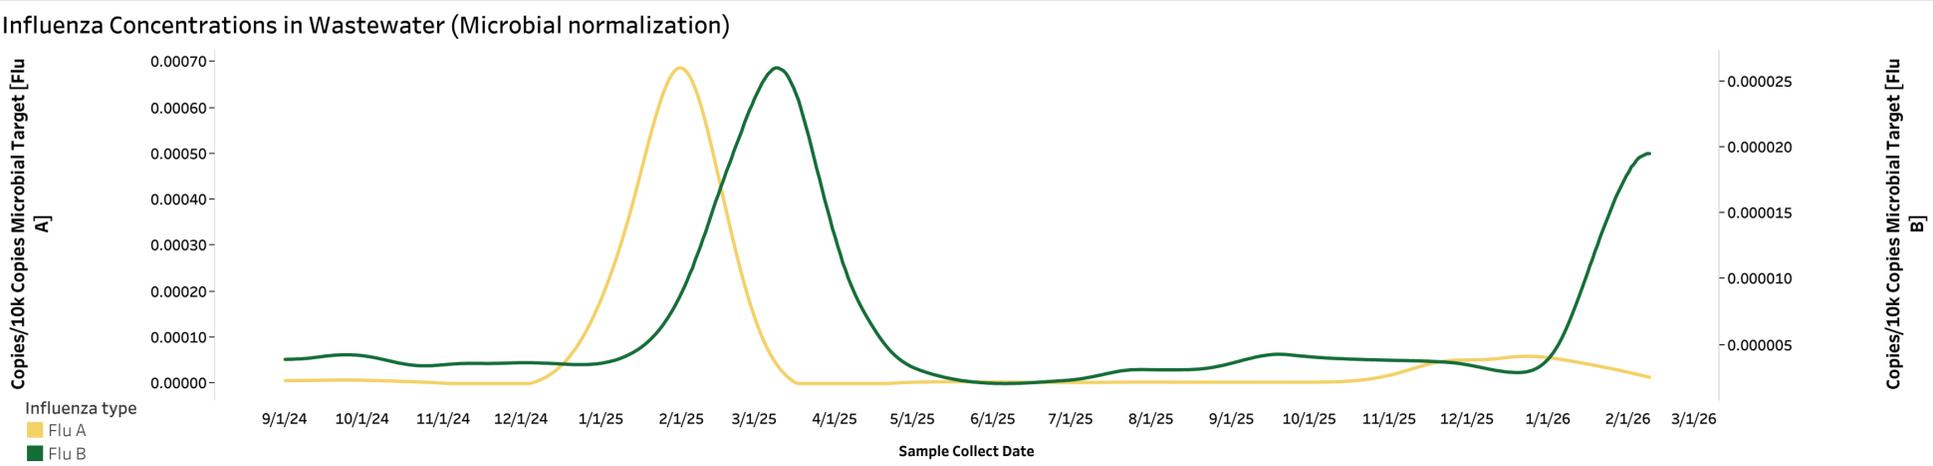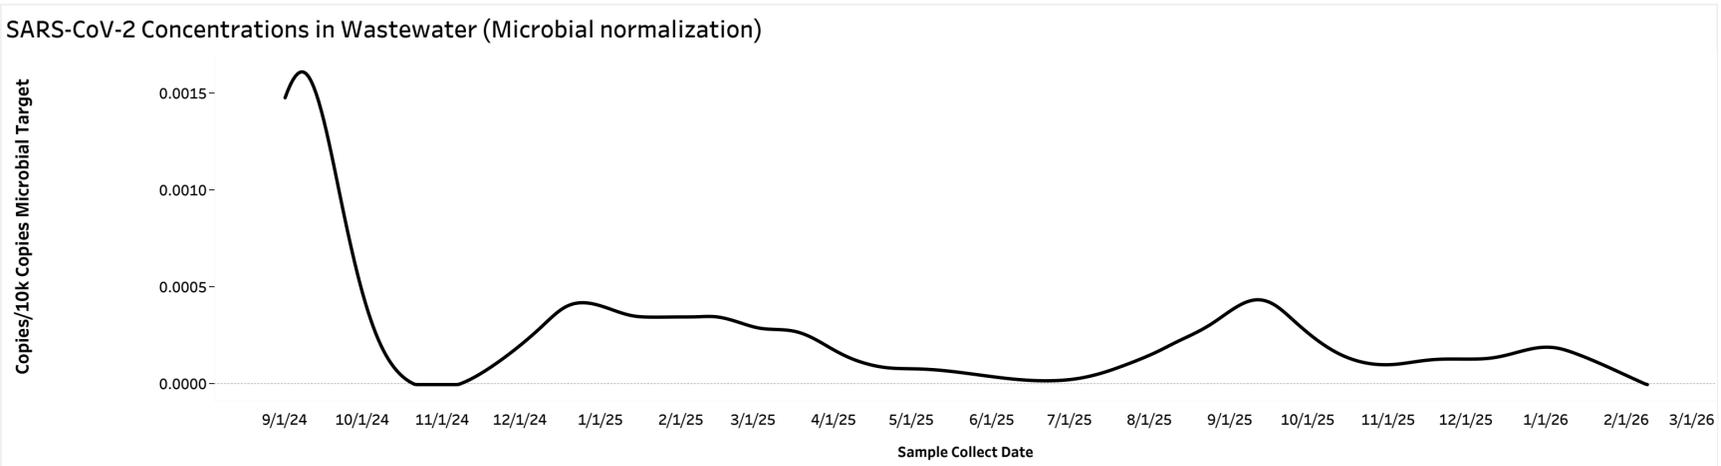
Dominant Variants
JN.1
KP.1.1.3
KP.2
KP.3
KP.3.1.1
LB.1
BA.2.86
JN.1.16
LP.8.1
MC.10.1
NW.1
XEC
XEC.4
XFC
XFG

Influenza A(H5) Detection in Wastewater

H5 Detection
Not Detected ✖
Detected ✖

Mpox Detection in Wastewater

Mpox dectection
Not Detected ▪
Detected ▪