


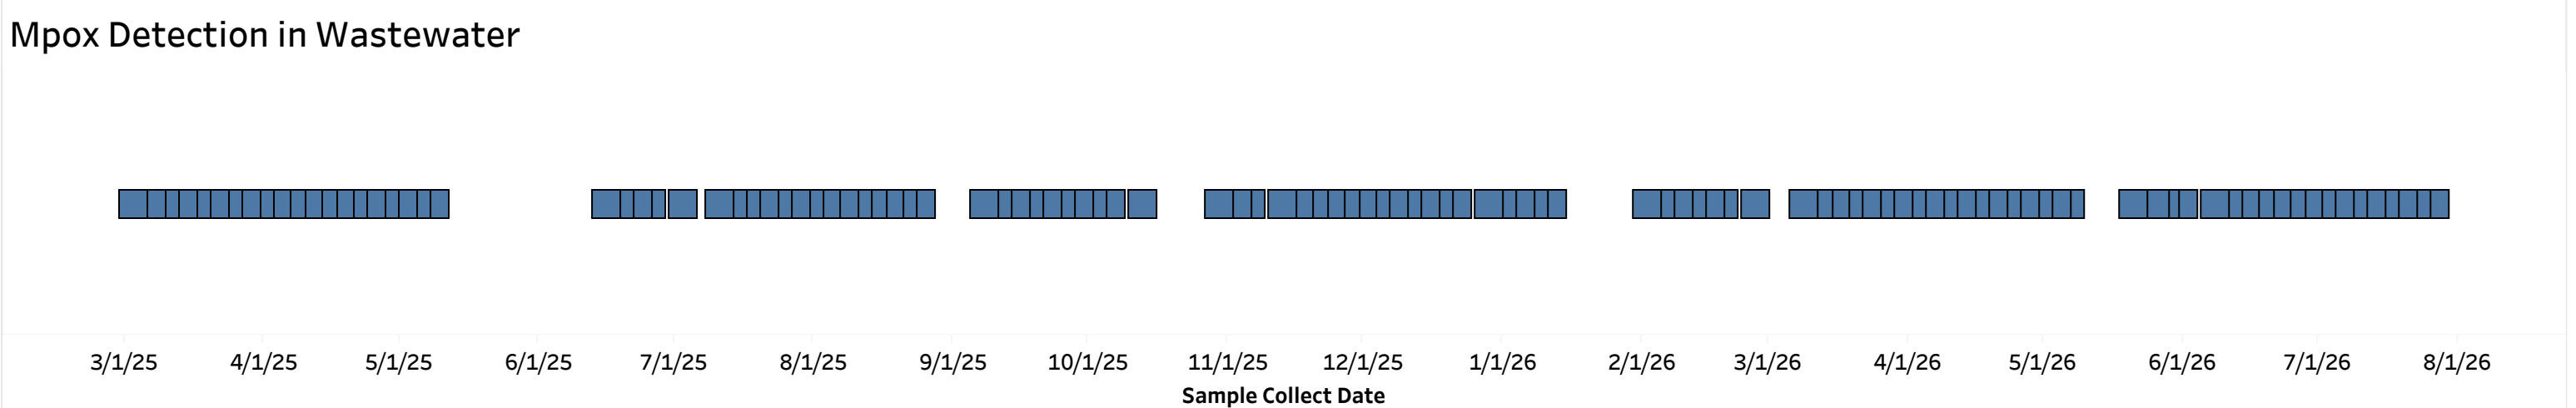
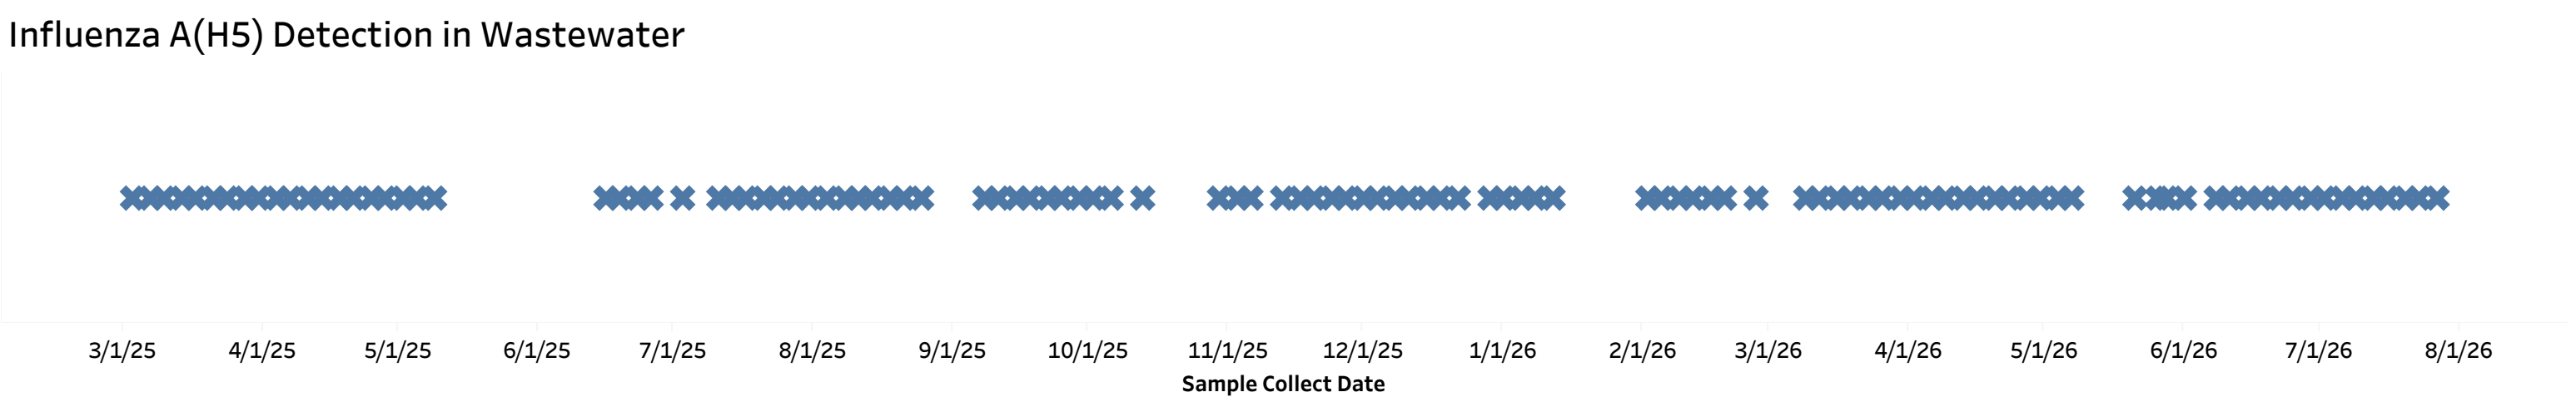
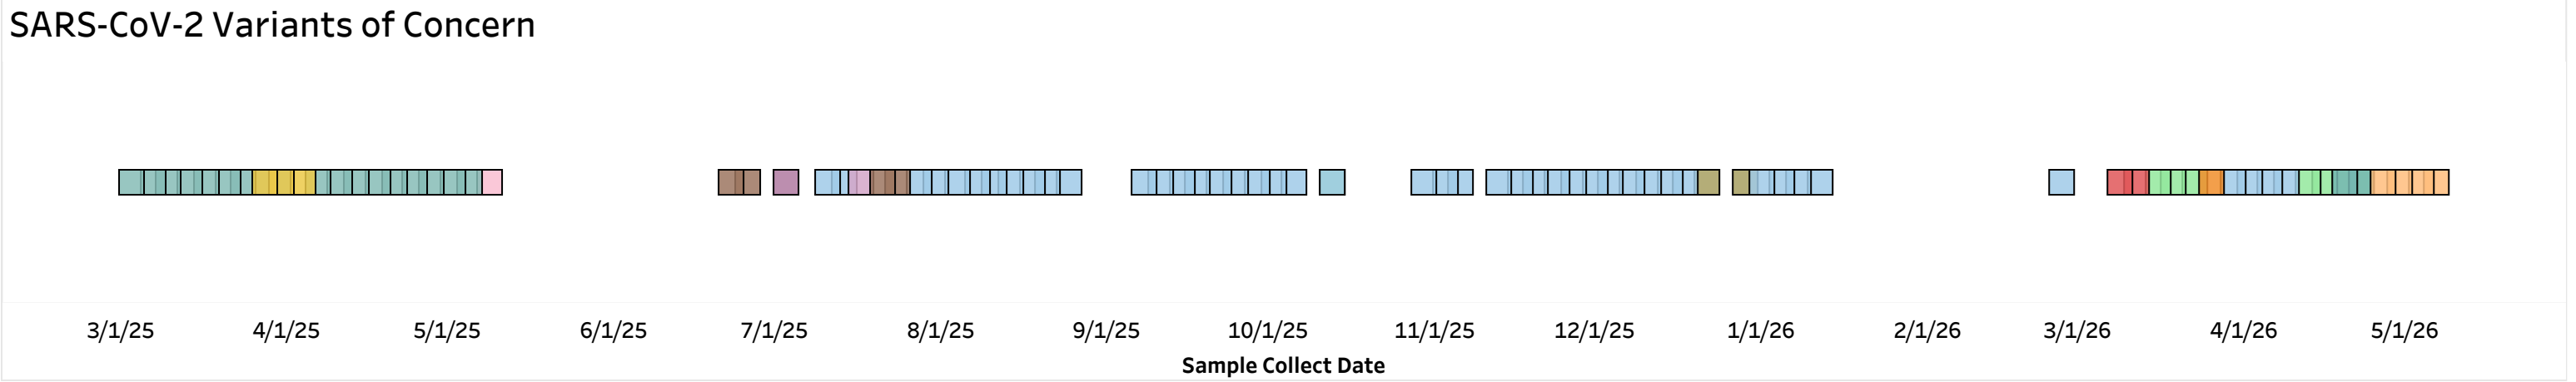


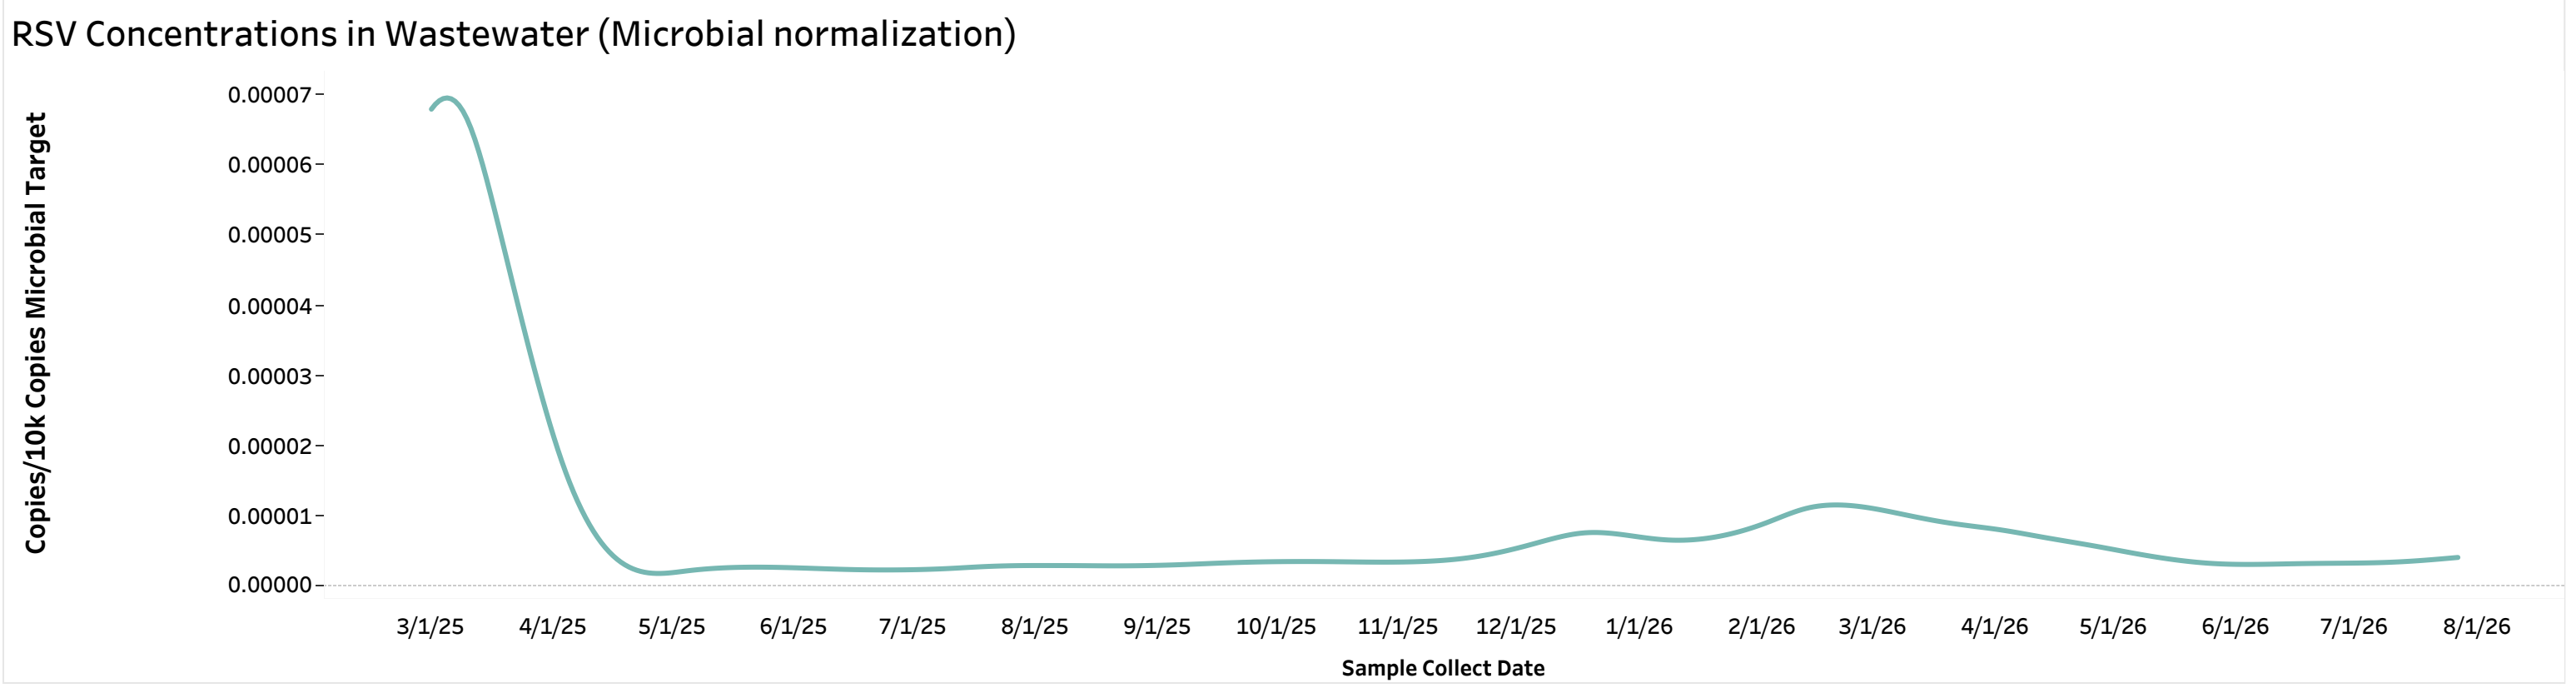

New Jersey Department of Health Wastewater Surveillance
Testing Results

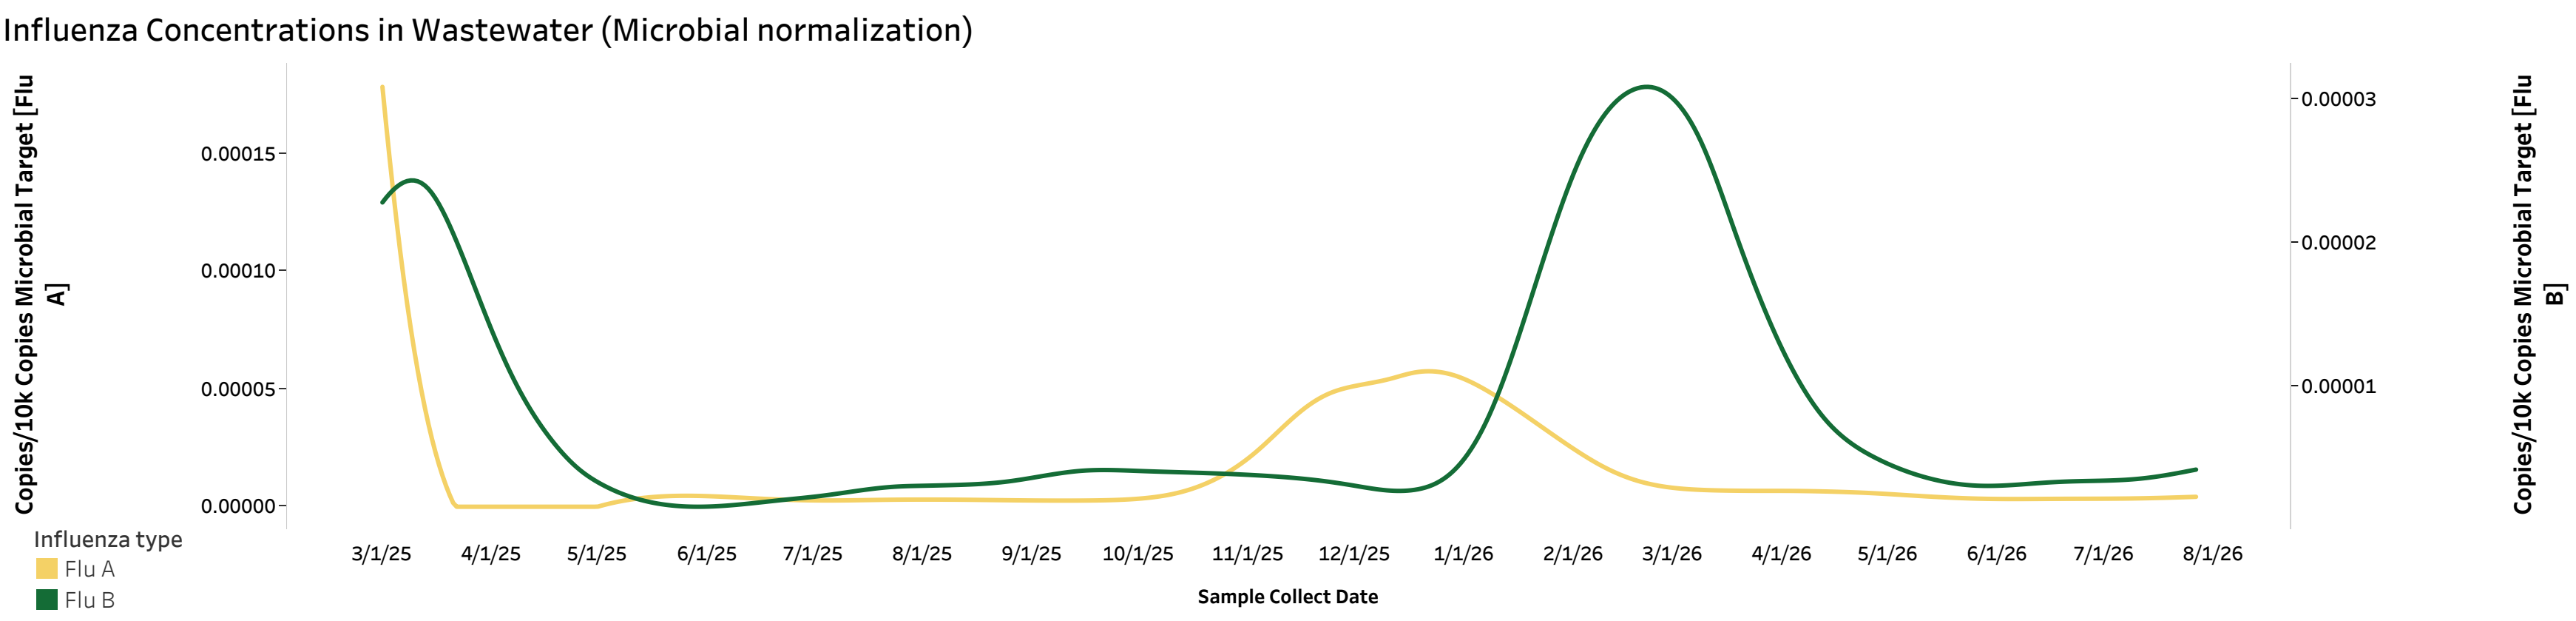

Site Name:	Counties Served:	Population Served:
Rowan University	Gloucester	18,000
First Sample Date:	Most Recent Sample Date:	
10/2/2023	7/27/2026	

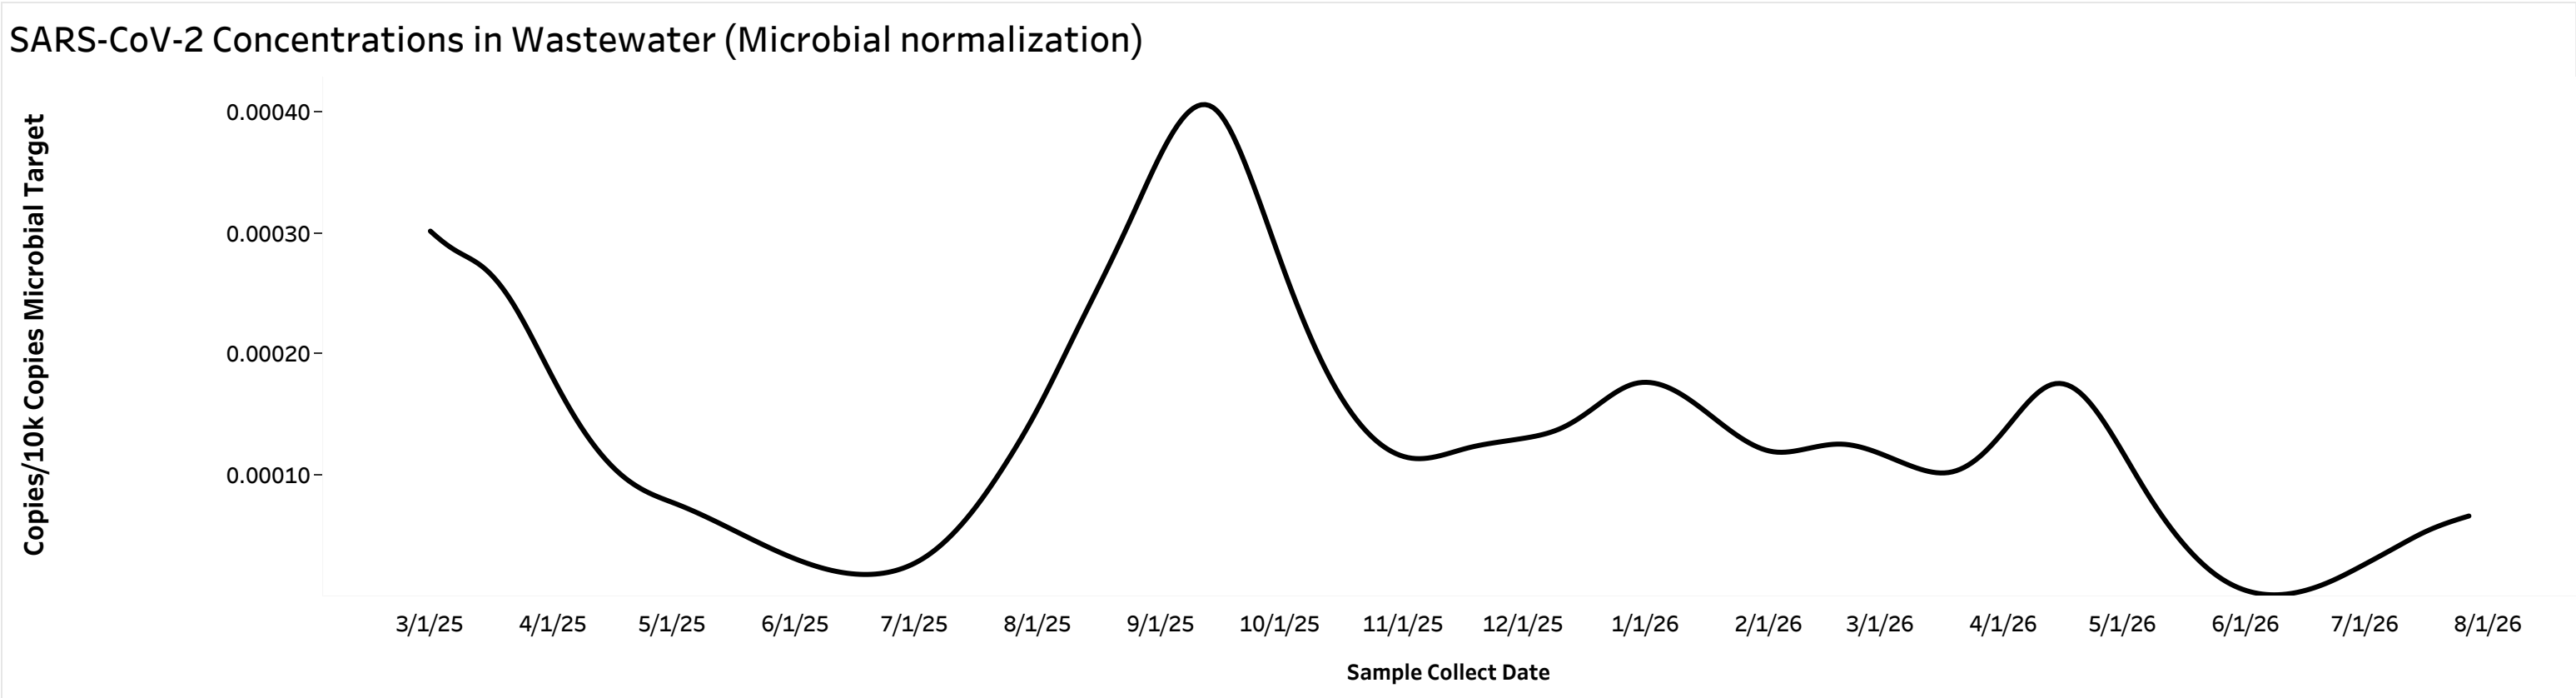

Dominant Variants

- JN.1
- KP.2
- BA.2
- BA.3.2
- LP.8.1
- MC.10.1
- NW.1
- XEC
- XFC
- XFG
- XFG.1
- XFG.6
- XFG.14.1

H5 Detection

- Not Detected
- Detected

Mpox detection

- Not Detected
- Detected