


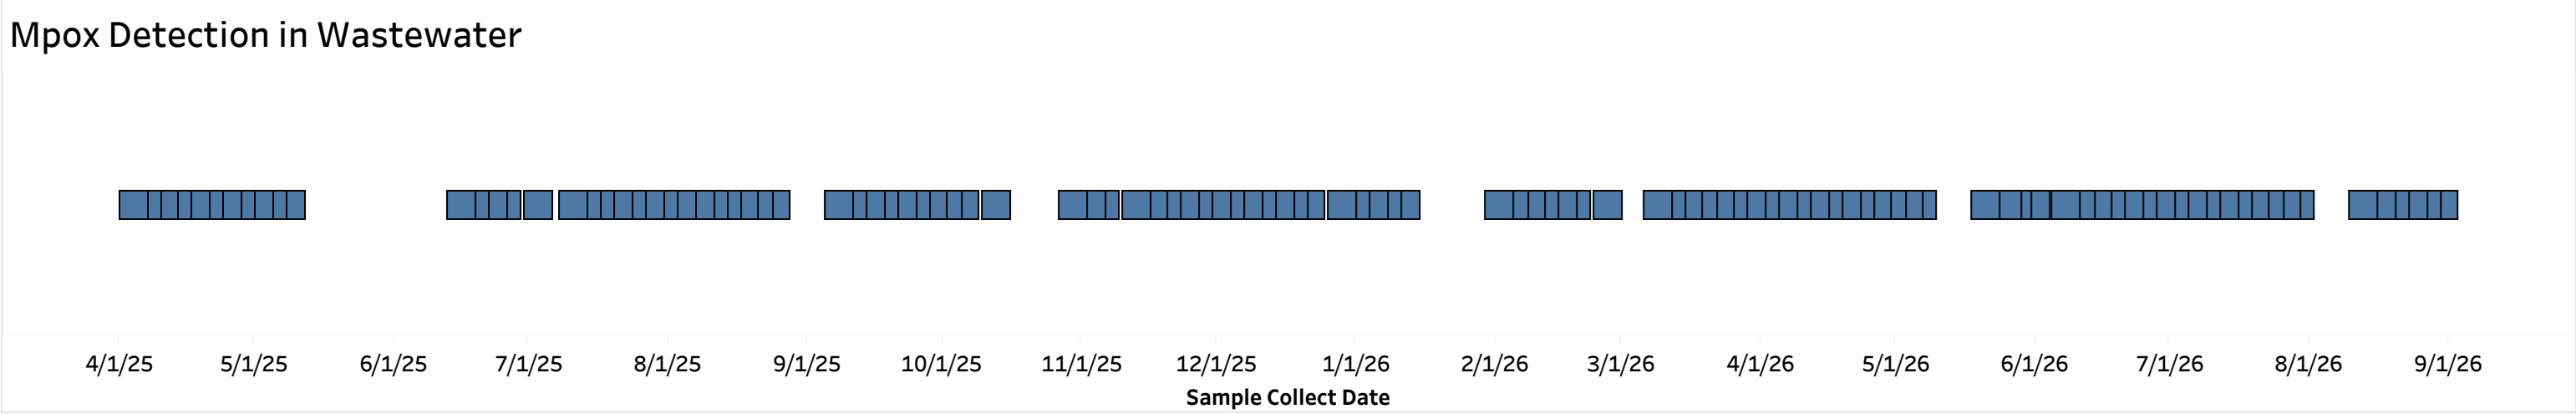
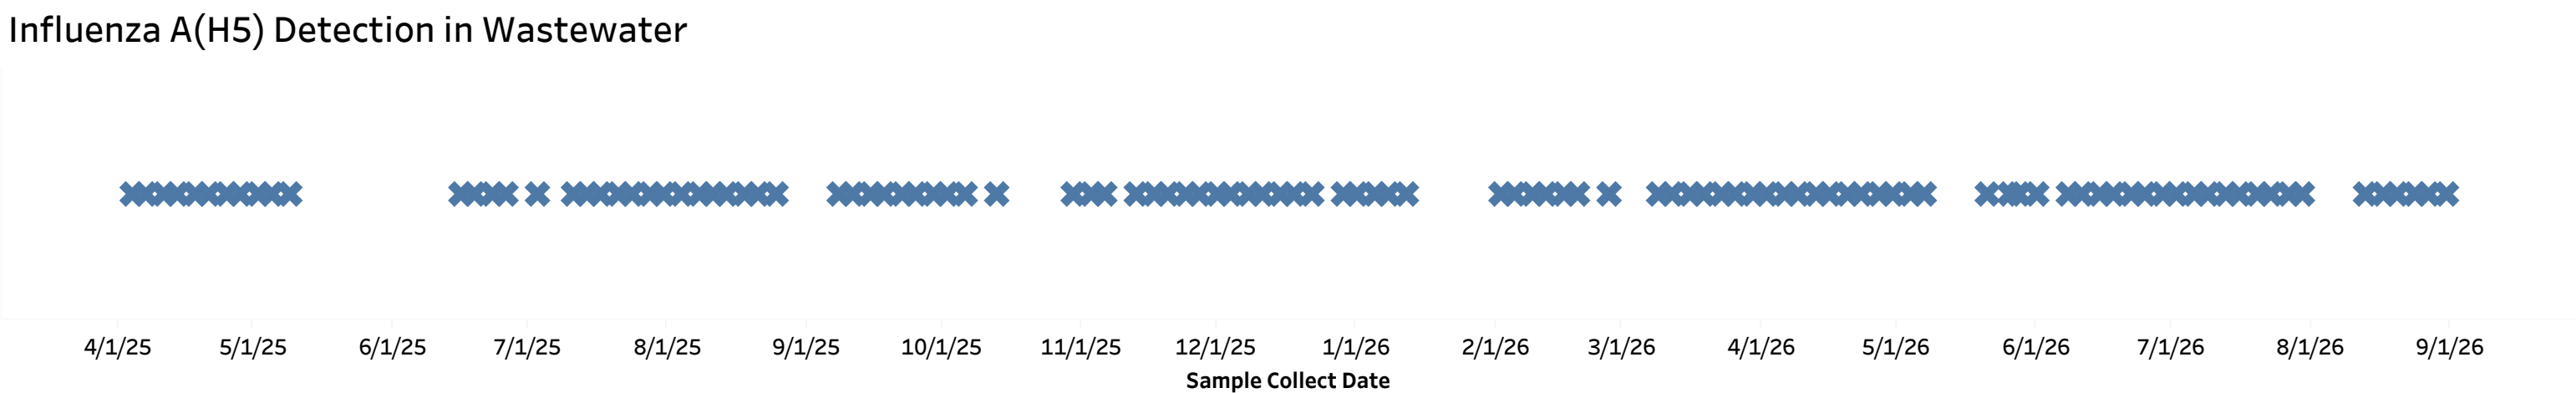
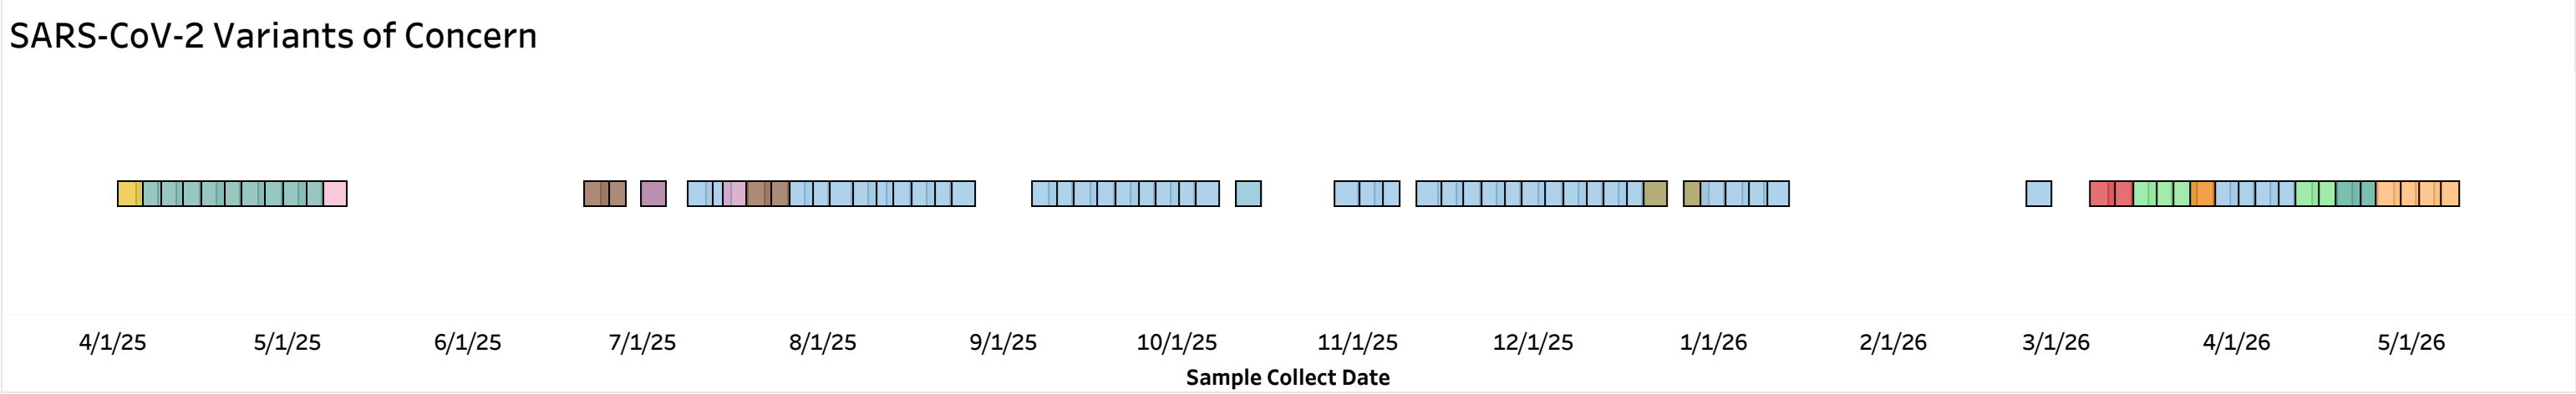


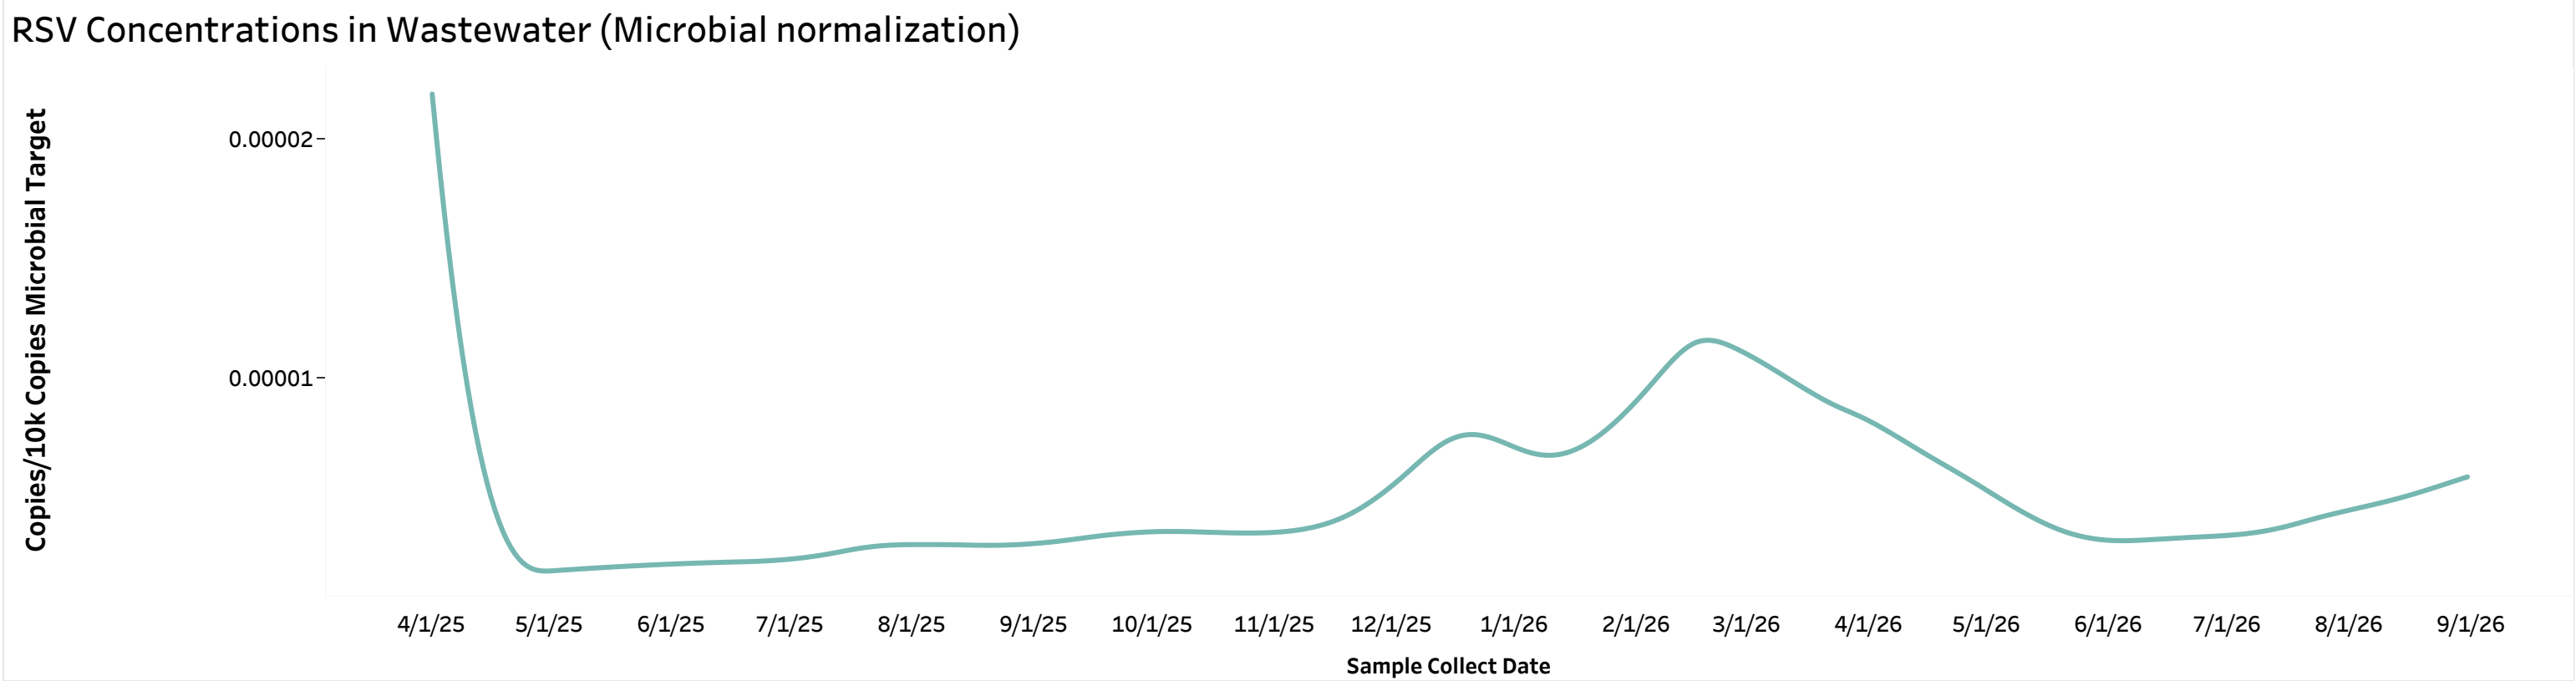

New Jersey Department of Health Wastewater Surveillance
Testing Results

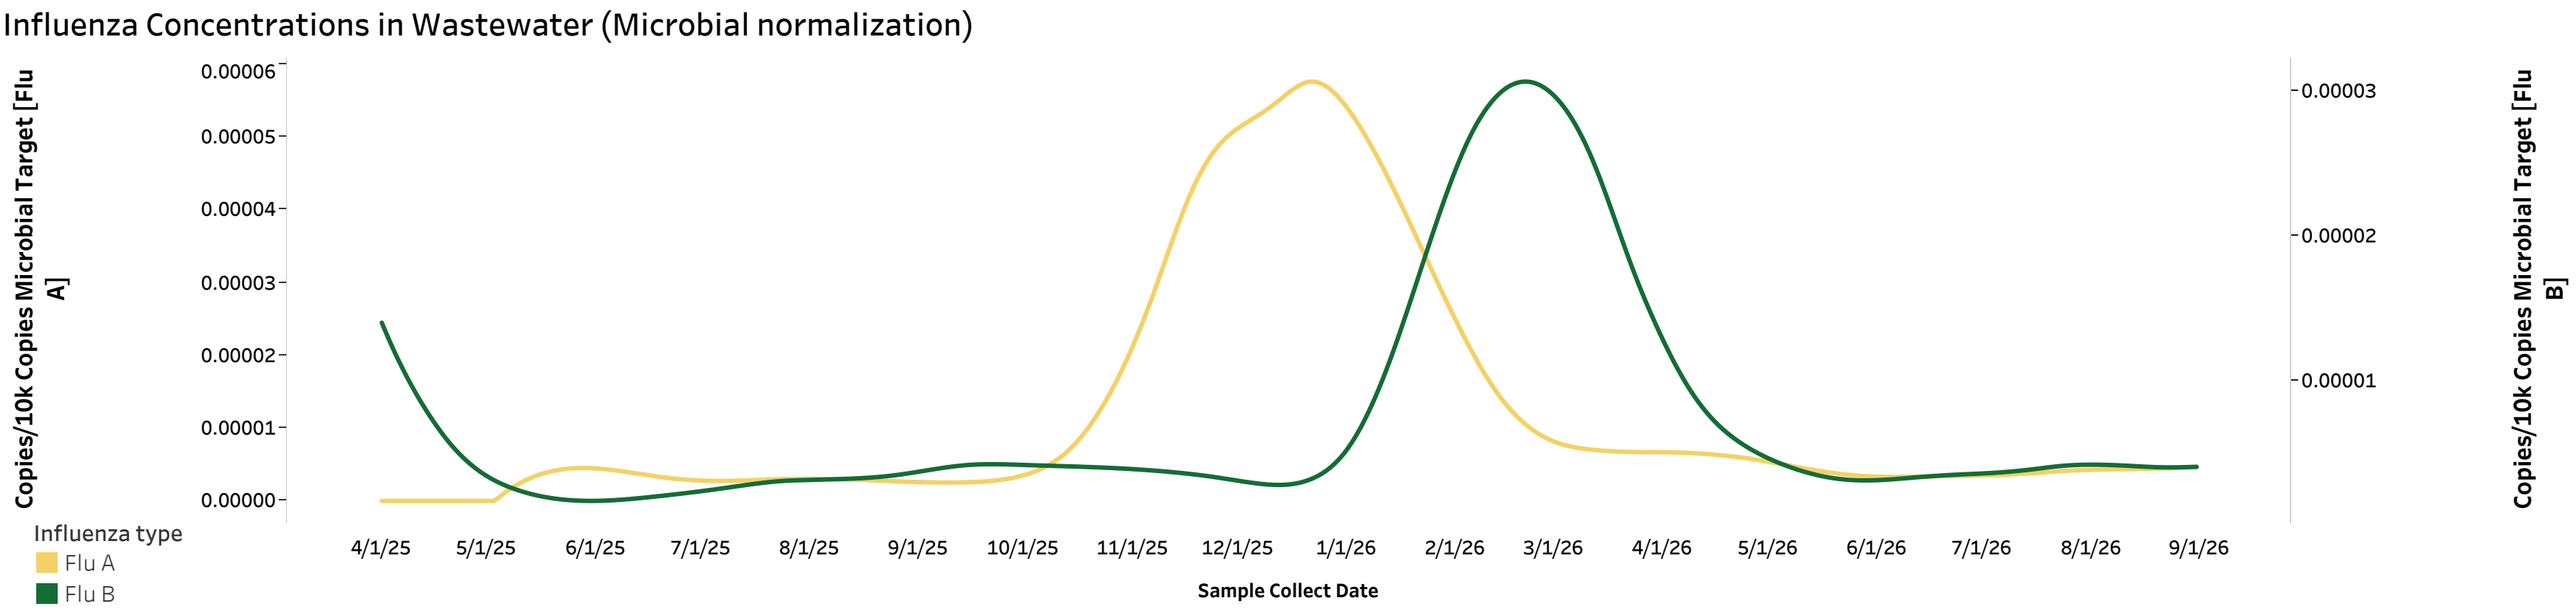

Site Name:	Counties Served:	Population Served:
Rowan University	Gloucester	18,000
First Sample Date:	Most Recent Sample Date:	
10/2/2023	8/31/2026	

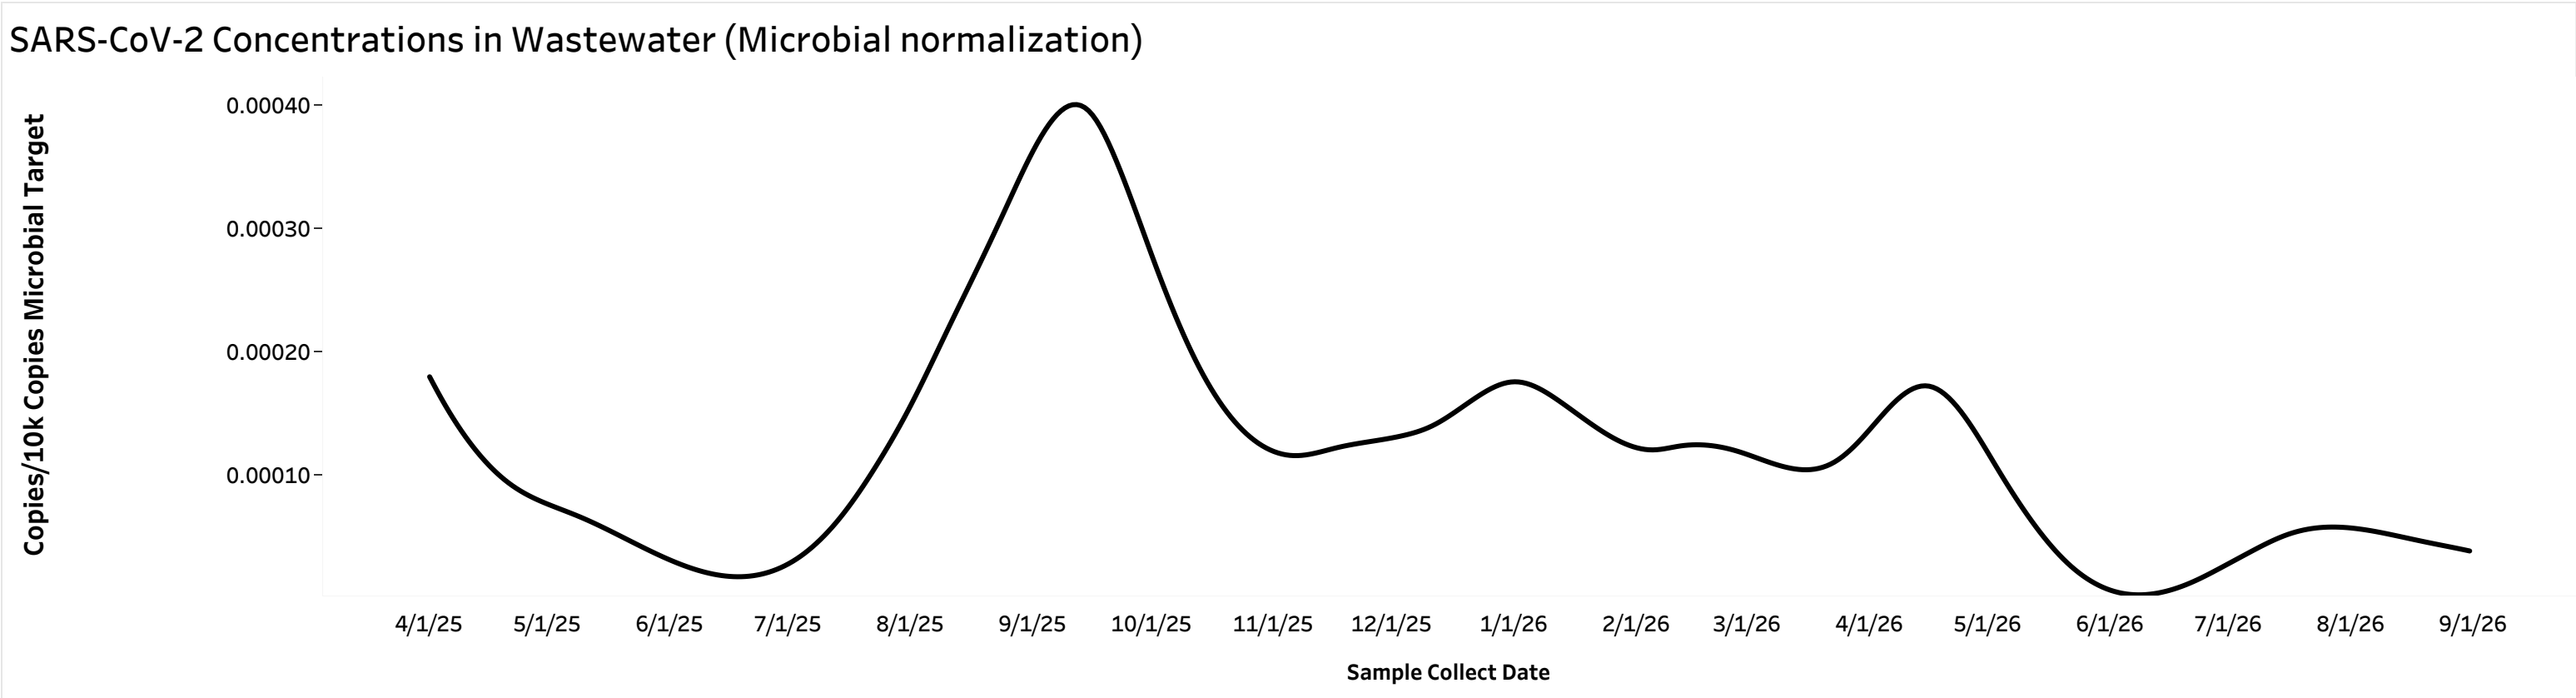

- Dominant Variants
- JN.1
 - KP.2
 - BA.2
 - BA.3.2
 - LP.8.1
 - MC.10.1
 - NW.1
 - XEC
 - XFC
 - XFG
 - XFG.1
 - XFG.6
 - XFG.14.1

H5 Detection

Not Detected

Detected

Mpox detection

Not Detected

Detected