


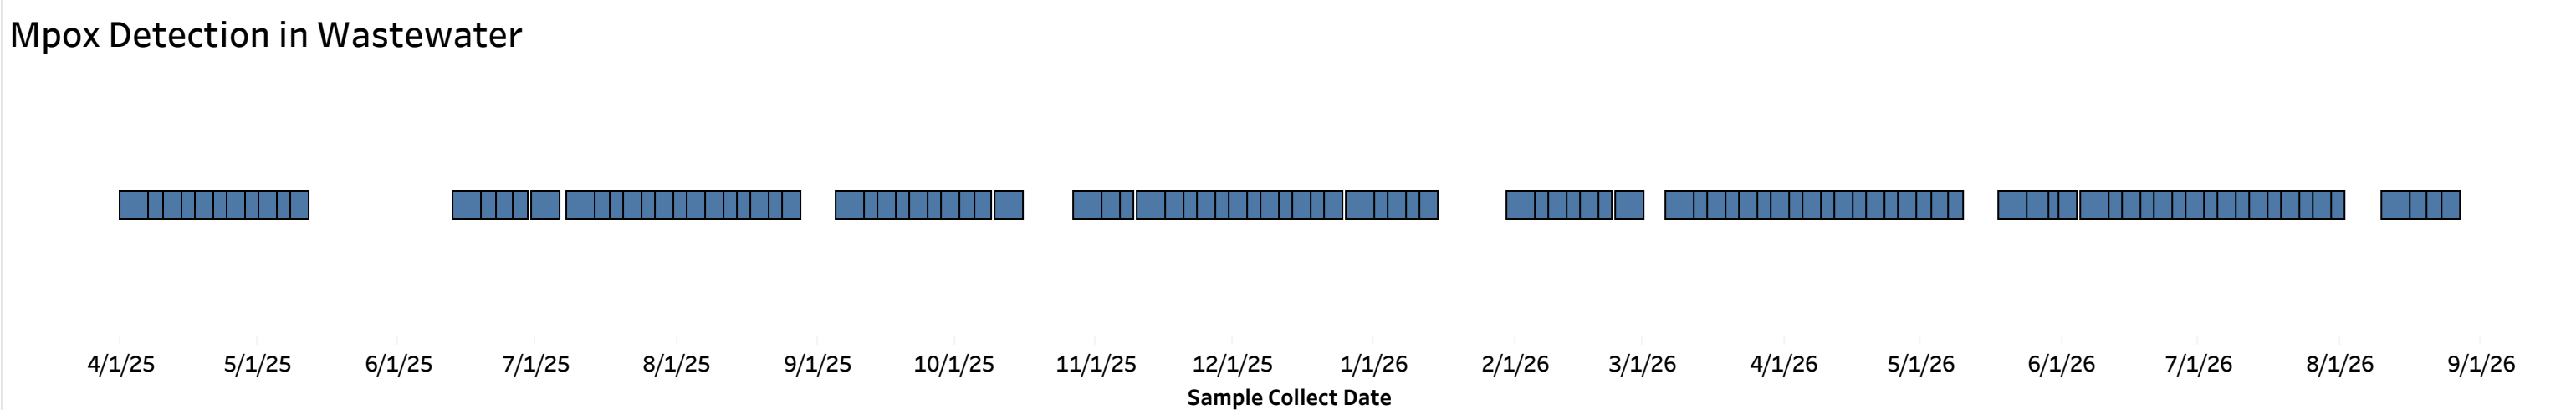
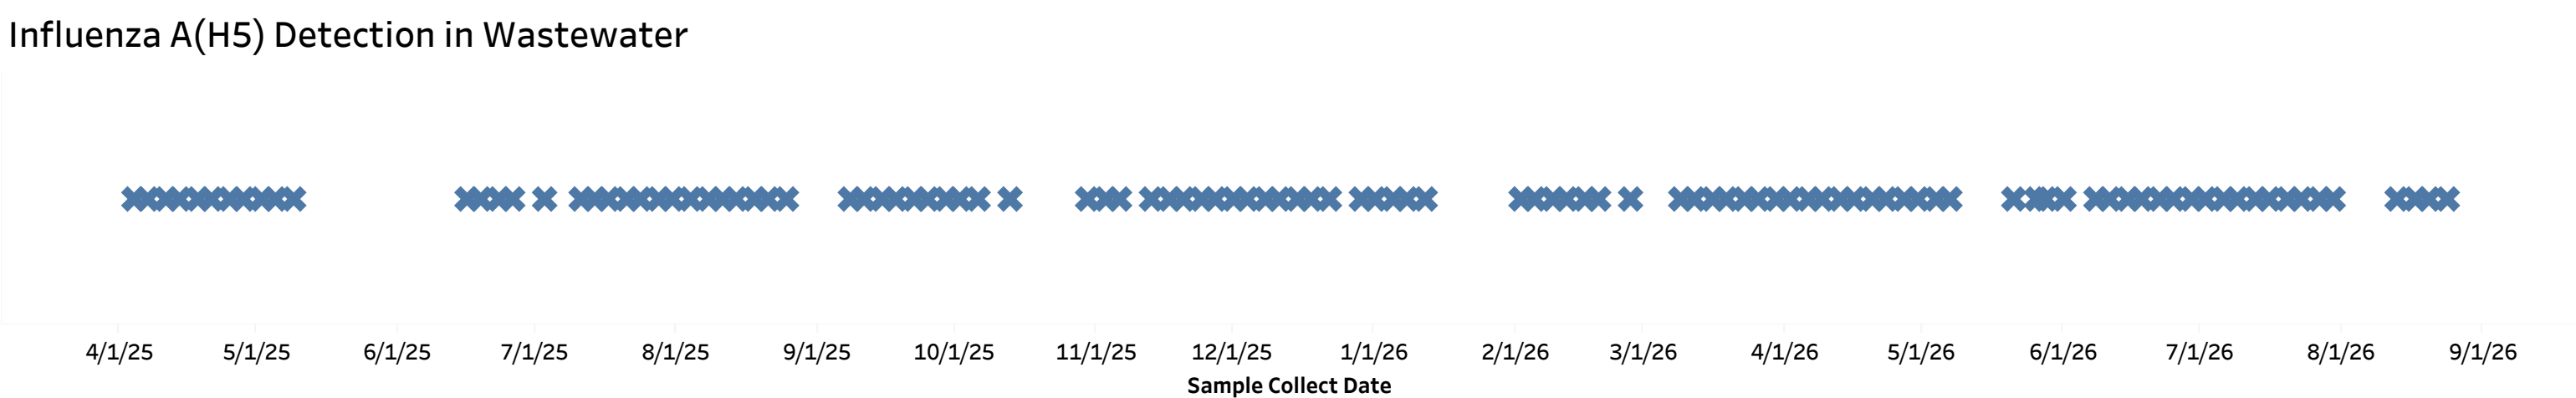
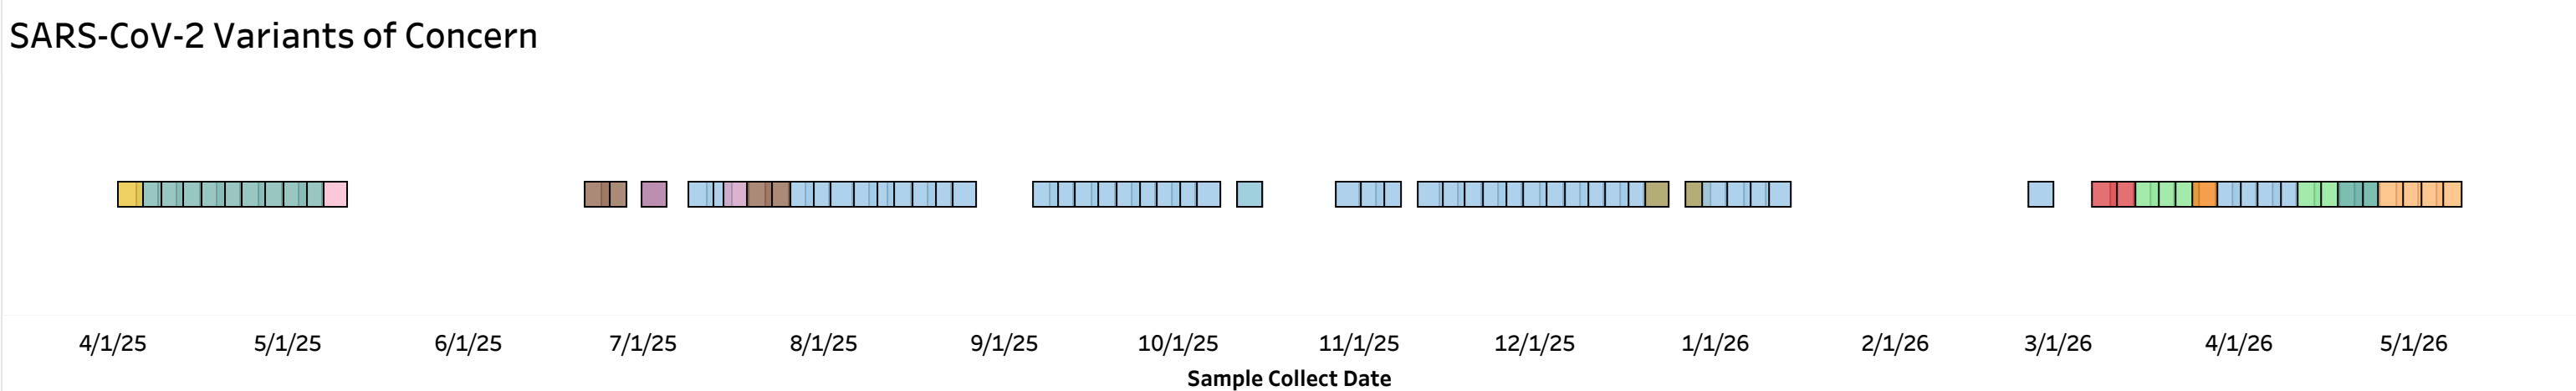


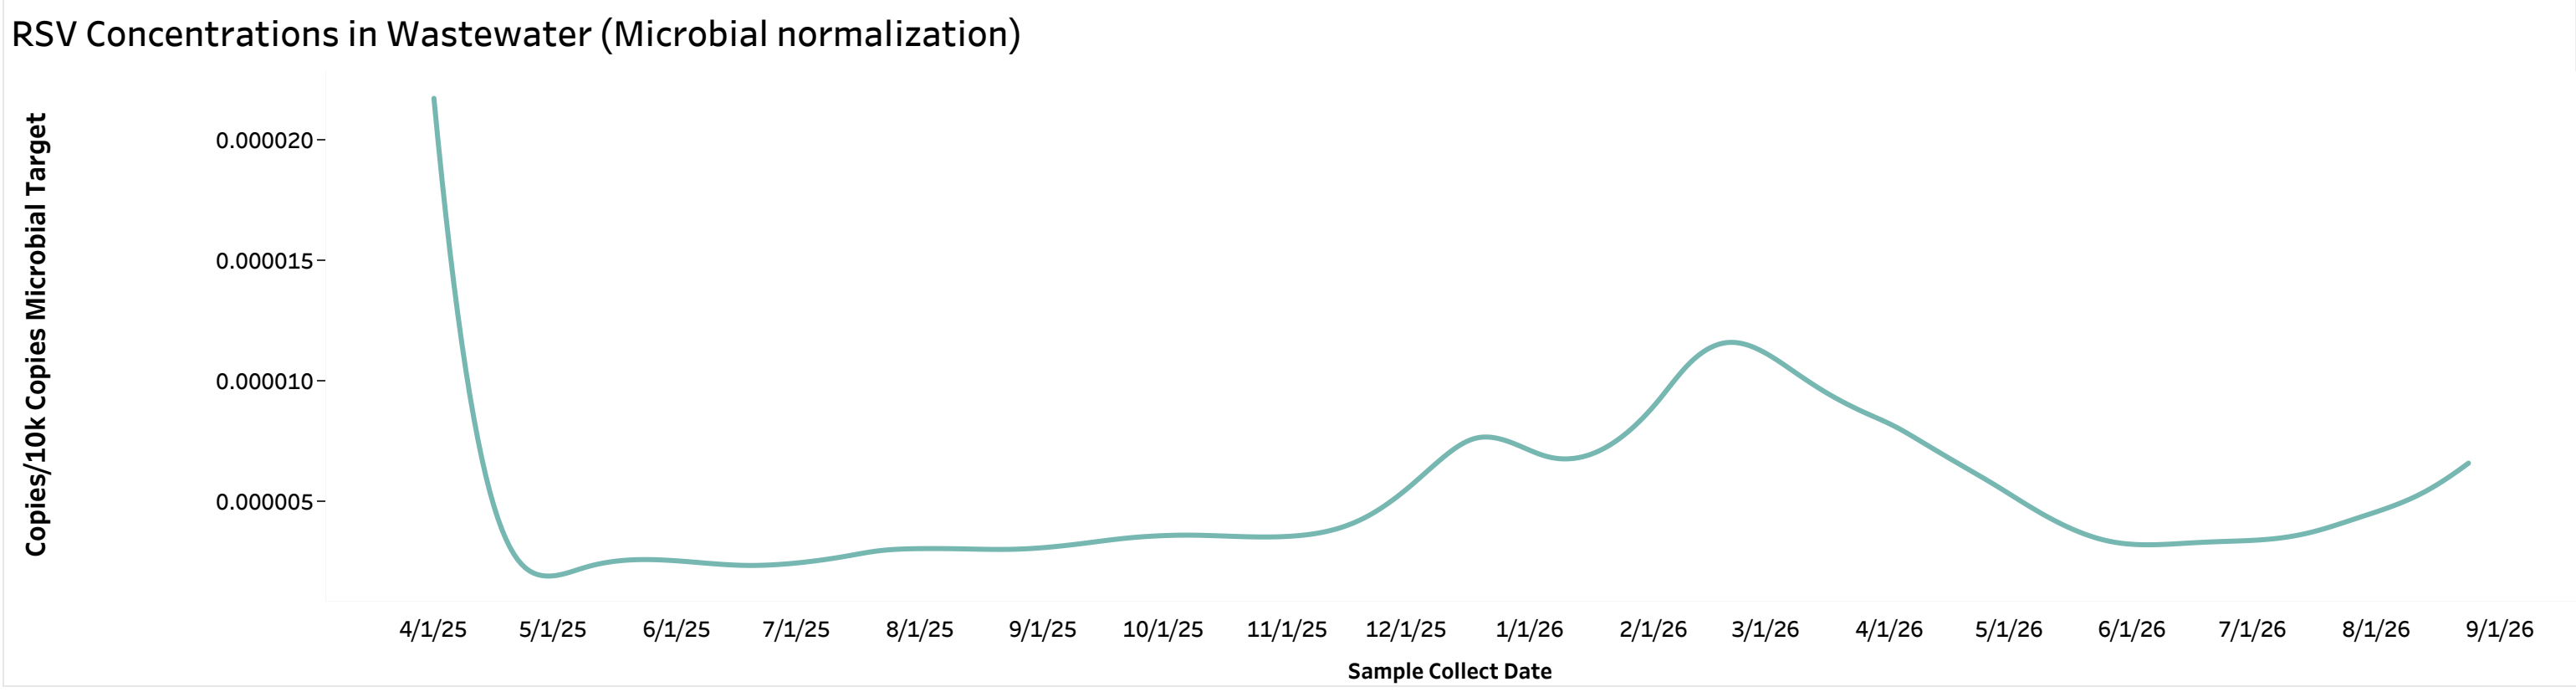

New Jersey Department of Health Wastewater Surveillance
Testing Results

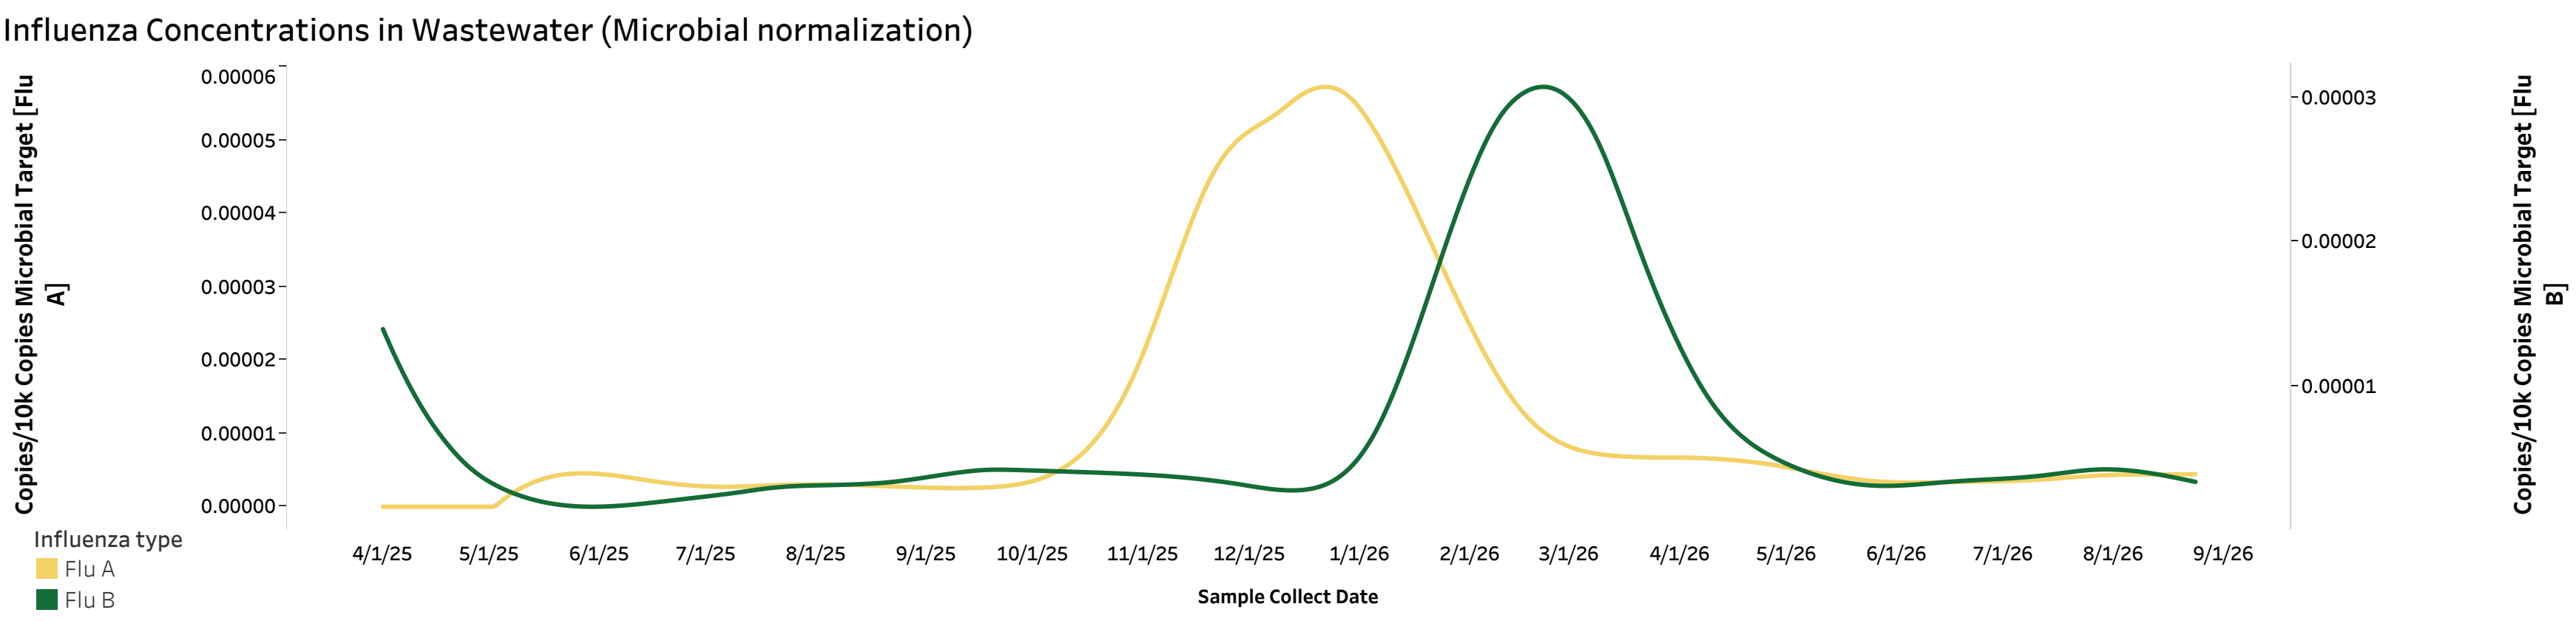

Site Name: Rowan University	Counties Served: Gloucester	Population Served: 18,000
First Sample Date: 10/2/2023	Most Recent Sample Date: 8/24/2026	

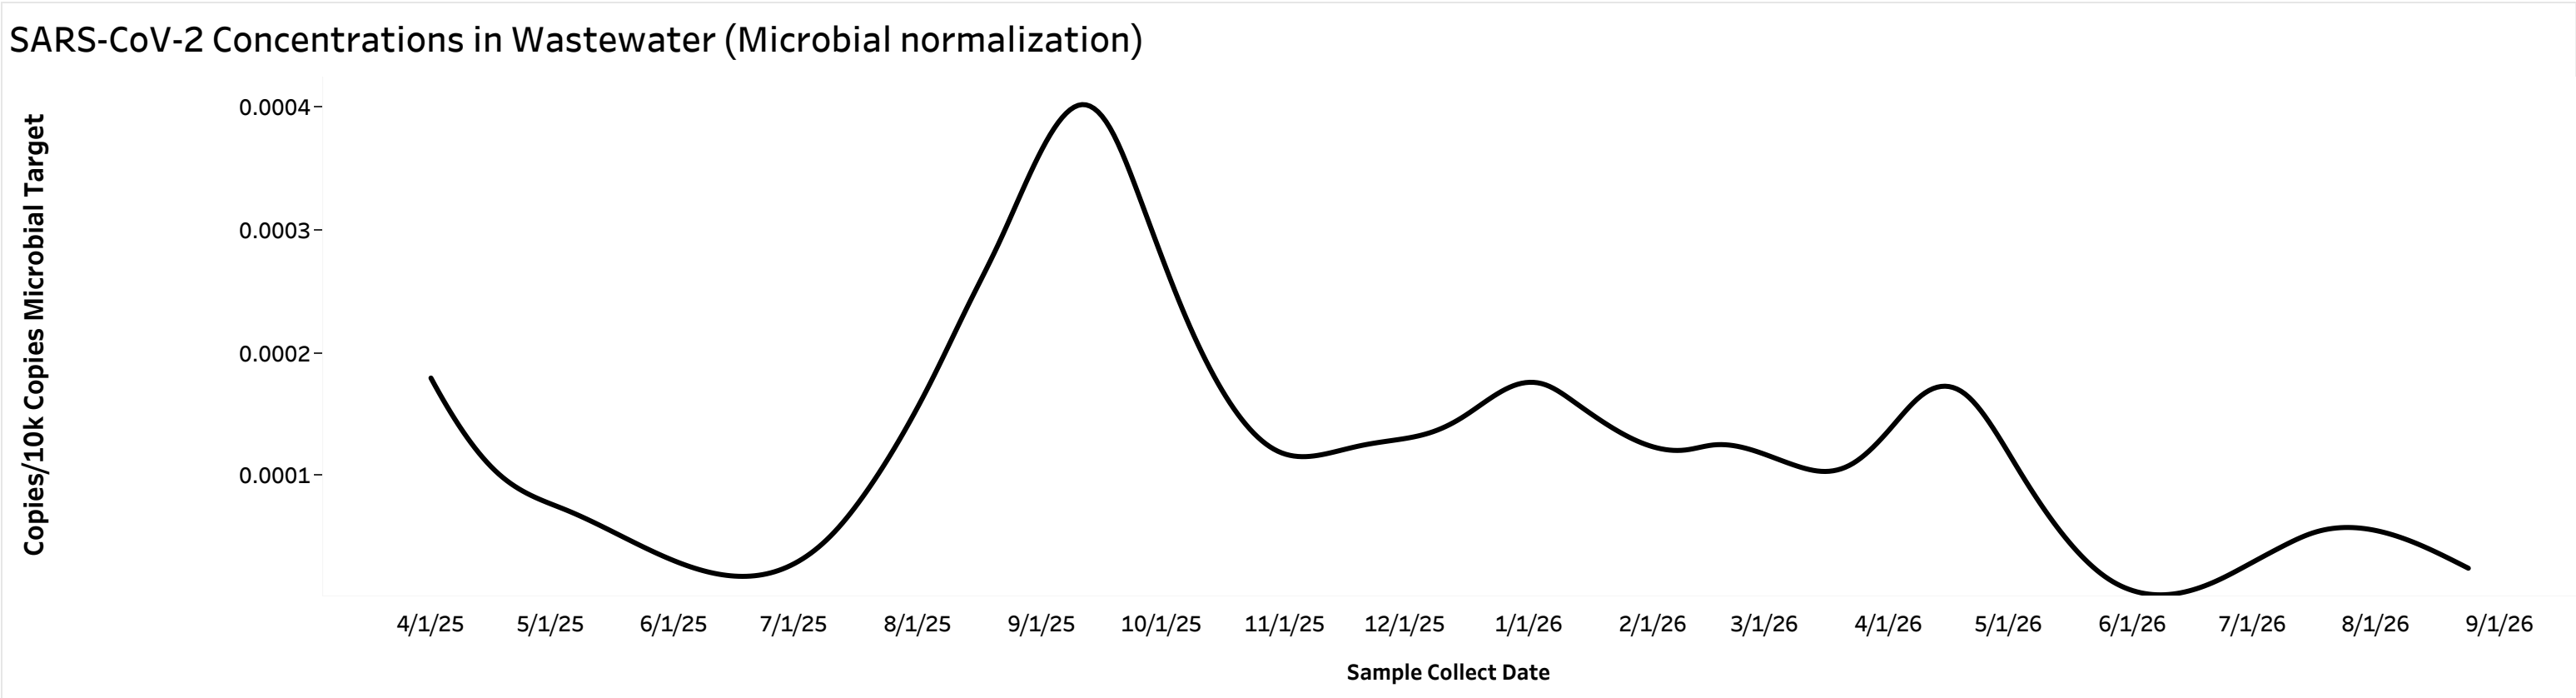

Dominant Variants

- JN.1
- KP.2
- BA.2
- BA.3.2
- LP.8.1
- MC.10.1
- NW.1
- XEC
- XFC
- XFG
- XFG.1
- XFG.6
- XFG.14.1

H5 Detection

Not Detected

Detected

Mpox detection

Not Detected

Detected